

ORDERING INFORMATION

VA301C Controller

- | | |
|---|---|
| <input checked="" type="checkbox"/> 301-C | Gas detection controller with display and plastic housing. |
| <input type="checkbox"/> 301-C-DLC | Gas detection controller with data logging, display and plastic housing. |
| <input type="checkbox"/> 301-C-DLC-BIP | Gas detection controller with data logging and display, BACnet/IP output and plastic housing. |


SPECIFICATIONS VA301C and VA301CDS (same if not specified)

Power Requirements:	17 -27 Vac, 50 or 60 Hz 24 - 38 Vdc, 500 mA
Operating Environment:	Indoor Use
Operating Temperature Range:	-4°F to 122°F (-20°C to 50°C)
Operating Humidity Range:	0 to 95% RH, (non-condensing)
Operating Altitude:	Up to 9843 feet (3,000 m)
Network Capacity:	Up to 96 transmitters, 32 per channel Channel 1 and 2: Modbus & Vulbus Channel 3 : Modbus only Channel 4 : Slave communication (i.e.: for BACnet option)
Communication (length of lines):	Up to 2,000 feet (600 m) per channel T-tap: 65 feet (20 m) maximum per t-tap 130 feet (40 m) total
User Interface:	Graphic 122 x 82 dot matrix backlit display User friendly keypad
Visual Indicators:	Power On Green LED Alarm A Red LED Alarm B Red LED Alarm C Red LED Fault Amber LED Tx Amber LED (blinks when in use) Rx Green LED (blinks when in use)
Outputs:	4 DPDT relays 5A, 30 Vdc or 250 Vac (resistive load)
Audible Alarm:	65dBA at 3 feet (1 m)
Time delays:	0, 30 , 45 sec and 1 to 99 min.before/after delay
Battery:	Lithium Battery 3 Volts
Enclosure VA301C:	NEMA 4X, ABS - Polycarbonate, Indoor use
Enclosure VA301CDS:	Cast Aluminium #A356.0T6
Overvoltage category:	II
Pollution degree:	2
Dimensions VA301C:	7.99'' (H) x 11.02'' (W)x 2.76'' (D) (20.3cm x 28 cm x 7 cm)
Dimensions VA301CDS:	9,50'' (H) x 14,00'' (W) x 3,5'' (D) (24 cm x 36 cm x 9 cm)
Weight VA301C:	2.4 lbs (1.1 Kg)
Weight VA301CDS:	11,4 lbs (5.2 Kg)

INSTALLATION INSTRUCTIONS

Installation instructions must be strictly followed to ensure the proper functioning of the equipment. Honeywell Analytics will not be liable or responsible for any malfunctions or incidents that may occur from improper installation:

- Place each unit in a location that is easily accessible for service
- Avoid placing units near sources of vibrations.
- Avoid placing units near equipment that emits electromagnetic interference.
- Avoid any location where there are large temperature swings.
- Before installing, verify all local codes, standards or legislation that could impact choice of installation location.

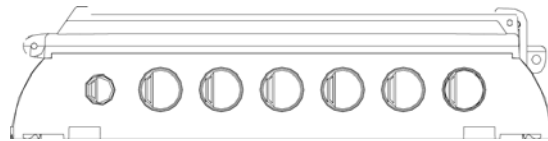WALL MOUNT INSTALLATION

PRODUCT SUBMITTAL

301-C CONTROLLER

Honeywell

VA301C WIRING DETAILS

CONTROLLER PCB


POWER (J22)
17 to 24 Vac, 24 to 38 Vdc, 500 mA
See note 1

COMMUNICATION (J23-J24)
See note 2

Communication Wire Gauge:
24 AWG (Belden 9841)
Twisted and shielded cable
2000 feet (600 m) per channel
T-tap: 65 feet (20 m) / T-tap
130 feet (40 m) total

Channel Specifications:
Channel 1-2: Modbus, Vulbus
protocol
Channel 3: Modbus protocol only
Communicates only with Vulcain
transmitters
Channel 4: Modbus output
Communicates only with
VA301BDCM

***No transmitter can be connected
to channel 4**



End-of-line specification:
The E.O.L. jumper for
channels 1-2-3-4 must
always be in E.O.L. position.

BACnet/IP MODULE (-BIP option)
Ethernet: 10/100-compatible with
10Base-T interface, RJ-45


Visual Indicators:
Green LED LINK
Yellow LED ACT

SD Card Datalogger


Notes:

- 1: Dedicated power supply must be used only for the controller.
- 2: Relays must not be linked directly on the ventilation system or other mechanism with a consumption higher than 1/6 HP.

Vulcain
508332
PCB301C1
MADE IN CANADA

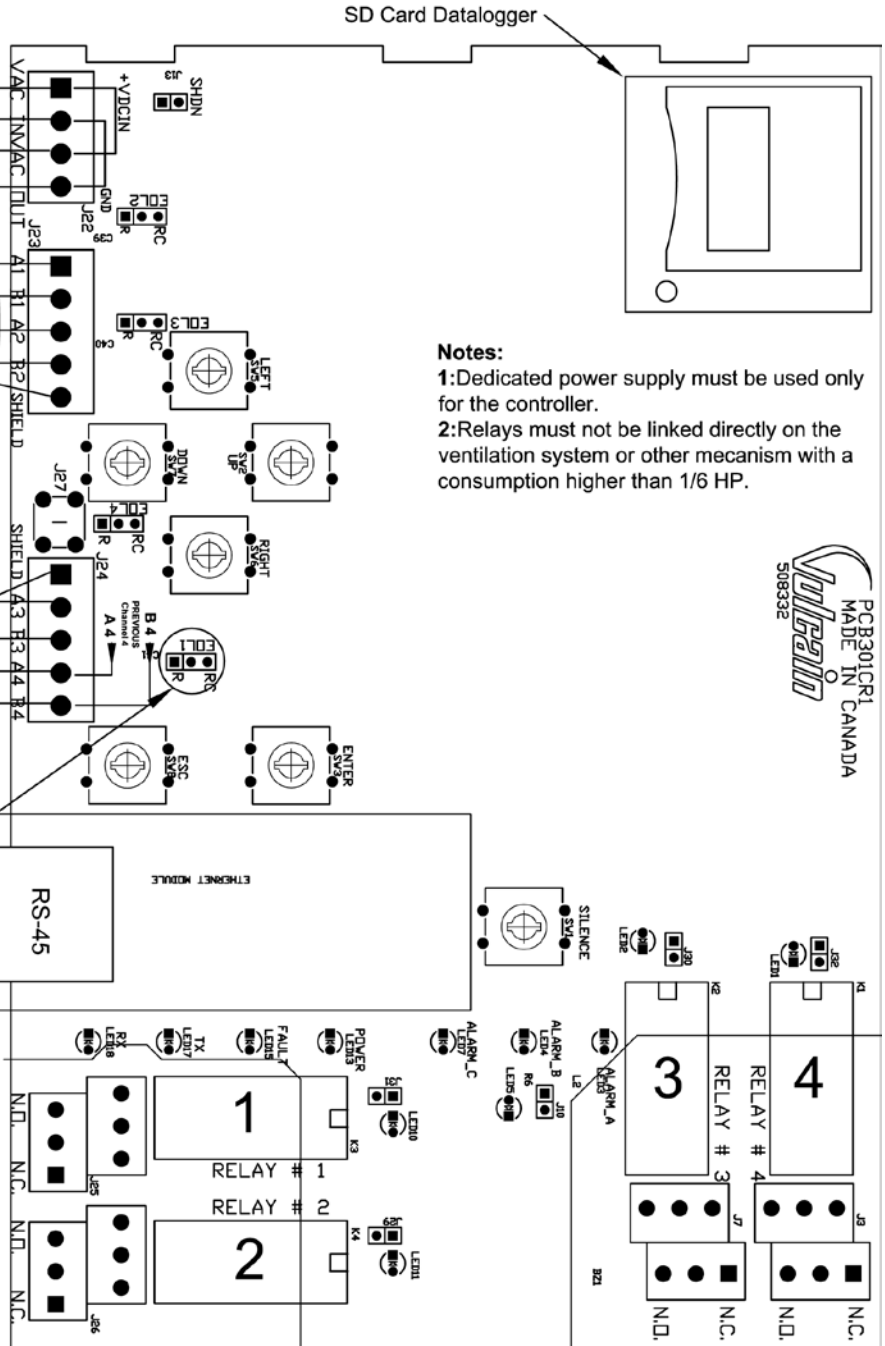

RELAY OUTPUTS (J3-J7-J25-J26)
5A, 30Vdc or 250Vac (resistive load)



WIRING DETAILS**Power :**

The power requirement range is 17-27 Vac, 24-38 Vdc, 500 mA. In both AC or DC mode, the polarisation is not important. The system must be grounded on the transformer. A dedicated circuit-breaker should be used.

Communication:

The communication cables have to be grounded using the shield terminal. Use twisted and shielded Belden cable 24 AWG # 9841 for the connection. The network can be up to 2000 feet (600 m) per channel. The length of a T-tap can be a maximum of 65 feet (20 m). A maximum of 130 feet (40 m) for all the T-tap must be respected.

Relay Output:

The relay output will withstand up to 5 A at 30Vdc or 250Vac (resistive load only). They can be used to activate horns and strobes. Refer to drawing below for proper wiring. Each relay can be configured in the programming menu. Default setting is :

Relay 1 (J25) = A

Relay 2 (J26) = B

Relays 3 (J3) = C

Relay 4 (J7) = Fault

5 A, 30 Vdc or 250 Vac (resistive load)

BACnet/IP MODULE (-BIP option)

Specifications

Ethernet Port : 10/100-compatible with 10Base-T interface, RJ-45

Visual Indicators : Green LED LINK
 Yellow LED ACT

DATALOGGER (-DLC option)

The DLC option for the controller collects data automatically and stores it on a digital flash Multimedia Card (SDcard). If ever the SDcard gets full;

- the information logging is stopped
- no SDc flag is displayed on the screen
- the SDcard LED blinks

WARRANTY AND LIMITS OF LIABILITY

Honeywell Analytics Inc. warrants to the original purchaser that its product, and the component parts thereof, will be free from defects in workmanship and materials for a period of one year from the date of purchase. Honeywell Analytics will, without any charge and at its option, repair or replace defective products or components upon their delivery to its Repair and Service Department. This warranty does not apply in the event of misuse or abuse of the product, or as a result of unauthorized alterations or repairs. Honeywell Analytics shall not be liable for any consequential damages, including, without limitation, damages resulting from loss of use. Every precaution for accuracy has been taken in the preparation of this manual. However, Honeywell Analytics neither assumes responsibility for any omissions or errors that may appear, nor liability for any damages that may result from the use of the products in accordance with the information contained in this manual.

To obtain warranty service, return the product, along with a complete description of the defect, transportation prepaid. Honeywell Analytics assumes no risk for damage in transit. Following warranty repair, the product will be returned to the buyer, transportation prepaid.