

**Ventilation Guidelines: Wine-mate Self-Contained Cooling Units**


Your cellar must be properly insulated and vapor sealed in order for these units to function properly. Place the unit in a properly ventilated location. If it is not, heat exhausted by the condensing unit will build up and the cooling system will not operate properly.

<b>Model Number</b>		
WM-4510HZD	WM-1500HZD	<p>To allow for proper ventilation, please allow a 36" clearance at the front of the unit (cold air intake) as well as 36" clearance at the rear of the unit (hot air exhaust).</p>
WM-1500CD	WM-2500HZD	
WM-2500CD	WM-3500HZD	
WM-1500-HTD	WM-4500HZD	
WM-1500-HTD-TE	WM-6500HZD	
WM-2500-HTD	WM-8500HZD	
WM-2500-HTD-TE	WM-2520HZD	
	WM-4520HZD	
	WM-8520HZD	

# Self-Contained Unit Diagram

## Clearance Guidelines

Place the unit in a properly ventilated location.

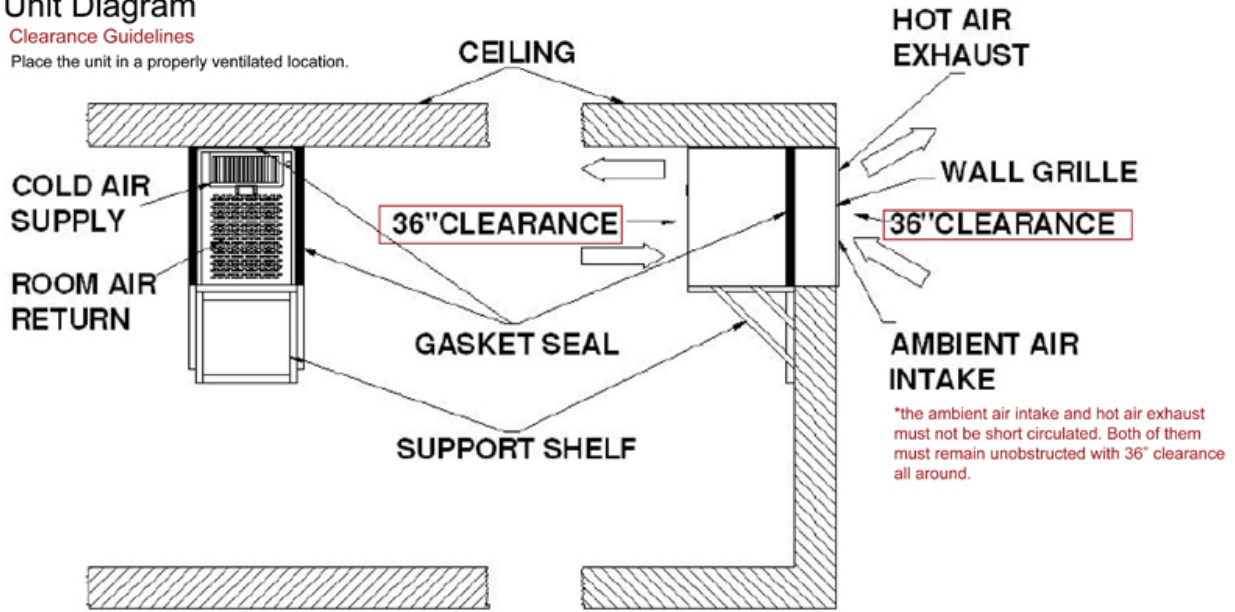


## THROUGH-WALL INSTALLATION

# Self-Contained Unit Diagram

## Clearance Guidelines

Place the unit in a properly ventilated location.

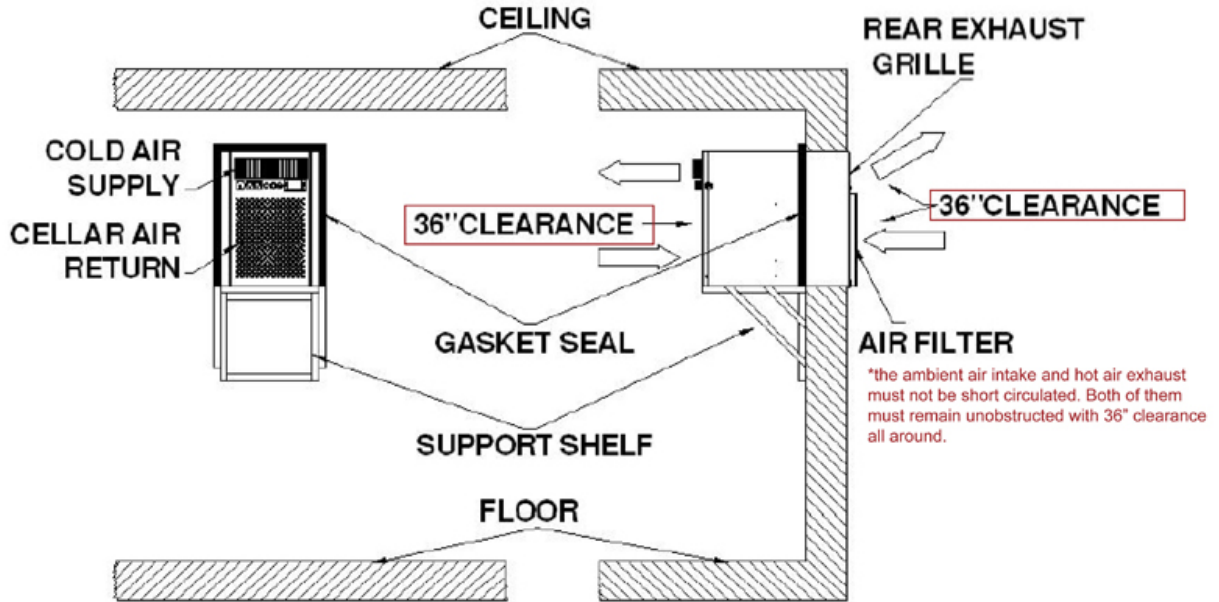

Flush to the outside of wall with air filter & rear exhaust grille