


This enclosure includes a lockout provision (in the OFF position) for a suitable padlock. USE ONLY a padlock with a shackle diameter of 1/4 inch (6.35 mm) to isolate power from the connected equipment in compliance with OSHA Lockout/Tagout Regulation 29 CFR Part 1910.147. **NOTE:** Lockout feature does NOT interrupt the power supplied to the switch within the enclosure.

- Ensure that the rating marked on the device is correct for the intended installation.
- Suitable as Motor Disconnect on a circuit capable of delivering not more than:
 - **MDS3-AX** - 10kA rms symmetrical amperes, 600V max., when protected by 60A, Class J fuses.
 - **MDS6-AX** - 100kA rms symmetrical amperes, 600V max., when protected by 100A, Class J or T fuses.
 - **MDS8-AX** - 100kA rms symmetrical amperes, 600V max., when protected by 100A, Class J or T fuses.
 - **MDS1-AX** - 65kA rms symmetrical amperes, 600V max., when protected by 100A, Class J fuses.

ENGLISH


- For NEMA Type 4X, Type 1 and IP69K applications, enclosure must be mounted by means of mounting feet. Do not drill or punch any holes into enclosure for mounting purposes.
- Use of a UL Listed Watertight conduit fitting required to maintain the NEMA Type 4X, Type 12 and IP69K ratings. Leviton conduit hubs (see Table 1) are rated for Type 4X and Type 12 applications. **NOTE:** If required, use only a listed/certified breather drain rated for Type 4X, Type 12 and/or IP69K depending on required environmental application. Drill or punch a 0.796" (20.2 mm) diameter hole through the bottom of the enclosure at the drill point provided.
- Mounting feet will accept up to 1/4" (6 mm) screws.
- Drill points provided for conduit entry.
- When using top or side feed conduit entrance, always form condensation drip loops in wiring as shown.

Cat. No.	Hub Trade Size	Min QTY Required	Leviton Part No.	Conduit Hole
MDS3	3/4" (19.05 mm)	1	00HUB-034	1.05" (26.67 mm)
MDS6	1-1/4" (31.75 mm)	1	00HUB-114	1.66" (42.16 mm)
MDS8	1-1/4" (31.75 mm)	2	00HUB-114	1.66" (42.16 mm)
MDS1	1-1/4" (31.75 mm)	2	00HUB-114	1.66" (42.16 mm)

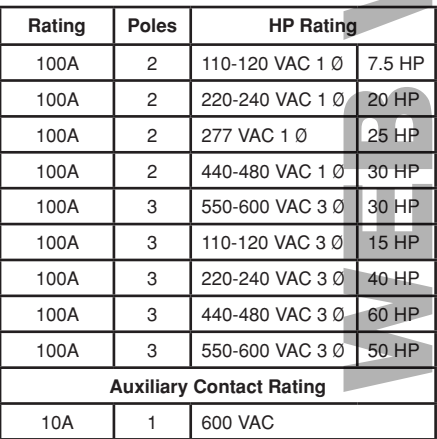

REMOVE SWITCH

- NOTE: DO NOT REMOVE DIN RAIL.**
1. Remove both mounting screws securing the switch.
 2. Insert a flathead screwdriver in switch tab **(A)**. Gently pull tab outward while pulling switch up; beginning with tab side and then opposite side.
- NOTE:** If replacing the switch component remove switch rod by loosening set screw **(B)**, pulling rod out of switch and set rod aside.
- NOTE:** If replacing the switch component you can remove auxiliary contact on switch by inserting flathead screwdriver tip between switch and auxiliary contact and pressing outward.

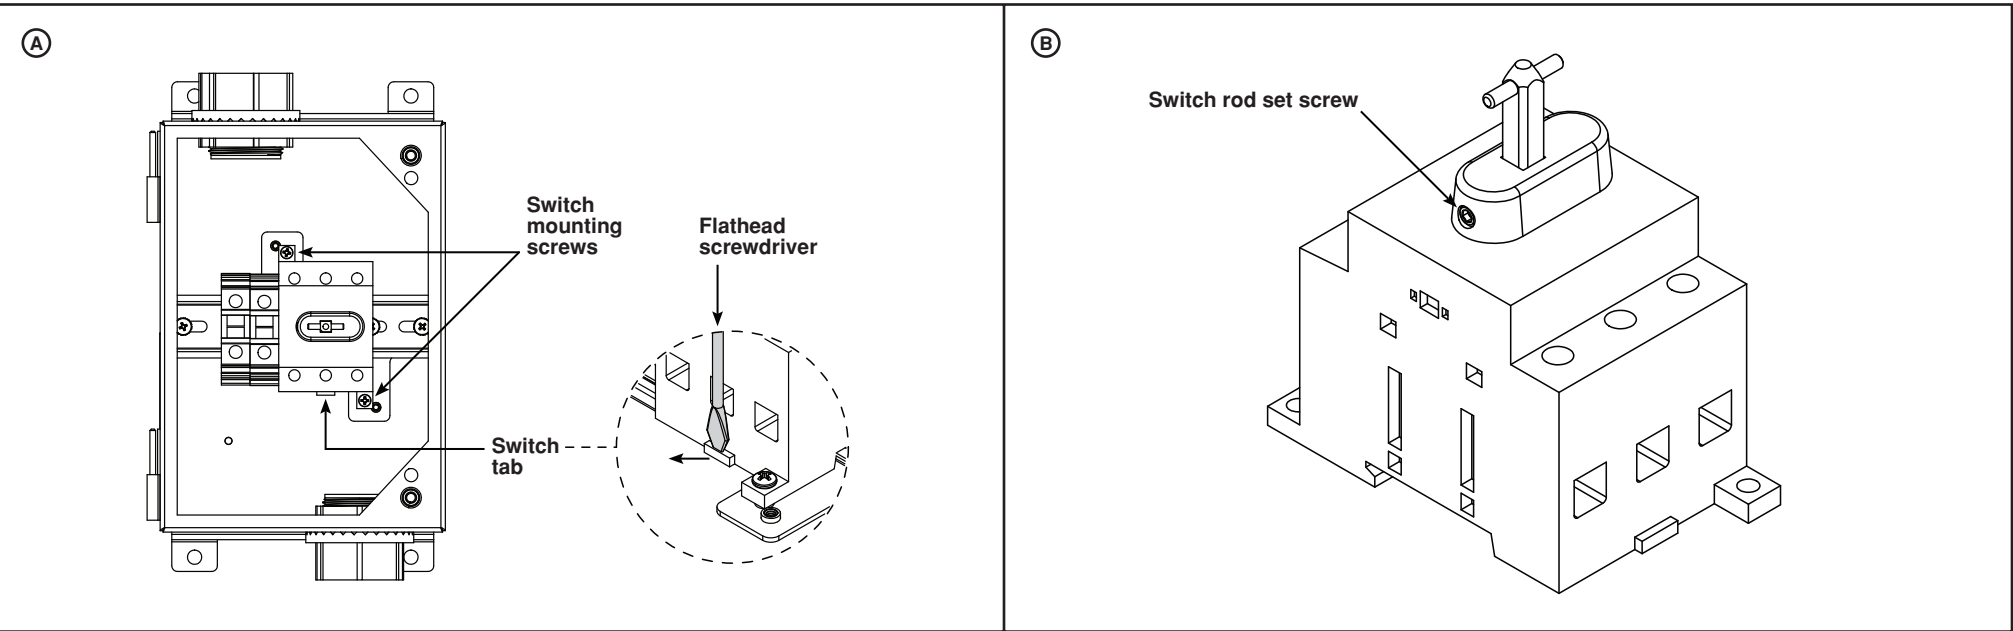

REPLACE SWITCH


- NOTE:** If replacing the switch component re-install switch rod ensuring it is fully seated in bottom of pocket. Tighten set screw to 8-10 in.-lbs. (0.9-1.1 N-m).
- NOTE:** If replacing the switch component attach auxiliary contact (if applicable) to switch by fitting the tabs on top and pressing in auxiliary contact in a downward motion.
1. Mount switch onto DIN rail by hooking back side hinge onto DIN rail, then gently pull switch tab outward and push switch down until it snaps into place.
 2. Slide switch into position and align the two screw holes with threaded holes in base plate. Tighten 2 mounting screws to 6-8 in.-lbs. (0.67-0.9 N-m).
 3. Verify switch cover properly mates with switch mechanism with cover closed and ON/OFF handle moves freely.

CLEANING

- CAUTION: RISK OF ELECTRIC SHOCK. DO NOT** clean this product while undergoing electrical maintenance or service.
- CAUTION:** Use only chemicals and cleaning solutions that are safe for use with plastics and rubber gaskets.
1. Follow general cleaning procedures established by your facility.
 2. This product is certified by NSF® International for use in food processing facilities.
 3. Recommended cleaning procedures are:
 - a. Use hose directed water or cleaning solution to remove any collected contaminants from behind the enclosure. Ensure water completely cleans the area between the enclosure and the mounting surface.
 - b. Use hose directed water or cleaning solution to remove soil and contaminants from the exterior surfaces of the enclosure.
 - c. **CAUTION: DO NOT** direct or concentrate high pressure water or cleaning solution on the enclosure gasket seams, switch handle area or exterior labels.
 - d. After cleaning the exterior surfaces of the enclosure, open the enclosure door and use a clean damp cloth to manually remove and soil or contaminants from the gasket seam area and flanged lip on enclosure body.
 - e. If needed, the door can be lifted off the enclosure body to clean hinge cavities.
 - f. Use a dry clean cloth to wipe away any excess water.

WIRING DIAGRAMS

Break All Lines

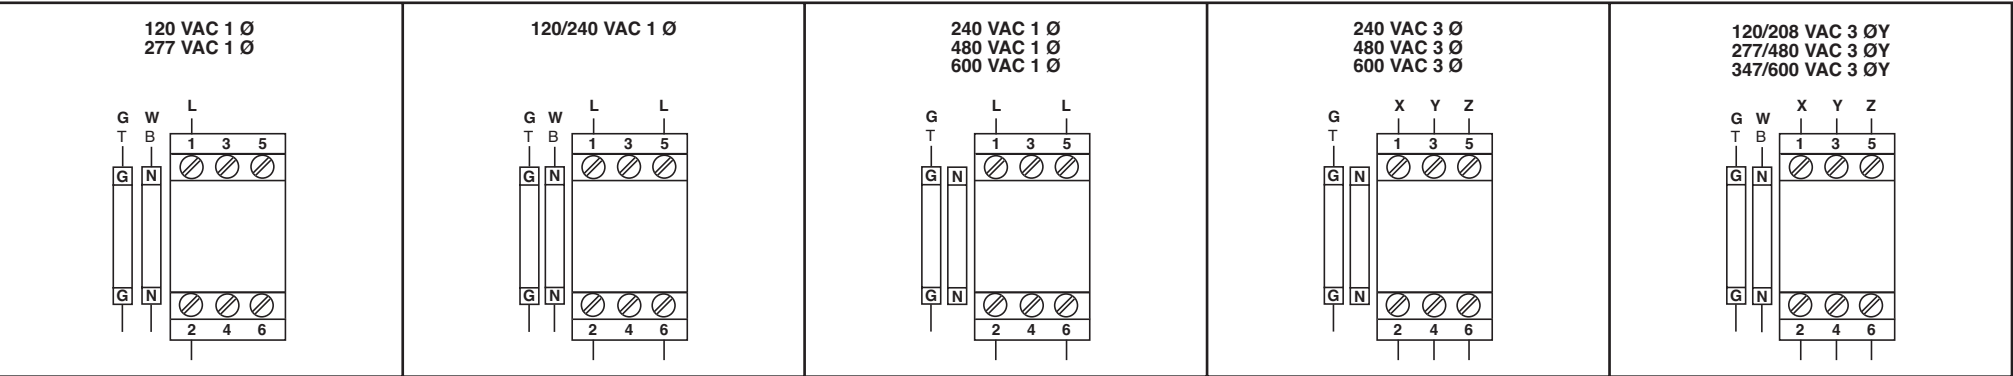

NSF is a registered trademark of NSF International.

Powerswitch is a trademark of Leviton Mfg. Co., Inc., registered in the U.S.A.

FOR CANADA ONLY
For warranty information and/or product returns, residents of Canada should contact Leviton in writing at **Leviton Manufacturing of Canada Ltd to the attention of the Quality Assurance Department, 165 Hymus Blvd, Pointe-Claire (Quebec), Canada H9R 1E9** or by telephone at **1 800 405-5320**.

LIMITED 2 YEAR WARRANTY AND EXCLUSIONS

Leviton warrants to the original consumer purchaser and not for the benefit of anyone else that this product at the time of its sale by Leviton is free of defects in materials and workmanship under normal and proper use for two years from the purchase date. Leviton's only obligation is to correct such defects by repair or replacement, at its option. **For details visit www.leviton.com or call 1-800-824-3005.** This warranty excludes and there is disclaimed liability for labor for removal of this product or reinstallation. This warranty is void if this product is installed improperly or in an improper environment, overloaded, misused, opened, abused, or altered in any manner, or is not used under normal operating conditions or not in accordance with any labels or instructions. **There are no other or implied warranties of any kind, including merchantability and fitness for a particular purpose,** but if any implied warranty is required by the applicable jurisdiction, the duration of any such implied warranty, including merchantability and fitness for a particular purpose, is limited to two years. **Leviton is not liable for incidental, indirect, special, or consequential damages, including without limitation, damage to, or loss of use of, any equipment, lost sales or profits or delay or failure to perform this warranty obligation.** The remedies provided herein are the exclusive remedies under this warranty, whether based on contract, tort or otherwise.