



**All cables should flow directly into vertical cable managers
on the corresponding side of the Angled Panel.**

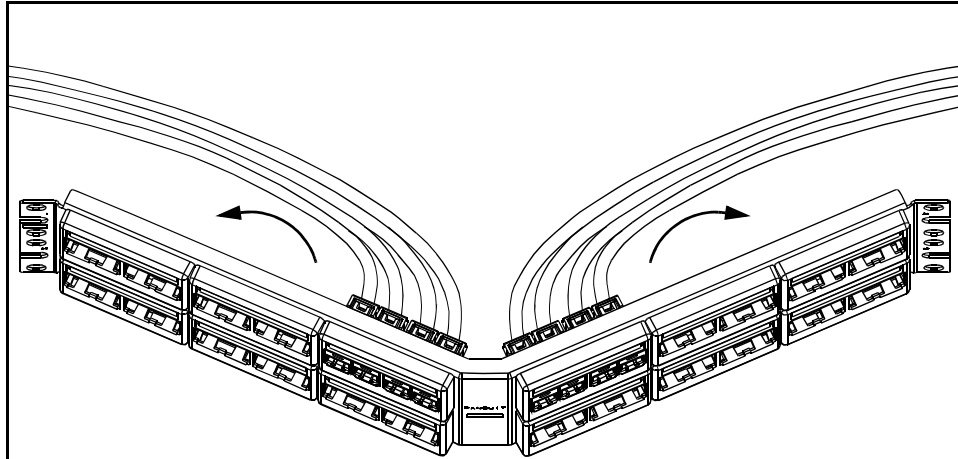

Recommended cable routing for terminated modules.

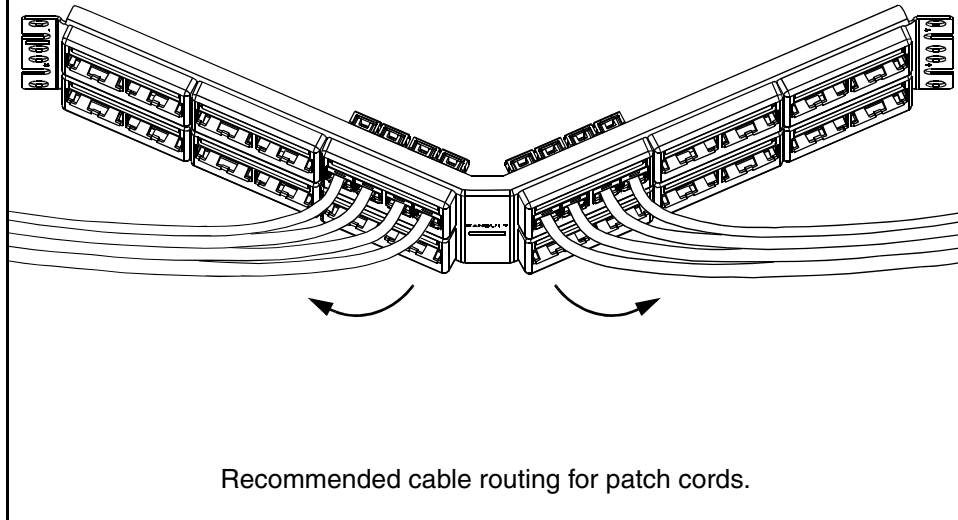

Recommended cable routing for patch cords.