


INSTRUCTIONS CM223B

© Panduit Corp. 2008

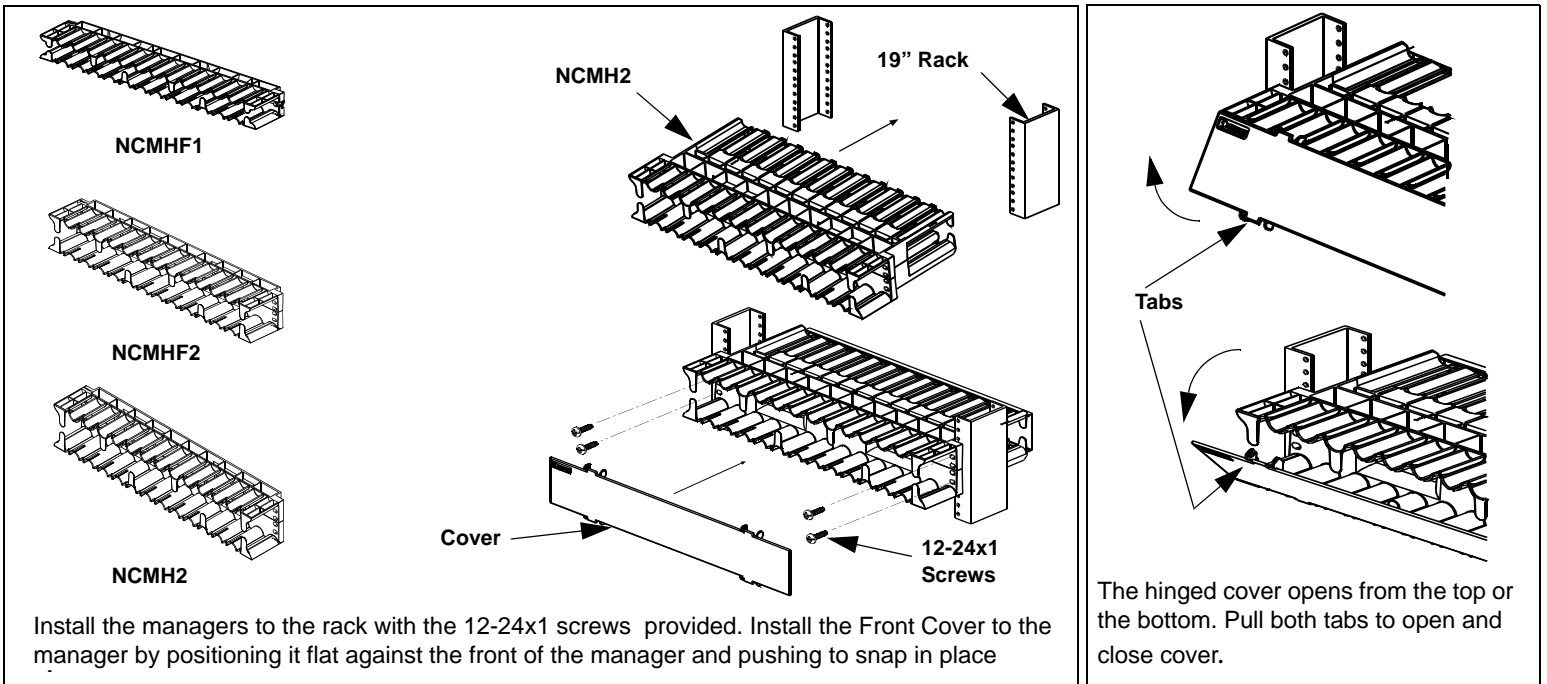

Install the managers to the rack with the 12-24x1 screws provided. Install the Front Cover to the manager by positioning it flat against the front of the manager and pushing to snap in place

The hinged cover opens from the top or the bottom. Pull both tabs to open and close cover.


The network cable manager is recommended for use with Panduit 24 or 48 port patch panels mounted above and below the manager. When routing the cables for the patch panels, either of the following two methods are recommended to help maintain cable bend radius.

METHOD 1: For each row of 24 ports, place two cables in each slot on the manager, leaving the middle slot empty. Route half the cables through each of the wire retainers on the ends of the manager.


METHOD 2: If the cables are coming from one side of the rack, place 2 cables in each of the slots on the manager, leaving the last slot empty.

NOTE: When using the NCMH2 to manage cables on the rear of the rack, place 2 cables in each of the 12 slots in the rear of the manager, for each row of 24 ports.

METHOD 1

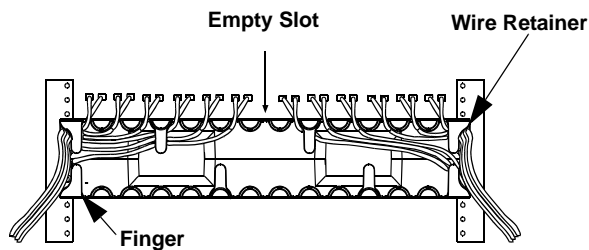

METHOD 2

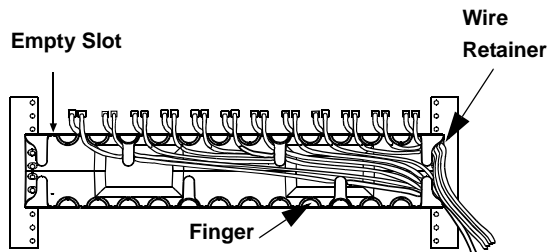

CABLE CAPACITY

MANAGER		UTP Cable .187" Dia	SeTP Cable .250" Dia	Fiber 3mm
NCMH2/ NCMHF2	Method 1	96	72	312
	Method 2	72	48	192
NCMHF1	Method 1	48	32	144
	Method 2	24	16	72