





## PANDUCT PANELMAX Noise Shield

For Use Mounted Separately or With  
PANDUIT PANDUCT Types D, F, FS, G,  
H, HN, and HS Wiring Duct


Part Numbers: SD2EMI, SD3EMI, SD4EMI

### INSTALLATION INSTRUCTIONS

© Panduit Corp. 2009

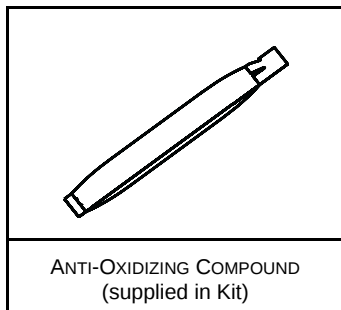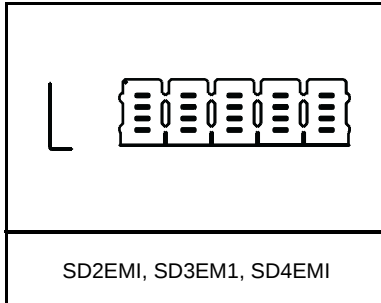


#### Sizing Noise Shield


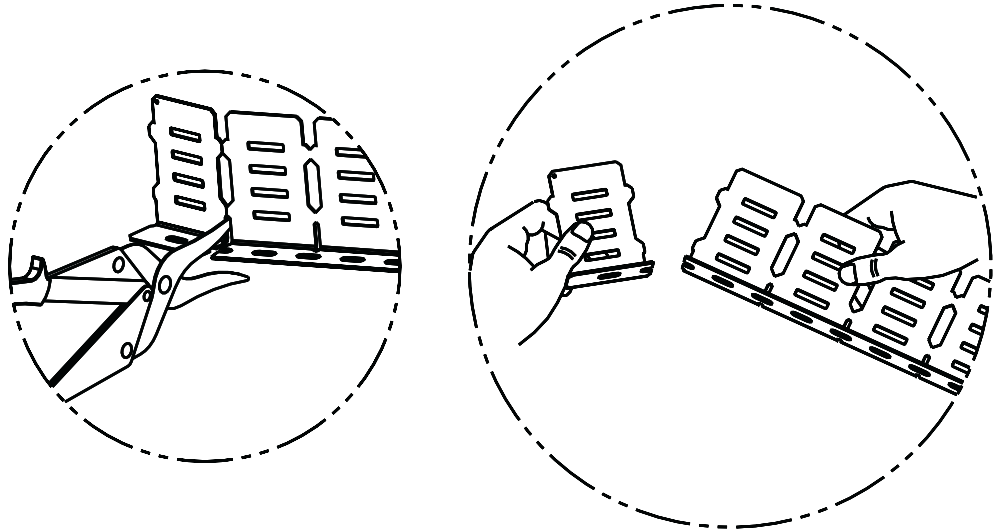


#### Option 1 - Noise Shield Mounted Separately

1

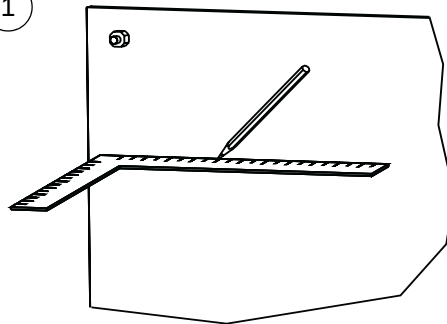


Panel surface must be prepared prior to mounting Noise Shield to achieve electrical bond (see back page)

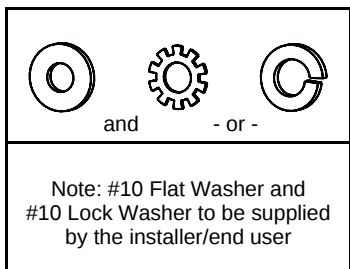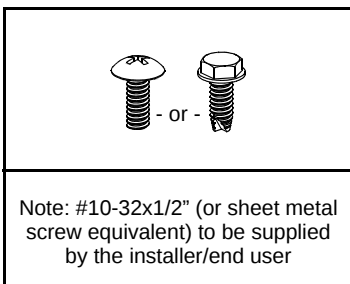

2







Installer/end user supplied hardware

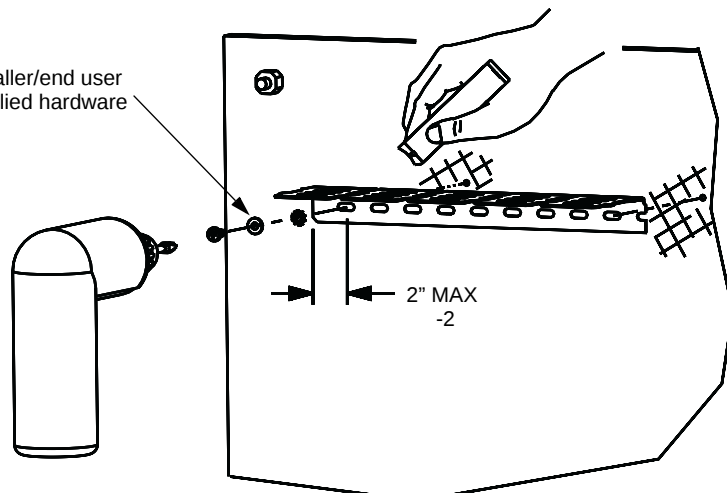



For Technical Assistance, Call: 800-777-3300

# INSTALLATION INSTRUCTIONS

## Option 2 - Noise Shield Mounted with Duct

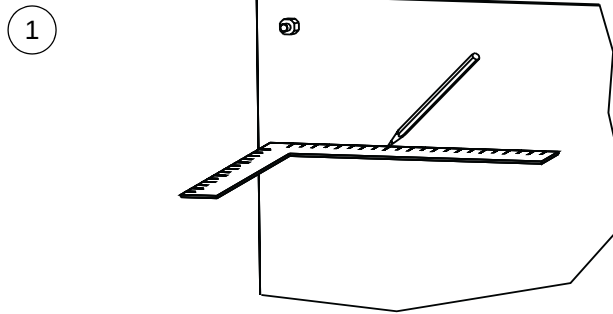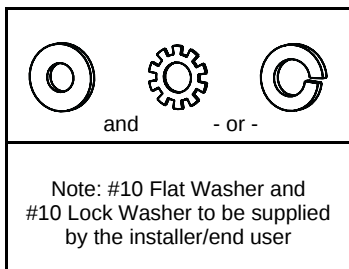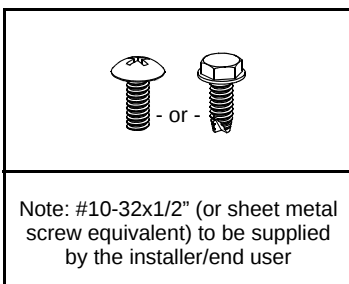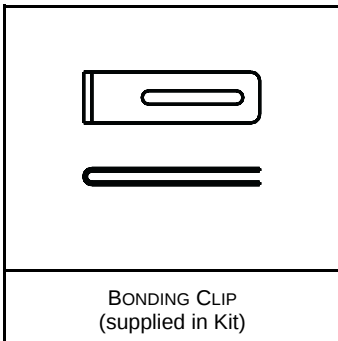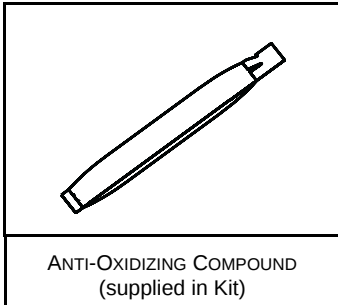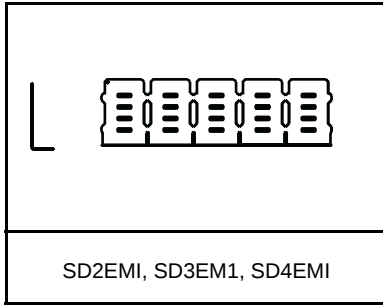


Panel surface must be prepared prior to mounting Noise Shield to achieve electrical bond (see back page)

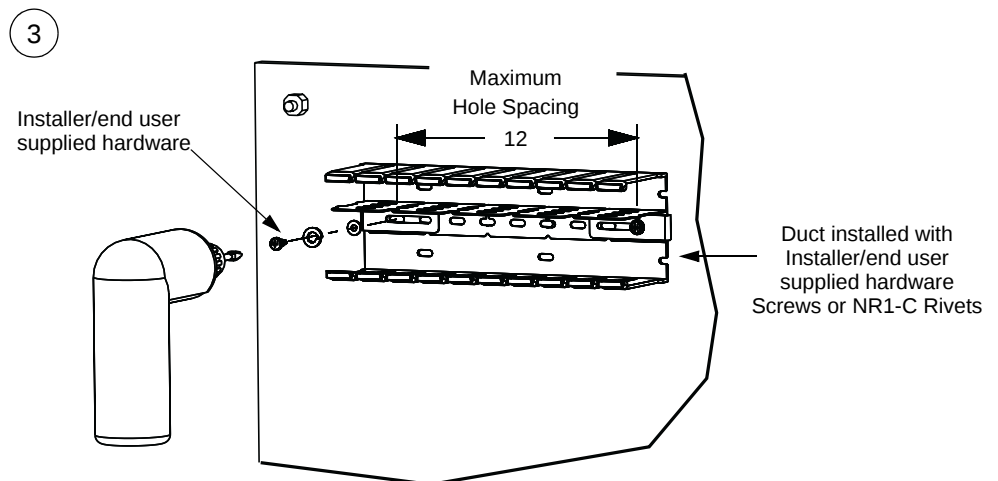
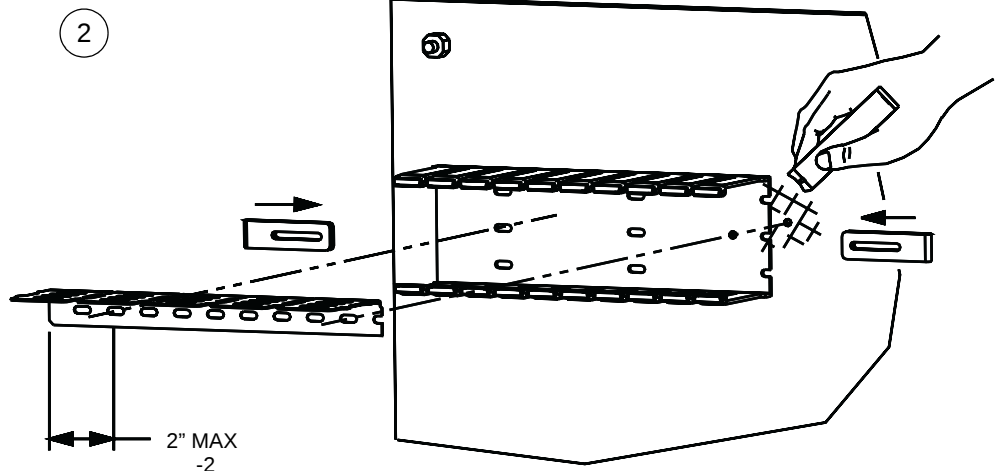


# INSTALLATION INSTRUCTIONS


## Recommended Wiring and Labeling Practices

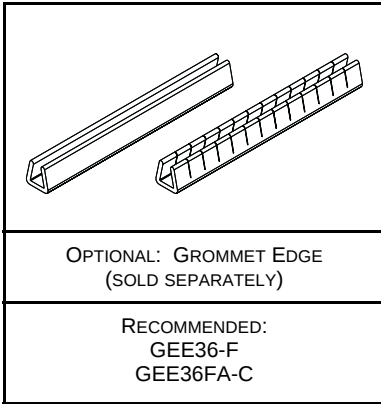



Option for Additional Abrasion Protection

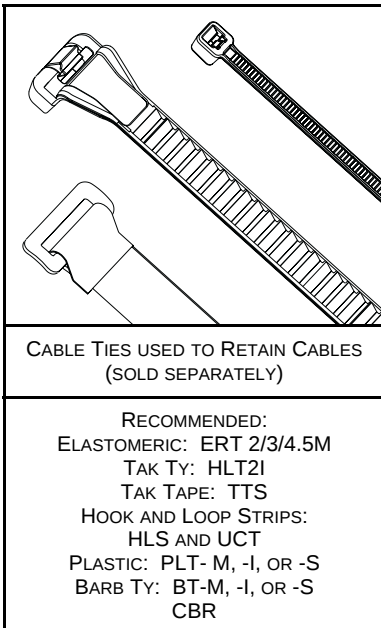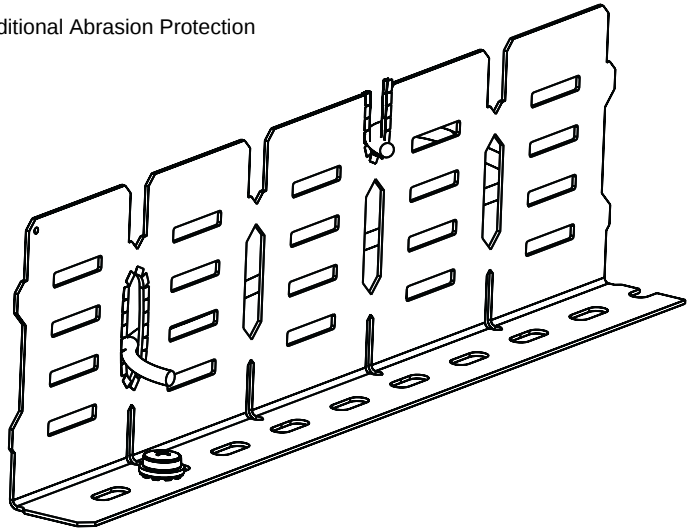

Do not use excessive tension when fastening cable ties.  
Apply cable ties loosely to Ethernet Cabling.

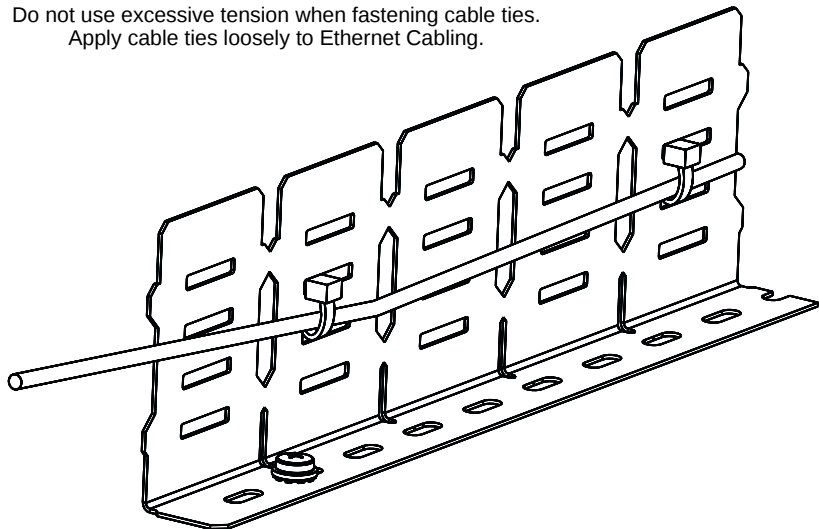


Option for Identifying the Noise Shield and Location/Side of Noise.  
Applied to Noise Shield or Panel Surface.

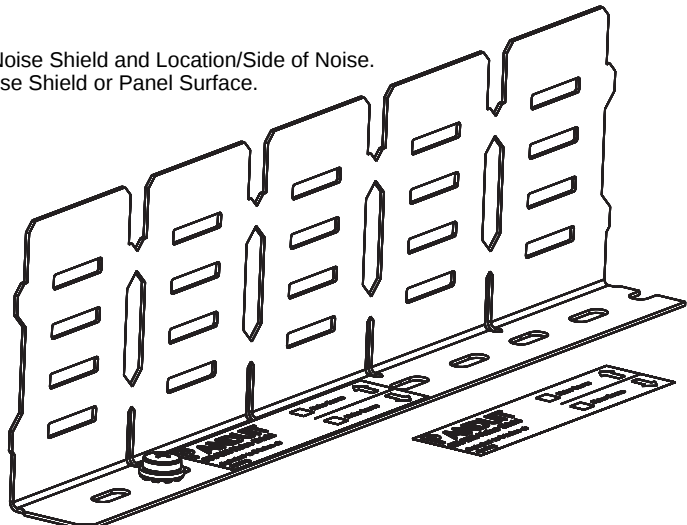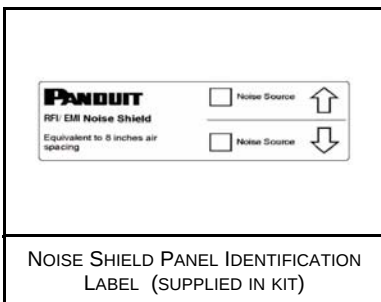


# INSTALLATION INSTRUCTIONS

## Surface Preparation For Good Electrical Bond


Location of Bonds should be within 2" of Both Shield Ends

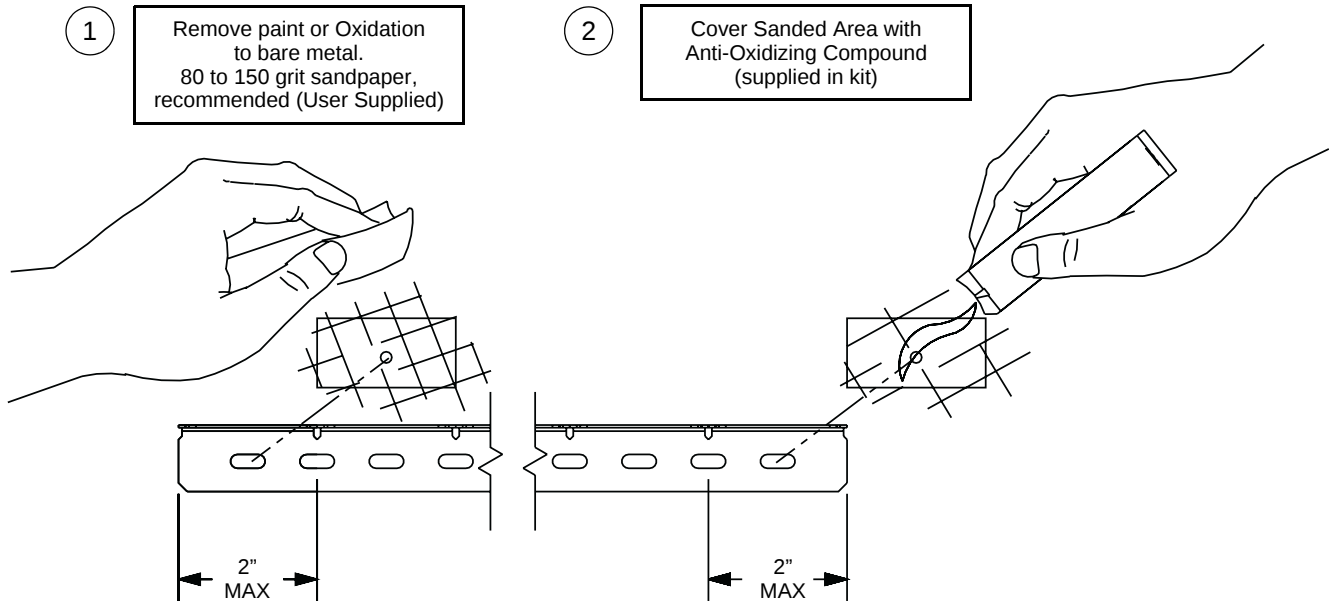

Noise Shield Sanding Template

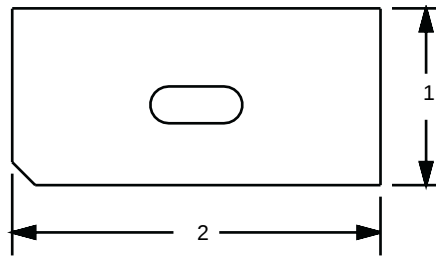

Noise Shield within Duct Sanding Template

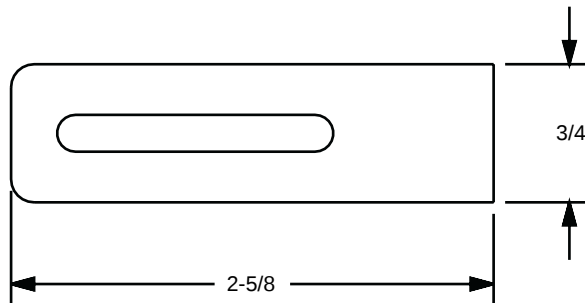

Instruction Sheet RW260

## WORLDWIDE SUBSIDIARIES AND SALES OFFICES

17301 Ridgeland Avenue  
Tinley Park, IL 60477-3901  
Web Site: [www.panduit.com](http://www.panduit.com)



Fax: 708-532-1811  
Technical Support: 800-777-3300