


CONFIGURATION NOMENCLATURE

- (1) **FRAME HARDWARE:** ☐ 0 - NONE
☐ E - CENTER DIVIDER, (1) #10-32 TEST PORT
☐ W - CENTER DIVIDER, (2) #10-32 TEST PORTS
- (2) **MEDIA:** ☐ 007 - 99.97% / 99.99% ON 0.3 µm
☐ 008 - 99.999% ON 0.3 µm
☐ 009 - 99.9995% ON 0.12 µm
☐ 012 - 99.99999% ON 0.12 µm
☐ H14 - 99.995% ON MPPS
- (3) **PACK STYLE:** ☐ 2 - 2" DIMPLEPLEAT PACK
☐ 3 - 3" DIMPLEPLEAT PACK
☐ 4 - 4" DIMPLEPLEAT PACK
- (4) **FRAME MATERIAL:** ☒ 19 - EXTRUDED ALUMINUM (ANODIZED)
- (5) **FRAME STYLE:** ☒ 33 - 3/4" KNIFE-EDGE FOR FLUID SEAL GRID SYSTEM
- (6) **SEALANT:** ☐ SU - F.R. POLYURETHANE, 99.99% SCANNED
☐ PG - F.R. POLYURETHANE, 99.99% AUTOSCAN, NO PATCHES
☐ PA - F.R. POLYURETHANE, 99.99% PAO TEST
- (7) **GASKET/GEL MATERIAL:** ☒ 0 - NONE
- (8) **GASKET/GEL LOCATION:** ☒ 0 - NONE
- (9) **FACEGUARD:** ☐ 0 - NONE
☐ A - ANODIZED ALUM., 40% OPEN PERF.
☐ B - ALUM. PERF (WHITE PAINT)
☐ C - CRS PERF., 40% OPEN (WHITE PAINT)
☐ E - EXPANDED STAINLESS STEEL
☐ F - EXPANDED CRS (WHITE PAINT)
☐ S - STAINLESS STEEL, 40% OPEN
- (10) **FACEGUARD LOCATION:** ☐ 0 - NONE
☐ 1 - UPSTREAM
☐ 2 - DOWNSTREAM
☐ 3 - BOTH
- (11 & 12) **SIZE (HEIGHT AND WIDTH):** SEE CHART
- (13) **UL CODE:** ☐ BLANK - NONE
☐ U5 - UL 586
☐ U9 - UL 900

NOTES

FRAME - EXTRUDED ALUMINUM ANODIZED
SEALANT - PHOSPHORUS FREE, FIRE RETARDANT POLYURETHANE
SCAN - FILTER SCANNED TO MAXIMUM 0.010% LOCAL LEAK
(MAXIMUM 0.005% WITH 009 MEDIA)
RATING - MAXIMUM OPERATING TEMPERATURE 250°F, UL-900 CLASSIFIED
TOLERANCE - FILTERS ARE SQUARE WITHIN 1/8" FOR DIAGONALS UP TO 30",
WITHIN 1/4" FOR DIAGONALS GREATER THAN 30"
HEIGHT / WIDTH / DEPTH - (+0.0625", -0.0625")
MANUFACTURED IN ACCORDANCE WITH IEST-RP-CC-001.6

REV	ECN #	DESCRIPTION	BY	DATE
<div><div></div><div>B</div></div>	24385	MAX TEMP WAS 150°F	JWH	10/18/24

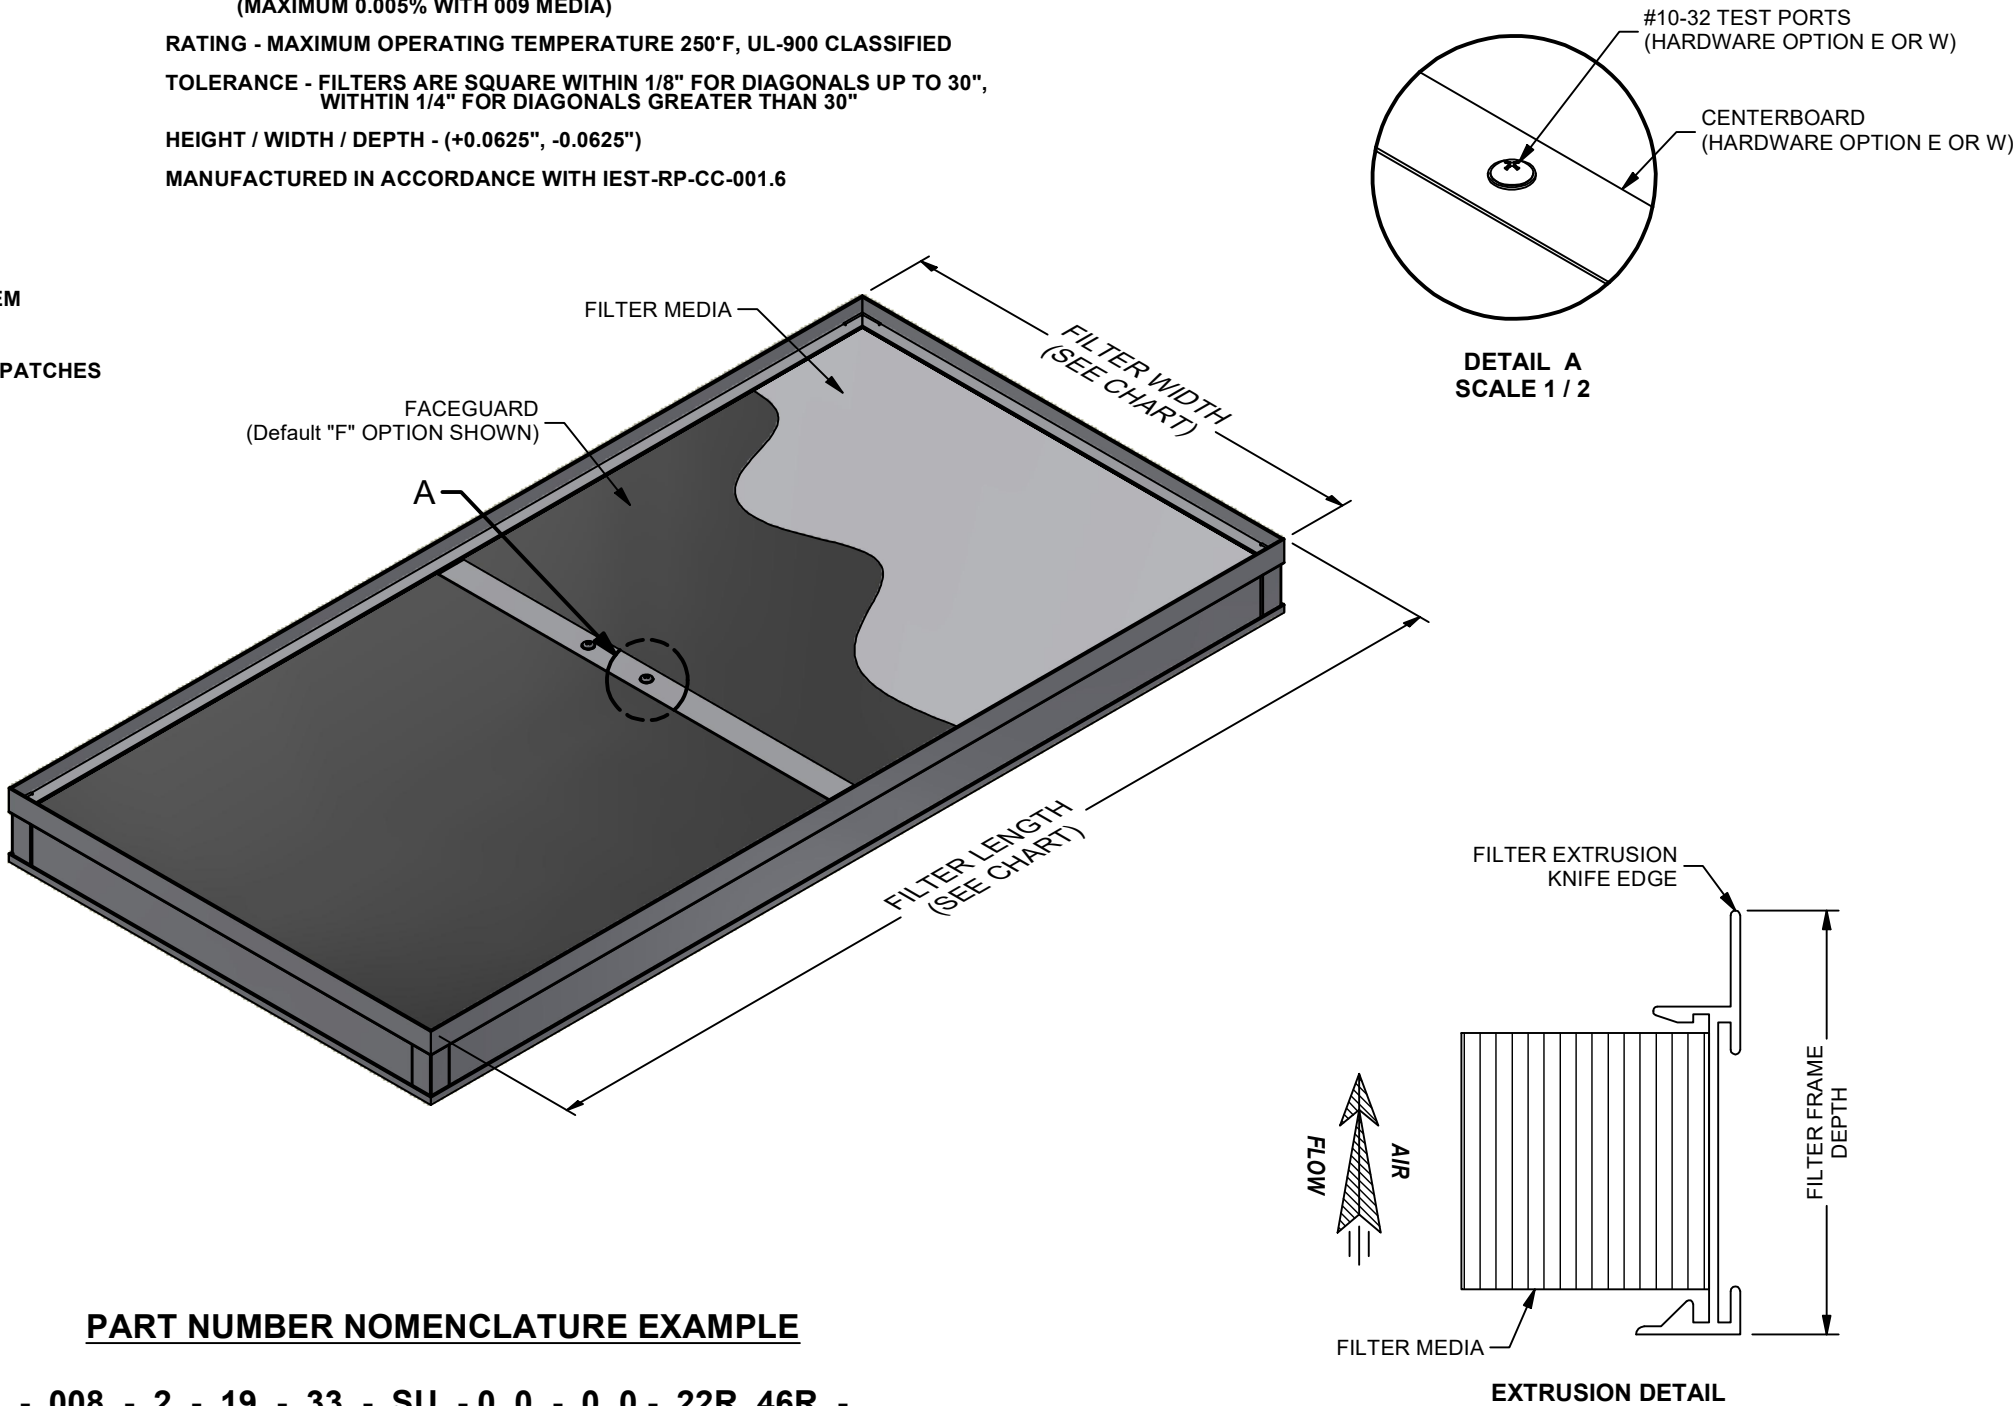

SIZE (HEIGHT AND WIDTH) DESIGNATIONS

DISCRETE SIZE FRACTIONAL DESIGNATIONS	
LETTER	DESCRIPTION
A -	0"
B -	1/16"
C -	1/8"
D -	3/16"
E -	1/4"
F -	5/16"
G -	3/8"
H -	7/16"
J -	1/2"
K -	9/16"
L -	5/8"
M -	11/16"
N -	3/4"
P -	13/16"
Q -	7/8"
R -	15/16"

FILTER FRAME DEPTH	
FILTER PACK HEIGHT	FILTER FRAME DEPTH
2"	3 5/16"
3"	5 11/32"
4"	5 11/32"

EXAMPLE: 21N44A = 21 3/4" X 44"

PART NUMBER NOMENCLATURE EXAMPLE

0 - 008 - 2 - 19 - 33 - SU - 0 0 - 0 0 - 22R 46R - _
(1) (2) (3) (4) (5) (6) (7) (8) (9) (10) (11) (12) (13)

CUSTOMER APPROVAL DRAWINGS MUST BE SIGNED IN ORDER TO PROCEED WITH PRODUCTION. [] APPROVED [] APPROVED AS NOTED [] NOT APPROVED - RESUBMIT		UNLESS OTHERWISE SPECIFIED DIMENSIONS ARE IN INCHES TOLERANCES ARE:		EST. WEIGHT		AAF Flanders®	
SIGNATURE: _____ DATE: _____		FRACTIONS X/X ±1/16 DECIMALS X.XX ±0.06 X.XXX ±0.063		TITLE: DIMPLE PLEAT SUBMITTAL DRAWING - KNIFE-EDGE EXTRUDED		DRAWN BY rwalston	
COMMENTS: _____		ANGLES ±0.5° MACHINE SURFACES 125°✓		CHECKED BY R.DUNN		APPROVED BY R.GRAVES	
CUSTOMER: _____		DATE 8/23/2022		DATE 10/18/2024		DATE 10/21/2024	
PROJECT NAME: _____		SHEET 1 OF 1		SHEET SIZE B		SCALE 1 / 7	
CUSTOMER P.O. NO.: _____		DRAWING NUMBER 600-00035-0003		REV B			
AAF FLANDERS ORDER NO.: _____							