


REVISIONS

(A02688) SWITCH 'MEDIA AREA' & 'GAC-WT' DATA IN CHART
 GAC 05MAY2025 - GC 05MAY2025 - KM 06MAY2025

AAF PART NUMBER	NOMINAL SIZE	ACTUAL SIZE (A x B x C)	MEDIA AREA (Sq. Ft.)	GASKET	INITIAL RESISTANCE (in. W.G.)		FINAL RESISTANCE (in. W.G.)	FILTER GAC-WT (lbs)
					300 FPM	500 FPM		
3190126-001	12 x 24 x 12	23.375 x 11.375 x 11.50	28.0	X	0.23	0.45	1.5	2.9
3190126-002	20 x 24 x 12	23.375 x 19.375 x 11.50	51.0		0.23	0.45	1.5	5.6
3190126-003	24 x 24 x 12	23.375 x 23.375 x 11.50	63.0		0.23	0.45	1.5	6.7
3190126-004	12 x 24 x 12	23.375 x 11.375 x 11.50	28.0	AIR LEAVING SIDE ONLY	0.23	0.45	1.5	2.9
3190126-005	20 x 24 x 12	23.375 x 19.375 x 11.50	51.0		0.23	0.45	1.5	5.6
3190126-006	24 x 24 x 12	23.375 x 23.375 x 11.50	63.0		0.23	0.45	1.5	6.7

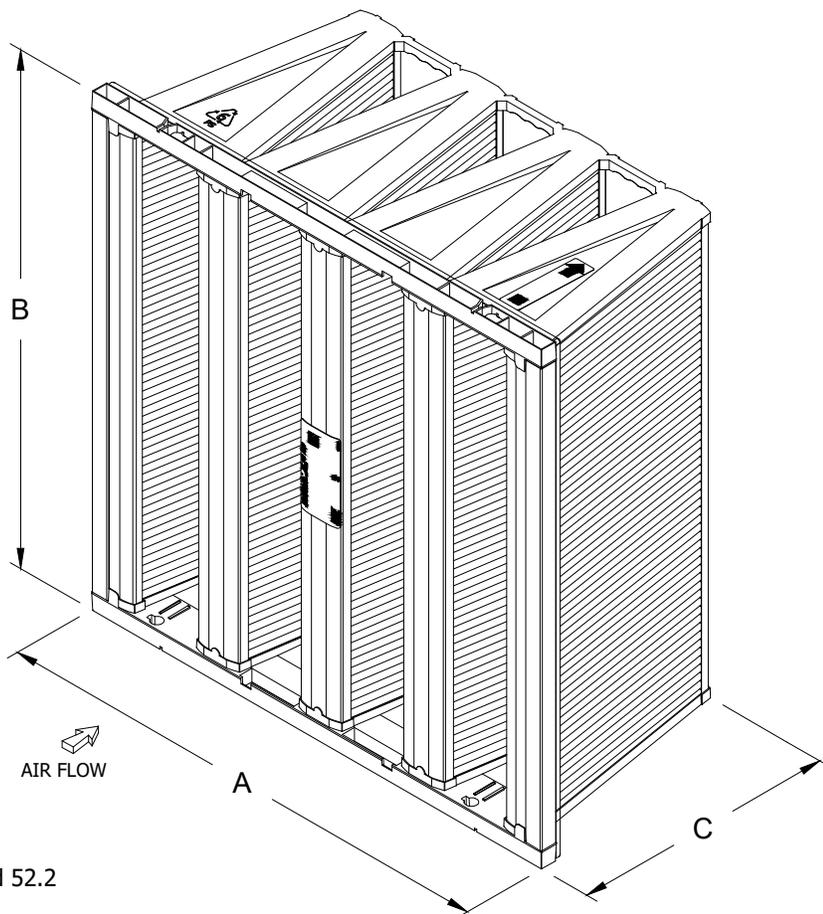

GENERAL NOTES:

- 1 Filters are MERV 15 in accordance with ASHRAE Standard 52.2
- 2 Materials of Construction:
 - a) Media: Mini carbon granulate bonded into a three dimensional network of bicomponent fibers. The carbon media is laminated to a high efficiency synthetic particulate filtration layer.
 - b) Frame: Injection molded high impact polystyrene
 - c) Sealant: Polyurethane
- 3 Dimensions:
 - A. Filter Depth = 11.50"
 - B. For face dimensions see table
- 4 Maximum Operating Temperature: 130° F (54° C)
- 5 Maximum Relative Humidity: 95%

FORM I297 REV. 5/00

DRAWN DVR	DATE 11/13/2024	CHECKED GAC	DATE 13NOV2024	APPR. KM	DATE 13NOV2024
--------------	--------------------	----------------	-------------------	-------------	-------------------



P.O. Box 35690
 Louisville, KY.
 40232-5690
www.aafintl.com

FILTER ASSEMBLY, VARISORB XL15
 (NON-RECESSED) (SUBMITTAL)

DRAWING NO.	REV
3190251	A
SHEET 1 OF 1	