



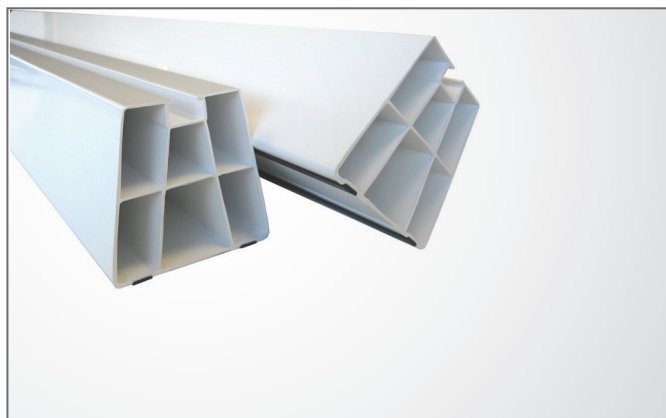

APPLICATION

Installation d'unité externe de conditionnement d'air

DIMENSIONS

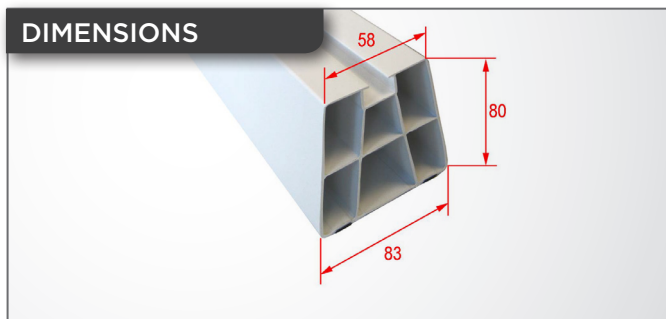

INFORMATION PRODUIT

Gamme de Produit:

Supports

Groupe de produits:

Mountblocs

Ref	Description
0502.00012.007	MBM 350 Socle 6x2 pcs - Blanc
0502.00013.008	MBM 450 Socle 6x2 pcs - Blanc
0502.00017.009	MBM 1000 Socle 2 pcs - Blanc

COULEUR STANDARD

Blanc (disponible en noir sur demande)

CARACTERISTIQUES

- Capacité recommandée de charge répartie maximale: 150Kg/pc
- Boulons de fixation inclus.
- Adapté à la plupart des unités, fixation par rail coulissant
- Installation facile et rapide
- Bandes anti-vibration contribuant à l'amortissement du bruit et vibrations

MATERIAL

PVC rigide résistant aux UV

PLAGE DE TEMPÉRATURES


De -20°C/-4°F jusqu'à +60°C/140°F en position statique

INFO D'EMBALLAGE

Ref	Ref commerciale	Description	Longueur	Boîte	Palette
0502.00012.007	MBM.350W	MBM 350 Socle 6x2 pcs - Blanc	350 mm	6 x 2 pcs	756 pcs = 63 sets
0502.00013.008	MBM.450W	MBM 450 Socle 6x2 pcs - Blanc	450 mm	6 x 2 pcs	660 pcs = 55 sets
0502.00017.009	MBM.1000W	MBM 1000 Socle 2 pcs - Blanc	1000 mm	2 pcs	448 pcs = 224 sets


ACCESSOIRES

INJ.437W


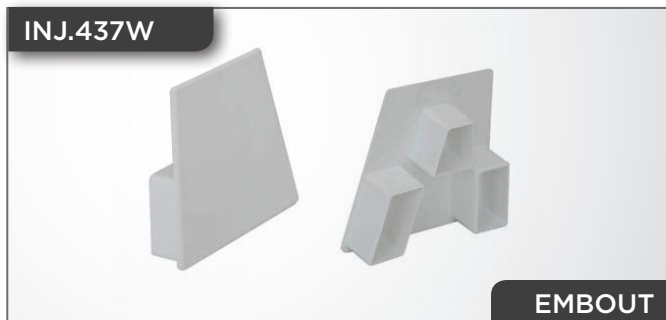


EMBOUT

A.12

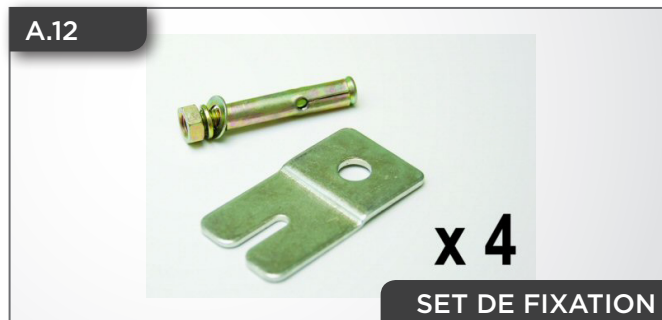

SET DE FIXATION

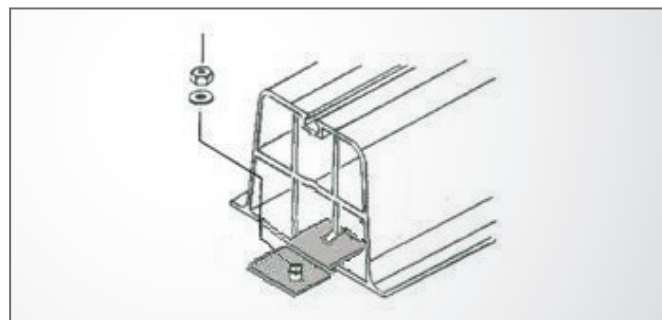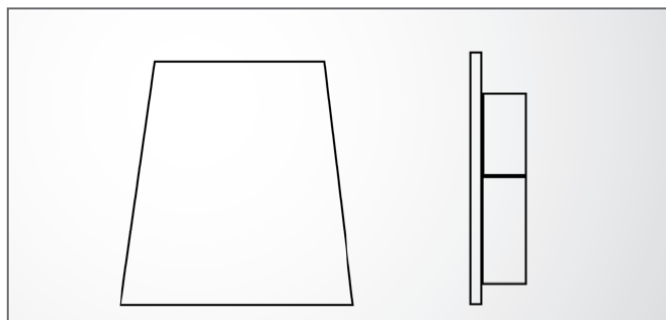

Inclus

- 4x plaques de fixation
- 4x Boulons hex. M6 + goujon d'ancrage
- 4x rondelles M6

Les accessoires doivent être commandés comme produits séparés supplémentaires

INFO D'EMBALLAGE

Ref	Ref commerciale	Description	Sachets	Boîte
0502.00019.036	INJ.437W	Embout MBM - Blanc	4 pcs / sachet	100 pcs
0502.00020.000	A.12	Plaque de Fixation	4 sets / sachet	200 sets

DISCLAIMER/RÉSERVES

Castel Engineering, Rue de la Royenne 84, B-7700 Mouscron, Tel +32 (0) 56 33 68 40 – Fax. +32 (0) 56 33 78 10

Copyright © 2015 Castel Engineering – All rights reserved. Tous droits réservés

Traduction disponible sur simple demande écrite.

Those who in any way utilize the product(s) are solely responsible for determining (a) the suitability of the product for the intended use, (b) the appropriate manner of processing and maintaining the product to ensure safety and quality and (c) chemical, physical and health effects related to those activities, (d) to inform themselves in order to be able to decide if specific tests are necessary for their intended use in respect* to norms and regulations in application at the location of their intended use*.

* The product should be installed with respect to possible climatic and seismic conditions when in use and during the installation and in conformity to the installation instructions and recommendations of the manuals of the air conditioning device.

The qualified installer is supposed to have professional knowledge

Appropriate tools and materials for installation and for maintenance must be selected and used according to the professional know-how, in respect with the nature of our products and in compliance with all procedures and regulations in application at the location of installation.

All above parameters, factors, operations, regulations, compliances and procedures are totally beyond Castel Engineering sa and its Affiliates' control.

By selling this product Castel Engineering sa and its Affiliates acts in a simple sale – purchase transaction.

Castel Engineering and its Affiliates disclaim any and all responsibility and liability for the use of any such data, information and/or the relevant product.

All dimensions in this document are in mm unless otherwise specified.