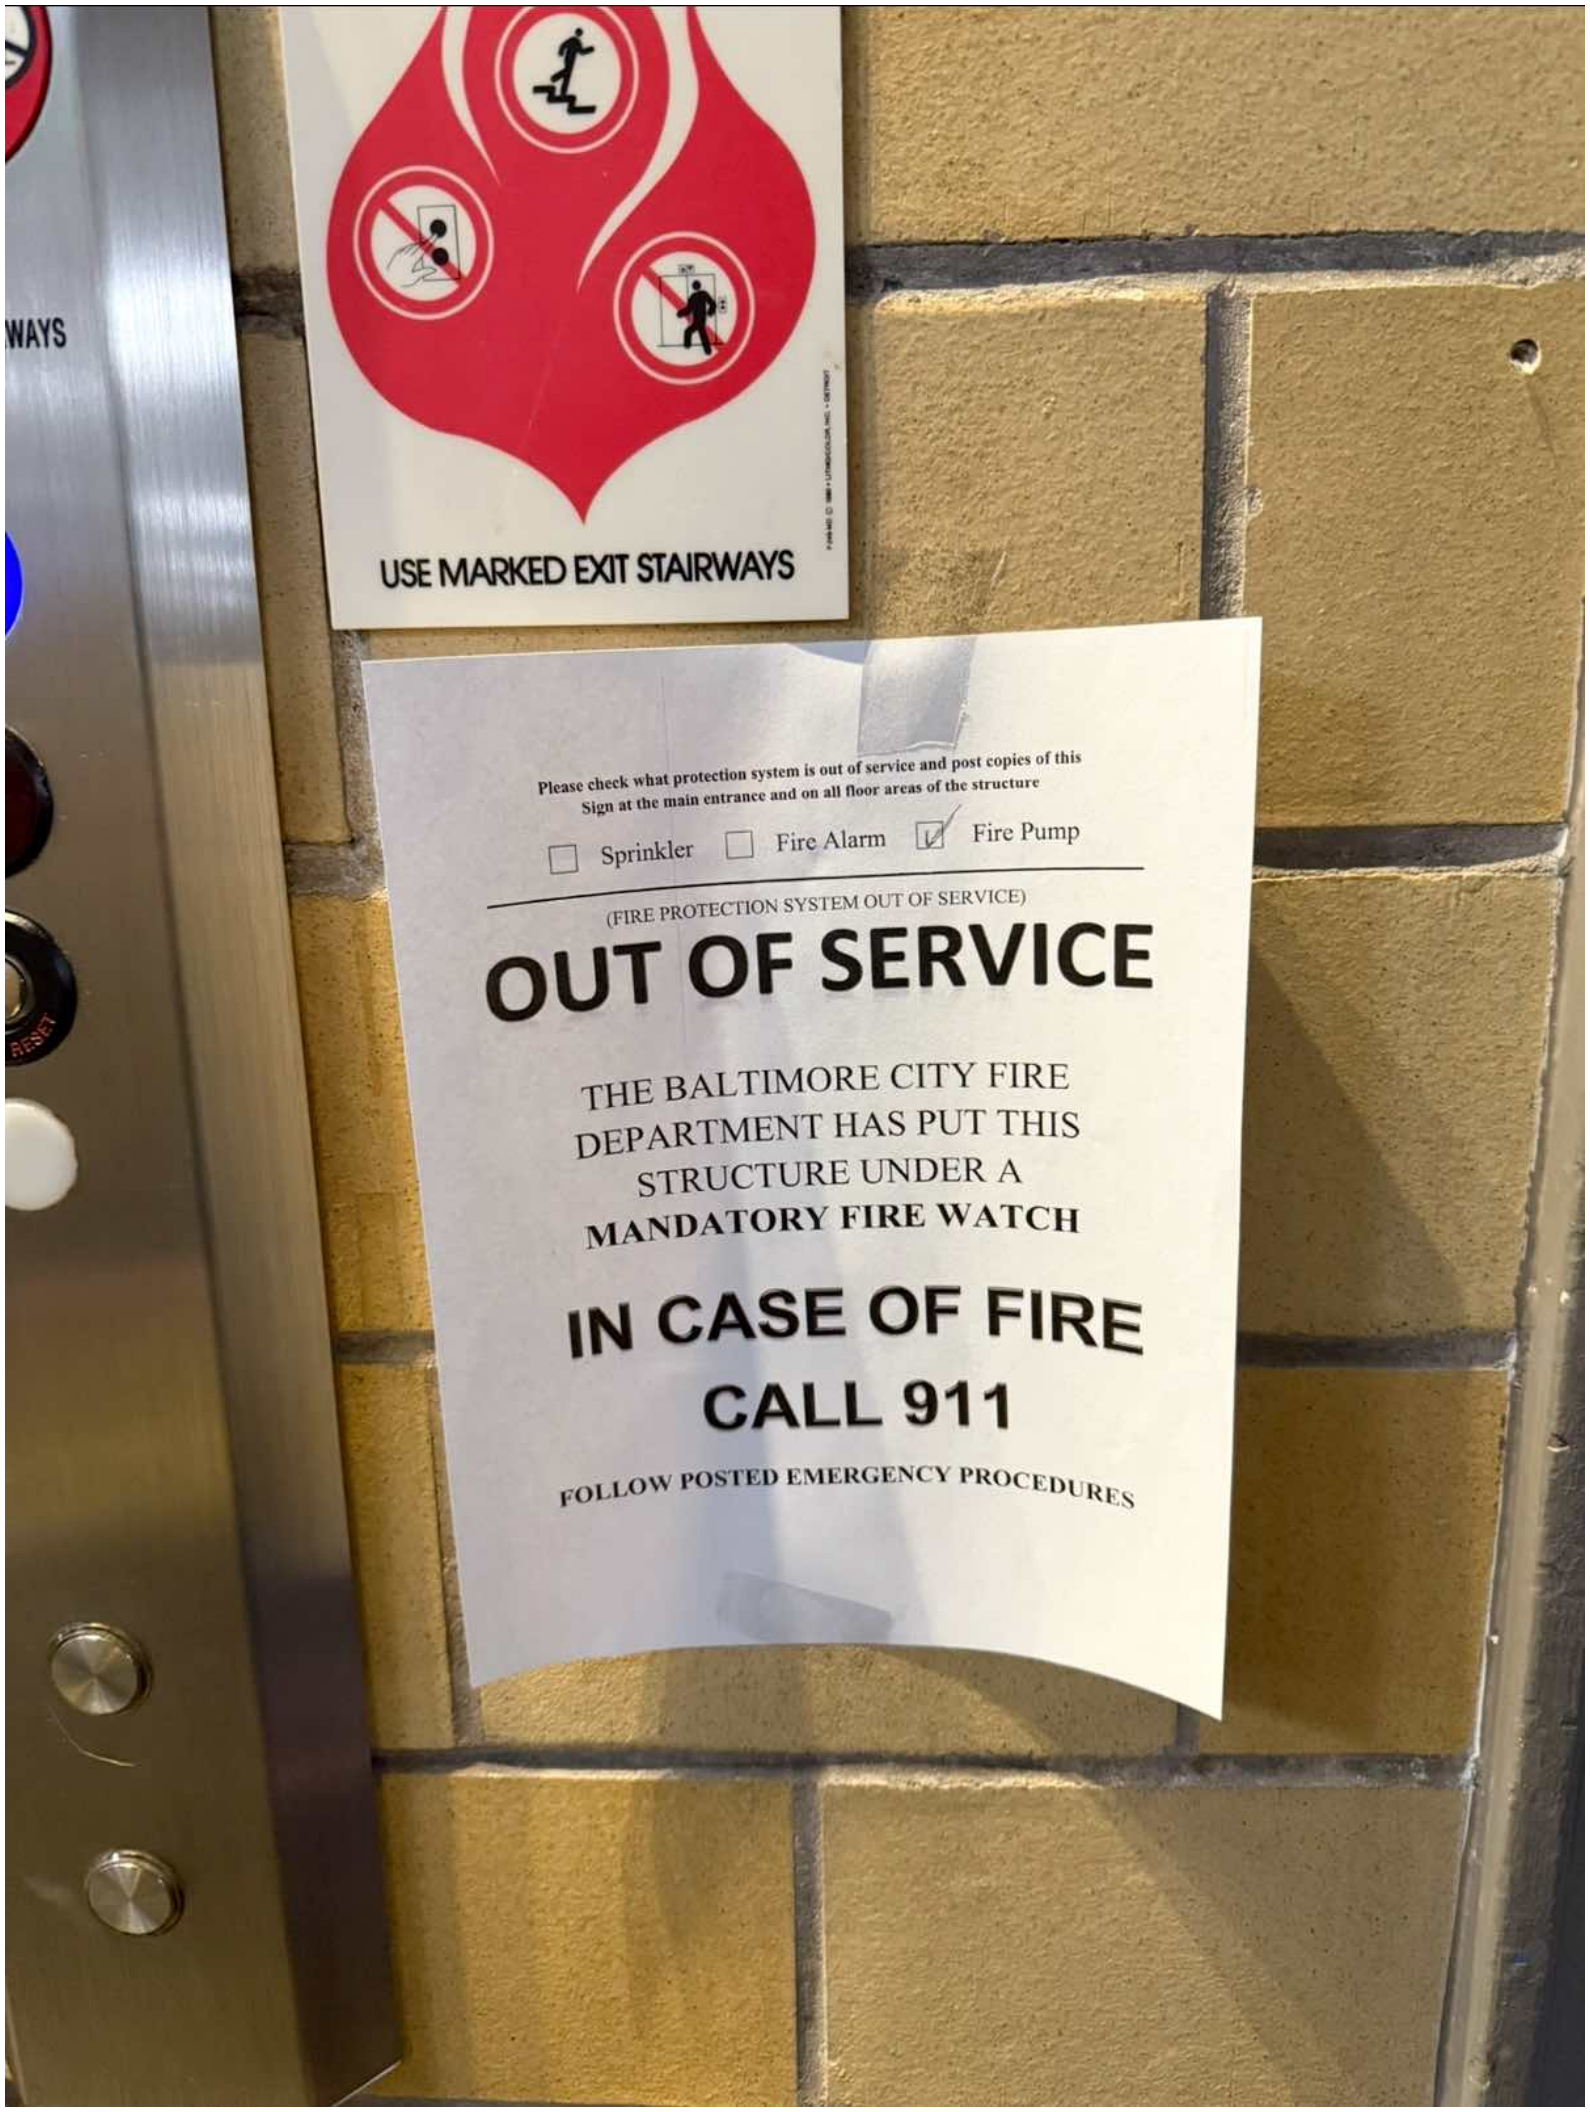

USE MARKED EXIT STAIRWAYS
Please check what protection system is out of service and post copies of this
Sign at the main entrance and on all floor areas of the structure
Sprinkler
Fire Alarm
Fire Pump
(FIRE PROTECTION SYSTEM OUT OF SERVICE)
OUT OF SERVICE
THE BALTIMORE CITY FIRE DEPARTMENT HAS PUT THIS STRUCTURE UNDER A
MANDATORY FIRE WATCH
IN CASE OF FIRE
CALL 911
FOLLOW POSTED EMERGENCY PROCEDURES

