

ENVIRONMENTAL PRODUCT DECLARATION

as per ISO 14025 and EN 15804+A2

| | |
|--------------------------|--------------------------------------|
| Owner of the Declaration | Armacell Austria GmbH |
| Publisher | Institut Bauen und Umwelt e.V. (IBU) |
| Programme holder | Institut Bauen und Umwelt e.V. (IBU) |
| Declaration number | EPD-ARM-20230410-IBA1-EN |
| Issue date | 04.09.2024 |
| Valid to | 03.09.2029 |

AustroPUR
Armacell Austria GmbH

www.ibu-epd.com | <https://epd-online.com>



1. General Information

Armaceil Austria GmbH

Programme holder

IBU – Institut Bauen und Umwelt e.V.
Hegelplatz 1
10117 Berlin
Germany

Declaration number

EPD-ARM-20230410-IBA1-EN

This declaration is based on the product category rules:

preinsulated pipes for district heating and cooling, 01.06.2023
(PCR checked and approved by the SVR)

Issue date

04.09.2024

Valid to

03.09.2029



Dipl.-Ing. Hans Peters
(Chairman of Institut Bauen und Umwelt e.V.)



Florian Pronold
(Managing Director Institut Bauen und Umwelt e.V.)

AustroPUR

Owner of the declaration

Armaceil Austria GmbH
Finkensteiner Strasse 7
9585 Gödersdorf-Villach
Austria

Declared product / declared unit

The specified product is AustroPUR. The declared unit is one tonne of pre-insulated pipe system.

Scope:

This document applies to AustroPUR. For the preparation of the Life Cycle Assessment, the production quantities of the company headquarters in Gödersdorf near Villach for the year 2022 were surveyed. The owner of the declaration shall be liable for the underlying information and evidence; the IBU shall not be liable with respect to manufacturer information, life cycle assessment data and evidences.

The EPD was created according to the specifications of EN 15804+A2. In the following, the standard will be simplified as *EN 15804*.

Verification

| | | |
|--|------------|--|
| The standard EN 15804 serves as the core PCR | | |
| Independent verification of the declaration and data according to ISO 14025:2011 | | |
| <input type="checkbox"/> | internally | <input checked="" type="checkbox"/> externally |



Angela Schindler,
(Independent verifier)

2. Product

2.1 Product description/Product definition

a) Company

Armacell Austria GmbH develops and produces energy-saving heating and cooling insulation solutions as well as flexible pre-insulated pipe systems for the following areas of application:

- Mineral wool insulation systems for building technology, energy technology and industry
- Flexible pre-insulated pipe systems for local and district heating, the connection of heat pumps and solar thermal energy, thermal water and cooling pipes, as well as cold water pipes with and without trace heating

In its 'Advanced Insulation' division, the Armacell Group develops flexible insulation materials to improve the energy efficiency of technical systems and in the 'Engineered Foams' division, it develops high-performance foams for various technical applications and lightweight construction solutions. Examples include products made from 100% recycled PET and next-generation aerogel technology.

b) Product

AustroPUR is a pre-insulated single and double pipe system made of polyurethane (PU) for underground installation.

Construction:

- Medium pipe: peroxide crosslinked polyethylene PE-Xa (alternatively with PE100 for cold water)
- Insulation: XPE (crosslinked polyethylene) edge insulation and PU core insulation
- Casing pipe: flexible, parallel-corrugated HDPE casing pipe

Energy efficiency:

Two insulation thicknesses are offered, whose thermal insulation properties correspond to thermal insulation series 2 and 3 for pre-insulated steel pipes in accordance with EN 253 and thus also meet the highest requirements in terms of energy efficiency.

The following products are grouped under the collective term AustroPUR and are included in this EPD (average EPD):

- AustroPUR Single Pipe
- AustroPUR Double Tube
- AustroPUR Cold Water

Product number: 114APE000000 Use of the product is subject to the respective national regulations at the place of use; in Germany, for example, the building codes of the federal states, and the technical regulations based on these regulations. Declaration of Performance based on *DIN EN 15632-1:2022-08, District heating pipes – Factory-made flexible pipe systems – Part 1: Classification, general requirements and test methods* and *DIN EN 15632-2:2022-08, District heating pipes – Factory-made flexible pipe systems – Part 2: Bonded pipe systems with plastic service pipes; requirements and test methods*. The respective national regulations apply for application and use.

2.2 Application

AustroPUR single/double pipes are used as local and district heating pipes, thermal pipes, door-to-door pipes and cooling pipes

2.3 Technical Data

| Name | Value | Unit |
|---|--------|-------------------|
| Pre-insulated pipe – pipe assembly | | |
| Thermal conductivity λ_{50} | 0.0219 | W/(mK) |
| Maximum operating temperature | 95 | °C |
| Continuous operating temperature | 80 | °C |
| Maximum operating pressure PN6 | 6.6 | bar |
| Axial shear strength (23 + 2) °C min | 0.09 | MPa |
| Minimum bending radius - according to product documents | - | m |
| Polyurethane foam | | |
| Compressive strength | 0.3 | MPa |
| Foam density | 60 | kg/m ³ |
| Casing | | |
| Carbon black content (LDPE) HDPE casing pipe; min. | 2 | % |
| Thermal stability (OIT) testing at 2100C (LDPE) 210°C | 20 | min |

The operating temperature and pressure specifications refer to PE-Xa medium pipes PN6. For PE-Xa PN10 medium pipes, the operating pressure increases to 10 bar. For PE100 medium pipes, the information in the specific technical data sheets or the information in *EN 1741* applies.

Performance data of the product with respect to its Declaration of Performance in accordance with the relevant technical provisions of *DIN EN 15632-1:2022-08, District heating pipes – Factory-made flexible pipe systems – Part 1: Classification, general requirements and test methods*, and *DIN EN 15632-2:2022-08 District heating pipes – Factory-made flexible pipe systems – Part 2: Bonded pipe systems with plastic medium pipes; Requirements and tests*, as well as *EN 17414:2020-09, District cooling pipes – Factory-made flexible pipe systems*.

2.4 Delivery status

AustroPUR is manufactured in coils with coil lengths of between 260 metres and 85 metres, depending on the pipe dimension. The pipes are designed for direct burial in a sand bed and are rolled out and installed directly into the pipe trench. The water-bearing medium pipes are connected with press and clamp fittings. After that, the connection points are re-insulated and sealed watertight.

2.5 Base materials/Ancillary materials

AustroPUR pipe systems consist of flexible PE-X pipes with an oxygen barrier or PE100 medium pipes, flexible PU insulation material, which is made from the components polyol, isocyanate and cyclopentane (alternatively: CO₂), a highly-flexible XPE insulation layer and the HDPE corrugated pipe as an outer jacket. The following table shows the average material composition of the product group.

| Name | Value | Unit |
|--------------------------------------|-------|------|
| Water-bearing PE-X/PE pipes | | |
| Crosslinked polyethylene PE-Xa PN 6 | 31,76 | % |
| Crosslinked polyethylene PE-Xa PN 10 | 4,55 | % |
| HDPE PE100 | 1,79 | % |
| Subtotal | 38,10 | % |
| Insulation | | |
| Polyurethane foam | 24,6 | % |
| XPE foam | 0,98 | % |
| Aluminium foil | 0,029 | % |
| Subtotal | 25,60 | % |
| Outer casing HDPE | | |
| HDPE | 36,3 | % |
| Total | 100 | % |

The water-bearing PE pipes, the XPE insulation layer and the aluminium foil are sourced from upstream suppliers. The polyurethane (PU) insulation layer is supplied in three liquid components. These components are processed in the factory and introduced into the pipe system to be insulated beforehand in a continuous process. The outer jacket made of HDPE is applied via a cross extruder and shaped with a corrugator.

1. The product/article/at least one partial product contains substances on the *ECHA list* of Substances of Very High Concern (SVHC) (20.11.2023) above 0.1% by mass: **no**
2. The product/product/at least one partial product contains other CMR substances of category 1A or 1B which are not on the *Candidate List*, above 0.1% by mass in at least one partial product: **no**
3. Biocidal products have been added to this construction product or it has been treated with biocidal products (it is therefore a treated product within the meaning of the Biocidal Products Regulation (EU) No. 528/2012): **no**

2.6 Manufacture


AustroPUR products are manufactured in a continuous production process. In the first part, the medium pipes (PE-X or PE100) are pulled from the unwinding devices, straightened and subjected to heat treatment.

At the same time, the aluminium foil and the XPE insulation layer are supplied. They serve as a collection layer for the liquid PU foam and are closed after PU has been introduced and inserted into the transverse extruder.


There, the outer casing made of HDPE is applied and the entire pipe, including medium pipes and insulation, is fed into the subsequent corrugator, where on the one hand the final corrugated shape of the outer casing is formed and on the other hand the PU foam goes through its foaming process. Foaming is monitored with cameras in front of the transverse extruder.

The cooling section is then connected with water and air cooling, where the finished product receives its marking and is then applied to the production wrapper.

Quality assurance is carried out in accordance with *EN 15632* Parts 1 and 2. Quality management system in accordance with *ISO 9001*.

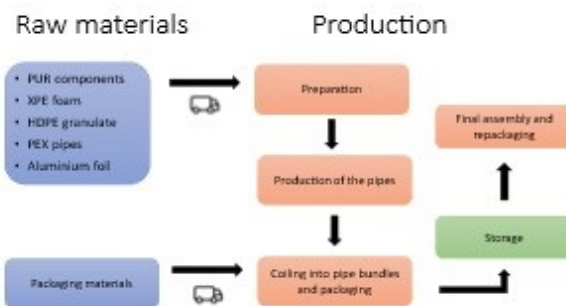

Construction:

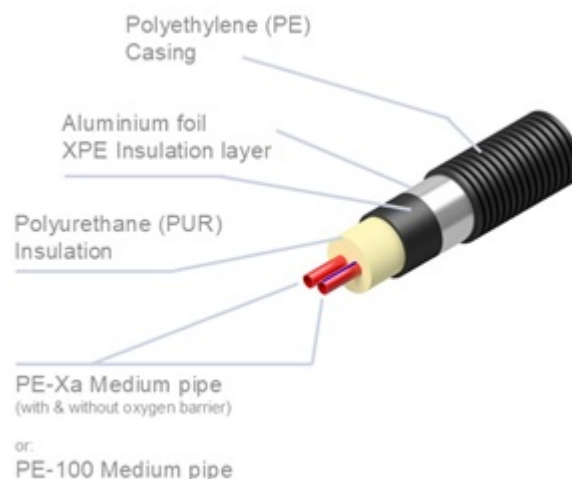

2.7 Environment and health during manufacturing

During all manufacturing steps and in all Armacell production facilities, production follows national guidelines and regulations. The cooling water is stored in the cycle. The electrical energy is covered by electricity from renewable energies.

2.8 Product processing/Installation

The product is connected using press-fittings, for which rental equipment is offered. In addition, neither special tools nor special protective measures are necessary. When using PU assembly foam, the information on the relevant safety data sheets must be observed. The recommendations for installing the product depend on the product and system and are described in the respective documentation as well as in the safety data sheets (e.g. in the installation instructions). For more details, see www.austroflex.com.

2.9 Packaging

The AustroPUR tube bundles are held together by tension straps and are provided with an outer PE protective film. The accessories are packed in boxes and attached directly to the tube bundles as well as transported on returnable pallets.

The polyethylene-based packaging elements and cardboard boxes are recyclable and recycled in the countries with a take-back system.

2.10 Condition of use

When the products are used for their intended purpose, no changes in the material composition occur during use, except in the case of extraordinary effects (see 2.13).

2.11 Environment and health during use

There are no special aspects of material composition during use. The product does not release water-soluble substances that can leak into the environment. No energy is required to use AustroPUR.

2.12 Reference service life

AustroPUR products are durable products. The results show that their useful life can be more than 50 years if used and installed properly. The PE-Xa pipe used by Armacell is manufactured in accordance with *DIN 16892* and *DIN 16893* and is quality monitored. Designed for an operating time of 24 hours a day, 365 days a year (8760 h/year), the service life cycle of 30 years at 80 °C required by *EN 15632* is fulfilled. At application temperatures < 75 °C, service life values of > 50 years are achieved. The thermal insulation performance is maintained almost without restriction over the entire service life. Impairments of the thermal insulation performance are only caused by extraordinary effects and damage during the construction phase.

2.13 Extraordinary effects

Fire

Fire protection

| Name | Value |
|-------------------------|-------|
| Building material class | E |

Water

The penetration of water vapour caused by soil moisture is kept to a minimum with the help of the outer jacket and post-insulation systems.

The product is not water-soluble and does not release water-soluble substances when used as intended that could pollute groundwater, rivers or oceans.

Mechanical destruction

AustroPUR is designed for direct installation in the ground. The outer casing is dimensioned in such a way that the earth and traffic loads can be fully absorbed at a minimum cover height of 0.8 metres above the pipe apex and sand bed, if the Armacell installation guidelines are complied with.

2.14 Re-use phase

After proper dismantling, the product can be thermally recycled or led to proper separation of components and recycling in a reprocessing process.

2.15 Disposal

The materials must be disposed of in accordance with local regulations, regulated by the European Waste Catalogue: waste code 07 02 13 (plastic waste). Note: Please refer to Commission Decision 2001/118/EC.

2.16 Further information

Further information about AustroPUR can be found on the manufacturer's website www.austroflex.com. Detailed specifications of the products are available on <https://austroflex.com/download/>.

3. LCA: Calculation rules

3.1 Declared Unit

The declared unit of one tonne refers to the average of the production volume of the year 2022. This methodology was chosen to present the different versions of the product on a balance sheet.

Declared unit and mass reference

| Name | Value | Unit |
|-------------------------------------|-------|-------------------|
| Declared unit | 1 | t |
| Mass reference | 2,61 | kg/lfm |
| Mass percentage of pipes | 0.38 | t |
| Mass percentage of insulation | 0.26 | t |
| Mass percentage of the outer sheath | 0.36 | t |
| Gross density | 60 | kg/m ³ |

Other declared units are allowed if the conversion is transparent.

The robustness of the data is shown in section 3.6.

3.2 System boundary

The data collected refers to the annual production of 2022. Type of EPD: Cradle to factory gate with options

The following stages of the use cycle are taken into account:

Production A1–A3: The LCA calculation includes production of AustroPUR components (raw material supply – A1), transport to the production facility in Gödersdorf, Austria (A2) and on-site production of the pipes, as well as assembly and packaging (A3). For the environmental impact, the use of green electricity in A3 was calculated taking into account the residual electricity mix for the residual electricity. The share of electricity demand covered by green electricity within total electricity demand is

99.47% (A3). The aggregated module also includes waste treatment of the waste from the manufacturing process.

Transport A4: Transport from the factory to the construction site.

Installation A5: Includes the disposal scenario for the packaging material and installation of the pipes with an excavator.

Disposal C1–C4: C1 (demolition) includes demolition with an excavator. C2 takes into account transport to the waste treatment plant and C3 considers treatment by thermal recovery.

D: Advantages and burdens for the next product system: electrical and thermal energy generation from the waste incineration process of the packaging (A5) and the product (C3).

3.3 Estimates and assumptions

A5: For the recycling routes, a realistic scenario for Europe is assumed, according to the *EPRC* and *BMK*. According to the manufacturer, the cardboard boxes and pallets are directed to recycling or reuse, which cannot be traced exactly, which is why no advantages or burdens are declared in module D and are therefore fed into a sink. The PE packaging is sent for thermal recycling. The useful energy produced during waste treatment is declared as exported energy in A5 (EEE and EET indicators) and the advantages and burdens associated with the useful energy generated are declared in module D. Material losses during collection and recycling are neglected. For the installation of one tonne of pipe (excavation and subsequent filling of the pipe trench), the manufacturer assumed a working time of 20 hours. The assumed excavator model has an engine output of 120 hp and a fuel consumption of 15 l/h.

For C1 (demolition), the same assumptions apply for working time and excavator model as for module A5 Installation.

C2: An average of 250 km is assumed for transport from the place of use to a waste incineration plant.

C3: Based on the current situation, it is assumed that 100% of the quantity of AustroPUR sold is used for thermal recycling. Useful energy produced during waste treatment is declared as exported energy in C3 (EEE and EET indicators) and the advantages and burdens associated with the useful energy produced are declared in module D.

C4: No material, energy and mass flows are balanced in module C4, as 100% of these are fed into waste treatment (C3).

D: The waste in module A5 is partly recycled (except cardboard boxes and pallets) and 100% in C3 in a waste incineration plant. The useful energy produced is declared as exported energy in A5 and C3 and the advantages and burdens associated with the useful energy produced in module D. According to the data set used for incineration of the PE films and PE bags in module A5 'Treatment of waste polyethylene, municipal incineration [RoW]', 5.55 MJ/kg of electrical energy and 10.69 MJ/kg of thermal energy are recovered. For the incineration of AustroPUR in module C3, 3.92 MJ/kg of electrical energy and 7.66 MJ/kg of thermal energy are recovered, according to the data set used ('Treatment of waste plastic, mixture, municipal incineration [RoW]').

3.4 Cut-off criteria

The cut-off criteria according to PCR are taken into account.

For the input and output data acquisition of the pipe production process, all material flows above 1% of the total mass flow and all energy flows above 1% of the total energy input were applied. For the LCA calculation, all available inputs and outputs, even below the 1% threshold, were taken into account.

Raw materials: EVOH (oxygen diffusion layer): the quantities are below the mass-related cut-off limit of 1%. The cooling water used is circulated and can therefore be neglected.

Packaging: tension straps: the quantities are below the mass-related cut-off limit of 1%. The packaging in the form of cardboard boxes and PE films of delivered products is also neglected or only used as a conservative approach to transport to a recycling plant. Overall, the unbalanced processes per module A1–A3 are less than 5% of the energy and mass input.

Buildings, machines and production infrastructure in the manufacturing plant: buildings and infrastructure of underlying data sets are taken into account. In addition, no specific buildings, machines and production infrastructures are recorded and taken into account in accordance with the cut-off criteria at the manufacturing plant.

3.5 Background data

The LCA model was created using *SimaPro* software (version 9.5). The '*EN 15804+A2 Method*' was used to calculate the core indicators (except 'Climate Change – biogenic') for the environmental impacts and the additional environmental indicators. This method takes into account the characterisation factors of the Ecological Footprint Method, version 3.1. The *Ecoinvent database* (version 3.9.1) provides the LCA data from the underlying system for various raw and process materials. The database was last updated in 2022.

3.6 Data quality

The foreground data collected by the manufacturer is based on production volumes and sales volumes in 2022 and extrapolations of measurements for specific machines and equipment at the production site.

The pipes within the AustroPUR product group vary in diameter, thickness of the individual layers, and design (double, single, cold water pipe). Since the average environmental performance of the product brand was calculated using site-specific production volumes, the results also provide a representative picture of site-specific production technologies. Most of the necessary LCI (Life Cycle Inventories) of the basic materials are available in the *Ecoinvent* database. This database was last updated in 2022. LCI data not available in *Ecoinvent* is approximated using LCIs of similar materials or estimated by combining available LCIs.

There is a valid certificate for the green electricity, as well as proof of the composition of the sources. For thermal energy, the region-specific natural gas supply is taken into account. The data is plausible, i.e. the deviations from comparable results (other manufacturers, literature, similar products) are comprehensible. A detailed assessment of the data quality according to *EN 15804* (Annex E) was carried out and presented in the associated project report.

3.7 Period under review

The production data refers to an average value from 2022.

3.8 Geographic Representativeness

Land or region, in which the declared product system is manufactured, used or handled at the end of the product's lifespan: Austria

3.9 Allocation

In addition to AustroPUR, other products are manufactured at the factory under review.

For those inputs and outputs for which no precise data is available, a mass-based allocation (based on the raw materials used) is applied.

The following allocations are carried out:

A1–A3 Energy: The electricity is needed for production, warehouse, charging station for electric forklifts, compressed air system, lighting and administration. For production, electricity consumption is calculated on the basis of the machine power and the running metres produced. In the case of AustroPUR, the extrusion line is taken into account. Mass-based allocation is used to allocate the electricity consumption for the warehouse, charging station for electric forklifts, compressed air system, lighting and administration, as well as natural gas for heating and hot water to the individual products.

A1–A3: Outputs: The distribution of outputs from production follows mass-based allocation.

A1–A3: Transport of the outputs for waste treatment is also accounted for on the basis of the quantities calculated in outputs. The intermediate packaging of the inputs is fed to a recycling plant and is used as a conservative addition to the transports.

A4: For transportation from the factory to the construction site, distances at home and abroad are weighted according to revenue. The average transport distance is estimated on the

basis of order processing.

3.10 Comparability

Basically, a comparison or an evaluation of EPD data is only possible if all the data sets to be compared were created

according to *EN 15804* and the building context, respectively the product-specific characteristics of performance, are taken into account. The background database used is *Ecoinvent*.

4. LCA: Scenarios and additional technical information

Characteristic product properties of biogenic carbon

Biogenic carbon content at the factory gate

Specification refers to one tonne of AustroPUR.

| Name | Value | Unit |
|---|-------|------|
| Biogenic carbon in the associated packaging | 18,1 | |

The biogenic carbon contained leaves the system in module A5.

Note: 1 kg of biogenic carbon is equivalent to 44/12 kg of CO₂.

Transport from manufacturer to place of use (A4)

| Name | Value | Unit |
|---|-------|---------|
| Litres of fuel | 40 | l/100km |
| Transport distance (average) | 1688 | km |
| Capacity utilisation (including empty runs) | 80 | % |
| Bulk density of transported products | 60 | kg/m |

Installation in the building (A5)

The figures refer to one tonne of AustroPUR.

| Name | Value | Unit |
|---|-------|------|
| Other energy sources Diesel consumption | 10573 | |
| Output materials as a result of waste treatment on the construction site (=product packaging) | 41.58 | |
| Collection for energy recovery product packaging – plastic | 1,91 | kg |
| Collection for recycling product packaging cardboard boxes | 21,69 | kg |
| Collection for reuse product packaging – pallets | 17,99 | kg |

The service life declared by the manufacturer applies to the assumptions and conditions of use described in section 2.12.

Reference service life

| Name | Value | Unit |
|---|-------|------|
| Service life according to the manufacturer's specifications | 50 | a |

End of Life (C3)

The values refer to one tonne of AustroPUR.

| Name | Value | Unit |
|---|--------|------|
| Collected as mixed construction waste | 1000 | kg |
| Thermal recycling without energy recovery – aluminium | 0,29 | kg |
| Thermal recycling for energy recovery – plastic | 999,71 | kg |

Reuse, recovery and recycling potential (D), relevant scenario information

Module D covers the advantages and burdens of the incineration process of A5 (packaging waste) and C3 (thermal utilisation of the product). A waste incineration plant with an R1 value > 0.6 is assumed. The following values refer to one tonne of AustroPUR.

| Name | Value | Unit |
|----------------------|-------|------|
| Thermal recycling A5 | 1,91 | kg |
| Thermal recycling C3 | 1000 | kg |

5. LCA: Results

In the following, the results of the indicators of impact assessment, resource use and waste and other output streams are presented in relation to 1 t of AustroPUR.

To calculate the core indicators of environmental impact and additional environmental indicators, the "EN 15804+A2 Method" of the *Simapro* software was used. This method takes into account the characterization factors of the Ecological Footprint Method, version 3.1.

The results of the biogenic global warming potential (GWP-biogenic) only take into account the greenhouse gas emissions that are stored in the packaging materials made from renewable raw materials in the form of carbon in the biomass (negative value in A1-A3) and are released back into the environment when the product is installed in the course of packaging disposal (positive value in A5). The very low biogenic greenhouse gas emissions of the energy supply processes are neglected in the present case. The product itself contains no renewable raw materials and therefore does not cause any biogenic greenhouse gas emissions.

DESCRIPTION OF THE SYSTEM BOUNDARY (X = INCLUDED IN LCA; MND = MODULE OR INDICATOR NOT DECLARED; MNR = MODULE NOT RELEVANT)

| Product stage | | | Construction process stage | | Use stage | | | | | | | End of life stage | | | | Benefits and loads beyond the system boundaries |
|---------------------|-----------|---------------|-------------------------------------|----------|-----------|-------------|--------|-------------|---------------|------------------------|-----------------------|----------------------------|-----------|------------------|----------|---|
| Raw material supply | Transport | Manufacturing | Transport from the gate to the site | Assembly | Use | Maintenance | Repair | Replacement | Refurbishment | Operational energy use | Operational water use | De-construction demolition | Transport | Waste processing | Disposal | Reuse-Recovery-Recycling potential |
| A1 | A2 | A3 | A4 | A5 | B1 | B2 | B3 | B4 | B5 | B6 | B7 | C1 | C2 | C3 | C4 | D |
| X | X | X | X | X | MND | MND | MNR | MNR | MNR | MND | MND | X | X | X | X | X |

RESULTS OF THE LCA - ENVIRONMENTAL IMPACT according to EN 15804+A2: 1 t AustroPUR

| Parameter | Unit | A1-A3 | A4 | A5 | C1 | C2 | C3 | C4 | D |
|----------------|----------------------------------|-----------|----------|----------|----------|----------|----------|----|-----------|
| GWP-total | kg CO ₂ eq | 3.77E+03 | 3.12E+02 | 1.12E+03 | 1.05E+03 | 4.62E+01 | 2.38E+03 | 0 | -4.93E+02 |
| GWP-fossil | kg CO ₂ eq | 3.84E+03 | 3.12E+02 | 1.06E+03 | 1.05E+03 | 4.62E+01 | 2.38E+03 | 0 | -4.93E+02 |
| GWP-biogenic | kg CO ₂ eq | -6.64E+01 | 0 | 6.64E+01 | 0 | 0 | 0 | 0 | 0 |
| GWP-luluc | kg CO ₂ eq | 2.95E+00 | 1.54E-01 | 1.19E-01 | 1.18E-01 | 2.28E-02 | 1.8E-02 | 0 | -3.15E-01 |
| ODP | kg CFC11 eq | 1E-04 | 6.79E-06 | 1.67E-05 | 1.67E-05 | 1.01E-06 | 2.44E-06 | 0 | -1.98E-05 |
| AP | mol H ⁺ eq | 1.78E+01 | 6.82E-01 | 9.73E+00 | 9.72E+00 | 1.01E-01 | 5.42E-01 | 0 | -9.31E-01 |
| EP-freshwater | kg P eq | 1.54E-01 | 2.53E-03 | 3.81E-03 | 3.79E-03 | 3.75E-04 | 6.67E-04 | 0 | -3.02E-02 |
| EP-marine | kg N eq | 3.73E+00 | 1.68E-01 | 4.5E+00 | 4.5E+00 | 2.49E-02 | 2.57E-01 | 0 | -2.05E-01 |
| EP-terrestrial | mol N eq | 3.26E+01 | 1.75E+00 | 4.9E+01 | 4.9E+01 | 2.59E-01 | 2.64E+00 | 0 | -2.43E+00 |
| POCP | kg NMVOC eq | 1.4E+01 | 1.06E+00 | 1.45E+01 | 1.45E+01 | 1.57E-01 | 6.64E-01 | 0 | -1.07E+00 |
| ADPE | kg Sb eq | 2.46E-02 | 1.02E-03 | 3.73E-04 | 3.66E-04 | 1.51E-04 | 1.14E-04 | 0 | -7.65E-04 |
| ADPF | MJ | 1E+05 | 4.43E+03 | 1.38E+04 | 1.37E+04 | 6.56E+02 | 4.39E+02 | 0 | -7.46E+03 |
| WDP | m ³ world eq deprived | 2.2E+03 | 1.83E+01 | 2.97E+01 | 2.96E+01 | 2.7E+00 | 1.08E+02 | 0 | -6.38E+01 |

GWP = Global warming potential; ODP = Depletion potential of the stratospheric ozone layer; AP = Acidification potential of land and water; EP = Eutrophication potential; POCP = Formation potential of tropospheric ozone photochemical oxidants; ADPE = Abiotic depletion potential for non-fossil resources; ADPF = Abiotic depletion potential for fossil resources; WDP = Water (user) deprivation potential)

RESULTS OF THE LCA - INDICATORS TO DESCRIBE RESOURCE USE according to EN 15804+A2: 1 t AustroPUR

| Parameter | Unit | A1-A3 | A4 | A5 | C1 | C2 | C3 | C4 | D |
|-----------|----------------|----------|----------|-----------|----------|----------|-----------|----|-----------|
| PERE | MJ | 6.72E+03 | 6.96E+01 | 6.31E+02 | 7.82E+01 | 1.03E+01 | 1.8E+01 | 0 | -2.98E+03 |
| PERM | MJ | 5.53E+02 | 0 | -5.53E+02 | 0 | 0 | 0 | 0 | 0 |
| PERT | MJ | 7.27E+03 | 6.96E+01 | 7.86E+01 | 7.82E+01 | 1.03E+01 | 1.8E+01 | 0 | -2.98E+03 |
| PENRE | MJ | 6.17E+04 | 4.43E+03 | 1.39E+04 | 1.37E+04 | 6.56E+02 | 3.9E+04 | 0 | -7.46E+03 |
| PENRM | MJ | 3.87E+04 | 0 | -8.4E+01 | 0 | 0 | -3.86E+04 | 0 | 0 |
| PENRT | MJ | 1E+05 | 4.43E+03 | 1.38E+04 | 1.37E+04 | 6.56E+02 | 4.42E+02 | 0 | -7.46E+03 |
| SM | kg | 1.6E-01 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| RSF | MJ | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| NRSF | MJ | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| FW | m ³ | 2.12E+03 | 1.82E+01 | 2.99E+01 | 2.98E+01 | 2.69E+00 | 1.07E+02 | 0 | -6.35E+01 |

PERE = Use of renewable primary energy excluding renewable primary energy resources used as raw materials; PERM = Use of renewable primary energy resources used as raw materials; PERT = Total use of renewable primary energy resources; PENRE = Use of non-renewable primary energy excluding non-renewable primary energy resources used as raw materials; PENRM = Use of non-renewable primary energy resources used as raw materials; PENRT = Total use of non-renewable primary energy resources; SM = Use of secondary material; RSF = Use of renewable secondary fuels; NRSF = Use of non-renewable secondary fuels; FW = Use of net fresh water

RESULTS OF THE LCA – WASTE CATEGORIES AND OUTPUT FLOWS according to EN 15804+A2:

1 t AustroPUR

| Parameter | Unit | A1-A3 | A4 | A5 | C1 | C2 | C3 | C4 | D |
|-----------|------|----------|----------|----------|----------|----------|----------|----|-----------|
| HWD | kg | 1.01E-01 | 2.82E-02 | 9.27E-02 | 9.25E-02 | 4.17E-03 | 2.65E-03 | 0 | -2.27E-02 |
| NHWD | kg | 4.2E+02 | 2.2E+02 | 2.11E+01 | 1.97E+01 | 3.26E+01 | 6.47E+01 | 0 | -3.36E+01 |
| RWD | kg | 2.21E-01 | 2.65E-03 | 2.71E-03 | 2.7E-03 | 3.93E-04 | 4E-04 | 0 | -3.03E-02 |
| CRU | kg | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| MFR | kg | 0 | 0 | 2.17E+01 | 0 | 0 | 0 | 0 | 0 |
| MER | kg | 0 | 0 | 0 | 0 | 0 | 0 | 0 | 0 |
| EEE | MJ | 0 | 0 | 1.06E+01 | 0 | 0 | 3.92E+03 | 0 | 0 |
| EET | MJ | 0 | 0 | 2.04E+01 | 0 | 0 | 7.66E+03 | 0 | 0 |

HWD = Hazardous waste disposed; NHWD = Non-hazardous waste disposed; RWD = Radioactive waste disposed; CRU = Components for re-use; MFR = Materials for recycling; MER = Materials for energy recovery; EEE = Exported electrical energy; EET = Exported thermal energy

RESULTS OF THE LCA – additional impact categories according to EN 15804+A2-optional:

1 t AustroPUR

| Parameter | Unit | A1-A3 | A4 | A5 | C1 | C2 | C3 | C4 | D |
|-----------|-------------------|----------|----------|----------|----------|----------|----------|----|-----------|
| PM | Disease incidence | 2.12E-04 | 2.31E-05 | 2.71E-04 | 2.71E-04 | 3.43E-06 | 2.69E-06 | 0 | -4.02E-06 |
| IR | kBq U235 eq | 1.53E+02 | 2.24E+00 | 2.82E+00 | 2.81E+00 | 3.32E-01 | 3.34E-01 | 0 | -1.78E+01 |
| ETP-fw | CTUe | 8.09E+04 | 2.19E+03 | 6.58E+03 | 6.57E+03 | 3.24E+02 | 4.7E+03 | 0 | -9.11E+02 |
| HTP-c | CTUh | 1.58E-05 | 1.42E-07 | 3.22E-07 | 3.21E-07 | 2.11E-08 | 2.07E-07 | 0 | -1.18E-07 |
| HTP-nc | CTUh | 4.62E-05 | 3.14E-06 | 2.26E-06 | 2.23E-06 | 4.66E-07 | 7.32E-06 | 0 | -2.23E-06 |
| SQP | SQP | 1.45E+04 | 2.68E+03 | 9.42E+02 | 9.26E+02 | 3.97E+02 | 1.31E+02 | 0 | -1.3E+03 |

PM = Potential incidence of disease due to PM emissions; IR = Potential Human exposure efficiency relative to U235; ETP-fw = Potential comparative Toxic Unit for ecosystems; HTP-c = Potential comparative Toxic Unit for humans (carcinogenic); HTP-nc = Potential comparative Toxic Unit for humans (not carcinogenic); SQP = Potential soil quality index

Limitation note 1 – applies for the indicator 'Potential impact of human exposure to U235'. This impact category deals mainly with the possible impact of low-dose ionising radiation on human health in the nuclear fuel cycle. It does not take into account effects attributable to possible nuclear accidents and occupational exposure, or to the disposal of radioactive waste in underground facilities. The potential ionising radiation emitted by soil, radon and some building materials is also not measured by this indicator.


Limitation note 2 – applies for the indicators 'Abiotic depletion potential for non-fossil resources', 'Abiotic depletion potential for fossil fuels', 'Water depletion potential (users)', 'Potential toxicity comparison unit for ecosystems', 'Potential toxicity comparison unit for humans – carcinogenic', 'Potential toxicity comparison unit for humans – non-carcinogenic', 'Potential soil quality index'. The results of this environmental impact indicator must be used with caution, as the uncertainties of these results are high or there is limited experienced with the indicator. This EPD was created with a software tool. This EPD was created using a software tool.

6. LCA: Interpretation

The following interpretation provides a summary of the LCA results (excluding module D) based on a declared unit of one tonne of AustroPUR pipe.

The A1–A3 manufacturing phase is the dominant factor in the environmental profile. In 10 out of 13 indicators, it is responsible for at least 40% of the environmental impacts. One exception is EP-marine, EP-terrestrial and POCP, in which the diesel combustion of the excavator during installation (A5) and dismantling (C1) of AustroPUR is a major contributor.

The production phase and the thermal recycling of the product in C3 mainly contribute to the global warming potential (Climate change-total). During thermal utilisation of the product, the sequestered fossil carbon is released into the atmosphere in the form of CO₂ emissions, thus contributing to global warming. The biogenic greenhouse gas emissions are attributable to the carbon content of the product packaging made of cardboard and pallets. This carbon was taken from the atmosphere during tree growth and stored in the biomass (hence negative CO₂ emissions in A1-A3). In module A5, the cardboard boxes and pallets leave the product system (hence positive CO₂ emissions in A5) and are recycled or reused. Over the entire life cycle of the product, this results in a balanced CO₂ balance for the biogenic carbon sequestered in the product packaging. In terms of volume, however, the two indicators Climate change–biogenic and Climate change–Land use account for only minor shares of the Climate change–total indicator, which is why the latter hardly differs from the Climate change–fossil indicator.

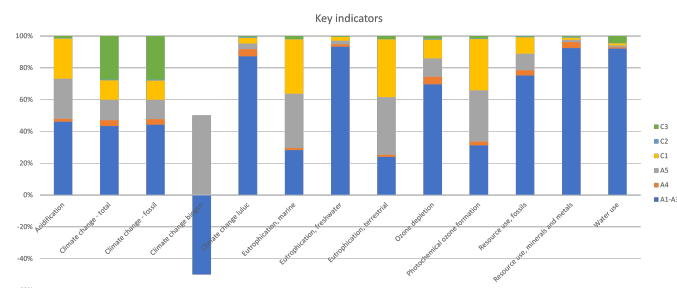

The analysis of the production phase of AustroPUR identifies the supply of raw materials (including ancillary materials and packaging) as a key driver with a share of at least 85% in all environmental indicators. Among the individual raw materials, PUR insulation and PN pipes together are responsible for at least 65% of the environmental impact in all environmental indicators.

Fluctuation

The following table shows the range of results for the different

AustroPUR pipe dimensions (off-the-shelf goods) for the 3 indicators GWP-fossil, acidification (AP), and the total non-renewable primary energy demand per tonne of AustroPUR. Only A1–A3 is considered, as the fluctuations are mainly reflected in the composition of the raw materials and this has no influence on the remaining modules.

| Parameter | Pipe dimension | Unit/ t AustroPUR | A1-A3 | Deviation from the average |
|-------------------|----------------|---------------------------|----------|----------------------------|
| MAX GWP-fossil | A200 1x110 | kg CO ₂ equiv. | 3.99E+03 | +4.02% |
| MIN GWP-fossil | A125 1x32 | kg CO ₂ equiv. | 3.33E+03 | -13.11% |
| Fluctuation range | | kg CO ₂ equiv. | 6.57E+02 | |
| MAX AP | A240 1x125 | Mol H+ equiv. | 1.80E+01 | +1.29% |
| MIN AP | A125 1x50 | Mol H+ equiv. | 1.51E+01 | -15.02% |
| Fluctuation range | | Mol H+ equiv. | 2.90E+00 | |
| MAX PENRT | A200 1x110 | MJ | 1.05E+05 | +4.54% |
| MIN PENRT | A125 1x32 | MJ | 9.02E+04 | -9.81% |
| Fluctuation | | MJ | 1.44E+04 | |

In the GWP fossil and PENRT indicators, the A200 1x110 single pipe has the highest values. This is due to a high PE-Xa pipe content, which has a relatively high global warming potential and a high non-renewable primary energy demand (total) compared to the other raw materials.

The cold water single pipe A125 1x32, on the other hand, has the lowest values in the two indicators. The reason for this is the use of a PE-100 pipe instead of a PE-Xa pipe, which has both a lower global warming potential and a lower non-renewable primary energy demand (total), and also has the lowest raw material content in the 'A125 1x32' pipe version.

In the AP indicator, the single pipe A240 1x125 has the highest value, which is again due to a high proportion of PE-Xa pipes and a high proportion of PU insulation material. The cold water single pipe A125 1x50 has the lowest value, as it is a PE-100 pipe instead of a PE-Xa pipe, which has a lower acidification potential and contains a relatively small proportion of PU insulation material compared to the other pipe designs.

7. Requisite evidence

8. References

DIN 16892

DIN 16892:2019-10, Crosslinked high-density polyethylene (PE-X) pipes – General quality requirements, testing

DIN 16893

DIN 16893:2019-10, Crosslinked high-density polyethylene (PE-X) pipes – Dimensions

EN 253

DIN EN 253:2020-03, District heating pipes – Bonded single pipe systems for directly buried hot water networks – Factory-made pipe assembly of steel service pipe, polyurethane thermal insulation and a casing of polyethylene

EN 15632-1

DIN EN 15632-1:2022-08, District heating pipes – Factory-made flexible pipe systems – Part 1: Classification, general requirements and test methods

EN 15632-2

DIN EN 15632-2:2022-08, District heating pipes – Factory-made flexible pipe systems – Part 2: Bonded system with plastic service pipes; requirements and test methods

EN 15804

EN 15804:2012+A2:2019+AC:2021, Sustainability of construction works – Environmental product declarations – Core rules for the product category of construction products

EN 17414

DIN EN 17414:2020-09, District cooling pipes – Factory-made flexible pipe systems

ISO 9001

DIN EN ISO 9001:2015-11, Quality management systems – Requirements

ISO 14025

EN ISO 14025:2011-10, Environmental labelling and declarations – Type III Environmental declarations – Principles and procedures

ISO 14040

DIN EN ISO 14040:2021-02, Environmental management – Life cycle assessment – Principles and framework

ISO 14044

DIN EN ISO 14044:2006-10, Environmental management – Life cycle assessment – Requirements and guidelines

Further reading

AMAG, 2015

AMAG, 2015. Sustainability Report – Value Creation through Appreciation. Aluminium. Ranshofen: Austria Metall AG

Construction EPD

Bau-EPD, 2023. Management System manual, version 4.0.0; available [online] at: <https://www.bau-epd.at/>

bauforumstahl

bauforumstahl: Calorific Value Table, 2023; available [online] at: <https://bauforumstahl.de/upload/documents/brandschutz/kennwerte/He>

BMK

BMK, 2023. EU Plastics Strategy; available [online] at: https://www.bmk.gv.at/themen/klima_umwelt/kunststoffe/europ_kunststoffstrategie.html [accessed on 5 July 2023].

Ecoinvent

Ecoinvent. Version 3.9.1. Zurich, Switzerland: Ecoinvent Association, 2022 [accessed on 7 August 2023]

EPRC

European Paper Recycling Council (EPRC), 2021. bvse – Fachverband Papierrecycling; available [online] at: <https://www.bvse.de/altpapier/nachrichten-papier-recycling/8933-papier-recyclingquote-von-71-4-in-europa.html> [accessed on 5 July 2023]

FPO, 2005

Free Patents Online, 2005. Cross-linkable Polyethylene Composition – German patent DE60011692, Germany

IBU 2021

General Instructions for the EPD programme of Institut Bauen und Umwelt e.V., version 2.0, Berlin: Institut Bauen und Umwelt e.V., 2021; <http://www.ibu-epd.com>

klimaaktive, 2020

klimaaktiv, 2020: Missionzero Fact Sheet: Plastic. Vienna: Federal Ministry for Climate Action, Environment, Energy, Mobility, Innovation and Technology

Müller, 2019

F. Müller, 2019: Aluminium Fact Sheet, Dessau-Roßlau, Germany: Federal Environment Agency

PCR, Part A

Institut Bauen und Umwelt e.V., 2022. Product category rules for building-related products and services. Part A: Calculation rules for the life cycle assessment and requirements for the project report according to EN 15804+A2:2019, version 1.3, Berlin: Institut Bauen und Umwelt e.V., 2022

PCR, Part B

Institut Bauen und Umwelt e.V., 2023. Product category rules for building-related products and services. Part B: Requirements for the EPD for pre-insulated pipe systems for the application in buildings, version 1, Berlin: Institut Bauen und Umwelt e.V., 2023

SimaPro

SimaPro, version 9.5, Amersfort, Netherlands: PRé Sustainability B.V., 2023 [accessed on 7 August 2023]

Federal Environment Agency, 2007

Federal Environment Agency, 2007. Waste incineration in Austria – Status report 2006. Vienna, Austria: Umweltbundesamt GmbH

Uponor Corporation, 2021

Uponor Corporation, 2021. Environmental Product Declaration in accordance with EN 15804+A2 & ISO 14025 / ISO 21930 – Uponor Aqua Pipe. Virsbo, Sweden: EPD Hub



Publisher

Institut Bauen und Umwelt e.V.
Hegelplatz 1
10117 Berlin
Germany

+49 (0)30 3087748- 0
info@ibu-epd.com
www.ibu-epd.com



Programme holder

Institut Bauen und Umwelt e.V.
Hegelplatz 1
10117 Berlin
Germany

+49 (0)30 3087748- 0
info@ibu-epd.com
www.ibu-epd.com



Author of the Life Cycle Assessment

Ressourcen Management Agentur GmbH
Kölbgasse 17/30
1030 Wien
Austria

+4318905799
office@rma.at
www.rma.at



Owner of the Declaration

Armacell Austria GmbH
Finkensteiner Strasse 7
9585 Gödersdorf-Villach
Austria

+43 (0)4257 3345 0
office.austroflex@armacell.com
www.austroflex.com