

Environmental Product Declaration



EPD of multiple products, based representative product in accordance with ISO 14025:2006 and EN 15804:2012+A2:2019/AC:2021 for:

Electrofusion Transition fittings, Balloon, Transition and Tapping valve saddles

from

Fusion Group Limited



Programme:

Programme operator:

EPD registration number:

Publication date:

Valid until:

The International EPD® System, www.environdec.com

EPD International AB

EPD-IES-0005658

2025-05-26

2030-05-25

An EPD should provide current information and may be updated if conditions change. The stated validity is therefore subject to the continued registration and publication at www.environdec.com

/ SOLUTIONS, NOT JUST PRODUCTS



A dedicated member of the **AVR** Group

General information

Programme information

Programme:	The International EPD® System
Address:	EPD International AB Box 210 60 SE-100 31 Stockholm Sweden
Website:	www.environdec.com
E-mail:	info@environdec.com

Accountabilities for PCR, LCA and independent, third-party verification
Product Category Rules (PCR)
CEN standard EN 15804 serves as the Core Product Category Rules (PCR)
Product Category Rules (PCR): <i>PCR 2019:14 Construction Products version 1.3.4, UN CPC code: 36320 - Tubes, pipes and hoses, and fittings therefor, of plastics.</i>
PCR review was conducted by: <i>The Technical Committee of the International EPD® System</i>
Life Cycle Assessment (LCA)
LCA accountability: <i>Jesper Kokborg Lassen, NRGi Rådgivning A/S</i>
Third-party verification
Independent third-party verification of the declaration and data, according to ISO 14025:2006, via:
☒ EPD verification by individual verifier
Third-party verifier: <i>Hüdaï Kara PhD, Metsims Sustainability Consulting, Oxford, U.K., www.metsims.com</i>
Approved by: The International EPD® System
Procedure for follow-up of data during EPD validity involves third party verifier:
☐ Yes ☒ No

The EPD owner has the sole ownership, liability, and responsibility for the EPD.

EPDs within the same product category but registered in different EPD programmes, or not compliant with EN 15804, may not be comparable. For two EPDs to be comparable, they must be based on the same PCR (including the same version number) or be based on fully-aligned PCRs or versions of PCRs; cover products with identical functions, technical performances and use (e.g. identical declared/functional units); have equivalent system boundaries and descriptions of data; apply equivalent data quality requirements, methods of data collection, and allocation methods; apply identical cut-off rules and impact assessment methods (including the same version of characterisation factors); have equivalent content declarations; and be valid at the time of comparison. For further information about comparability, see EN 15804 and ISO 14025.

Company information

Owner of the EPD: Fusion Group Limited

Contact: Michael Day, mida@avkuk.co.uk

Description of the organisation: Fusion Group Limited is a manufacturer of electrofusion fittings for PE piping infrastructure.

Product-related or management system-related certifications: ISO 9001, ISO 14001, and ISO 29001

Name and location of production site(s): Fusion Plastic Limited

Product information

Product name: Fusamatic Electrofusion transition fittings, balloon, transition and tapping valve saddles

Product identification: Series 1210, 1211, 1212, 1213, and 1233

Product description: Electrofusion fittings enable utilities, designers and contractors to create fully welded pipe networks and are fully end load resistant. Specifically Fusion Fusamatic electrofusion fittings are suitable for use on polyethylene pipe networks across a range of industries and infrastructure projects both above and below ground. Common applications include gas, water, wastewater, irrigation and mining projects which require a homogeneous welded network, helping to ensure the pipeline remains flexible, corrosion resistant, with excellent long term flow characteristics and no maintenance needs.

Product representativeness: The representative product declared is based on a weighted material average for the products series covered in this EPD.

UN CPC code: 36320 - *Tubes, pipes and hoses, and fittings therefor, of plastics.*

Geographical scope: Raw materials are sourced from Europe, with production being situated at in the UK. Module A4, A5, C1-C4, and D are all based on a global scenario.

LCA information

Functional unit / declared unit: 1 kg of transition fittings, balloon, transition and tapping valve saddles

Reference service life: Not applicable

Time representativeness: Covers production data from 2023

Database(s) and LCA software used: SimaPro 9.6.0.1, Ecoinvent 3.10 – Allocation, cut-off, EN 15804

Description of system boundaries: Cradle to gate with options, modules A4-A5, C1-C4, and D

Calculation method and version: EF3.1

Module A1-A3:

A1: The raw materials are procured from a supply mix in Europe. The PE polymer and Brass is 100% virgin.

A2: Transport of raw materials within Europe to UK are modelled as truck with EURONORM6.

A3: The raw materials are received and combined through an injection moulding process which integrates the resistance wire and any other sub-components within the moulding. Where products require additional components after the primary moulding process, these are assembled post moulding. Quality assurance tests are also undertaken on the products before being packed in PE bags and shipped in cardboard boxes on wooden pallets. Energy utilized in A3 is a GB fully covered by green and certified electricity sourced from wind.

Applied energy mix	Kg CO2-eq/kWh/DU
Great Britain (Green wind electricity)	0.30

Module A4-A5:

A4: A global scenario has been applied based with a transport to customer of 12.000 km to account for shipping. 200 km by truck, and 10.000 km by ship.

A5: The electrofusion products are fused together with a PE pipe, by sending a current through the resistance wire with an Electrofusion Welding Machine, thus creating a homogeneous welded joint.


Module B1-B7:

Assessed as not relevant, and therefore not covered by the EPD

Module C1-C4: C1 is modelled with a minor energy use, as the pipes can be cut (during dismantling) with manual labour, or electric pipe cutters. For C2, transport is considered 50 km for waste sent for recycling or energy recovery, whereas 100 km is considered for landfill. Transport in C2 utilize lorry with EURO4 classification. The waste treatment scenario in C3 and C4 is comprised of 3 sub scenarios – Based on Eurostat waste statistics for plastics 2022, and Plastic waste management and burden in China, IPEN.

Module D: For the material sent for energy recovery at a CHP-plant, 75% of the energy recovered is thermal energy, whereas 25% is electrical energy. A 15% loss is factored into the energy recovered at the CHP-plant. The electricity generated substitutes the grid mixes of Europe and China, whereas the thermal energy substitutes natural gas markets in Europe and China.

System diagram:

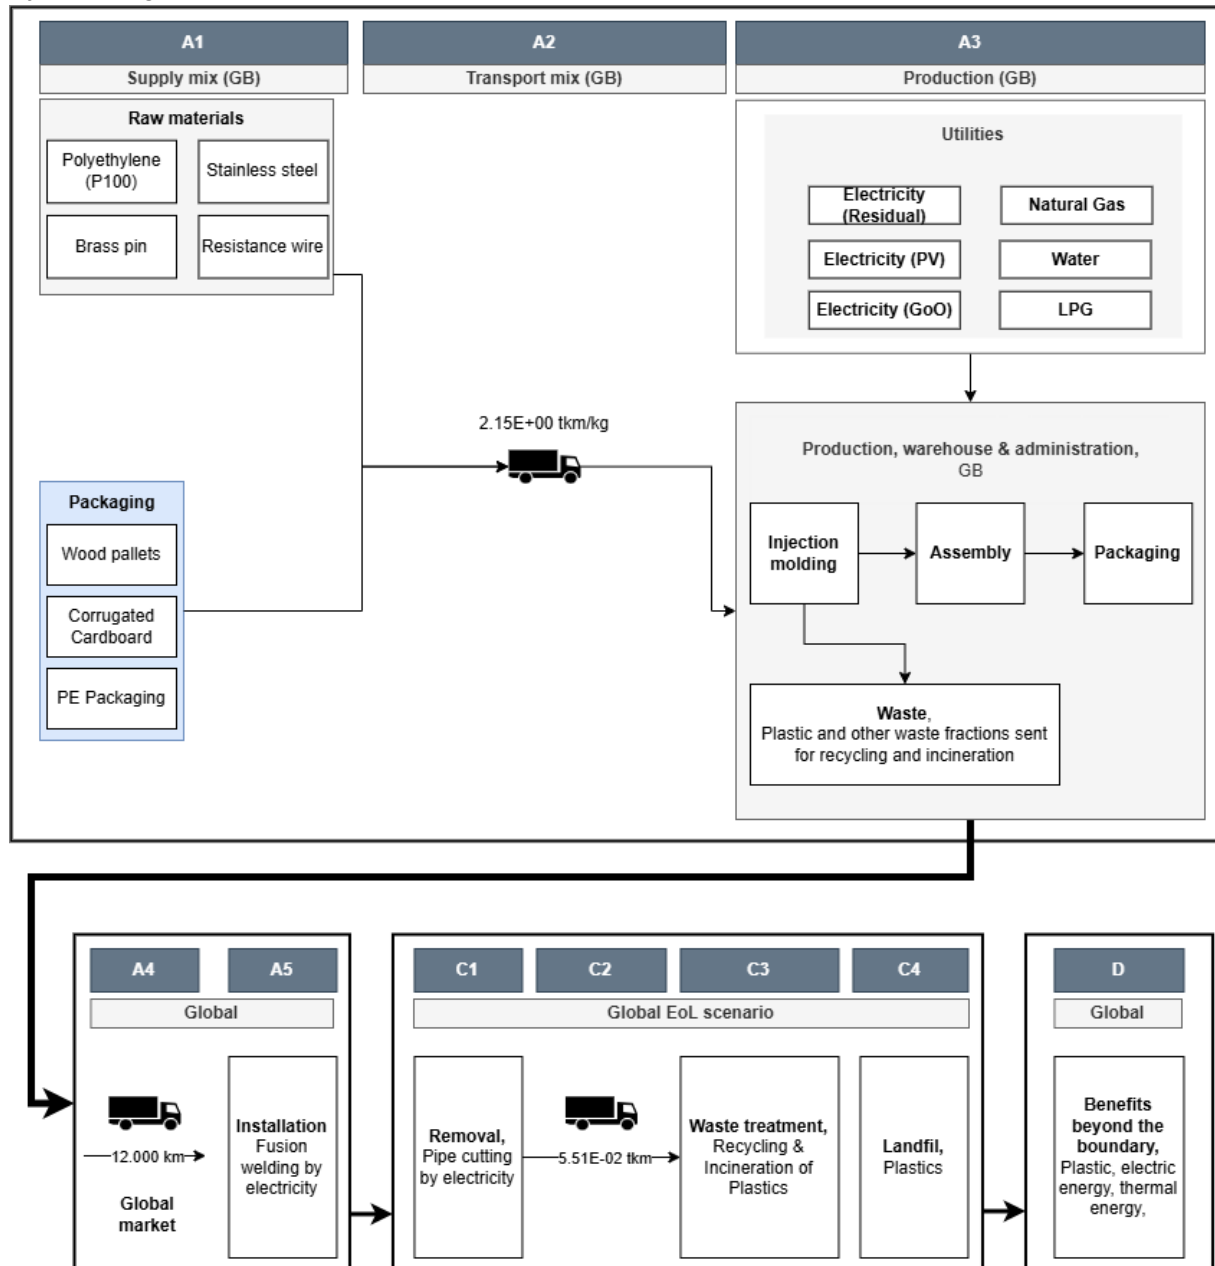

Modules declared, geographical scope, share of specific data (in GWP-GHG results) and data variation (in GWP-GHG results):

	Product stage			Construction process stage		Use stage							End of life stage				Resource recovery stage
	Raw material supply	Transport	Manufacturing	Transport	Construction installation	Use	Maintenance	Repair	Replacement	Refurbishment	Operational energy use	Operational water use	De-construction demolition	Transport	Waste processing	Disposal	Reuse-Recovery-Recycling-potential
Module	A1	A2	A3	A4	A5	B1	B2	B3	B4	B5	B6	B7	C1	C2	C3	C4	D
Modules declared	X	X	X	X	X	ND	ND	ND	ND	ND	ND	ND	X	X	X	X	X
Geography	UK, EU	RER	UK	GLO	GLO	ND	ND	ND	ND	ND	ND	ND	GLO	GLO	GLO	GLO	GLO
Specific data used	>90%			-	-	-	-	-	-	-	-	-	-	-	-	-	-
Variation – products	<1%			-	-	-	-	-	-	-	-	-	-	-	-	-	-
Variation – sites	0%			-	-	-	-	-	-	-	-	-	-	-	-	-	-

Content information

Product components	Weight, %	Post-consumer material, weight-%	Biogenic material, weight-% and kg C/kg
Polyethylene (P100)	0.25	0.00	0.00
Brass	0.72	0.00	0.00
Resistance wire	0.01	0.00	0.00
Stainless steel	0.02	0.00	0.00
TOTAL	1.00	0.00	0.00
Packaging materials	Weight, %	Weight-% (versus the product)	Weight biogenic carbon, kg C/kg
Cardboard	0.02	2.07%	0.010
PE-Plastic	0.02	1.50%	0.000
Pallet	<0.00	0.19%	0.001
TOTAL	0.04	3.76%	0.011

Results of the environmental performance indicators

Mandatory impact category indicators according to EN 15804

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles									
Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
GWP-fossil	kg CO ₂ eq.	5.80E+00	1.10E-01	3.11E-03	3.11E-03	1.05E-02	6.10E-01	2.40E-02	-3.45E+00
GWP-biogenic	kg CO ₂ eq.	-4.02E-02	0.00E+00	4.02E-02	0.00E+00	0.00E+00	0.00E+00	0.00E+00	-1.75E-02
GWP-luluc	kg CO ₂ eq.	9.89E-03	5.88E-05	9.61E-06	9.62E-06	3.48E-06	2.35E-05	2.02E-07	-6.36E-03
GWP-total	kg CO ₂ eq.	5.77E+00	1.10E-01	4.33E-02	3.12E-03	1.05E-02	6.10E-01	2.40E-02	-3.47E+00
ODP	kg CFC 11 eq.	9.94E-08	1.79E-09	5.38E-11	5.39E-11	2.08E-10	3.26E-10	7.69E-12	-4.38E-08
AP	mol H ⁺ eq.	3.00E-01	2.02E-03	1.58E-05	1.58E-05	2.18E-05	2.81E-04	7.93E-06	-3.03E-01
EP-freshwater	kg P eq.	2.38E-02	5.25E-06	2.77E-06	2.77E-06	7.09E-07	1.20E-05	4.41E-08	-2.41E-02
EP-marine	kg N eq.	1.68E-02	4.84E-04	2.75E-06	2.75E-06	5.24E-06	8.52E-05	8.52E-06	-1.62E-02
EP-terrestrial	mol N eq.	2.24E-01	5.38E-03	2.39E-05	2.39E-05	5.65E-05	9.05E-04	3.87E-05	-2.21E-01
POCP	kg NMVOC eq.	6.68E-02	1.55E-03	7.91E-06	7.91E-06	3.62E-05	2.49E-04	2.26E-05	-6.23E-02
ADP-minerals&metals*	kg Sb eq.	4.11E-03	2.07E-07	6.79E-09	6.79E-09	3.40E-08	1.23E-06	1.35E-09	-4.18E-03
ADP-fossil*	MJ	8.68E+01	1.42E+00	7.35E-02	7.35E-02	1.47E-01	2.85E-01	7.02E-03	-5.83E+01
WDP*	m ³	5.56E+00	6.01E-03	2.38E-03	2.38E-03	8.29E-04	1.01E-02	1.09E-04	-5.23E+00
Acronyms	GWP-fossil = Global Warming Potential fossil fuels; GWP-biogenic = Global Warming Potential biogenic; GWP-luluc = Global Warming Potential land use and land use change; ODP = Depletion potential of the stratospheric ozone layer; AP = Acidification potential, Accumulated Exceedance; EP-freshwater = Eutrophication potential, fraction of nutrients reaching freshwater end compartment; EP-marine = Eutrophication potential, fraction of nutrients reaching marine end compartment; EP-terrestrial = Eutrophication potential, Accumulated Exceedance; POCP = Formation potential of tropospheric ozone; ADP-minerals&metals = Abiotic depletion potential for non-fossil resources; ADP-fossil = Abiotic depletion for fossil resources potential; WDP = Water (user) deprivation potential, deprivation-weighted water consumption								

* Disclaimer: The results of this environmental impact indicator shall be used with care as the uncertainties of these results are high or as there is limited experience with the indicator.

Note that the LCIA results are relative expressions and do not predict impacts on category end-points, the exceeding of thresholds, safety margins or risks. It is discouraged to use the results of Modules A1-A3 without considering the results of other modules, particularly, Module C.

Additional mandatory and voluntary impact category indicators

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles

Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
GWP-GHG ¹	kg CO ₂ eq.	5.83E+00	1.10E-01	3.13E-03	3.13E-03	1.05E-02	6.10E-01	2.41E-02	-3.47E+00

Resource use indicators

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles

Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
PERE	MJ	3.93E+01	1.69E-02	1.72E-02	1.72E-02	2.53E-03	4.57E-02	9.76E-05	-1.45E+01
PERM	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
PERT	MJ	3.93E+01	1.69E-02	1.72E-02	1.72E-02	2.53E-03	4.57E-02	9.76E-05	-1.45E+01
PENRE	MJ	8.68E+01	1.42E+00	7.35E-02	7.35E-02	1.47E-01	2.85E-01	7.02E-03	-5.83E+01
PENRM	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
PENRT	MJ	8.68E+01	1.42E+00	7.35E-02	7.35E-02	1.47E-01	2.85E-01	7.02E-03	-5.83E+01
SM	kg	2.39E-01	7.45E-04	7.89E-06	7.89E-06	6.83E-05	4.55E-04	4.16E-06	-1.94E-01
RSF	MJ	2.78E-02	4.19E-06	3.24E-08	3.24E-08	8.64E-07	1.40E-05	3.69E-08	-1.11E-03
NRSF	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
FW	m ³	1.38E-01	1.48E-04	6.11E-05	6.11E-05	2.04E-05	2.46E-04	2.59E-06	-1.28E-01
Acronyms	PERE = Use of renewable primary energy excluding renewable primary energy resources used as raw materials; PERM = Use of renewable primary energy resources used as raw materials; PERT = Total use of renewable primary energy resources; PENRE = Use of non-renewable primary energy excluding non-renewable primary energy resources used as raw materials; PENRM = Use of non-renewable primary energy resources used as raw materials; PENRT = Total use of non-renewable primary energy re-sources; SM = Use of secondary material; RSF = Use of renewable secondary fuels; NRSF = Use of non-renewable secondary fuels; FW = Use of net fresh water								

¹ This indicator accounts for all greenhouse gases except biogenic carbon dioxide uptake and emissions and biogenic carbon stored in the product. As such, the indicator is identical to GWP-total except that the CF for biogenic CO₂ is set to zero.

Waste indicators

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles

Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
Hazardous waste disposed	kg	1.61E+00	2.15E-03	1.68E-04	1.68E-04	2.15E-04	5.24E-03	9.16E-05	-1.45E+00
Non-hazardous waste disposed	kg	1.04E+02	3.51E-02	1.36E-02	1.36E-02	4.54E-03	2.72E-01	3.04E-02	-9.15E+01
Radioactive waste disposed	kg	1.55E-04	2.88E-07	5.28E-07	5.28E-07	4.75E-08	5.51E-07	1.46E-09	-1.42E-04

Output flow indicators

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles

Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
Components for re-use	kg	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Material for recycling	kg	1.98E-02	0.00E+00	1.50E-02	0.00E+00	0.00E+00	4.38E-01	0.00E+00	0.00E+00
Materials for energy recovery	kg	1.25E-03	0.00E+00	2.26E-02	0.00E+00	0.00E+00	7.71E-02	0.00E+00	0.00E+00
Exported energy, electricity	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00
Exported energy, thermal	MJ	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00	0.00E+00

Other environmental performance indicators

Results per 1 kg – Electrofusion transition fittings, balloon, transition and tapping valve saddles

Indicator	Unit	A1-A3	A4	A5	C1	C2	C3	C4	D
PM	[Disease incidence]	7.66E-07	5.22E-09	5.53E-11	5.53E-11	7.71E-10	3.13E-09	1.13E-08	-7.22E-07
IRP2	[kBq U235 eq.]	5.99E-01	1.17E-03	2.05E-03	2.05E-03	1.91E-04	2.15E-03	5.92E-06	-5.47E-01
ETP-fw1	[CTUe]	4.35E+02	3.17E-01	9.46E-03	9.46E-03	4.01E-02	3.32E-01	9.76E-02	-4.38E+02
HTP-c1	[CTUh]	6.80E-08	6.25E-10	6.33E-12	6.33E-12	7.43E-11	2.72E-10	8.22E-12	-5.57E-08



HTP-nc1	[CTUh]	3.15E-06	5.88E-10	2.80E-11	2.80E-11	9.53E-11	1.63E-09	1.76E-10	-3.19E-06
SQP1	-	1.12E+02	3.94E-01	1.25E-02	1.25E-02	8.89E-02	4.81E-01	2.03E-02	-1.00E+02
Caption		PM = Particulate Matter emissions; IRP = Ionizing radiation – human health; ETP-fw = Eco toxicity – freshwater; HTP-c = Human toxicity – cancer effects; HTP-nc = Human toxicity – non cancer effects; SQP = Soil Quality							
Disclaimers		1 The results of this environmental indicator shall be used with care as the uncertainties on these results are high or as there is limited experienced with the indicator. 2 This impact category deals mainly with the eventual impact of low dose ionizing radiation on human health of the nuclear fuel cycle. It does not consider effects due to possible nuclear accidents, occupational exposure nor due to radioactive waste disposal in underground facilities. Potential ionizing radiation from the soil, from radon and from some construction materials is also not measured by this indicator.							

References

- General Programme Instructions of the International EPD® System. Version 5.0.
- PCR 2019:14. Construction Products. 1.3.4 – Expires June 2025
Ecoinvent 3.10 – Allocation, cut-off, EN 15804
- SimaPro 9.6.0.1
- ISO 14025
DS/EN ISO 14025:2010 – "Miljømærker og -deklarationer - Type III-miljøvaredeklarationer - Principper og procedurer
- ISO 14040
DS/EN ISO 14040:2008 – "Miljøledelse – Livscyklusvurdering – Principper og struktur"
- ISO 14044
DS/EN ISO 14044:2008 – "Miljøledelse – Livscyklusvurdering – Krav og vejledning"
Effects of Recycling Cycle on Used Thermoplastic Polymer and Thermoplastic Elastomer Polymer, Yu, Lih-Jiun Et.al, 2016
https://www.researchgate.net/publication/311514179_Effects_of_Recycling_Cycle_on_Used_Thermoplastic_Polymer_and_Thermoplastic_Elastomer_Polymer
- PlasticsEurope, 2020, Plastics – the Facts 2020. An analysis of European plastic production, demand, and waste data.
- EeBGuide Project, 2012, Transport of waste to landfill, incineration, and recycling facilities – Screening and simplified LCA.
<https://www.eebguide.eu/eeblog/?p=1636>
- Applied Energy, Coupling the heating and power sectors: The role of centralised combined heat and power plants and district heat in a European decarbonised power system, 2020
<https://www.sciencedirect.com/science/article/pii/S0306261920306462>
- Plastic waste management and burden in China, International Pollutants Elimination Network (IPEN), 2022
https://ipen.org/sites/default/files/documents/ipen-china-2021-epa_v1_2.pdf
- Treatment of waste by waste category, hazardousness and waste management operations, EUROSTAT, 2022
https://ec.europa.eu/eurostat/databrowser/view/env_wastrt_custom_15920331/default/table?lang=en
- Fusamatic F60 230V Electrofusion Welding Machine, Fusion Group Limited
<https://www.fusiongroup.com/en/product-finder/pe-equipment-and-ancillaries/electrofusion-control-box-equipment/1281-00-010>

