

# Electronic Exposed TECK® Flush Valve

**TECK®**  
COMMERCIAL



## 81T201HWA-42-MMO Exposed Hardwire Operated 1-1/2" Top Inlet Closet Fixture



- Polished chrome plated vandal resistant metal cover with top mounted sensor operated **H2Optics®** electronics
- True mechanical manual override button**
- Right or left-hand supply installation
- ADA compliant, automatic operation hardwire powered infrared sensor
- Scratch resistant replaceable lens window
- Supplied with an advanced infrared sensor activated flush system that uses precise user distance measurements along with a bowl length setting to activate the correct flush for each usage
- Hardwire adaptor 24 VAC to 6.4 VDC converter (supplied)
- Vandal resistant copper tube conduit
- Optional 24 hour automatic flush factory set to off
- Set-up sensor range adjustment indicator lights
- 24 VAC input, 6 second arming delay
- Electronic operated non-hold-open **metal** override button with 5 second lockout (110 to 24 VAC Transformer not included. See selection below for additional part number.)
- Quiet action, TECK® exposed diaphragm flush valve
- Chloramine resistant diaphragm
- Forged brass diaphragm retainer
- Renewable seat
- Polished chrome plated body
- External water conserving flush adjustment**, factory set to 4.2 litre (1.1 gal.), **Not field adjustable**
- 1" FIP/Copper sweat inlet adaptor**, angle check stop with protecting cap
- Adjustable 121mm (4-3/4") plus or minus 11mm (7/16") inlet/valve outlet centers
- Vacuum breaker
- Cover tube, wall flange, spud flange, concealed spud nut, and 292mm (11-1/2") outlet tube
- Recommended water supply:**  
Minimum flowing pressure – 25 psi (172 kPa)  
Minimum flow rate – 25 gpm (95 L/min)
- 4.2 Lpf (1.1 gpf) valve is recommended for new construction only

### APPROVALS:

- IAPMO listed to ASSE 1037/ ASME A112.1037/CSA B125.37
- Indicates compliance to ICC/ANSI A117.1

(Contact Delta Representative for State and/or Local Approvals.)

Patented



### Engineer/Architect Approval

Model Specified:

Approval:

Date:


## 81T201HWA-42-MMO



### AVAILABLE OPTIONS FOR FIELD CONVERSION

- 061047A**  
Hardwire with Battery Backup  
See DSP-BB for detailed specification.

| ✓ | TRANSFORMERS   |  |
|---|----------------|--|
|   | <b>060704A</b> | 110 to 24VAC Class 2 20 VA<br>(for up to 5 Electronic Valves)  |
|   | <b>060771A</b> | 110 to 24VAC Class 2 40 VA<br>(for up to 10 Electronic Valves) |

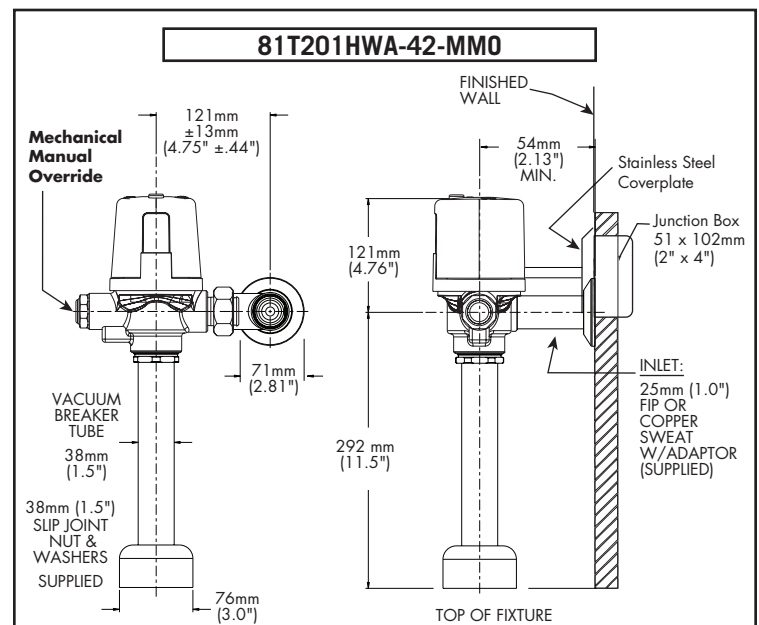

Note: For high and low pressure applications, please see page FEA-81T High Water Pressure note for more details.  
Verify flow requirements with bowl manufacturer.

Note: Measurements may vary ± 6mm (0.25")

Refer to [www.specselect.com](http://www.specselect.com) for individual models.

Note: Use this page as a product submittal sheet.