



Tank Kit Caution Sheet

CAUTION SHEET

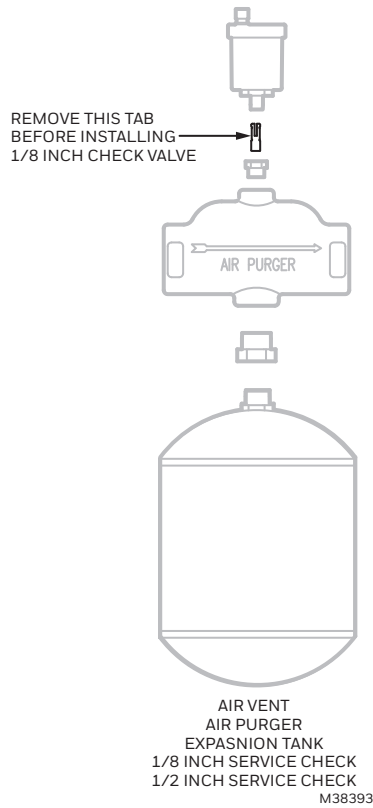


Fig. 1. Air Vent Air Purger Expansion Tank 1/8" service check; 1/2" service check.

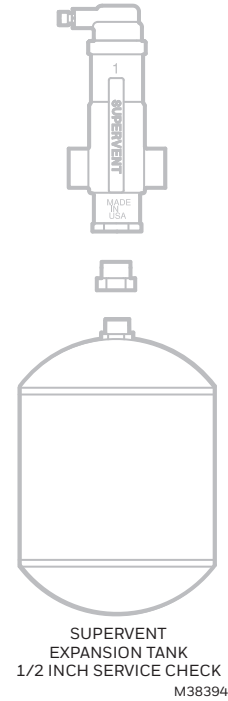


Fig. 2. Super Vent Expansion Tank 1/2" service check.



CAUTION

Personal injury hazard.

When removing components (Expansion Tank and Air Vent Only) from a Hydronic Heating System that have been isolated by a Resideo SCV Service Check Valve the system pressure must be reduced to 0 psi and the system fluid temperature must be reduced to ambient before removal of the system components. Failure to comply may result in injuries.



www.resideo.com

Resideo Technologies, Inc.
 1985 Douglas Drive North, Golden Valley, MN 55422
 1-800-468-1502
 33-00644-01 M.S. Rev. 01-23 | Printed in United States

© 2023 Resideo Technologies, Inc. All rights reserved.
 This product is manufactured by Resideo Technologies, Inc. and its affiliates.



33-00644-01