



## GAS-FIRED SEPARATED COMBUSTION UNIT HEATERS AND DUAL RATED VENTING UNIT HEATERS



MODEL HDS



MODEL HDC



IN MODEL PTX / BTX

# TABLE OF CONTENTS



Modine's separated combustion unit heaters are designed for the heating requirements of commercial and industrial buildings with select models available for residential garage heating as well. The separated combustion units draw combustion air from outside to ensure that the unit will always have plenty of fresh, clean air for combustion, reducing common concerns about dusty, dirty, humid, or negative space pressure applications. In addition, by drawing the combustion air from the outside, the overall heating efficiency is increased.

With 13 propeller and 11 blower model sizes available, the units cover a wide variety of applications with input ranges from 30,000 to 400,000 Btu/Hr in either natural or propane gas. This catalog describes the design benefits, construction features, performance data, unit selection procedure, and the optional and accessory devices available.

## Table of Contents

	Page
Design Features - All Models . . . . .	3-5
General Performance Data - Propeller Models HDS/PTX . . . . .	6
General Performance Data - Blower Models HDC/BTX . . . . .	7
Blower Performance Data - Blower Model HDC . . . . .	8
Blower Performance Data - Blower Model BTX . . . . .	9-11
Gas Control Data - All Models . . . . .	12
Field Installed Accessories . . . . .	13
Downturn Hood Performance Data - Propeller Models HDS/PTX . . . . .	14
Downturn Hood Performance Data - Blower Model HDC/BTX . . . . .	15
Unit Selection . . . . .	16-17
Dimensional Data - Models HDS/HDC . . . . .	18
Dimensional Data - Model PTX . . . . .	19
Dimensional Data - Model BTX . . . . .	20
Specifications - All Models . . . . .	21-22
Model Nomenclature - All Models . . . . .	23



## WARNING

Do not locate ANY gas-fired unit in areas where chlorinated, halogenated or acid vapors are present in the atmosphere.



## WARNING

Appliances must not be installed where they may be exposed to a potentially explosive or flammable atmosphere.

As Modine Manufacturing Company has a continuous product improvement program, it reserves the right to change design and specifications without notice.



The Modine Breeze® AccuSpec is the fastest way to generate performance data based on actual job conditions. The Breeze® AccuSpec program is a web-based sizing and selection program. The program provides a series of step-by-step questions that allow for the easy configuration of Modine products. After a model has been configured, the program can generate Submittal Schedules, Submittal Data (including performance and dimensional drawings), and Specifications.


# DESIGN FEATURES - ALL MODELS



## Separated Combustion Unit Heaters, 30-125MBH


For residential, commercial or industrial applications that require a low profile unit, Modine offers the Hot Dawg®. Capable of being installed just one inch below the ceiling, the superior quality of the Hot Dawg makes it a preferred choice for a variety of applications, including garages and workshops.

**Figure 3.1 - Hot Dawg Propeller Unit Heater**

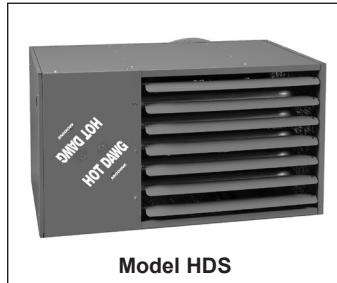

Model HDS

**Figure 3.2 - Hot Dawg Blower Unit Heater**

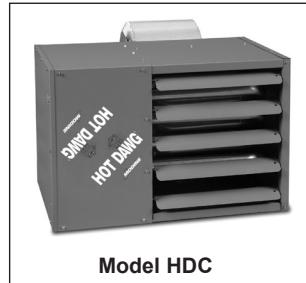

Model HDC

## Dual Rated Unit Heaters, 150-400MBH


For commercial or industrial applications that require higher input ratings, the PTX/BTX is available in ratings that range from 150,000 to 400,000 Btu/Hr in either natural or propane gas. Capable of being installed as separated combustion or power vented.

**Figure 3.3 - Propeller Unit Heater**



Model PTX

**Figure 3.4 - Blower Unit Heater**

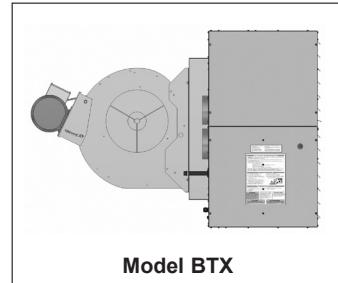

Model BTX

**Table 3.1 - Standard Features and Factory Options ①**


	Feature	Model			
		HDS	HDC	PTX	BTX
Cabinet and Air Mover	Aluminized steel cabinet (gauge indicated)	22 ga.	22 ga.	20 ga.	20 ga.
	Low profile casing design	•	•		
	Baked-on polyester powder paint for durability and corrosion resistance	•	•	•	•
	Adjustable air-deflector blades	•	•	•	•
	Fans engineered for quiet operation	•	•	•	•
	Totally enclosed fan/blower motors for maximum durability (model sizes 100 and above)	•		•	•
	Fingerproof fan guard (optional on PTX units)	•	•	•	
	Two L-shaped mounting brackets (optional on sizes 100/125)	•	•		
	Multi-tap 3-speed motors, certified to 0.8" W.C. external static pressure		•		
Heat Exchanger and Burner	Adjustable motor sheaves, certified to 0.7" W.C. external static pressure				•
	Efficiency	82-83%	82%	82-83%	82%
	Aluminized steel heat exchanger (409 stainless steel optional)	•	•	•	•
	Tubular heat exchanger for superior durability	•	•	•	•
	In-shot burner on each heat exchanger tube for reliable performance, ease of serviceability and low sound level on flame ignition/extinction	•	•	•	•
Controls	ETL certification for commercial and industrial use in the US and Canada	•	•	•	•
	ETL certification for residential use in the US and Canada	•	•		
	Factory-installed power exhaustor	•	•	•	•
	Contractor Convenience Box with Terminal Board, Unit On/Off Switch, and Indicator Light			•	•
	Single stage gas controls (two stage optional)	•	•	•	•
	High limit safety control	•	•	•	•
	Differential pressure switch for proof of venting	•	•	•	•
	Flame roll-out safety switch	•	•		
	Direct spark ignition with continuous retry control system	•	•	•	•
	Control terminal board and low voltage terminal connections	•	•	•	•
	Gas control step down transformer with 24V gas controls	•	•	•	•
	Fan delay timer	•	•	•	•
	Factory installed on/off toggle switch	•	•	•	•

① See page 13 for Field Installed Accessories

# DESIGN FEATURES - ALL MODELS



Figure 4.1 - Factory Mounted Standard and Optional Features

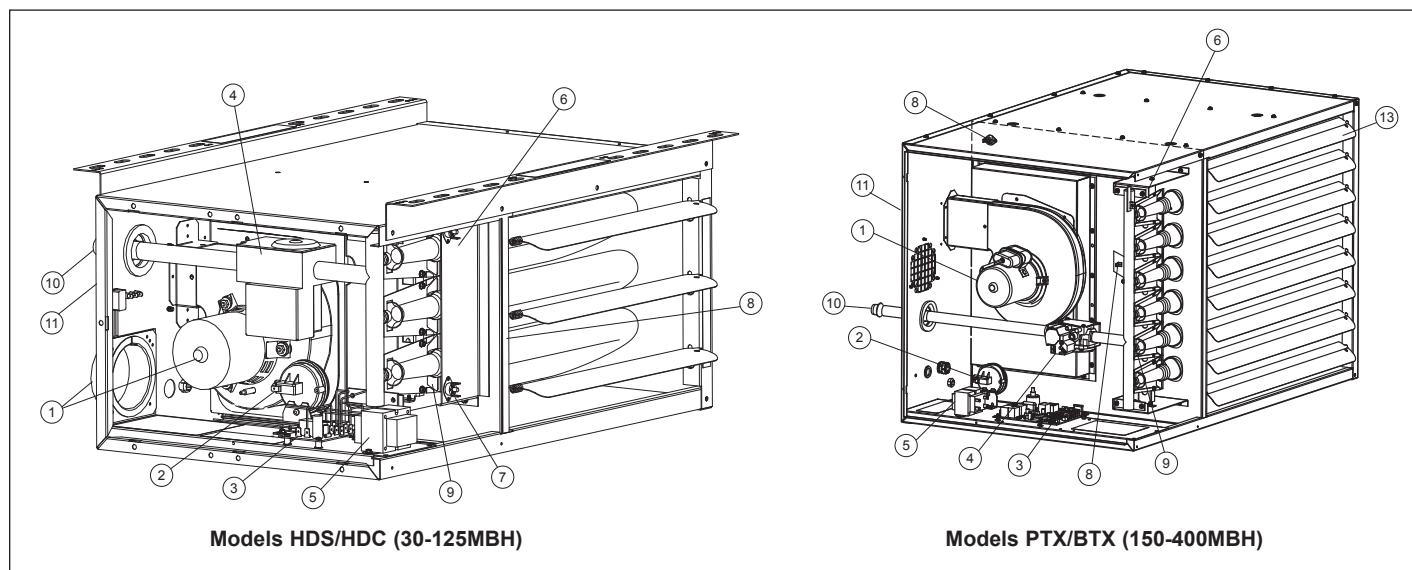

**① Power Exhauster (STD)**

All units are supplied with a round vent pipe and combustion air inlet pipe connections.

**② Pressure Switch (STD)**

An automatic reset vent pressure switch is supplied on all units and is designed to prevent operation of the main burner in the event there is restricted venting of flue products. This restriction may occur due to an improper vent diameter, long vent runs, un-approved vent terminal, high winds, high negative pressure within space, etc. After the cause of the restriction has been corrected, the pressure switch will reset automatically.

**③ Integrated Direct Spark Control Board (STD)**

The integrated direct spark ignition control combines all furnace control functions. The integrated board provides digital control of the air mover, inducer, ignition, gas valve and flame sense as well as monitoring the safety circuit at all times. The board includes LED diagnostics for trouble shooting and a fused power supply.

**④ Gas Valve - (See Table 12.2)**

**a) Single Stage Gas Valve - (STD)**

The main gas valve is factory installed on the unit heater gas train. The main gas valve provides regulator, main gas, and manual shutoff functions. The valve is redundant and provides 100% shut off.

**b) Two Stage Gas Valve - (OPT)**

The two-stage gas valve is factory installed on the unit heater gas train. The two stage gas valve provides the regulator, main gas (100% and 50% fire), and manual shutoff functions. The valve is redundant and provides 100% shut off.

**⑤ Control Step Down Transformer - (STD)**

The control step down transformer is located in the electrical junction box. The transformer is used to step down from 115V to 24V for the gas controls, fan delay relay, field supplied motor starter, etc. An additional field installed transformer is required if the supply voltage is 208V, 230V, 460V, or 575V. To determine the control transformer supplied as well as any accessory/field supplied transformers required, refer to Table 12.1

**⑥ Flame Sensor (hidden) - (STD)**

Remote flame sensor verifies ignition of all burners, monitors the flame signal and communicates with the integrated circuit board.

**⑦ Flame Roll Out Switch (HDS/HDC models - STD)**

Flame roll out switches are mounted near the burners and will shut off the gas supply in the event of an unsafe flame roll out condition.

**⑧ High Limit Switch (hidden) - (STD)**

The limit control is mounted in the air stream and will shut off the gas supply in the event of overheating.

**⑨ Direct Spark Igniter (hidden) - (STD)**

Provides spark for direct ignition of the burners.

**⑩ Gas Pipe Connection - (STD)**

Easy access to factory installed gas pipe connection stubbed to outside of unit casing.


**⑪ Contractor Convenience Package (PTX/BTX models STD)**

External junction box features simple connection of supply power wiring internally, thermostat wiring to terminals externally, an On/Off switch, and multi-color status indicator light to display the operational state of the unit.

# DESIGN FEATURES - ALL MODELS



Figure 5.1 - Factory Mounted Standard and Optional Features

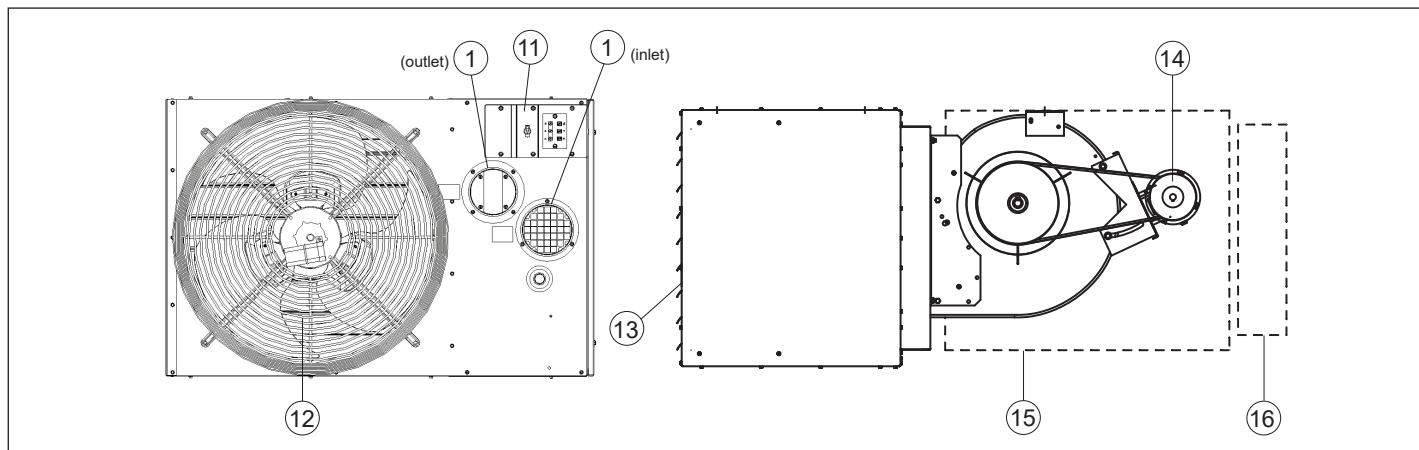

**⑫ Finger Proof Fan Guard (STD thru 125, OPT 150-400)**

Propeller units may be equipped with an optional finger proof fan guard for added protection. The finger proof fan guard is installed at the factory in place of the standard fan guard.

**⑬ Horizontal Air Deflector Blades (STD)**

Factory mounted on the discharge of the unit, the blades can be adjusted to provide horizontal (up and down) delivery control of the heated air. Vertical deflector blades are available as a field installed accessory.

**⑭ Blower Motor - (STD for HDC/BTX Models)**

The blower motor is factory installed on the blower housing. Blower motors smaller than 3 HP are factory installed on the blower housing. Motors 3 HP and above are shipped loose for field installation to prevent damage during shipment. For blower models 60-125, the blower is direct driven by a 3-speed motor. For blower models 150-400, the blower motor is supplied with an adjustable sheave that can be used to increase/decrease the blower RPM, and the blower motor can be provided in a variety of supply voltages and motor horsepower.

**⑮ Blower Enclosure (OPT for HDC/BTX Models)**

**⑯ Filter Rack (OPT for HDC/BTX Models)**

Provides filtration of air to be heated. Must include Blower Enclosure accessory.

# GENERAL PERFORMANCE DATA - MODELS HDS & PTX



**Table 6.1 - Propeller Unit Model HDS and PTX General Performance Data**

	Model HDS Sizes						Model PTX Sizes						
	30	45	60	75	100	125	150	175	200	250	300	350	400
Btu/Hr Input ①	30,000	45,000	60,000	75,000	100,000	125,000	150,000	175,000	200,000	250,000	300,000	350,000	400,000
Btu/Hr Ouput ①	24,900	36,900	49,200	61,500	82,000	102,500	123,000	143,500	164,000	205,000	246,000	287,000	332,000
Entering Airflow (CFM) @ 70°F	505	720	990	1160	1490	1980	2140	2725	2870	3995	4545	5280	5995
Outlet Velocity (FPM)	523	725	653	769	565	747	711	607	643	721	824	748	851
Air Temp. Rise (°F)	44	46	45	48	50	47	53	48	52	47	50	50	51
Max. Mounting Height (Ft.) ②	10	10	12	14	12	16	15	14	15	18	19	18	21
Heat Throw (Ft.) @ Max Mtg Ht ②	25	27	36	38	42	56	51	50	53	62	69	65	74
Motor Type ③	SP	SP	PSC	PSC	PSC	PSC	PSC	PSC	PSC	PSC	PSC	PSC	PSC
Motor HP	1/15	1/15	1/12	1/12	1/6	1/8	1/6	1/6	1/3	1/3	1/2	1/2	3/4
Motor RPM	1550	1550	1625	1625	1050	1625	1075	1075	1075	1075	1125	1125	1125

① Ratings shown are for elevations up to 2,000 ft. For elevations above 2,000 feet, ratings should be reduced at the rate of 4% for each 1,000 feet above sea level. (In Canada see rating plate.) Reduction of ratings requires use of a high altitude kit.

② Data taken at 55°F air temperature rise. At 65°F ambient and unit fired at full-rated input. Mounting height as measured from bottom of unit, and without deflector hoods.

③ All motors used are produced, rated and tested by reputable manufacturers in accordance with NEMA standards and carry the standard warranty of both the motor manufacturer and Modine. Motors on model sizes 100 and above are totally enclosed (Model size 75 and below are open drip proof) and all single phase motors have built in thermal overload protection.

**Table 6.2 - Propeller Unit Model HDS and PTX Operating Electrical Data ④**

Supply Voltage	Power Code		Model HDS Sizes						Model PTX Sizes						
			30	45	60	75	100	125	150	175	200	250	300	350	400
115V 1 Phase	01 (115V)	Motor Amps	2.40	2.40	1.95	1.95	2.50	2.20	2.50	2.50	4.60	4.60	7.00	7.00	8.80
		Total Amps	3.75	3.75	3.3	3.3	5.05	4.75	5.05	5.05	7.15	7.15	8.11	8.65	10.45
		Transformer kVA	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	n/a	
208V 1 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.50
		208V Total Amps	2.05	2.05	1.80	1.80	2.79	2.63	2.79	2.79	4.20	3.95	4.48	4.78	5.78
230V 1 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	0.75	0.75	0.75	0.75	1.00	1.00	1.00	1.00	1.50
		230V Total Amps	1.85	1.85	1.63	1.63	2.53	2.38	2.53	2.53	3.80	3.58	4.06	4.33	5.23
208V 3 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.00	1.50
		208V Total Amps	2.05	2.05	1.80	1.80	2.79	2.63	2.79	2.79	4.20	3.95	4.48	4.78	5.78
230V 3 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	0.75	0.75	0.75	0.75	1.00	1.00	1.00	1.00	1.50
		230V Total Amps	1.85	1.85	1.63	1.63	2.53	2.38	2.53	2.53	3.80	3.58	4.06	4.33	5.23
460V 3 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	0.75	0.75	0.75	0.75	1.00	1.00	1.00	1.00	1.50
		460V Total Amps	0.93	0.93	0.81	0.81	1.26	1.19	1.26	1.26	1.90	1.79	2.03	2.16	2.61
575V 3 Phase	01 (115V) with Transformer	Transformer kVA	0.50	0.50	0.50	0.50	0.75	0.75	0.75	0.75	1.00	1.00	1.50	1.50	1.50
		575V Total Amps	0.74	0.74	0.65	0.65	1.01	0.95	1.01	1.01	1.52	1.43	1.62	1.73	2.09

④ Amp draw data shown is operating amp draw at incoming power. For units that use a field installed accessory step-down transformer as noted, the amp draw shown is the primary side operating amp draw. For sizing of circuit protection for equipment with transformers, please refer to the National Electric Code.



# BLOWER PERFORMANCE DATA - MODEL HDC




**Table 8.1 - Power Code Description - HDC Models**

Power Code	Unit Voltage	HDC60	HDC75	HDC100	HDC125
01	115/60/1	1/4 HP	1/3 HP	1/2 HP	1/2 HP


## Blower Speed Curves Models (HDC 60-125)

— Low    - - - Medium    ..... High


**HDC 60**

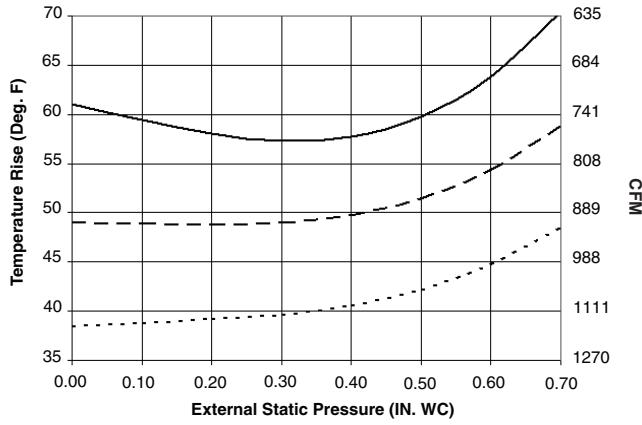


**HDC 100**

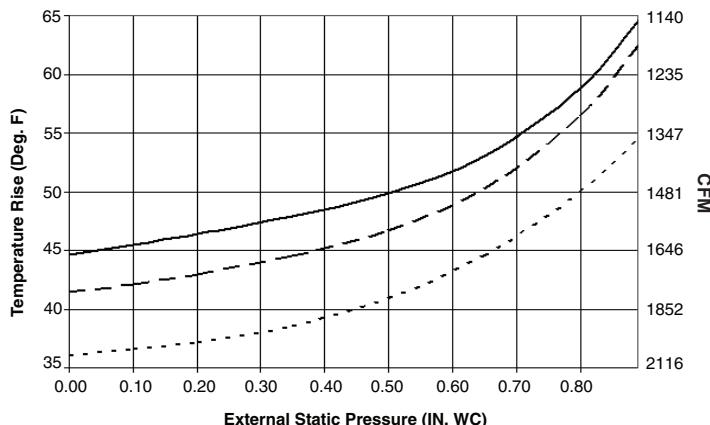

**HDC 75**

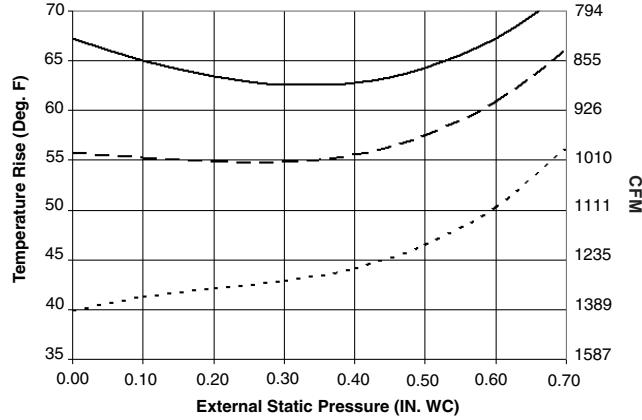

**HDC 125**

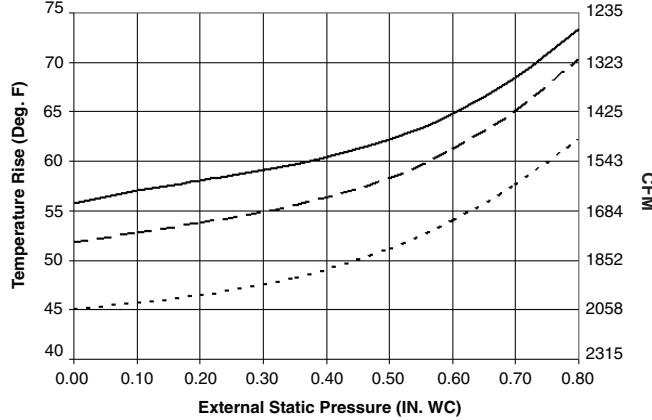

# BLOWER PERFORMANCE DATA - MODEL BTX



**Table 9.1 - Power Code Description - Blower Model BTX ①**

			BTX150		BTX175		BTX200		BTX250		BTX300		BTX350		BTX400	
Power Code	Voltage	Phase	HP	Drive												
01	115	1	1/4	230	-	-	-	-	-	-	-	-	-	-	-	-
02	115/230	1	1/3	230	1/3	238	1/2	233	1/2	204	1	240	1 1/2	250	1 1/2	247
08	208-230/460	3	1/3	230	1/3	238	1/2	233	1/2	204	1	257	1 1/2	251	1 1/2	248
11	575	3	1/3	231	1/3	239	1/2	233	1/2	204	1	257	1 1/2	251	1 1/2	248
13	115/230	1	1/3	232	1/2	229	1	229	1	241	1	241	1 1/2	247	-	-
19	208-230/460	3	1/3	232	1/2	229	1	259	1	258	1	258	1 1/2	248	2	177
22	575	3	1/3	233	1/2	229	1	259	1	258	1	258	1 1/2	248	2	177
24	115/230	1	1/2	229	1	175	1	175	1.5	23	1 1/2	243	1 1/2	252	-	-
30	208-230/460	3	1/2	229	1	253	1	253	1.5	177	1 1/2	244	1 1/2	180	3	246
33	575	3	1/2	229	1	253	1	253	1.5	177	1 1/2	244	1 1/2	180	3	246
35	115/230	1	1	175	1 1/2	237	1 1/2	235	-	-	1 1/2	23	-	-	-	-
41	208-230/460	3	1	253	1 1/2	234	1 1/2	236	2	180	1 1/2	177	2	177	5	245
44	575	3	1	253	1 1/2	234	1 1/2	236	2	180	1 1/2	177	2	177	5	245
52	208-230/460	3	-	-	-	-	-	-	-	-	2	177	2	180	-	-
55	575	3	-	-	-	-	-	-	-	-	2	177	2	180	-	-
63	208-230/460	3	-	-	-	-	-	-	-	-	3	112	3	246	-	-
66	575	3	-	-	-	-	-	-	-	-	3	112	3	246	-	-
74	208-230/460	3	-	-	-	-	-	-	-	-	-	-	5	245	-	-
77	575	3	-	-	-	-	-	-	-	-	-	-	5	245	-	-

① For selection of correct Power Code, refer to the Tables on pages 10-11.

**Table 9.2 - Filter Static Pressure Drop ②**

	BTX150	BTX175	BTX200	BTX250	BTX300	BTX350	BTX400
Filter Static ("W.C.)	0.1	0.2	0.1	0.2	0.2	0.2	0.2

② For blower units with enclosure and filter, add the following static pressures to the static pressure determined by the system designer for total external static pressure.





# GAS CONTROL DATA - ALL MODELS



**Table 12.1 - Electrical Selection Details - All Models**

Model	Supply Voltage	Phase	Motor Voltage	Power Exhaust & Gas Control Circuit Voltage	Accessory Transformer Required ①	Factory Installed Transformer	Motor Starter Coil Voltage		
HDS/HDC & PTX	115	1	115V/1ph	115V/1ph	none	115V to 24V	none		
	208	1 or 3			208V to 115V				
	230				230V to 115V				
	460	3			460V to 115V				
	575				575V to 115V				
BTX	115	1	115V/1ph	115V/1ph	none	115 to 24V	115V		
	208	1	208V/1ph		208V to 115V				
	230		230V/1ph		230V to 115V				
	208	3	208V/3ph		208V to 115V				
	230		230V/3ph		230V to 115V				
	460	3	460V/3ph		460V to 115V				
	575		575V/3ph		575V to 115V				

① For accessory transformer sizing, refer to Table 6.2 for HDS, HDC, and PTX models and Table 7.5 for model BTX.

**Table 12.2 - Gas Controls – All Models ②**

Model Size	Control System Description	Gas Type	Control Code	Control Voltage
30-400	<b>Single-Stage, Direct Spark Ignition</b> Utilizes a single-stage combination gas control and an ignition control. Gas is automatically lit with the direct spark igniter on call for heat.	Natural	11	24V
	Propane	21		
75-400	<b>Two-Stage, Direct Spark Ignition</b> Utilizes a two-stage combination gas control (fires at 50% or 100% of full rated input) and an ignition control. Gas is automatically lit with the direct spark igniter on call for heat.	Natural	12	24V
	Propane	22		

② All ignition controls are 100% Shut-Off with Continuous Retry.


## ACCESSORIES - ALL MODELS




**Table 13.1 - Field Installed Accessories**

	Feature	Model			
		HD	HDB	PTX	BTX
Cabinet and Air Mover	<b>Vertical Deflector Blades</b> - Allows directional discharge air control in the left and right directions.	•	•	•	•
	<b>Downward Air Deflector Hoods</b> - Available in 30°, 60°, and 90° configurations these deflector hoods enable the unit to be mounted higher while still providing heat to the building occupants. Refer to page 14 for further details.	•	•	•	•
	<b>Vibration Isolation Kit</b> - Minimizes unit vibration transmission to the building structure.	•	•		
	<b>Horizontal Concentric Vent Kit</b> - Enables horizontal concentric venting. Kit consists of one concentric adapter, one vent terminal, and one bird screen. (See Figure 13.1.)	•	•	•	•
	<b>Vertical Concentric Vent Kit</b> - Enables vertical concentric venting. Kit consists of one concentric adaptor, one combustion air inlet cap, and one vent terminal cap. (See Figure 13.2.)	•	•	•	•
	<b>Pipe Hanger Adapter Kits</b> - Allows the unit to be suspended by 3/4" pipe from the standard 3/8" holes found in the top of the unit.			•	•
	<b>Discharge Transition for Polytube</b> - Allows for the connection of polytube (not included) to the discharge of the unit.			•	•
	<b>Blower Enclosure with or without Filter Rack</b> - Totally encases the motor and blower assembly. Optional filters provide filtering of the air prior to entering the heater.			•	•
Controls	<b>Belt Guard</b> - Provides protection for building occupants as well as service people from the drive belt and sheaves.				•
	<b>Natural Gas to Propane Gas Conversion Kit</b> - Provides all required parts as well as instructions to convert a natural gas unit to propane gas.	•	•	•	•
	<b>Single or Two-Stage Room Thermostats</b> - See Table 13.2 for details.	•	•	•	•
	<b>Room Thermostat Guard</b> - Clear plastic for room thermostats. Guard is locking type and comes with two keys.	•	•	•	•
	<b>Stepdown Transformers</b> - Used to operate propeller units on 208/230/460/575V/3Ph supply voltage. Also may be required for control circuits for blower units. Refer to Table 12.1 for further selection details.	•	•	•	•
	<b>Control Relays</b> - This single pole single throw relay consists of a 24V coil with a maximum contact rating of 18 amps at 115V.	•	•	•	•
	<b>Gas Pressure Regulator</b> - Fisher Type S-100, 3/4 inch pressure regulator for 1/2 to 50 psi inlet pressure capacity, 30 MBH to 400 MBH.	•	•	•	•

**Figure 13.1 - Horizontal Concentric Vent Kit**

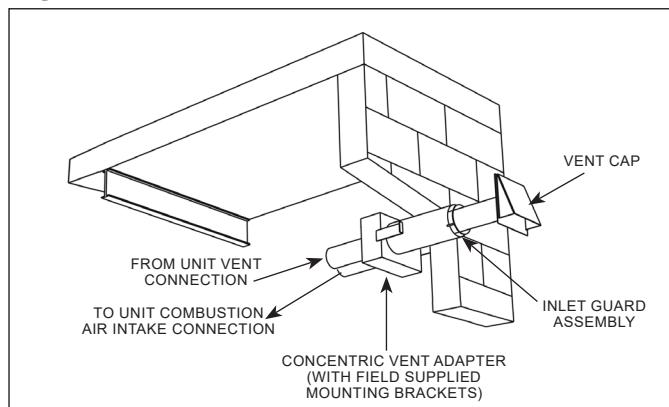

**Figure 13.2 - Vertical Concentric Vent Kit**

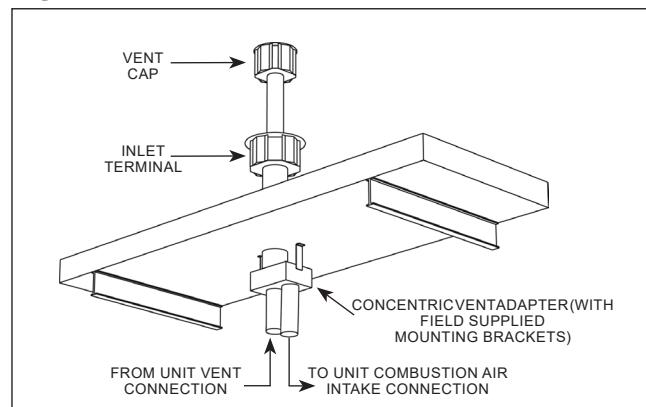

**Table 13.2 - Field Installed Thermostats**

Single-Stage Thermostats	Type	Description
	Room Thermostat	Thermostat, Modine Pro1 T-501M: 50-90°F, Non-programmable Thermostat includes 3 swap panels: 1.) Fan: On/Auto, System: Heat/Off/Cool, 2.) Fan: On/Auto, System: On/Off, 3.) System: On/Off
Two-Stage Thermostats	Room - Digital	Thermostat, Modine Pro1 T-715M: 41-95°F, Heat/Auto/Off, Fan Auto/On, 7-day programmable
	Room - WiFi	WiFi Thermostat, Modine Pro1 T855ISH: 41-95°F, 7-day prog, wifi, hardwire only
	Duct	Johnson Controls A350 Electronic Temp Control with Sensor and S350 Stage Adder (Blower units only)
Guard	Room	Thermostat Guard, Modine Pro1 T-150, Clear Plastic, Tumbler Lock with two keys



# PERFORMANCE DATA - HOODS FOR BLOWER MODELS



**Table 15.1 - Deflector Hood General Performance Data - Model HDC**

Model Size	Airflow	Temp Rise	Mounting Height	Blade Angle	30° Hood			60° Hood			90° Hood		
					X	Y	Z	X	Y	Z	S	(ft)	(ft)
60	808	55		8	27	5	14	20	0	13	18	10	
				9	8	4	11	16	0	8	12	9	
75	1010	55		8	45	9	20	28	0	21	28	14	
				10	27	7	17	24	0	16	23	12	
				11	13	5	14	21	0	12	17	12	
100	1347	55		8	44	9	20	28	0	21	28	14	
				10	27	7	17	24	0	16	23	12	
				11	12	5	14	20	0	12	17	12	
125	1543	60		8	49	10	23	32	0	24	32	16	
				10	35	8	21	29	0	20	28	14	
				12	13	6	16	23	0	14	19	13	

Note: Refer to Figures 14.2 through 14.3 on page 14.

**Table 15.2 - Deflector Hood General Performance Data - Model BTX**

Model Size	Airflow	Temp Rise	Mounting Height	Blade Angle	30° Hood			60° Hood			90° Hood		
					X	Y	Z	X	Y	Z	S	(ft)	(ft)
150	2020	55		8	57	13	29	40	0	31	42	21	
				10	48	12	28	38	0	28	39	19	
				12	37	10	25	35	0	25	34	17	
				14	21	8	21	30	0	19	27	16	
				15	10	7	19	27	0	12	18	15	
175	2357	55		8	51	11	24	33	0	25	34	17	
				10	39	9	22	31	0	22	30	15	
				12	22	7	19	26	0	17	23	14	
				13	2	5	14	21	0	10	14	13	
				8	57	13	29	39	0	30	41	20	
200	2694	55		10	47	12	27	37	0	28	38	18	
				12	35	10	25	34	0	24	33	17	
				14	18	7	20	29	0	18	25	15	
				15	2	5	16	24	0	11	16	15	
				8	59	14	31	42	0	32	44	22	
250	3367	55		10	50	13	29	40	0	30	41	20	
				12	39	11	27	37	0	27	37	18	
				14	25	9	23	33	0	22	30	17	
				15	15	7	20	29	0	18	25	16	
				8	64	17	37	51	0	40	54	29	
300	4040	55		10	57	16	36	50	0	38	52	26	
				12	50	15	35	48	0	36	49	23	
				14	41	13	33	45	0	33	45	22	
				16	30	12	30	41	0	28	39	20	
				18	14	9	24	35	0	21	29	19	
350	4714	55		8	63	16	36	49	0	37	51	27	
				10	55	15	34	47	0	36	49	24	
				12	47	14	33	45	0	33	46	22	
				14	37	12	30	42	0	30	41	20	
				16	25	10	27	38	0	25	34	19	
400	5387	55		8	67	19	41	56	0	44	60	32	
				10	60	18	40	55	0	42	58	29	
				12	53	17	39	53	0	40	55	26	
				14	46	15	37	51	0	37	51	25	
				16	37	14	34	48	0	34	47	23	
				18	26	12	31	43	0	29	40	22	
				20	8	8	23	34	0	20	28	21	

Note: Refer to Figures 14.2 through 14.3 on page 14.

## Selection Procedure

In order to properly select a unit heater it is necessary to have the following basic information.

### 1. Heating output capacity

Model size output is to be matched against the heat loss to be replaced.

### 2. External static pressure (blower units only)

The external static pressure (E.S.P.) is determined using the ASHRAE Guide for duct losses or provided by the design engineer.

### 3. Accessory internal static pressure (transitions, filters, etc.) (blower units only)

The critical accessories are those that add internal static pressure (I.S.P.) to the unit. Once these items are determined, the total pressure drop can be determined (if applicable).

### 4. Heat exchanger material

The heat exchanger type is determined by the application. The standard heat exchanger material is aluminized steel. A 409 stainless steel heat exchanger is recommended when the combined entering/return air to the unit is below 40°F or in high humidity applications.

### 5. Type of fuel

Either natural or propane gas determined by the design engineer.

### 6. Gas controls

Either single stage or two stage, as determined by the design engineer.

### 7. Main power supply voltage to unit

### 8. BMS (yes/no)

Building management system (BMS), interface board

## Selection Example (Propeller Unit)

### Selection Example Conditions (Propeller Unit)

Select a unit heater to meet the following conditions:

1. Heating output capacity = 156,000 Btu/Hr per design engineer
2. External Static Pressure = 0.0
3. Internal Static Pressure = 0.0. No static producing accessories are required
4. Heat exchanger and burner = 409 Stainless Steel
5. Gas Type = Natural
6. Gas Controls = Single Stage
7. Supply Voltage: 460V/60Hz/3Ph
8. BMS needed

With the information listed above, the basic model, using the information in this catalog and the Model Nomenclature shown on page 23, can be selected as shown:

### 1. Determine the Model and Input Rating (MBH):

Using the Heating output capacity, the Furnace Input Rating is determined from Table 6.1. The closest model to 156,000 Btu/Hr output has an Btu/Hr Input rating of 200,000 Btu/Hr so the Furnace Input Rating = 200. The corresponding model for a 200 size, propeller, separated combustion unit heater is PTX. The model and size are a PTX200.

### 2. Determination of Heat Exchanger Material:

From item #4 in the example, the Heat Exchanger required is 409 Stainless Steel. Thus, the Heat Exchanger Material = S from the Model Nomenclature on page 23.

### 3. Determine the Ignition Type:

The Ignition Type = S from the Model Nomenclature on page 23.

### 4. Determine Power Code Required:

Referring to Table 6.2, it can be seen that the supply voltage from the example conditions is not available (460V). A transformer kit selected later in this example must be used. In this instance, from Table 6.2 select the 115V/60Hz/1Ph power code (PC) = 01 unit.

### 5. Determine the control type:

From items #5 and #6 in the example conditions, the gas type is Natural Gas and controls are Single Stage. From Table 12.2, we are directed to use Control Code (CC) of 11.

### 6. Determine the fan guard type:

No specific type of fan guard was specified, so select Fan Guard = S from the Model Nomenclature on page 23.

### 7. Determine factory installed option:

non-BMS = N, BMS = C.

**At this point we have a full model number of:**

**PTX200SS0111SBAC**

### 8. Determination of transformer:

To operate a 115V/60Hz/1Ph unit on 460V/60Hz/3Ph supply power a unit step down transformer must be selected. By referring to Table 12.1 we see that a 460V to 115V step down transformer is required. As noted in the footnote for Table 12.1, the size can be determined to be 0.75kVA from Table 6.2.

## Selection Example (Blower Unit)

### Selection Example Conditions (Blower Unit)

In the following example, select a unit heater to meet the following conditions:

1. Heating output capacity = 156,000 Btu/Hr per design engineer
2. External Static Pressure = 0.2.
3. Internal Static Pressure = 0.0. No static producing accessories are required at this point, but filters may be added later.
4. Heat exchanger and burner = Aluminized Steel
5. Gas Type = Propane
6. Gas Controls = Two Stage
7. Supply Voltage: 230V/60Hz/3Ph
8. CFM = 2,400
9. BMS not needed

With the information listed above, the basic model, using the information in this catalog and the Model Nomenclature shown on page 23, can be selected as shown:

### 1. Determine the Model and Input Rating (MBH):

Using the Heating output capacity, the Furnace Input Rating is determined from Table 7.1. The closest model to 156,000 Btu/Hr output has an Btu/Hr Input rating of 200,000 Btu/Hr so the Furnace Input Rating = 200. The corresponding model for a 200 size, blower, separated combustion unit heater is BTX. The model and size are a BTX200.

### 2. Determination of Heat Exchanger Material:

From item #4 in the example, the Heat Exchanger required is aluminized steel. Thus, the Heat Exchanger Material = A from the Model Nomenclature on page 23.

### 3. Determine the Ignition Type:

The Ignition Type = S from the Model Nomenclature on page 23.

### 4. Determine Power Code Required:

From page 10 we see that a unit requiring a static of 0.2 and a cfm of 2400 requires a 1/2 horsepower motor with a -233 drive that is turned open 1.5 turns. Referring to Table 9.1 it can be determined that for a BTX200 with a 1/2 HP motor and a -233 drive operating on 230V/60Hz/3Ph that it will have a power code = 08. However, note that if filters are added later, that drive/motor combination will not be sufficient. Two alternate drive selections could have been made with a 1hp motor with either a -253 or -229 drive. The power code would be 30 or 19 respectively. Note that the 229 drive would likely be the best choice, as the turns open is near the center of the range.

### 5. Determine the control type:

From items #5 and #6 in the example, the gas type is Propane Gas and controls are Two Stage. From Table 12.2, we are directed to use Control Code (CC) = 22.

### 6. Determine factory installed option:

non-BMS = N, BMS = C.

At this point we have a full model number of:  
**BTX200AS1922NBAN**

### 6. Determination of Transformer:

To operate the BTX200AS1922NBAN on 230V/60Hz/3ph supply voltage, we need to review Table 12.1 to determine if any field installed transformers are required. The table indicates that we need a 230V to 115V step down transformer for the power exhaust and gas control circuit voltage. As indicated in the footnote for that table, Table 7.5 directs us to the correct size for this model, which is 0.5kVA. Transformers for blower models are typically smaller than those used for propeller models, as the transformer is not needed for the blower motor.

# DIMENSIONAL DATA - HDS/HDC



Figure 18.1 - Dimensional Drawings - Models HDS/HDC

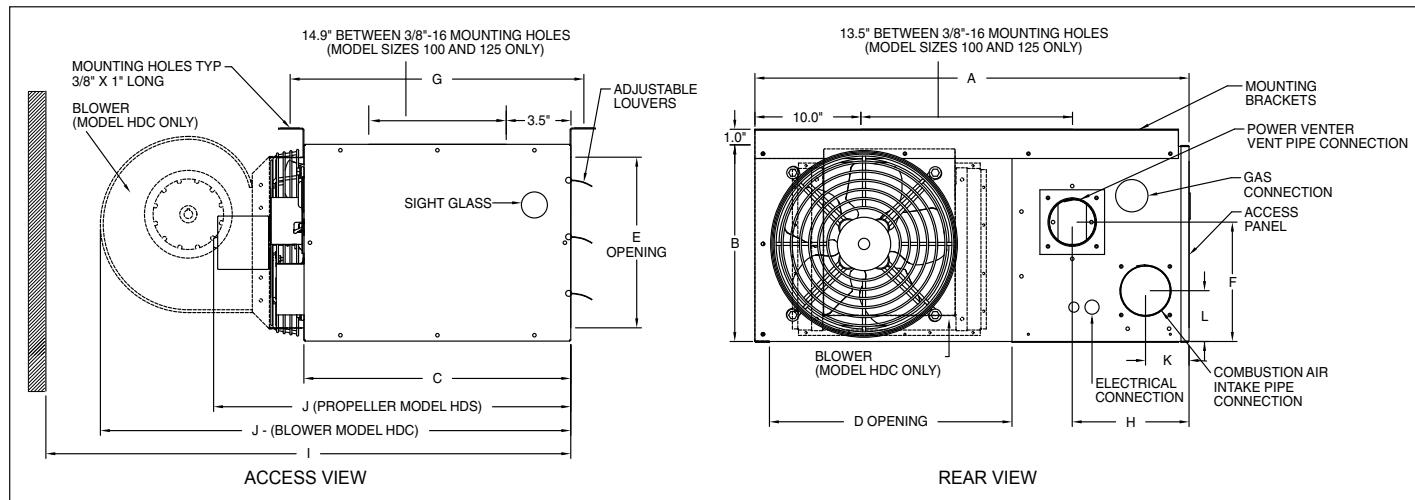


Table 18.1 - Dimensions (inches) ①

Dimension	Propeller Model Size - HDS					Blower Model Size - HDC		
	30	45	60	75	100/125	60	75	100/125
A	26.8	26.8	26.8	26.8	35.5	26.8	26.8	35.5
B	12.2	12.2	18	18	20.5	18	18	20.5
C	16.5	16.5	16.5	16.5	22	16.5	16.5	22
D	14.9	14.9	14.9	14.9	22.5	14.9	14.9	22.5
E	10.1	10.1	15.9	15.9	13.4	15.9	15.9	18.4
F	7.25	7.25	10.75	10.75	14	10.75	10.75	14
G	18.5	18.5	18.5	18.5	-	18.5	18.5	-
H	7.6	7.6	7.835	7.835	8.4	7.835	7.835	8.4
I	34.5	34.5	34.5	34.5	43	35.5	35.5	44.5
J	22	22	25	25	31	32.5	32.5	41.5
K	2.74	2.74	3.15	3.15	3.87	3.15	3.15	3.87
L	3.19	3.19	5.55	5.55	10.73	5.55	5.55	10.73
Gas Connecton	1/2"	1/2"	1/2"	1/2"	1/2"	1/2"	1/2"	1/2"
Vent and Combustion Air Connector Size	3	3	4	4	4	4	4	4
Fan or Blower Diameter	10	10	14	14	18	9 - 7	9 - 7	10 - 10
Approx. Weight (lbs.)	55	60	80	85	125	92	97	125

① Do not use propeller units with duct work.

Figure 18.2 - Mounting Bracket Slot Locations

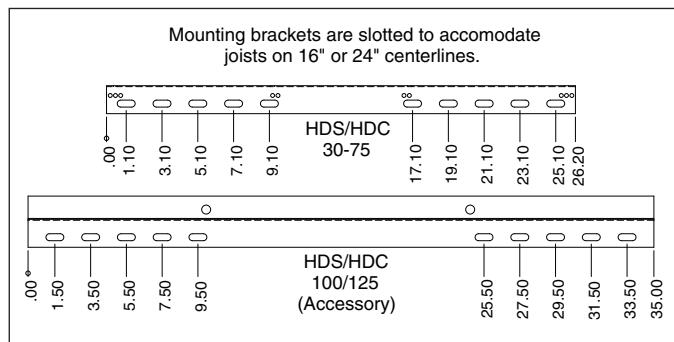


Table 18.2 - Clearances

Unit Side	Clearance to Combustible Material		Recommended Service Clearance
	HD	HDB	
Top and Bottom	1"	6"	18"
Access Side	1"	6"	18"
Non-Access Side	1"	6"	18"
Rear	18"	18"	18"
Vent Connector	4"	4"	18"

# DIMENSIONAL DATA - MODEL PTX



Figure 19.1 - Dimensional Drawings - Model PTX

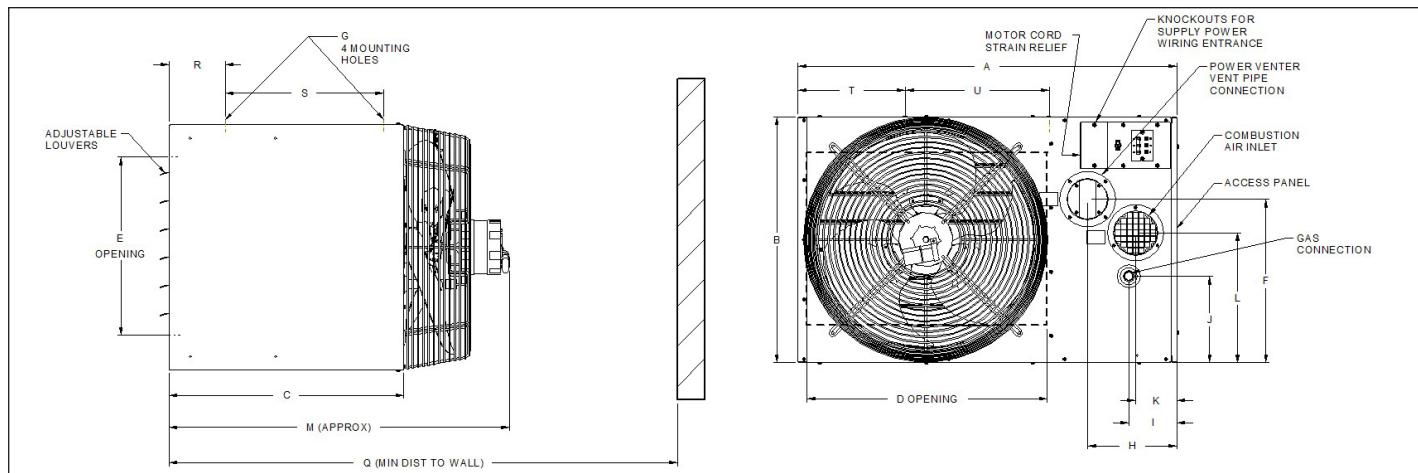


Table 19.1 - Dimensions (inches) - PTX ①

Models	PTX150	PTX175	PTX200	PTX250	PTX300	PTX350	PTX400
A	35.53	42.53	42.53	42.53	42.53	42.53	42.53
B	23.06	25.81	25.81	31.31	31.31	39.56	39.56
C	22.05	22.05	22.05	22.05	22.05	22.05	22.05
D	22.52	29.52	29.52	29.52	29.52	29.52	29.52
E	16.20	18.95	18.95	29.43	29.43	32.17	32.17
F	15.33	16.70	16.70	19.45	19.45	23.58	23.58
G (Mounting Hole) ②	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16
H	8.37	8.37	8.37	8.37	8.37	8.37	8.37
I	4.50	4.50	4.50	4.50	4.50	4.50	4.50
J	8.09	9.47	9.47	6.72	6.72	10.84	10.84
K	3.87	3.87	3.87	5.20	5.20	5.20	5.20
L	12.17	13.55	13.55	12.66	12.66	16.78	16.78
M	31.79	32.83	34.43	33.83	33.83	34.83	34.83
Q ③	43.79	44.83	46.43	45.83	45.83	46.83	46.83
R	3.56	3.56	3.56	3.56	3.56	3.56	3.56
S	14.90	14.90	14.90	14.90	14.90	14.90	14.90
T	10.00	10.00	10.00	10.00	10.00	10.00	10.00
U	13.54	20.53	20.53	20.53	20.53	20.53	20.53
Gas Connection	1/2	1/2	1/2	3/4	3/4	3/4	3/4
Vent and Combustion Air Connector Size	4"	4"	4"	6"	6"	6"	6"
Fan Diameter	20.00	22.00	22.00	22.00	22.00	24.00	26.00
Approx. Shipping Weight (lbs.)	165	210	220	265	270	310	320

① Do not use propeller units with duct work.

② Listed is the hole diameter and threads per inch to accept threaded rod.

③ Dimension equals overall plus 12".

Table 19.2 - Clearances to Combustible Materials

Unit Side	Clearance To Combustible Materials	Recommended Service Clearance
Top and Bottom	6"	6"
Access Side	6"	18"
Non-Access Side	6"	6"
Rear	18"	18"
Vent Connector	6"	6"

# DIMENSIONAL DATA - MODEL BTX



Figure 20.1 - Dimensional Drawings - Model BTX

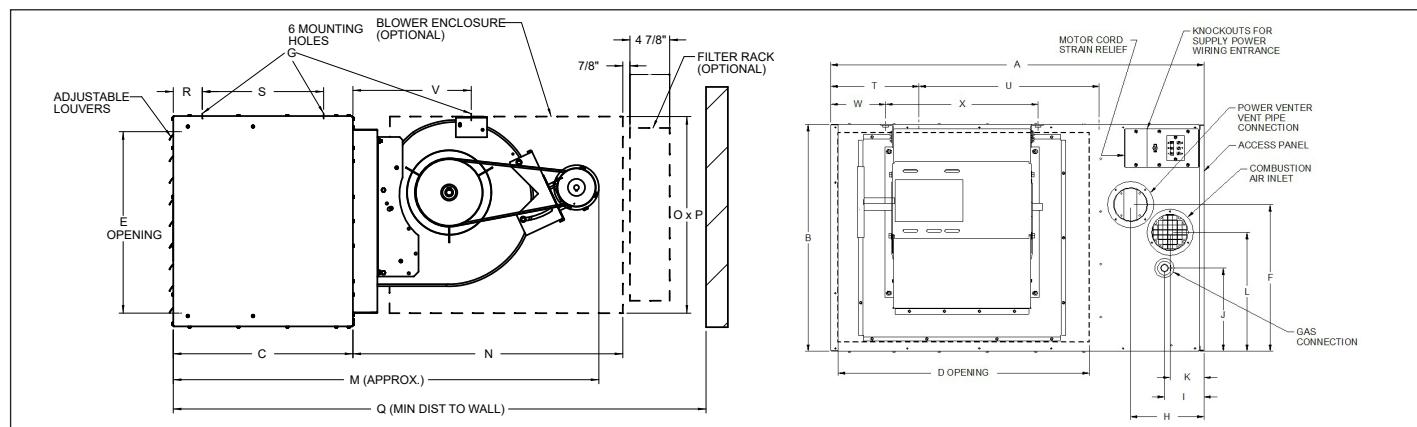


Table 20.1 - Dimensions (inches) — BTX

Models	BTX150	BTX175	BTX200	BTX250	BTX300	BTX350	BTX400
A	35.53	42.53	42.53	42.53	42.53	42.53	42.53
B	23.06	25.81	25.81	31.31	31.31	39.56	39.56
C	22.05	22.05	22.05	22.05	22.05	22.05	22.05
D	22.52	29.52	29.52	29.52	29.52	29.52	29.52
E	21.18	23.93	23.93	29.43	29.43	32.17	32.17
F	15.33	16.70	16.70	19.45	19.45	23.58	23.58
G (Mounting Hole) ①	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16	3/8-16
H	8.37	8.37	8.37	8.37	8.37	8.37	8.37
I	4.50	4.50	4.50	4.50	4.50	4.50	4.50
J	8.09	9.47	9.47	6.72	6.72	10.84	10.84
K	3.87	3.87	3.87	5.20	5.20	5.20	5.20
L	12.17	13.55	13.55	12.66	12.66	16.78	16.78
M ②	52.25	52.19	52.19	58.88	58.88	58.88	58.88
N	33.18	33.90	33.90	39.88	39.88	39.88	39.88
O	23.90	24.13	24.13	27.04	27.04	28.57	28.57
P	24.77	24.52	24.52	27.19	27.19	28.28	28.28
Q (w/Blower Encl & Filter Rack)	73.04	73.70	73.70	79.68	79.68	79.68	79.68
Q (w/o Blower Encl & Filter Rack)	64.25	64.19	64.19	70.88	70.88	70.88	70.88
R	3.56	3.56	3.56	3.56	3.56	3.56	3.56
S	14.90	14.90	14.90	14.90	14.90	14.90	14.90
T	10.00	10.00	10.00	10.00	10.00	10.00	10.00
U	13.54	20.53	20.53	20.53	20.53	20.53	20.53
V	14.52	14.52	14.52	18.04	18.04	18.00	18.00
W	3.27	7.15	7.15	4.77	4.77	5.24	5.24
X	17.38	17.38	17.38	20.38	20.38	20.38	20.38
Gas Connection	1/2	1/2	1/2	3/4	3/4	3/4	3/4
Vent and Combustion Air Connector Size	4"	4"	4"	6"	6"	6"	6"
Blower	12-12	12-12	12-12	15-15	15-15	15-15	15-15
Approx. Shipping Weight (lbs.)	220	275	280	340	345	395	405

① Listed is the hole diameter and threads per inch to accept threaded rod.

② This is an approximate dimension for standard motors, allow 3" for sheave and optional motors.

Table 20.2 - Clearances to Combustible Materials

Unit Side	Clearance To Combustible Materials	Recommended Service Clearance
Top and Bottom	6"	6"
Access Side	6"	18"
Non-Access Side	6"	6"
Rear	18"	18"
Vent Connector	6"	6"

## General

### A. Standards

All unit(s) shall include:

- A.1. ETL Listed and ETL Verified design certification for use in both the US and Canada to the ANSI Z83.8 - latest revision, standard for "Gas Unit Heater and Gas-Fired Duct Furnaces" for safe operation, construction, and performance.

### B. Mechanical Configuration

- B.1. Furnace(s) section with 82% minimum efficiency provided by an indirect-fired tubular heat exchanger with individually fired tubes.

### C. Venting Arrangement

- C.1. The unit shall be separated combustion. The venting shall be a power exhausted arrangement with a separate combustion air intake pipe connection to allow for fresh combustion air from outside the conditioned space. The unit shall be tested to insure proper ignition when the unit is subjected to 40 mile per hour wind velocities. The unit shall also include a factory mounted differential pressure switch designed to prevent main burner ignition until positive venting has been proven. (HDS/HDC)
- C.2. The unit shall be constructed such that it can be installed either of 2 ways. (PTX/BTX)
- C.2.a The unit may be installed as separated combustion power exhausted arrangement with separate vent pipe and combustion air intake pipe to allow for fresh combustion air drawn from outside the conditioned space. (PTX/BTX)
- C.2.b The unit may be installed in a 1 pipe power vented arrangement without the combustion air pipe installed, drawing combustion air from inside the conditioned space. This installation shall not be considered a separated combustion installation.

### D. Unit Casing

- D.1. The unit heater(s) casing shall be constructed of not less than 20 gauge aluminized steel with minimization of exposed fasteners. (PTX/BTX)
- D.1.a. The unit heater(s) casing shall be constructed of not less than 22 gauge aluminized steel with minimization of exposed fasteners. (HDS/HDC)
- D.2. All exterior casing parts shall be cleaned of all oils and a phosphate coating applied prior to painting. All exterior casing parts shall be painted with a electrostatically applied baked-on gray-green polyester powder paint (7-mil thickness) for corrosion resistance.
- D.3. The unit shall be furnished with horizontal air deflectors. The deflectors are adjustable to provide for horizontal directional airflow control (up or down).

### E. Furnace Section

- E.1.c. The heat exchanger(s) shall be made of 18 gauge aluminized steel tubes and headers (opt 409 stainless steel). The thermal efficiency of the unit(s) shall be a minimum of 82-83% efficient for all air flow ranges. Each heat exchanger tube shall be individually and directly flame-fired. The heat exchanger tube shall be crimped to allow for thermal expansion and contraction. The flue collector box shall be made of 20 gauge aluminized steel (opt 409 stainless).

- E.2. The heat exchanger(s) seams and duct connections shall be certified to withstand 0.9" W.C. external static pressure without burner flame disturbance.
- E.3. The burner(s) shall be in-shot type, directly firing each heat exchanger tube individually and is (are) designed for good lighting characteristics without noise of extinction for both natural and propane gas.
- E.4. The ignition controller(s) shall be 100% shut-off with continuous retry.
- E.5. The gas pressure shall be between 6-7" W.C for natural gas. (opt) The gas pressure shall be 11-14" W.C. for propane gas.
- E.6. The solid state ignition system shall directly light the gas by means of a direct spark igniter each time the system is energized.
- E.8. The unit gas controls shall be provided with the following:
- E.8.a. (opt) Single-stage gas controls with a single-stage combination gas control, an ignition control, and a single-stage low voltage thermostat. The unit fires at 100% full fire based on a call for heat from a room thermostat.
- E.8.b. (opt) Two-stage gas controls with a two-stage combination gas control, an ignition control, and a two-stage low voltage thermostat. The unit fires at 50% fire on low stage or 100% fire on high stage of the unit based on the call for heat from either a room or duct thermostat.
- E.9. An automatic reset high limit switch mounted in the air stream to shut off the gas supply in the event of overheating.
- E.10. A time delay relay that delays the start of the air mover to allow the heat exchanger a warm-up period after a call for heat. The time delay relay shall also continue the air mover operation after the thermostat has been satisfied to remove any residual heat in the heat exchanger.
- E.11. The unit shall be orificed for up to 2000' elevation above sea level.
- E12. For altitude, the manifold pressure has been de-rated to \_\_\_\_\_ for \_\_\_\_\_ elevation above sea level.

### F. Electrical

- F.1. All electrical components shall carry UL, ETL, or CSA listing.
- F.2. A low voltage terminal board shall be provided for direct wiring connection to an external thermostat.
- F.3. A single 115V to 24V step down transformer shall be provided for all unit controls.
- F.4. A contractor convenience junction box with unit on/off switch, terminal board for low voltage wiring, and system status indicator light (PTX/BTX models)

### G. Air Mover

- G.1. The motor horsepower shall be \_\_\_\_\_.  
G.2. The motor wiring shall be HPN two wire motor code (HDS/HDC).  
G.3. The motor wiring shall be jacketed 3 wire motor code (PTX/BTX).

# SPECIFICATIONS - ALL MODELS



- G.4. Propeller models shall meet the following requirements.
- G.4.a. The motor type shall be single-speed, totally enclosed (TE) (open drip proof (ODP) on HDS units 75MBH and smaller).
- G.4.b. The motor shall be rated for:
- (a) 115V/60Hz/1Ph
- G.5. Blower models shall meet the following requirements.
- G.5.a. The motor type shall be single-speed, totally enclosed (TE) (open drip proof (ODP) on all HDC models).
- G.5.b. The motor shall be rated for:
- (a) 115V/60Hz/1Ph
  - (b) 208V/60Hz/1Ph (BTX model)
  - (c) 230V/60Hz/1Ph (BTX model)
  - (d) 208V/60Hz/3Ph (BTX model)
  - (e) 230V/60Hz/3Ph (BTX model)
  - (f) 460V/60Hz/3Ph (BTX model)
  - (g) 575V/60Hz/3Ph (BTX model)
- G.5.c. The motor shall be provided with an adjustable motor sheave to allow for minor adjustment of the blower rpm at the job site. (BTX model)
- G.5.d. The blower shall be a double width, double inlet (DWDI), forward curved, belt driven, assembly with spider ball bearings. (BTX model)
- G.5.e. The motor shall be provided with three speed taps to allow for adjustment of the blower rpm at the job site. (HDC model)
- G.5.f. The blower shall be a double width, double inlet (DWDI), forward curved, direct motor drive assembly with spider ball bearings. (HDC model)

## H. Mounting

- H.1. The unit shall be equipped with tapped holes to accept 3/8-16 threaded rod for suspension. (HDS/HDC size 100/125 and PTX/BTX models).
- H.1.a. The unit shall be equipped with mounting brackets to allow for threaded rod suspension or to be bolted directly to the ceiling support structure allowing 1" of top clearance. (HDS/HDC models - opt on sizes 100/125)
- H.3. Propeller unit (Sizes 30-400) and blower units (Sizes 60-125) to have 4 suspension points.
- H.4. Blower unit (Sizes 150-400) to have 6 suspension points.

## J. Accessories

The following field installed accessory control devices shall be provided with the unit:

- J.1. A 5-50 psi gas pressure regulator to reduce the inlet gas pressure for the operating controls.
- J.2. A clear plastic thermostat guard with two keys for room thermostats.
- J.4. Pipe Hanger Adapter Kit to facilitate threaded pipe suspension. (HDS/HDC size 100/125 and PTX/BTX models)
- J.7. Vertical Deflector Kit to enable side distribution of airflow.
- J.8. A blower enclosure fully encloses blower to enable the attachment of filter racks and/or duct.
- J.9. A combination filter rack/duct connector containing a 1" thick, cleanable filter.

- J.11. A belt guard enclosing the belts and sheaves (pulleys) on a blower type unit heater. (BTX model)
- J.12. Propane conversion kit for converting natural gas units to propane gas.
- J.17. Discharge Transition from unit to polytube. (HDC/BTX models)
- J.18. 30° non-velocity generating downward air deflector hood constructed of 20 ga. cold rolled steel with baked-on gray-green polyester powder paint.
- J.19. 60° non-velocity generating downward air deflector hood constructed of 20 ga. cold rolled steel with baked-on gray-green polyester powder paint.
- J.20. 90° non-velocity generating downward air deflector hood constructed of 20 ga. cold rolled steel with baked-on gray-green polyester powder paint.
- J.21. (opt) A 208V to 115V step down shall be provided for operation of the 115V unit (HDS/HDC/PTX models). J.22. (opt) A 230V to 115V step down shall be provided for operation of the 115V unit (HDS/HDC/PTX models).
- J.23. (opt) A 460V to 115V step down shall be provided for operation of the 115V unit (HDS/HDC/PTX models).
- J.24. (opt) A 575V to 115V step down shall be provided for operation of the 115V unit (HDS/HDC/PTX models).
- J.25. A 208V to 115V step down shall be provided for operation of the 115V power exhauster and control circuit. (BTX model)
- J.26. A 230V to 115V step down shall be provided for operation of the 115V power exhauster and control circuit. (BTX model)
- J.27. A 460V to 115V step down shall be provided for operation of the 115V power exhauster and control circuit. (BTX model)
- J.28. A 575V to 115V step down shall be provided for operation of the 115V power exhauster and control circuit. (BTX model)
- J.29. A horizontal concentric vent kit shall be provided to allow the vent outlet and combustion air inlet pipes to penetrate the building wall through one opening.
- J.30. A vertical concentric vent kit shall be provided to allow the vent outlet and combustion air inlet pipes to penetrate the building roof through one opening.

## K. Thermostats


The unit shall be provided with the following thermostat:

- K.1. A single stage room thermostat with a 50°-90°F range.
- K.2. A single stage room thermostat with a 50°-90°F temperature set point range. The stat shall also include switching for Heat/Off and Fan On/Auto control.
- K.3. Modine Pro1 T-501M: 50-90°F, Non-programmable thermostat with 3 swap panels: 1.) Fan: On/Auto, System: Heat/Off/Cool, 2.) Fan: On/Auto, System: On/Off, 3.) System: On/Off.
- K.4. Modine Pro1 T-715M: 41-95°F, Heat/Auto/Off Thermostat with Fan Auto/On switching, 7-day programmable
- K.5. A two-stage electronic duct thermostat with field installed temperature sensor, temperature selector and one stage adder.

# MODEL NOMENCLATURE



Figure 23.1 - Model Number Designations

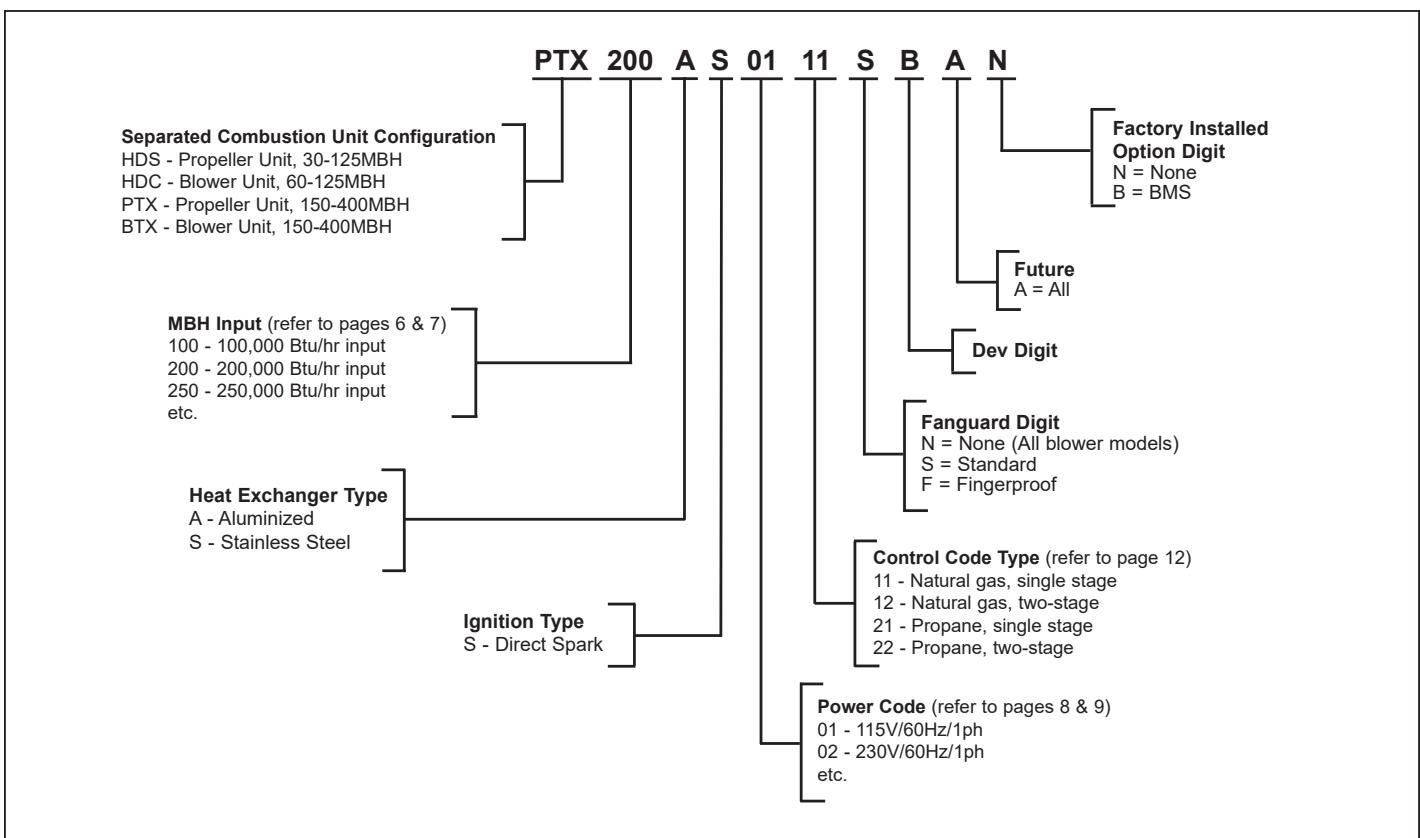

Products from Modine are designed to provide indoor air-comfort and ventilation solutions for residential, commercial, institutional and industrial applications. Whatever your heating, ventilating and air conditioning requirements, Modine has the product to satisfy your needs, including:

#### **HVAC**

- Unit Heaters:
  - Gas
  - Hydronic
  - Electric
  - Oil
- Ceiling Cassettes
- Duct Furnaces
- Hydronic Cabinet Unit Heaters, Convector
- Infrared Heaters
- Make-up Air Systems
- Unit Ventilators

#### **School Products**

- Vertical Packaged Classroom HVAC:
  - DX Cooling/Heat Pump
  - Water/Ground Source Heat Pump
  - Horizontal/Vertical Unit Ventilators

Specific catalogs are available for each product. Catalogs 75-136 and 75-137 provide details on all Modine HVAC equipment.



**Modine Manufacturing Company**

1500 DeKoven Avenue  
Racine, Wisconsin 53403-2552  
Phone: 1.800.828.4328 (HEAT)  
[www.modinehvac.com](http://www.modinehvac.com)

© Modine Manufacturing Company 2023