

NFPA SPRINKLER SPACING INQUIRY

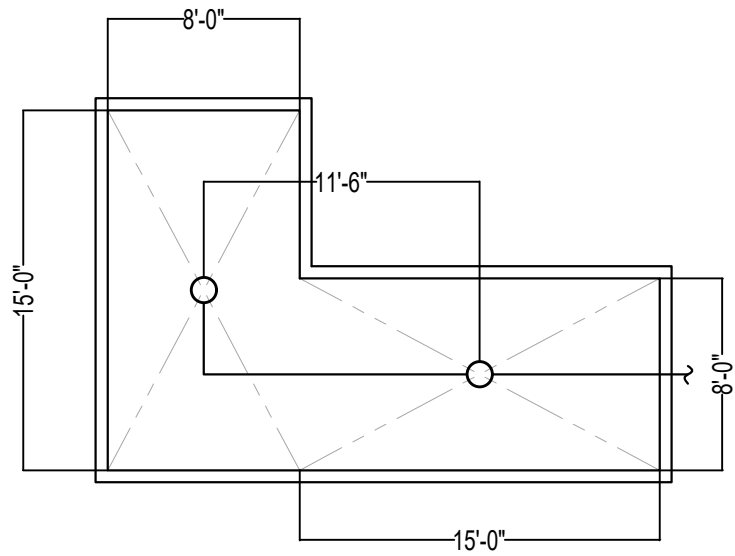


FIGURE A:

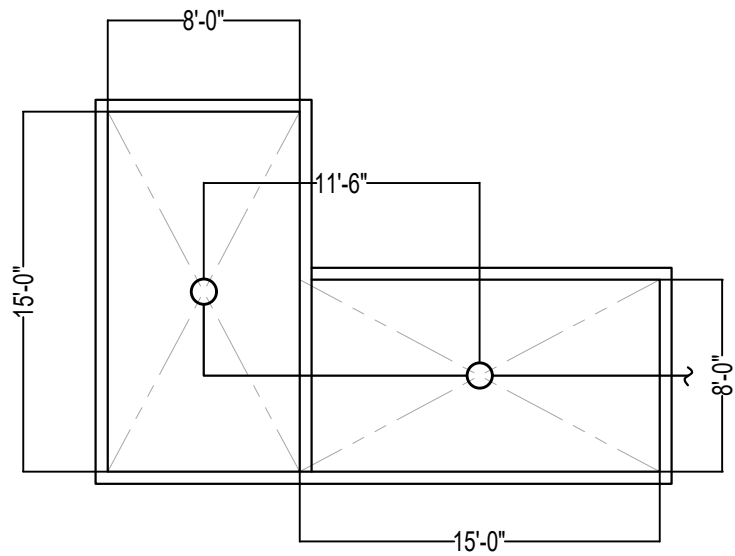


FIGURE B: