



SUITE 17, 808 FOREST ROAD, PEAKHURST 2210 ABN: 73 107 291 494
P. 02 9046 3800 ACOUSTICS@DAYDESIGN.COM.AU WWW.DAYDESIGN.COM.AU

Acoustic Test and Opinion

LVP/T 2.5 mm EU plank Construction Flooring System

REPORT No
6968-2.3R Rev A

DATE ISSUED
15 October 2020

Prepared For:
Godfrey Hirst Australia Pty Ltd
PO Box 93
Geelong VIC 3220

Attention: Ms Jamuna Sivathasan



Revision History

Report	Date	Prepared	Checked	Comment
Draft	11/08/2020	Benjamin Lamont	Stephen Gauld	By email, for client review
Final	13/10/2020	Benjamin Lamont	Stephen Gauld	
Revision A	15/10/2020	Benjamin Lamont	Stephen Gauld	Added 150 mm opinion

Document R\6968-2.3R REV A, 17 pages plus attachments

Disclaimer

The work presented in this document was carried out in accordance with the Day Design Pty Ltd Quality Management System. Day Design is certified to ISO9001.

Day Design Pty Ltd is a member company of the Association of Australasian Acoustical Consultants, and the work herein reported has been performed in accordance with the terms of membership.

Day Design Pty Ltd reserves all copyright of intellectual property in any or all of Day Design's documents. No permission, license or authority is granted by Day Design to any person or organisation to use any of Day Design's documents for any purpose without written consent of Day Design.

This report has been prepared for the client identified in Section 1.0 only and cannot be relied or used by any third party. Any representation, statement, opinion or advice, expressed or implied in this report is made in good faith but on the basis that Day Design is not liable (whether by reason of negligence, lack of care or otherwise) to any person for any damage or loss whatsoever which has occurred or may occur in relation to that person taking or not taking (as the case may be) action in any respect of any representation, statement, or advice referred to above.

Recommendations made in this report are intended to resolve acoustical problems only. No claims of expertise in other areas are made and no liability is accepted in respect of design or construction for issues falling outside the specialist field of acoustical engineering including but not limited to structural, fire, thermal, architectural buildability, fit for purpose, waterproofing or other aspects of building construction. Supplementary professional advice should be sought in respect of these issues.

The information in this document should not be reproduced, presented or reviewed except in full. Prior to passing onto a third party, the Client is to fully inform the third party of the specific brief and limitations associated with the commission.



TABLE OF CONTENTS

1.0	CONSULTING BRIEF.....	4
2.0	PREDICTION OF $L'_{nT,w}$	5
3.0	MATERIALS USED FOR SOUND REDUCTION.....	6
3.1	Concrete Slab.....	6
3.2	Furring Channels.....	6
3.3	Plasterboard.....	6
3.4	Flooring.....	6
3.5	Insulation.....	6
4.0	TESTING SPECIFICATIONS.....	7
5.0	MEASUREMENT PROCEDURE.....	8
6.0	IMPACT SOUND INSULATION DESCRIPTORS.....	9
6.1	Australian/ISO Standard.....	9
6.2	ASTM International Standard.....	9
6.3	Estimation of ΔL_w	9
7.0	TEST SAMPLE DESCRIPTION AND RESULTS.....	10
7.1	No Underlay.....	10
7.2	2 mm Damtec Colour Underlay.....	12
8.0	ACOUSTIC OPINIONS.....	14
8.1	System Specification 1.....	14
8.2	System Specification 2.....	15
9.0	STATEMENT OF ACOUSTIC OPINION.....	16



1.0 CONSULTING BRIEF

Day Design Pty Ltd was engaged by Godfrey Hirst Australia Pty Ltd to test and provide Acoustic Opinions on the $L'_{nT,w}$ ratings of their LVP/T 2.5 mm EU plank construction flooring system with different concrete slab thicknesses.

Opinions have been generated for various configurations of concrete slab thicknesses of 150mm, 200 mm and 250 mm, based upon the test results on a 270 mm thick concrete slab. The objective is to provide acoustical data useful to building designers for inclusion in Godfrey Hirst technical publications.

Scope of Work:

- Measure the impact sound insulation of the specified floor system.
- Model four variations of the tested system using acoustic modelling software.
- Compare the $L'_{nT,w}$ predictions with test results.
- Provide Acoustic Opinions on the $L'_{nT,w}$ ratings the nominated flooring system.
- Prepare an Acoustical Test and Opinion Report.



2.0 PREDICTION OF $L'_{nT,w}$

The impact sound insulation performance of a system is denoted by a single value descriptor, the weighted impact sound insulation $L_{n,w}$ (for laboratory tested rating) or $L'_{nT,w}$ (for field tested rating). The single value descriptor allows for easy comparisons of impact noise levels between different systems. The lower the number, the better the impact sound insulation performance.

The rating of the system is determined by comparing the measured noise levels against a set of reference values between one-third-octave band centre frequency ranges of 100 Hz to 3150 Hz, as specified in AS/NZS ISO 717.2:2004.

The Acoustic Opinions expressed in this report are based firstly on calculations made using Insul software and secondly by comparison with Impact Sound Insulation tests for similar constructions. Acoustic opinions are then provided in the light of our general acoustic experience. Factors taken into account in our calculations include: the surface mass of the plasterboard, cavity depth, Young's Modulus, the critical frequency and speed of sound in wall lining materials, the effect of air cavities and acoustic insulation between furring channels.

We are of the opinion that using Insul modelling software and making corrections based on comparison with test results, is that our prediction accuracy is in the order of ± 2 dB.

Because of the complexity of such calculations, approved laboratory test results (in accordance with Australian Standard ISO 140.7:2006 and ISO 717.2:2004) are always preferred.



3.0 MATERIALS USED FOR SOUND REDUCTION

3.1 Concrete Slab

This schedule of $L'_{nT,w}$ ratings includes various concrete slab thicknesses. The standard density of the concrete is 2,400 kg/m³.

3.2 Furring Channels

Furring channels nominated in this report are 28 mm deep and 38 mm wide as offered by a number of manufacturers.

Deeper furring channels or other fixing structures that provide a greater cavity will provide equal or better impact sound insulation.

3.3 Plasterboard

The plasterboard used in the test was a 10 mm Knauf Mastashield plasterboard with surface density 6.5 kg/m².

3.4 Flooring

The flooring product is an LVP/T 2.5 mm EU plank construction with dimensions 1320 mm x 196 mm x 2.5 mm per plank. The flooring impact test was conducted twice; once with no underlay; and again, with a 2 mm Damtec colour underlay on the concrete slab.

3.5 Insulation

This schedule of $L'_{nT,w}$ ratings includes one configuration with ceiling insulation between furring channels. The minimum ceiling insulation density recommended is 10 kg/m³.



Acoustic Test and Opinion

4.0 TESTING SPECIFICATIONS

Location:	Concrete slab floor between Unit 18 and Unit 11 of 808 Forest Road, Peakhurst
Base Floor Construction:	270 mm thick concrete slab 35 mm furring channel No insulation within cavity 10 mm standard plasterboard
Receiving Room Dimensions:	Unit 11, 808 Forest Road, Peakhurst Length: 12.3 m Width: 5.6 m Height: 2.7 m
Test Samples:	1) LVP/T 2.5 mm EU plank construction; and 2) LVP/T 2.5 mm EU plank construction adhered to 2 mm Damtec colour underlay with Ultrabond ECO V4SP adhered to the concrete slab with Ultrabond ECO V4SP.
Sample size:	1320 mm x 196 mm x 2.5 mm thick
Test dates:	1) 6 July 2020 2) 13 July 2020



5.0 MEASUREMENT PROCEDURE

The impact sound insulation of a floor/ceiling system is determined by using a standard tapping machine¹ on the floor to generate impact noise and measuring the level of impact noise in the receiving room below.

The tapping machine is placed in 4 orientations as shown in Figure 1 below.

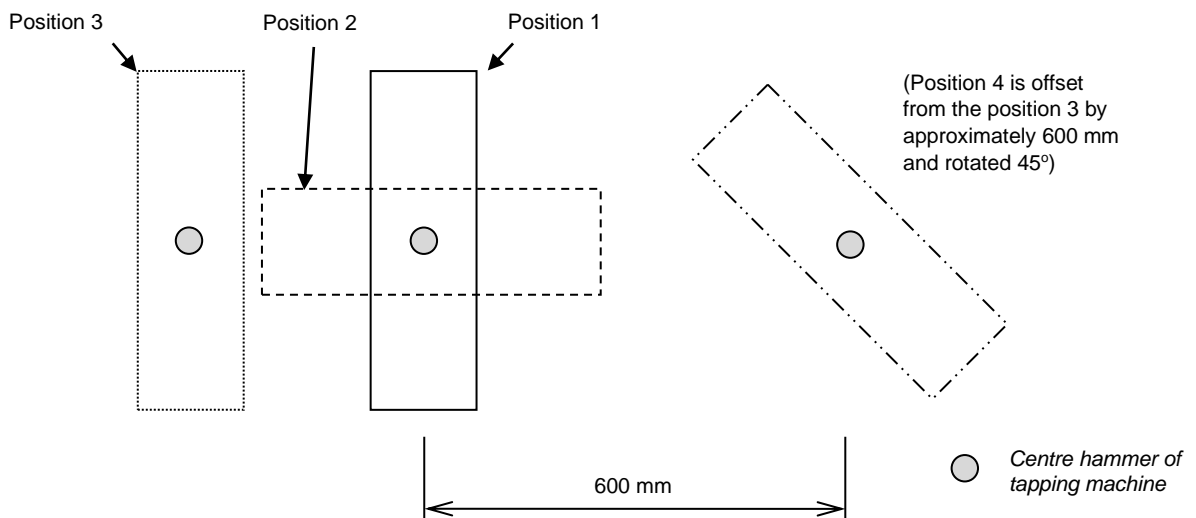


Figure 1 - Tapping machine test orientations

Impact noise levels in the receiving room are measured using the microphone sweep method for a period of 30 seconds per tapping machine orientation.

A background noise level measurement is carried out to account for any noise contributions from the environment and to apply appropriate corrections if required.

Reverberation time measurements are carried out in the receiving room. The reverberation time, T_{60} , is the time it takes for a noise source to decay by 60 dB after the stimuli is switched off. A “live” room, such as a reverberation room which consists of only hard surfaces, will typically have a long reverberation time. A “dead” room, such as an anechoic chamber, which consists of highly absorptive surfaces, will have a much shorter reverberation time.

Measurement of the reverberation time in the receiving room allows the measured sound insulation to be adjusted to account for the sound energy absorbed by the room.

Impact sound insulation measurements were carried out for the base floor and the base floor with the test sample to determine the improvement the test sample had on the existing floor/ceiling system.

¹ Brüel and Kjær Tapping Machine Type 3207



6.0 IMPACT SOUND INSULATION DESCRIPTORS

6.1 Australian/ISO Standard

The impact sound insulation performance of a system is denoted by a single value descriptor, the weighted impact sound insulation $L'_{n,w}$ (for laboratory tested rating) or $L'_{nT,w}$ (for field tested rating). The single value descriptor allows for easy comparisons between different systems. The lower the number, the better the impact sound insulation performance.

The rating of the system is determined by comparing the measured impact noise levels in the receiving room against a set of reference values between one-third-octave band centre frequency ranges of 100 Hz to 3150 Hz, as specified in AS/NSZ ISO 717.2:2004.

6.2 ASTM International Standard

The impact sound insulation performance can also be indicated by a single value descriptor known as the Impact Insulation Class (IIC) rating.

The IIC is derived from ASTM E1007-14: *Standard Test Method for Field Measurement of Tapping Machine Impact Sound Transmission Through Floor-Ceiling Assemblies and Associated Support Structures* and ASTM E989-06: *Standard Classification for Determination of Impact Insulation Class*.

The process in measuring and determining the IIC is very similar to the $L'_{nT,w}$, however the interpretation of the value is different. Where the $L'_{nT,w}$ improves as the number decreases, the IIC rating improves as the number increases. The prefix "A" in AIIC is representative of the Apparent Impact Insulation Class, and denotes the rating of a field measurement as opposed to a laboratory measurement.

6.3 Estimation of ΔL_w

The measurement procedure used to determine the reduction of transmitted impact noise is specified in AS/ISO 140.8: *Acoustics – Measurement of sound insulation in buildings and of building elements – part 8: Laboratory measurements of the reduction of transmitted impact noise by floor coverings on a heavyweight standard floor*. The impact noise reduction ΔL_w therefore cannot be calculated according to the standard, using field measurements.

However, we have calculated the reduction in impact sound pressure level (ΔL) and the weighted reduction of impact sound pressure level (ΔL_w) for this field measurement using the same method recommended for laboratory measurements in AS/ISO 140.8 and AS/ISO 717.2 and therefore is indicative only.



7.0 TEST SAMPLE DESCRIPTION AND RESULTS

The base floor (see Section 4.0) was tested to establish a reference performance of the floor/ceiling system from which the proposed test sample will be compared to.

7.1 No Underlay

The test sample of LVP/T 2.5 mm EU plank Construction, was set up loose laid on top of the base floor as shown below in Figure 2.



Figure 2 - LVP/T 2.5 mm EU plank construction loose laid on base floor.

The measured impact sound pressure levels (rounded to the nearest one-tenth decibel) are tabulated for each one-third-octave band measured and are presented below in Table 1.

Table 1 Measured Impact Sound Pressure Levels

1/3 Octave Band Centre Frequency (Hz)	Standardised Impact Sound Pressure Level L'_{nT} (dB)		ΔL (dB)	Normalised Impact Sound Pressure Level (dB)
	Base Floor	Test Sample	Test Sample	Test Sample
100	51.4	53.8	-2.4	62.9
125	56.3	56.5	-0.2	63.8
160	58.3	57.9	0.4	64.6
200	59.2	58.6	0.6	64.4
250	58.0	58.8	-0.8	64.9
315	56.4	56.5	-0.1	63.2
400	57.0	57	0	63.6
500	57.4	57.6	-0.2	64.6
630	59.5	58.2	1.3	65.5
800	59.5	58.3	1.2	65.8
1000	60.3	59	1.3	66.5
1250	60.6	59.4	1.2	66.5
1600	60.6	58.7	1.9	65.6
2000	60.5	57.6	2.9	64.0
2500	59.1	54.9	4.2	60.8
3150	61.6	55.7	5.9	60.9
4000	64.1	55.3	8.8	59.9
5000	60.4	47.4	13	51.5
	$L'_{nT,w} = 67$	$L'_{nT,w} = 63$	$\Delta L_w = 4$ dB	AIIC = 39



7.2 2 mm Damtec Colour Underlay

The test sample of LVP/T 2.5 mm EU plank construction, adhered to 2 mm Damtec colour underlay with Ultrabond ECO V4SP adhered to the base floor with Ultrabond ECO V4SP as shown below in Figure 3.



**Figure 3 - LVP/T 2.5 mm EU plank construction with
2 mm Damtec colour underlay on base floor**

The measured impact sound pressure levels (rounded to the nearest one-tenth decibel) are tabulated for each one-third-octave band measured and are presented below in Table 1.

Table 2 Measured Impact Sound Pressure Levels

1/3 Octave Band Centre Frequency (Hz)	Standardised Impact Sound Pressure Level L'_{nT} (dB)		ΔL (dB)	Normalised Impact Sound Pressure Level (dB)
	Base Floor	Test Sample	Test Sample	Test Sample
100	53.2	53.5	-0.3	60.1
125	55.1	57	-1.9	63.8
160	60.4	57.1	3.3	62.9
200	59.7	58.5	1.2	63.2
250	58.3	57.6	0.7	64.0
315	55.8	55	0.8	62.2
400	57.0	54.7	2.3	61.4
500	57.0	54.1	2.9	61.3
630	58.4	53.8	4.6	60.8
800	58.3	52.1	6.2	59.5
1000	59.3	50	9.3	57.3
1250	59.3	46.5	12.8	53.8
1600	59.2	41.2	18	48.2
2000	58.6	32.2	26.4	39.0
2500	57.6	24.8 B	32.8	31.0
3150	60.4	22.3	38.1	27.7
4000	63.3	20.2	43.1	25.0
5000	58.9	18.4	40.5	22.6
	$L'_{nT,w} = 65$	$L'_{nT,w} = 52$	$\Delta L_w = 13$ dB	AIRC = 52

Where the test sample impact sound pressure level is noted with the suffix “B”, the value required a correction as the difference between the measured impact level and background level was less than 10 dB. This provides a conservatively high value and therefore the true impact noise level may be less than the L'_{nT} value reported.



8.0 ACOUSTIC OPINIONS

Godfrey Hirst has developed a range of floor systems that include options for two concrete slab thicknesses. The acoustic opinions below are based on the comparable test on a 270 mm slab, Insul acoustic modelling software, as well as our own experience.

8.1 System Specification 1

LVP/T 2.5 mm EU plank construction flooring system

Concrete slab, as per table below

Ceiling lining as specified on 28 mm furring channels with insulation as specified between the furring channels

Table 3 Predicted Standardised ($L'_{nT,w}$) and Normalised (AIIIC) Impact Sound Insulation

Ceiling Lining	Concrete thickness, mm	Insulation	$L'_{nT,w}$	AIIIC
10 mm plasterboard	150	Nil	65	37
Nil	200	Nil	69	33
10 mm plasterboard	200	Nil	64	38
10 mm plasterboard	200	R2.5	61	39
10 mm plasterboard	250	Nil	63	39



8.2 System Specification 2

LVP/T 2.5 mm EU plank construction flooring system

Ultrabond ECO V4SP adhesive

2 mm Damtec colour underlay

Ultrabond ECO V4SP adhesive

Concrete slab, as per table below

Ceiling lining as specified on 28 mm furring channels with insulation as specified between the furring channels

Table 4 Predicted Standardised ($L'_{nT,w}$) and Normalised (AIIIC) Impact Sound Insulation with Damtec colour underlay

Ceiling Lining	Concrete thickness, mm	Insulation	$L'_{nT,w}$	AIIIC
10 mm plasterboard	150	Nil	54	50
Nil	200	Nil	58	46
10 mm plasterboard	200	Nil	53	51
10 mm plasterboard	200	R2.5	50	52
10 mm plasterboard	250	Nil	52	52



9.0 STATEMENT OF ACOUSTIC OPINION

Day Design was commissioned by Godfrey Hirst Pty Ltd to measure the impact sound insulation of a flooring system incorporating their LVP/T 2.5 mm EU plank construction flooring product.

The floor/ceiling system consisting of LVP/T 2.5 mm EU plank construction flooring product without underlay, installed on top of the base floor construction consisting of a 270 mm thick concrete slab, achieved a weighted standardized impact sound insulation rating of $L'_{nT,w}$ 63, a weighted impact sound improvement index of ΔL_w 4 dB and an apparent impact insulation class of AIIC 39.

The floor/ceiling system consisting of LVP/T 2.5 mm EU plank construction flooring product with 2mm Damtec colour underlay, installed on top of the base floor construction consisting of a 270 mm thick concrete slab, achieved a weighted standardized impact sound insulation rating of $L'_{nT,w}$ 52, a weighted impact sound improvement index of ΔL_w 13 dB and an apparent impact insulation class of AIIC 52.

Acoustic opinions have been provided for a number of common floor systems based on the test results.



Test measurements and calculations were conducted by the undersigned.

Benjamin Lamont

Benjamin Lamont, BE (Aero), MEngSc (Mech)
Acoustical Engineer,
for and on behalf of Day Design Pty Ltd

AAAC MEMBERSHIP

Day Design Pty Ltd is a member company of the Association of Australasian Acoustical Consultants. The work herein reported has been performed in accordance with the terms of membership.

Appendices

- A001 -270 mm concrete $L'_{nT,w}$
- A001 -270 mm concrete AIIC
- A004 -270 mm concrete + LVP/T 2.5 mm EU plank Construction $L'_{nT,w}$
- A004 -270 mm concrete + LVP/T 2.5 mm EU plank Construction AIIC
- A018 -270 mm concrete $L'_{nT,w}$
- A018 -270 mm concrete AIIC
- A028 -270 mm concrete + 2mm Damtec colour underlay + LVP/T 2.5 mm EU plank Construction $L'_{nT,w}$
- A028 -270 mm concrete + 2mm Damtec colour underlay + LVP/T 2.5 mm EU plank Construction AIIC



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

Bare Slab

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Standardised Impact Sound Pressure Level 1/3 Octave dB
100	51.4
125	56.3
160	58.3
200	59.2
250	58.0
315	56.4
400	57.0
500	57.4
630	59.5
800	59.5
1000	60.3
1250	60.6
1600	60.6
2000	60.5
2500	59.1
3150	61.6
4000	64.1
5000	60.4
L' nT,w	67

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004


Test Specimen Dimensions:

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

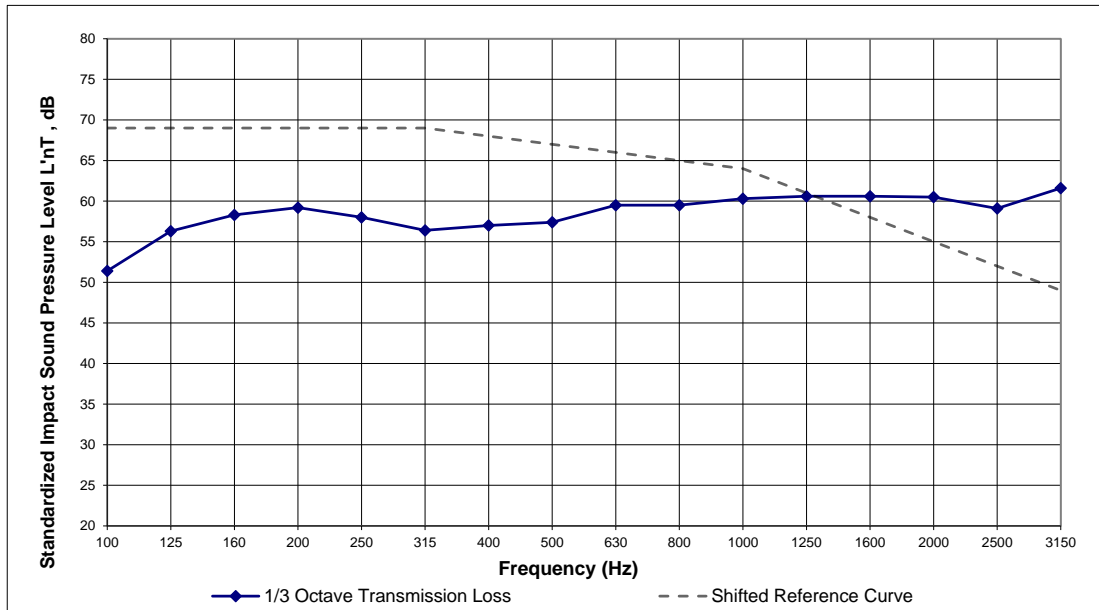

Date of Test: Monday, 6 July 2020

Project Number: 6968-2 A001

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

Bare Slab

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Normalised Impact Sound Pressure Level 1/3 Octave dB
100	59.9
125	63.5
160	64.5
200	65.0
250	64.4
315	63.4
400	63.9
500	65.4
630	66.6
800	67.2
1000	68.2
1250	68.4
1600	67.6
2000	67.1
2500	65.4
3150	67.4
4000	68.5
5000	63.5
AIIC	33

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004
Calculated according to ASTM E492 - 90
Calculated according to ASTM E989 - 06


Test Specimen Dimensions:

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

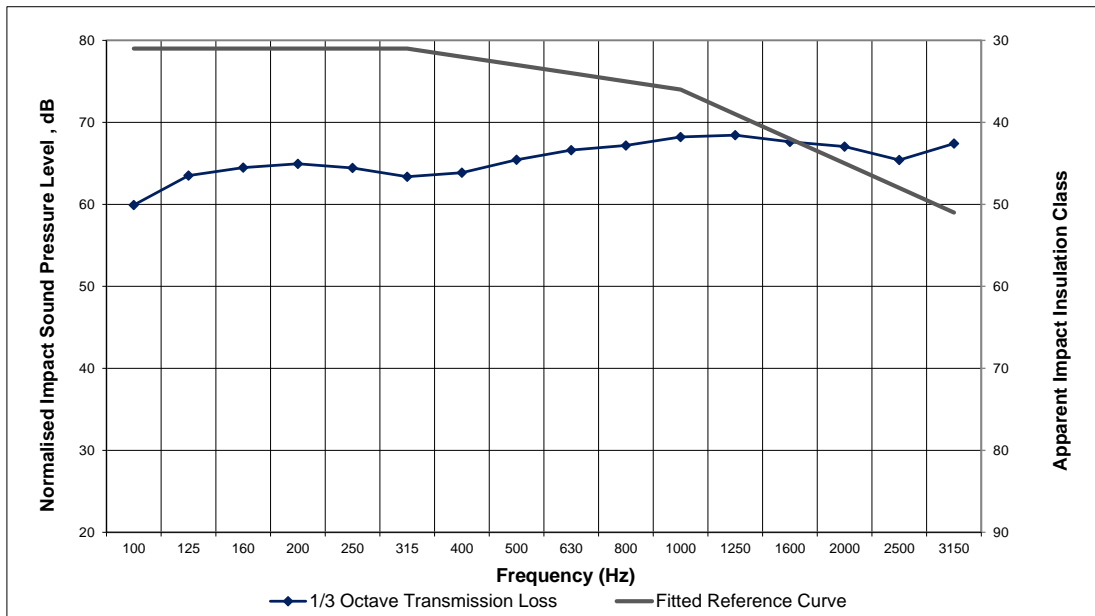

Date of Test: Monday, 6 July 2020

Project Number: 6968-2 A001

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

LVP/T 2.5 mm EU plank Construction

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Standardised Impact Sound Pressure Level 1/3 Octave dB
100	53.8
125	56.5
160	57.9
200	58.6
250	58.8
315	56.5
400	57.0
500	57.6
630	58.2
800	58.3
1000	59.0
1250	59.4
1600	58.7
2000	57.6
2500	54.9
3150	55.7
4000	55.3
5000	47.4
L' nT,w	63

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004

Test Specimen Dimensions:


1320 mm (L) x 196 mm (W) x 2.5 mm (T)

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

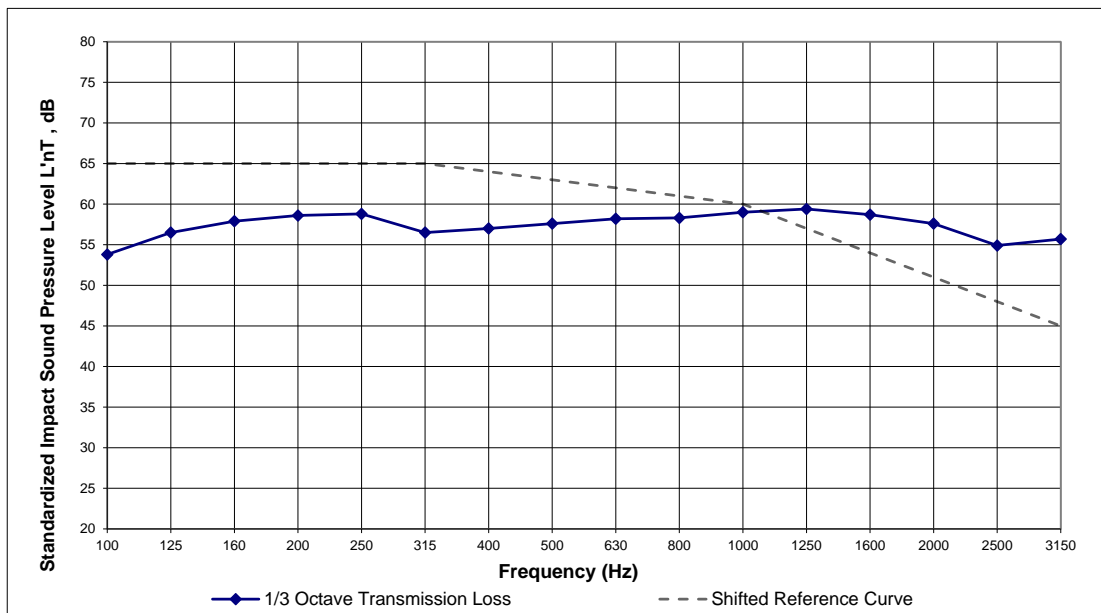

Date of Test: Monday, 6 July 2020

Project Number: 6968-2 A004

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

LVP/T 2.5 mm EU plank Construction

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Normalised Impact Sound Pressure Level 1/3 Octave dB
100	62.9
125	63.8
160	64.6
200	64.4
250	64.9
315	63.2
400	63.6
500	64.6
630	65.5
800	65.8
1000	66.5
1250	66.5
1600	65.6
2000	64.0
2500	60.8
3150	60.9
4000	59.9
5000	51.5
AIIC	39

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004
Calculated according to ASTM E492 - 90
Calculated according to ASTM E989 - 06

Test Specimen Dimensions:


1320 mm (L) x 196 mm (W) x 2.5 mm (T)

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

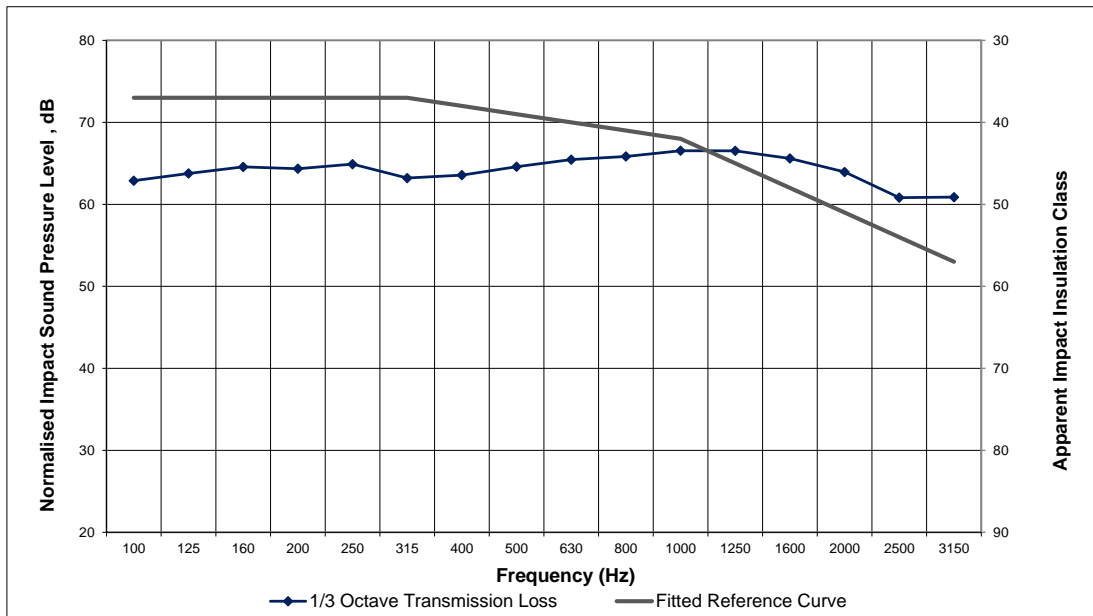

Date of Test: Monday, 6 July 2020

Project Number: 6968-2 A004

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

Bare Slab

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Standardised Impact Sound Pressure Level 1/3 Octave dB
100	53.2
125	55.1
160	60.4
200	59.7
250	58.3
315	55.8
400	57.0
500	57.0
630	58.4
800	58.3
1000	59.3
1250	59.3
1600	59.2
2000	58.6
2500	57.6
3150	60.4
4000	63.3
5000	58.9
L' nT,w	65

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004


Test Specimen Dimensions:

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

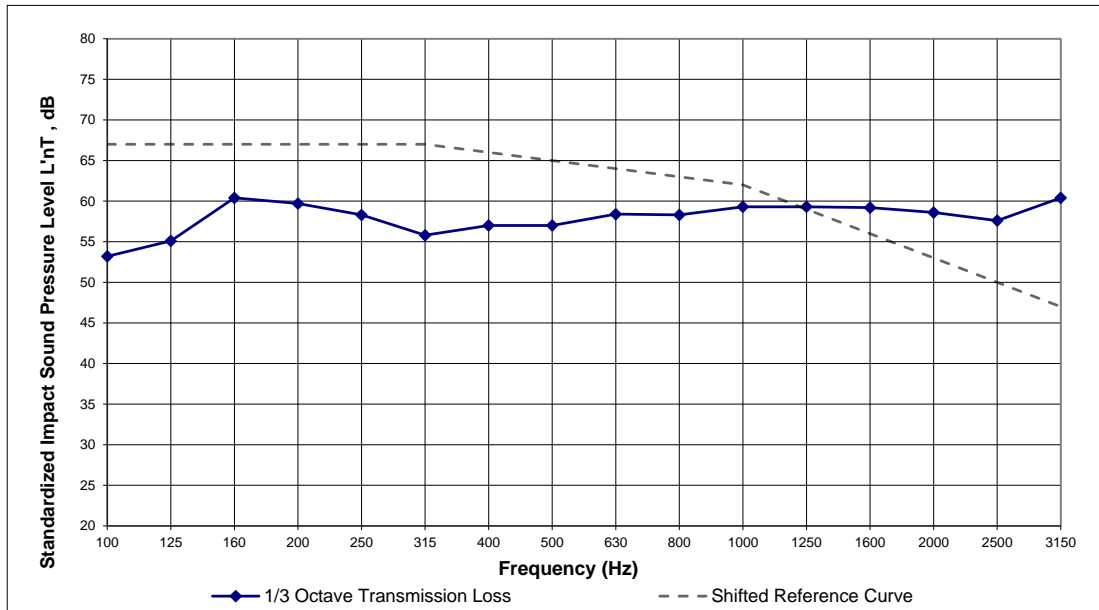

Date of Test: Monday, 13 July 2020

Project Number: 6968-2 A018

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

Bare Slab

Building Construction

270 mm concrete slab
28 mm furring channel
No Insulation
10 mm standard plasterboard

Frequency - Hz	Normalised Impact Sound Pressure Level 1/3 Octave dB
100	59.7
125	62.0
160	66.2
200	64.4
250	64.7
315	63.0
400	63.8
500	64.2
630	65.4
800	65.6
1000	66.7
1250	66.6
1600	66.1
2000	65.4
2500	63.8
3150	65.9
4000	68.1
5000	63.1
AIIC	34

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
Rated to AS ISO 717.2:2004
Calculated according to ASTM E492 - 90
Calculated according to ASTM E989 - 06


Test Specimen Dimensions:

Test Location:

Unit 18 to Unit 11 below
Day Design Pty Ltd
Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
Brüel and Kjær Microphone type 4189
Brüel and Kjær Acoustical Calibrator type 4231
Brüel and Kjær Tapping Machine type 3207

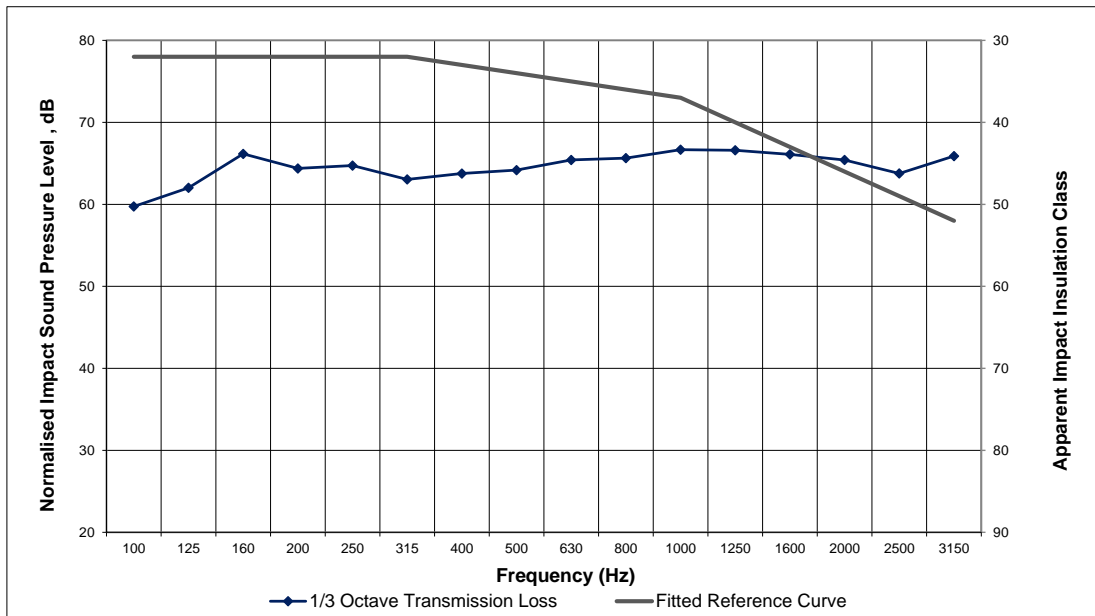

Date of Test: Monday, 13 July 2020

Project Number: 6968-2 A018

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

LVP/T 2.5 mm EU plank Construction

Ultrabond ECO V4SP adhesive
2 mm Damtec colour underlay
 Ultrabond ECO V4SP adhesive
Building Construction
 270 mm concrete slab
 28 mm furring channel
 No Insulation
 10 mm standard plasterboard

Frequency - Hz	Standardised Impact Sound Pressure Level 1/3 Octave dB
100	53.5
125	57.0
160	57.1
200	58.5
250	57.6
315	55.0
400	54.7
500	54.1
630	53.8
800	52.1
1000	50.0
1250	46.5
1600	41.2
2000	32.2
2500	24.8
3150	22.3
4000	20.2
5000	18.4
L' nT,w	52

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
 Rated to AS ISO 717.2:2004

Test Specimen Dimensions:


1320 mm (L) x 196 mm (W) x 2.5 mm (T)

Test Location:

Unit 18 to Unit 11 below
 Day Design Pty Ltd
 Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
 Brüel and Kjær Microphone type 4189
 Brüel and Kjær Acoustical Calibrator type 4231
 Brüel and Kjær Tapping Machine type 3207

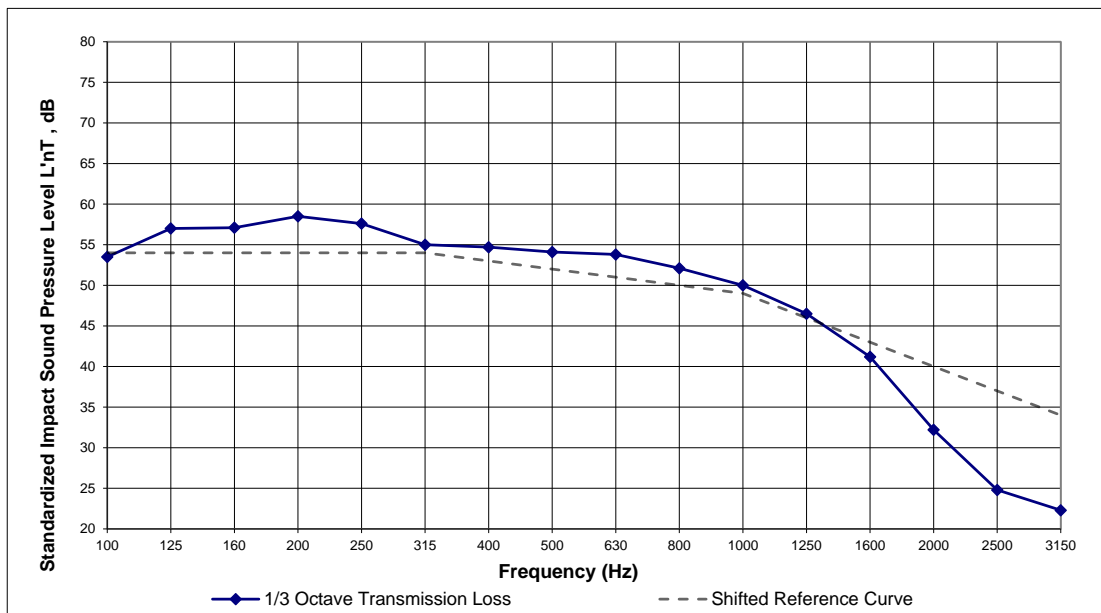

Date of Test: Monday, 13 July 2020

Project Number: 6968-2 A028

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd



Client:

Godfrey Hirst Australia Pty Ltd

Test Specimen:

LVP/T 2.5 mm EU plank Construction

Ultrabond ECO V4SP adhesive
2 mm Damtec colour underlay
 Ultrabond ECO V4SP adhesive
Building Construction
 270 mm concrete slab
 28 mm furring channel
 No Insulation
 10 mm standard plasterboard

Frequency - Hz	Normalised Impact Sound Pressure Level 1/3 Octave dB
100	60.1
125	63.8
160	62.9
200	63.2
250	64.0
315	62.2
400	61.4
500	61.3
630	60.8
800	59.5
1000	57.3
1250	53.8
1600	48.2
2000	39.0
2500	31.0
3150	27.7
4000	25.0
5000	22.6
AIIC	52

Australian Standards:

Measured according to AS/NZS ISO 140.7:2006
 Rated to AS ISO 717.2:2004
 Calculated according to ASTM E492 - 90
 Calculated according to ASTM E989 - 06

Test Specimen Dimensions:


1320 mm (L) x 196 mm (W) x 2.5 mm (T)

Test Location:

Unit 18 to Unit 11 below
 Day Design Pty Ltd
 Suite 17, 808 Forest Road, Peakhurst, NSW

Instrumentation:

Brüel and Kjær Sound Level Meter type 2270
 Brüel and Kjær Microphone type 4189
 Brüel and Kjær Acoustical Calibrator type 4231
 Brüel and Kjær Tapping Machine type 3207

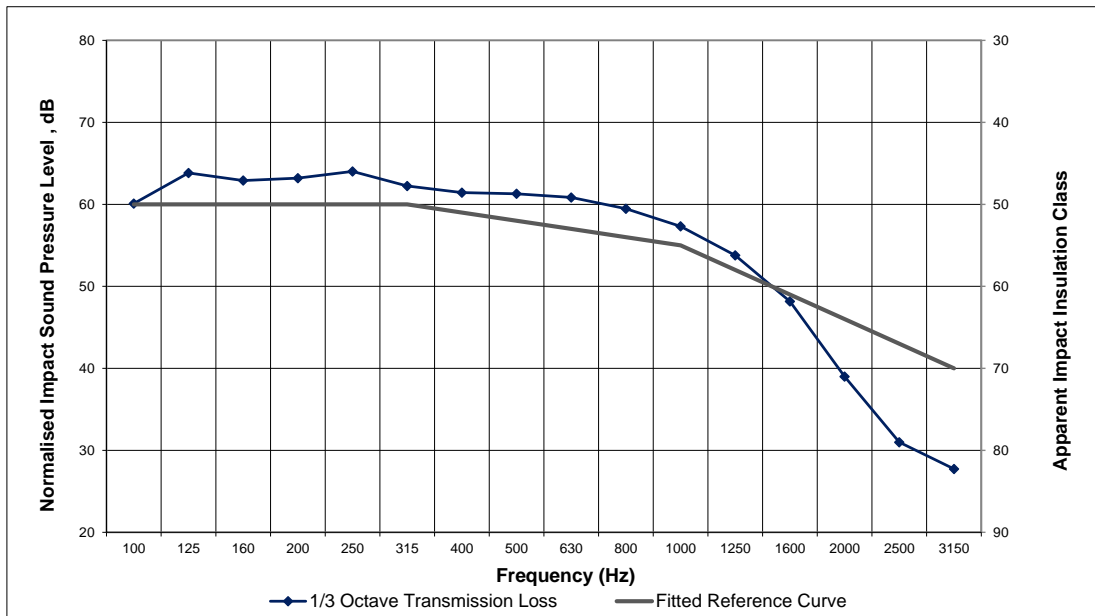

Date of Test: Monday, 13 July 2020

Project Number: 6968-2 A028

Test Engineer:

Benjamin Lamont

For and on behalf of Day Design Pty Ltd

