



Accredited for compliance with ISO/IEC 17025 –
Testing
NATA is a signatory to the ILAC Mutual
Recognition Arrangement for the mutual recognition
of the equivalence of testing, medical testing,
calibration and inspection reports

OIL-WET INCLINING PLATFORM SLIP RESISTANCE TEST

Prepared for: Godfrey Hirst
ATTENTION: Mandy Chandley
7 Factories Road
SOUTH GEELONG VIC 3220

Specimen Description: **Master Name:** **Sold As:**
GH LAM SW1380x242 – Laminate Plank Suite Wide
Opua Wide

No. of Specimens & Size: 2 off, 232x1380 mm. (Sampling conducted by client).

Surface Structure: Smooth

Specimen Preparation: Washed with water and pH neutral detergent, rinsed then dried.

Specimen Configuration: Fixed

Test Direction: Test conducted parallel with surface profile.

Joint Type & Width: N/A

Air Temperature: 22°C

Test Standard: AS 4586: 2013 Slip resistance classification of new pedestrian surface materials, Appendix D - Oil-Wet Inclining Platform Test.

Test Shoe: LeipzigV73-SP

Test Location: ATTAR, 44-48 Rocco Drive, Scoresby, VIC.

Test Date: 27 July 2023

Test Personnel: Dale Siegle and Marcus Braché

Displacement Space (rounded to nearest 0.5 cm ³ /dm ²):	Not tested
Displacement Space Assessment Group (Appendix E, AS 4586 – 2013):	Not tested
Corrected mean overall acceptance angle (α_{ave}) (rounded down to the nearest degree):	11°
Classification:	R10

These results apply only to the specimens tested and it is recommended that before selection of flooring or paving materials the effect of service conditions, including maintenance procedures and wear on their slip-resistance be checked.

Prepared by:



Dale Siegle
Technical Consultant – Compliance Services
Approved Signatory

Reviewed by:



Daniel King
BSc/BEng (mat) Hons., MIEAust
General Manager – Compliance Services
Approved Signatory

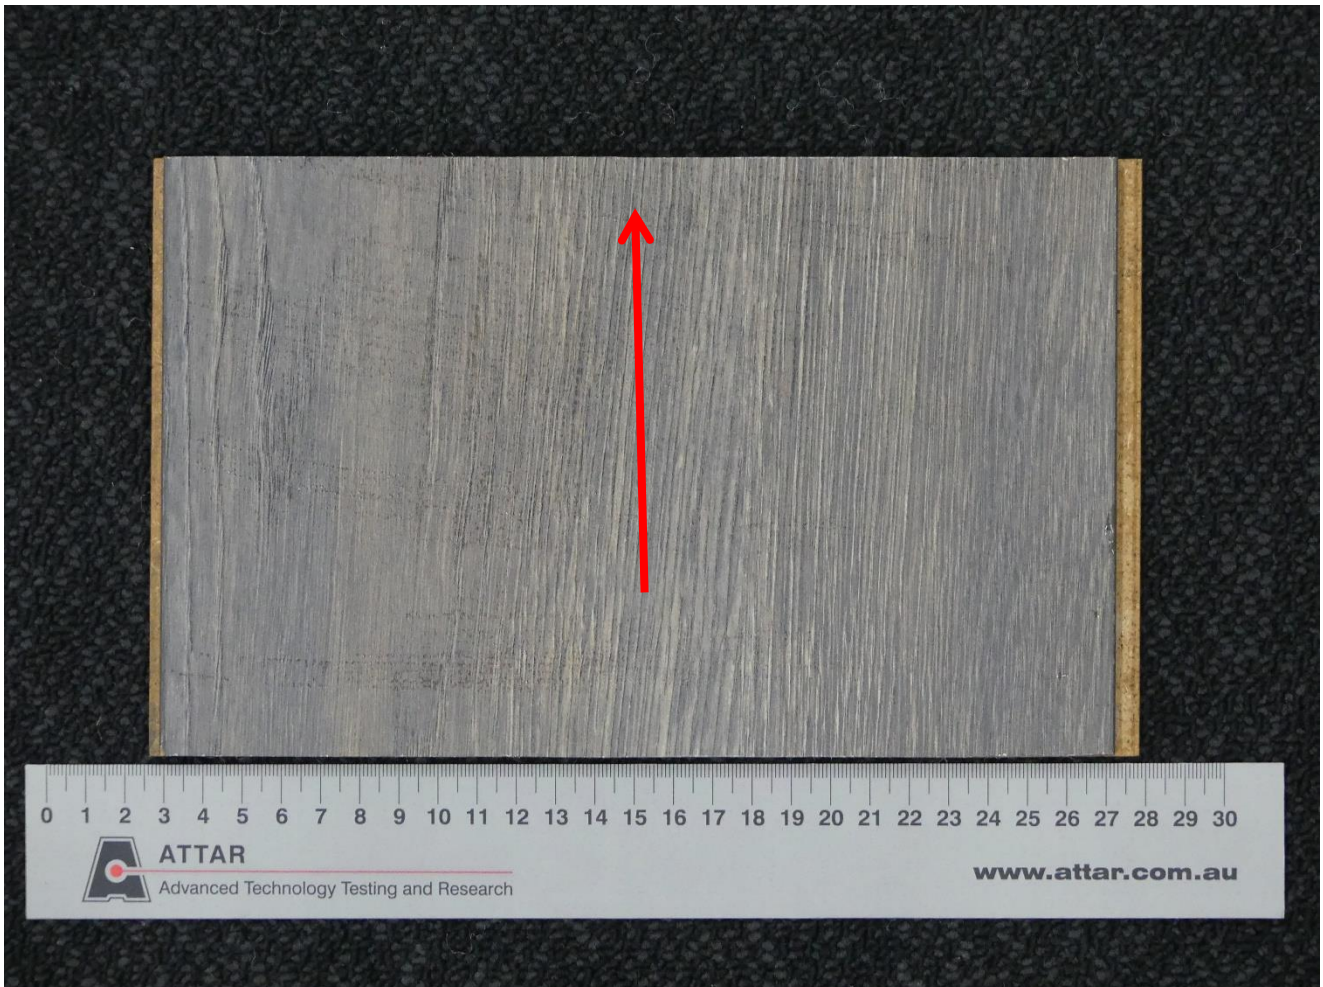


Figure 1: Photo of specimen tested.
Arrow indicates direction of test.



CLASSIFICATION CRITERIA – AS 4586: 2013
Oil Wet Inclining Platform Test – Appendix D

Compliance

**TABLE 5: CLASSIFICATION OF PEDESTRIAN SURFACE MATERIALS ACCORDING TO THE
OIL-WET INCLINING PLATFORM TEST**

Classification	Angle, degrees
No Classification	<6
R9	≥6 <10
R10	≥10 <19
R11	≥19 <27
R12	≥27 <35
R13	≥35