

Samsung DVM S Installation & Start Up Training



©2019 Samsung All rights reserved.

SAMSUNG

1

Samsung DVM S Installation & Start Up Training Disclaimer

Due to Samsung's policy of ongoing product development, specifications are subject to change without prior notice. Every effort has been made to insure that the information included in this presentation is as accurate as possible at the time of its publication.

This presentation is provided as a guide to help HVAC field technicians understand the proper procedures for installing Samsung DVM S VRF systems. This training module is not intended to replace Samsung service manuals, technical data books, installation/operation manuals or other factory documents.

Only properly trained, HVAC professionals should attempt to install and start up any Samsung heating and air-conditioning system.

High Voltage Caution:

Extra care must be taken when working on or around DVM S equipment due to numerous high voltage components. Whether installing or servicing DVM S equipment in the field or while attending Samsung HVAC training classes which include powered simulators and equipment, be aware of the potential dangers of high voltage – use caution

This presentation may only be used with authorization by Samsung HVAC. Unauthorized use, duplication or alteration of this presentation is prohibited.

For technical support issues, always contact your Samsung equipment provider.

www.samsunghvac.com

<https://Samsung.csod.com>

©2019 Samsung All rights reserved.

SAMSUNG

2

Samsung Business Academy

©2019 Samsung All rights reserved.

SAMSUNG

3

SBA Account Sign Up Required:

- Register for future training classes/courses.
- Receive credit for this training class.
- Access completion certificates.
- Complete surveys/submit feedback.



List of Courses



Training Courses
Catalog



Visitor's Guide



Samsung Business
Academy Login



Samsung Business
Academy Registration

©2019 Samsung All rights reserved.

SAMSUNG

4



1. Sign up for a SBA Account

- Contractor
- Distributor

2. View/print completion certificates

3. Register for future training

- Instructor-Led Courses
- Online Demand


SAMSUNG

5

Go to:

www.samsunghvac.com*

*Disable popup blocker.

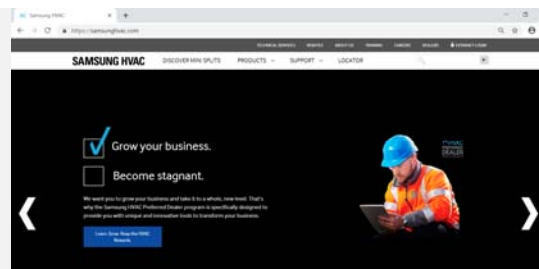


Hover over:



Samsung Business
Academy Registration

Choose either:

HVAC Distributor
HVAC Contractor

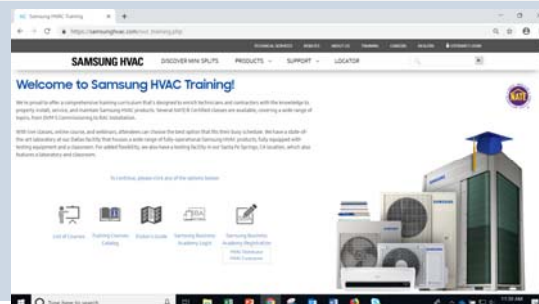

©2019 Samsung All rights reserved.

SAMSUNG

6

HVAC Contractor

Complete all required fields designated by an asterisk (*).

* Required Field
For Partner field, please search for and choose your dealer or distributor. If you cannot find your dealer name, please choose "Other" and provide the information in the text field below.

* First Name:

* Last Name:

* Email Address:

* Address Line 1:

Address Line 2:

* City:

State:

* Zip:

Phone:

* How did you learn about Samsung HVAC Training?

1 Type Distributor Name

Click **Partner:** to add Distributor information.

Partner:

Company Name (if not found above)

* Who is your Partner Distributor?

* Job Title:

SAMSUNG HVAC Dealer #

NATE ID #

Language:

2 Click Search

Search Partner

Distributor Name

10 Distributors

3 Click your Distributors name to add to form.

Partner: YOUR DISTRIBUTOR

If your Distributor is not in the list, 1 Type **Other** in the ID: field.

2 Click Search

Search Partner

ID:

3 Click OTHER to add to form.

Partner: OTHER

©2019 Samsung All rights reserved. **SAMSUNG**

7

Complete the rest of the Sign Up form.

4 Select "Opt-In" to receive training communications.

* Opt-In / Opt-Out of Training Promotion:

* Passwords must contain alpha and numeric characters.

* Passwords cannot have three or more consecutive same characters.

* Passwords must be 8 - 20 characters.

* Passwords cannot have leading or trailing spaces.

* Passwords cannot be the same as the Username, User ID, or email address.

* Passwords must contain at least one special character.

* New password

* Confirm password

5 Create password using required format.

Already a user? [Login here](#)

Return to Browsing? [Click here](#)

Cancel

6 Click **Submit** to complete sign-up.

After account is setup...

01 Approval takes 1-2 business days.

02 Attendance is marked complete.

03 Certificate available in SBA.

SAMSUNG

8

HVAC Distributor

Complete all required fields designated by an asterisk (*).

* Required Field

For Partner, click the icon to the right of the Partner field.

Click the * icon next to SHVAC to find the Distributor Partner.

* First Name:

* Last Name:

* Email Address:

* Address Line 1:

Address Line 2:

* City:

State:

* Zip:

Phone:

1 Type your Business Name

Click **Partner:** to add Distributor information.

Partner:

* Job Title:

NATE ID #:

Language:

- Sales
- Marketing
- Service
- Engineering
- Operations
- Research & Development
- Technical Support
- Finance (incl. Controlling)
- Human Resources & General Affairs
- Information Technology
- Logistics
- Procurement
- Legal & Compliance
- Training
- Product Application (Pre-Sales)
- Warranty
- Other

2 Click Search

3 Click your Business name to add to form.

Partner: DISTRIBUTOR NAME

If your Business is not in the list,

1 Type **Other** in the ID: field.

2 Click Search

3 Click OTHER to add to form.

Partner: OTHER

©2019 Samsung All rights reserved. **SAMSUNG**

9

Complete the rest of the Sign Up form.

4 Select "Opt-In" to receive training communications.

* Opt-In / Opt-Out of Training Promotion:

* Passwords must contain alpha and numeric characters.

* Passwords cannot have three or more consecutive same characters.

* Passwords must be 8 - 20 characters.

* Passwords cannot have leading or trailing spaces.

* Passwords cannot be the same as the Username, User ID, or email address.

* Passwords must contain at least one special character.

* New password

* Confirm password

5 Create password using required format.

Already a user? [Login here](#)

Return to Browsing? [Click here](#)

6 Click **Submit** to complete sign-up.

After account is setup...

01 Approval takes 1-2 business days.

Attendance is marked complete. **02**

03 Certificate available in SBA.

SAMSUNG

10


① Enter text style level

② Enter text style level

• Enter text style level

③ Open Menu. (☰)

④ Click "View Your Transcript".




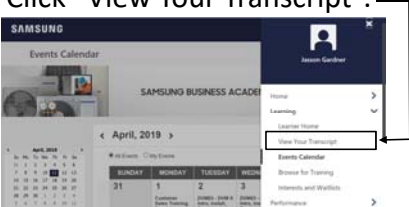
①

②

③

④

Login with Samsung Business Academy (SBA) username/password.

SAMSUNG




11

④ Click "View Completion Page".

⑤ Click "View My Certificate".

⑥ Select "Print" or "Save" option(s).

Note: Confirmation email will be sent with link to download certificate.

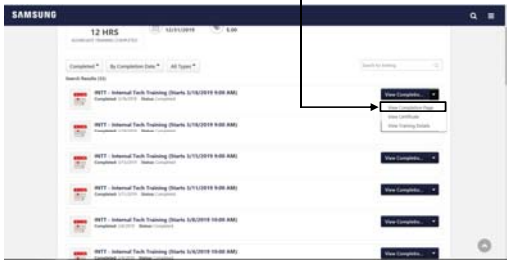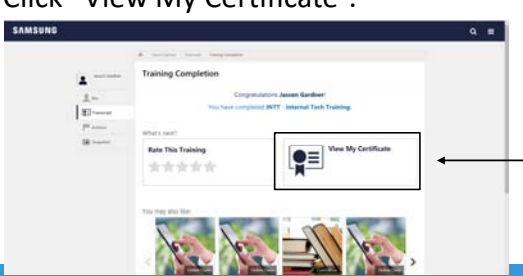©2019 Samsung All rights reserved.

SAMSUNG

12

The image is a composite of three parts. The top part shows a man with a beard and a blue shirt sitting at a desk, working on a laptop. A red circle with the number '1' is above him. To his right is a red circle with the number '2' above the text 'Enter text style'. Below this text is a 'Samsung Business Academy Login' button. The bottom part shows a laptop on a grey fur surface with a pink Samsung smartphone next to it. A login form is overlaid on the left side of the laptop screen. The form has a 'SAMSUNG' logo, a 'Welcome to Samsung Business Academy' message, and fields for 'Email' and 'Password'. Below these fields is a 'Login' button. The bottom right part of the image shows a screenshot of the Samsung Business Academy interface, which includes a 'SAMSUNG' logo, a 'SAMSUNG BUSINESS ACADEMY' header, and a calendar view for April 2019.

13

4 Click "Request".

5 Confirmation email will be sent.

Registration status screen displays.

Dear Jason, this message is to confirm you are registered to attend:

Title: RLC06 - RLC Advanced Service Introduction: 4/17 RLC06 - Roanoke, TX
Session Details:
4/17 RLC06 - Roanoke, TX
Date: 4/17/2019 9:30 AM
Time: 9:30 AM - 5:30 PM EST
Location: Samsung HVAC Roanoke, TX
Address: 776 Henrietta Creek Road, Suite 100, Roanoke, TX 76262
Room:
Instructor(s): Michael Wirtzberger (Primary Instructor)

Training Hours: 8 Hours 0 Min

If the training address does not appear above, please use the below address:

Please ensure that you download or print the **Training Material** prior to the class. Training documents can be found [here](#), sorted by class name.

Please accept this meeting request to add this session to your Outlook or Google calendar.

If you can no longer attend this session, please withdraw by clicking the "Withdraw" link from your [Transcript](#) in the SAMSUNG BUSINESS ACADEMY portal.

If you have questions, please submit them by replying to this message.

2018 Corporate Bulletin 2018-0904 Training Materials.PDF

Note: If you do not receive with email within 15 minutes, check your Junk/Spam folder.
Add [*@samsunghvac.com](mailto: *@samsunghvac.com) to trusted sites.

14

On - Demand Training

- ① Open Menu. (☰)
- ② Click "Browse for Training".
- ③ Click "Browse All".
- ④ Click "Type"*.
- ⑤ Select course and click "Launch".

*Online, Video and Materials.

©2019 Samsung All rights reserved. **SAMSUNG**

15

Thank You for setting up your account in class!

©2019 Samsung All rights reserved. **SAMSUNG**

16

DVM S VRF Technology Defined

- Digital Variable Multi
- Applications
 - 6 – 44 tons, per system
 - 1 - 3 outdoor units
 - 64 indoor units per system
 - Single refrigerant network
 - Up to 3,280 ft. collective piping length
 - Capacity is controlled by
 - Inverter driven variable speed scroll compressors
 - Electronic expansion valves
 - Capacity control
 - Is based on the individual zone load changes
 - Allows for increased system efficiency in part load conditions




©2019 Samsung All rights reserved.

SAMSUNG

17

VRF Heat Pump Systems

- Heat Pump Systems
 - Heating or cooling
 - Not simultaneous
 - 2-Pipe refrigerant network
 - Liquid & Dual pressure gas
 - Utilizing Y-Joints/Headers

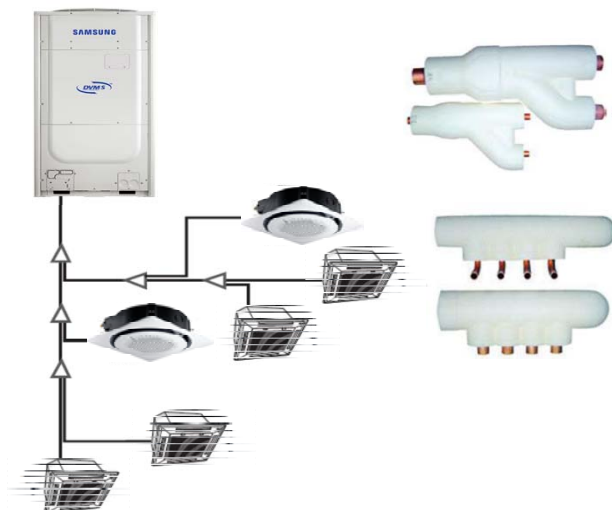

©2019 Samsung All rights reserved.


SAMSUNG

18

VRF Heat Recovery Systems

Heat Recovery Systems

- Simultaneous heating and cooling operation
- Auto changeover control
- 3-pipe refrigerant network
 - Liquid
 - Low pressure gas
 - Dual pressure vapor
- Utilizing MCU'S & y-joints

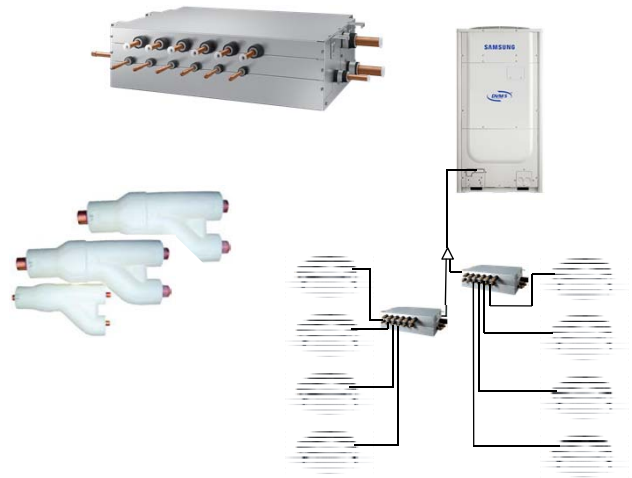


©2019 Samsung All rights reserved.

SAMSUNG

19

VRF Air Cooled Configurations - Single & Modular

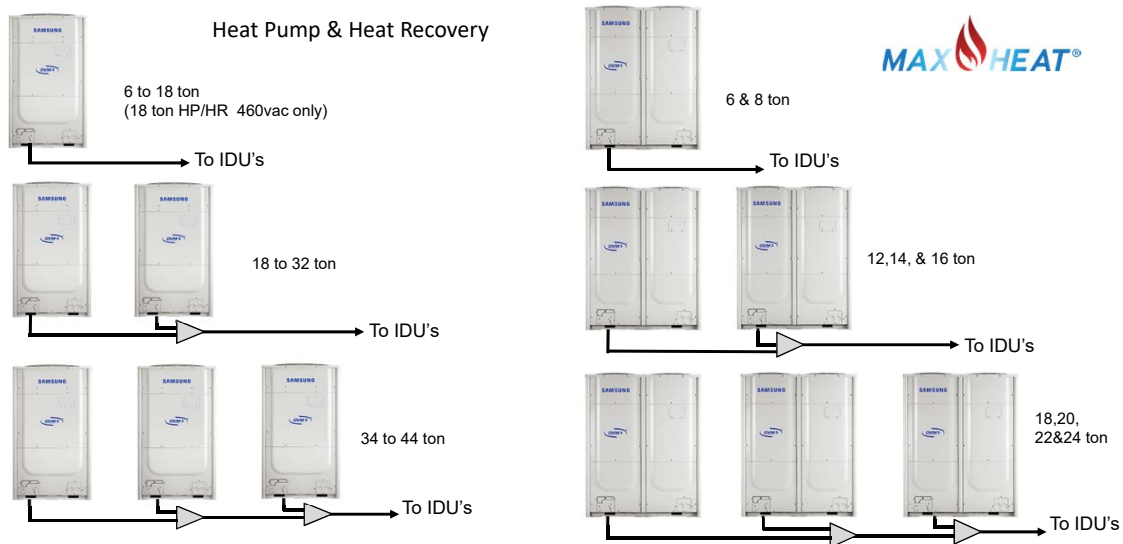


©2019 Samsung All rights reserved.

SAMSUNG

20

VRF Water Cooled Configurations - Single & Modular

- 3 phase condensers
 - 6,8,10 ton single compressor units
 - 16 & 20 ton dual compressor units
- Field configured Heat Pump or Heat Recovery operation
 - Requires "K" tactile setting and HP valve set
- Closed loop condenser water circuit
- If hydrothermal or open cooling towers are used, additional heat exchangers must be installed.

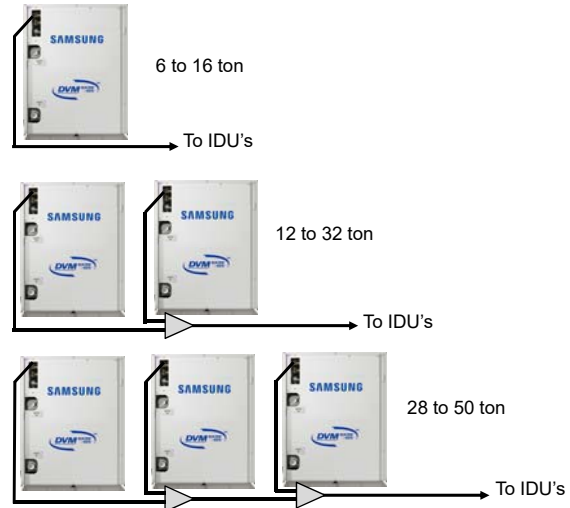


©2019 Samsung All rights reserved.

SAMSUNG

21

Condenser Water Circuit Applications

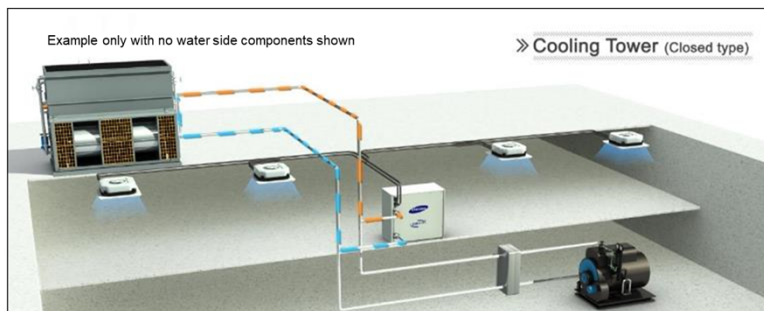

- Closed loop circulating water must have proper water treatment (Samsung specifications)
- Standard operating water temperature: 50°F to 113°F (without antifreeze)
 - Inlet water temperature below 50°F requires antifreeze
 - Lowest inlet water temperature: 14°F (requires antifreeze rated below 5°F)
 - Refer to Samsung Water Design Guide


NOTE: ALL closed loop designs require Samsung's water quality management – See Installation Manual for water quality requirements

©2019 Samsung All rights reserved.


SAMSUNG

22

Condenser Water Circuit Applications

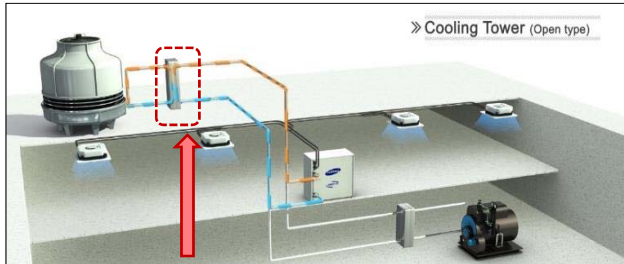

Example only with no water side components shown

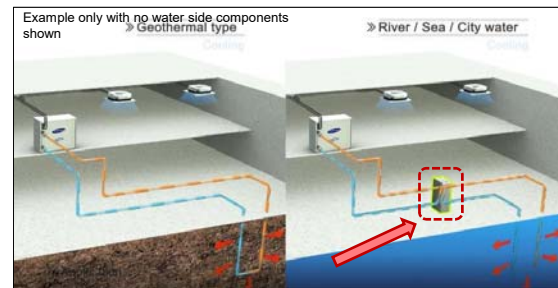


When using an open type cooling tower, an intermediate heat exchanger must be used

©2019 Samsung All rights reserved.

SAMSUNG

23

Condenser Water Circuit Applications

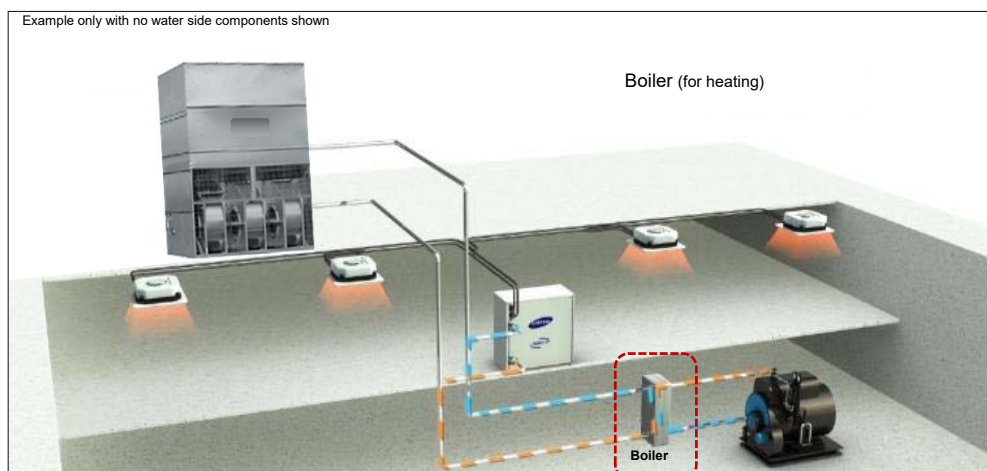

Boiler is used to temper water loop temperature in heating operation


©2019 Samsung All rights reserved.

SAMSUNG

24

DVM S System Power & Control Circuits

- Line voltage
 - Outdoor:
 - Dedicated 3 Phase 208/230 or 460 circuit
 - Indoor:
 - Dedicated 208/230vac 1 phase circuit
 - MCU
 - Dedicated 208/230vac 1 phase
- Control Circuits
 - Communication
 - 2 conductor control wire
 - 16/2 stranded with shield

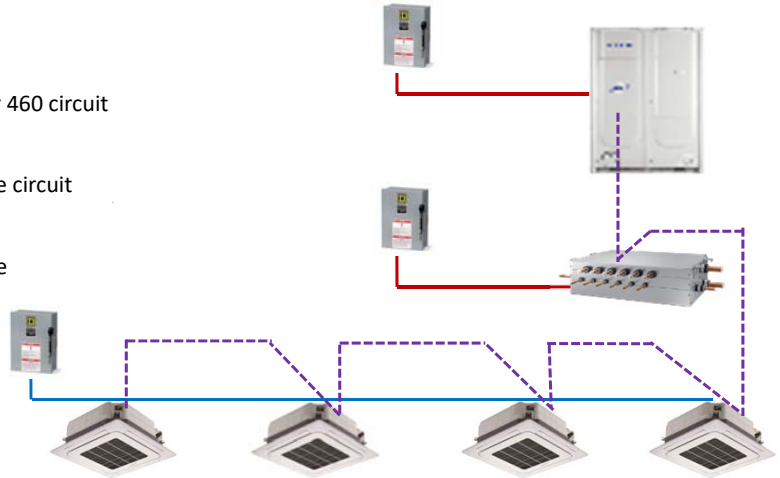


©2019 Samsung All rights reserved.

SAMSUNG

25

Indoor Fan Coil Basic Operation

- Internal EEV controls individual fan coil superheat and subcooling based on load demand
- Indoor temperature read from
 - Indoor unit return air sensor
 - Wired controller sensor
 - External room temperature sensor

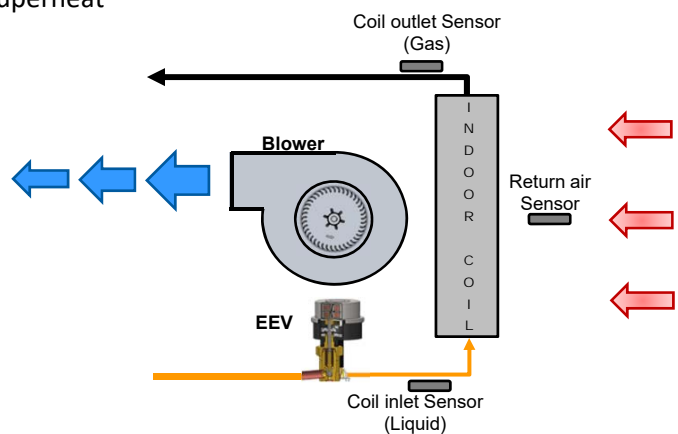


©2019 Samsung All rights reserved.

SAMSUNG

26

Capacity Connection Ratio

- Maximum outdoor unit capacity in relation to total capacity of the connected indoor units
- Indoor unit capacity can be greater or lower than outdoor unit maximum capacity
 - DVM S connection ratio range: 50% - 130%

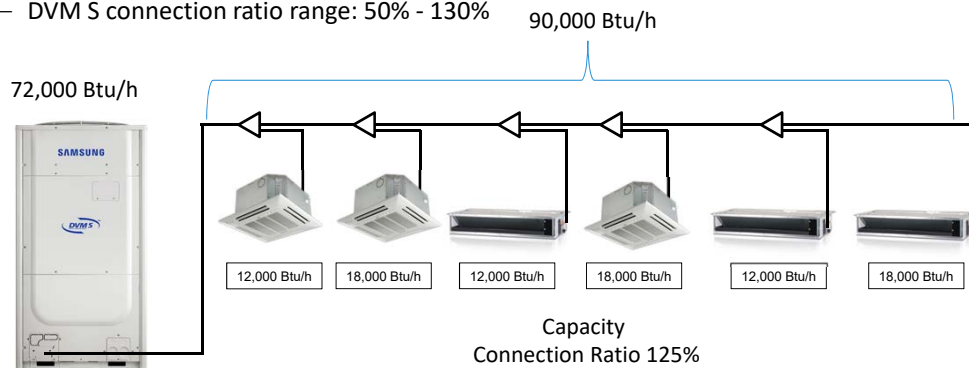

NOTE: Total system operating capacity is limited to the nominal outdoor unit capacity


©2019 Samsung All rights reserved.

SAMSUNG

27

DVM PRO Software

- Every great job starts and finishes with DVM PRO
 - Piping Size and layout
 - Power & Communication Wiring
 - System Match Ups
 - Charge Adjustment

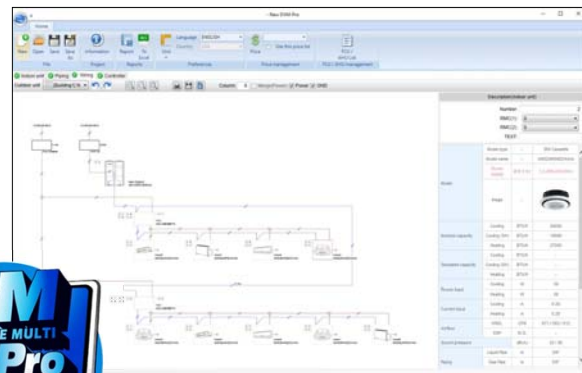


©2019 Samsung All rights reserved.

SAMSUNG

28

Piping Size and Layout

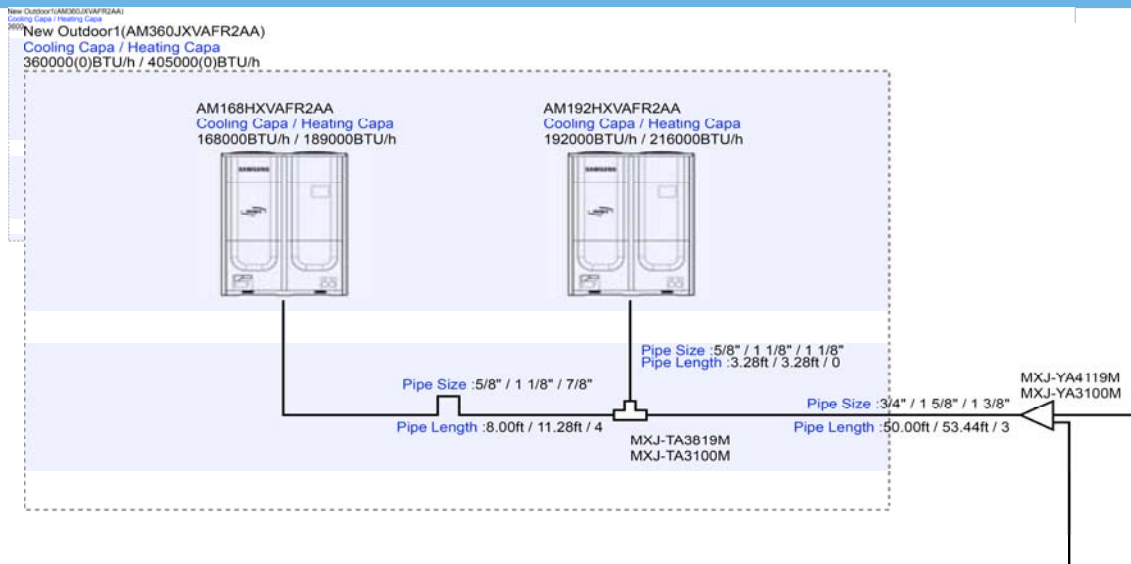


©2019 Samsung All rights reserved.

SAMSUNG

29

Wiring

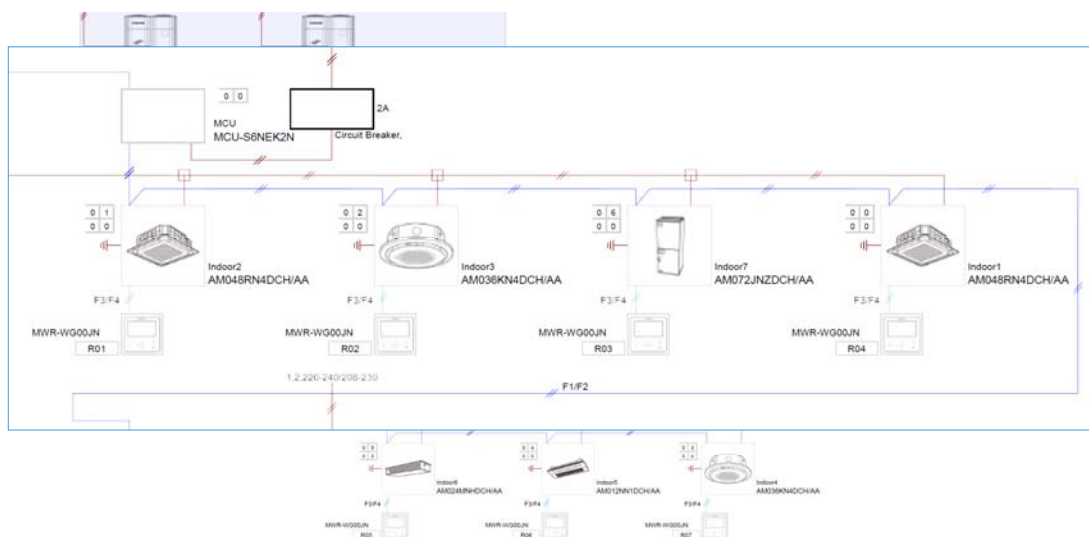

©2019 Samsung All rights reserved.

SAMSUNG

30

System Match up & Charge Adjustment

1) Equipment list

Categories	Model name	Qty	Categories	Model name	Qty
DVM S(NEW)	AM360JXVAFR2AA	1		MXJ-TA3819M	1
	AM168HXVAFR2AA	1		MXJ-TA3100M	1
Wind-Free 4Way Cassette	AM048RN4DCH/AA	2		MXJ-YA4119M	1
360 CST (Circle)	AM036KN4DCH/AA	2		MXJ-YA3100M	1
Wind-Free 1Way Cassette	AM012NN1DCH/AA	1		DB96-23143A	1
DUCT S	AM024MNHDC/AA	1		DB96-23144A	1
Multi AHU(Vertical)	AM072JNZDCH/AA	1	Mode Change Unit	MCU-S6NEK2N	2

2) Piping length

Length as pipe diameter		1/4"	3/8"	1/2"	5/8"	3/4"	7/8"	1"	1 1/8"	1 1/4"	1 3/8"	1 1/2"	1 5/8"	1 3/4"	1 7/8"	2"	2 1/8"
1. Liquid piping	ft	3.28	33.69		36.29	50.00											
2. Gas piping	ft			3.28	16.40	17.29			36.29				50.00				
3. High pressure gas piping	ft				3.28			8.01			28.28		50.00				
Restriction of pipe length		Restriction (Based on installation manual)						Actual piping length				Equivalent piping length					
1. Total piping length	ft							3281.00				126.21					
2. Maximum piping length	ft							656.00				99.48					
3. Main pipe length	ft											50.00					
4. Piping length between the first branch and the farthest indoor unit	ft							148.00/295.28				40.49					
5. Level difference between outdoor and indoor unit(Max) (OD above ID unit / OD below ID unit)	ft							131.23/360.99				3.28					
6. Level difference between indoor units	ft							131.23				121.46					

3) Basic and additional charging ref. amount

Basic (Factory) charge ref. amount : 48.502 lbs

Additional Field charging ref. amount : 30.644 lbs

Total number of bendings : 13

©2019 Samsung All rights reserved.

SAMSUNG

31

Outdoor Unit Basic Installation

- It is important to follow Samsung's outdoor unit placement guidelines
 - Specific placement guidelines are referenced in the DVM S Installation Manual
- Failure to follow these recommendations can severely impact system capacity, performance & reliability
- Improper placement can also shorten equipment service life
- Installations must always follow national, state and local HVAC and electrical codes to insure compliance

©2019 Samsung All rights reserved.

SAMSUNG

32

Air Cooled Outdoor Unit Nomenclature

Example: AM 072 F X V A F H / AA

① ② ③ ④ ⑤ ⑥ ⑦ ⑧

① Classification

AM	DVM S
----	-------

② Capacity

3 digits x 1,000 Btu/h

③ Version

F	2013
H	2014
J	2015
K	2016
M	2017
N	2018

④ Product Type

X	Outdoor Unit
N	Indoor Unit

⑤ Unit Type

V	DVM S Outdoor Unit – 72,000 MBtu and larger
---	---

⑥ System Orientation Type

A	Modular outdoor unit – 72,000 MBtu and larger
T	Low temp – high EER

⑦ Voltage

F	208/230vac 3 Ph
J	460vac 3 Ph

⑧ Mode

H	Heat Pump
R	Heat Recovery

©2019 Samsung All rights reserved.

SAMSUNG

33

Water cooled Nomenclature – Outdoor unit

Example: AM 220 K X W A N H AA

(1) (2) (3) (4) (5) (6) (7) (8) (Buyer)

(1) Classification
AM DVM

(2) Capacity (3Digit)
BTU x 1000

(3) Year
E 2012
F 2013
H 2014
J 2015
K 2016
M 2017

(5) Feature 1
W DVM Water

(6) Feature 2
A STANDARD / GENERAL / MODULE

(7) Voltage
F F(208~230V, 60Hz, 3Φ)
J J(460V, 60Hz, 3Φ)

(8) Mode
R Heat Recovery R410A

©2019 Samsung All rights reserved.

SAMSUNG

34

Outdoor Unit Features

- Operating Temperature Range
 - Cooling: 23°F – 120°F (-13°F w/LACH1(2) Low Ambient Cooling Hood)
 - Heating: -13°F – 75°F (“MAX HEAT” 100% capacity at -13°F)
- Compressor modulation
 - Cooling: Target refrigerant low pressure
 - Sample Rate every 40 Seconds
 - Heating: Target refrigerant high pressure
 - Sample Rate every 40 Seconds
- Features
 - Indoor & Outdoor PCB – Removable EEPROM
 - Intelligent Defrost
 - Flash & Vapor Injection inverter scroll compressors
 - Advanced oil recovery cycle logic


©2019 Samsung All rights reserved.

SAMSUNG

35

Outdoor Unit Placement

- Support the unit a minimum of 8 inches above grade, install above the normal snow line

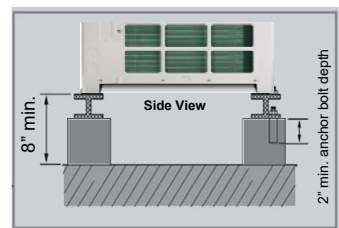

©2019 Samsung All rights reserved.

SAMSUNG

36

Outdoor Unit Placement

- Units must be installed on rails, or support structure for proper defrost operation or damage to the equipment may occur



©2019 Samsung All rights reserved.

SAMSUNG

37

Outdoor Unit Placement





©2019 Samsung All rights reserved.

SAMSUNG

38

Single Unit Installation - Clearances Based on Wall Height

Wall height 20" or less

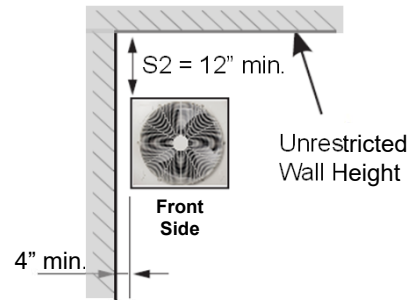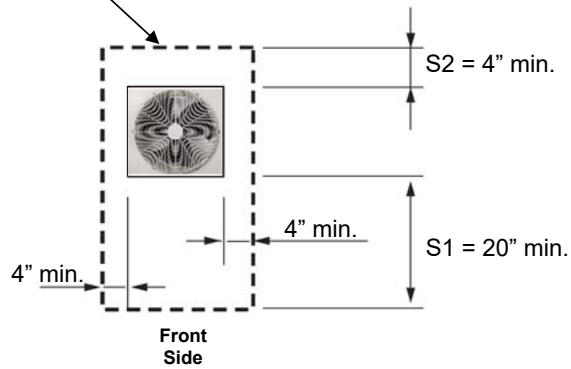



©2019 Samsung All rights reserved.

SAMSUNG

39

Module Unit Installation - Clearances Based on Wall Height

- Height of the wall on the front side should not exceed 60"
- Height of the wall on the air inlet side should not exceed 20"

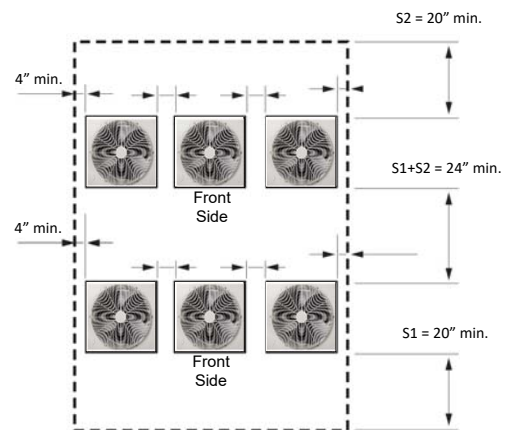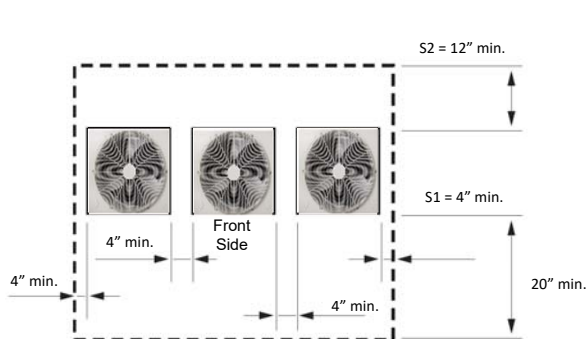


©2019 Samsung All rights reserved.

SAMSUNG

40

Module Unit Installation - Clearances Based on Wall Height

- If wall height exceeds the standard wall height
- Additional clearance of Half of the exceeded wall height must be added to the service space

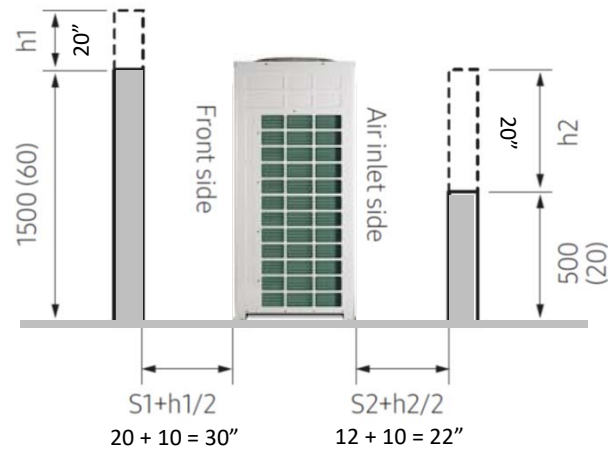


©2019 Samsung All rights reserved.

SAMSUNG

41

Module Unit Installation - Clearances Based on Wall Height

- Multiple systems with only two walls

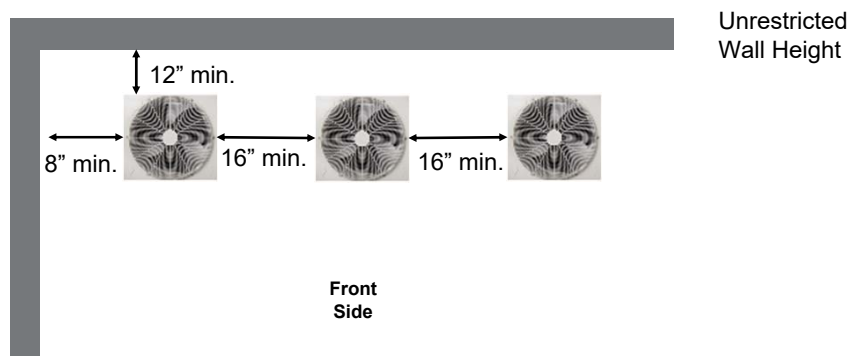

©2019 Samsung All rights reserved.


SAMSUNG

42

Water Cooled Clearance

Single installation

When the water pipe passes through top of the product

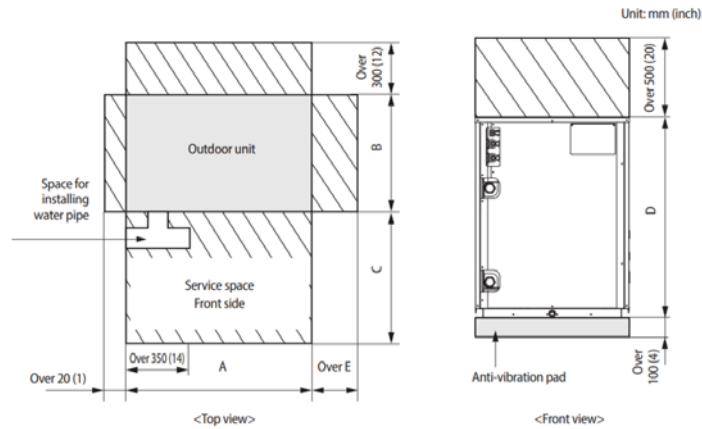


©2019 Samsung All rights reserved.

SAMSUNG

43

Water Cooled Clearance

Module or continuous installation

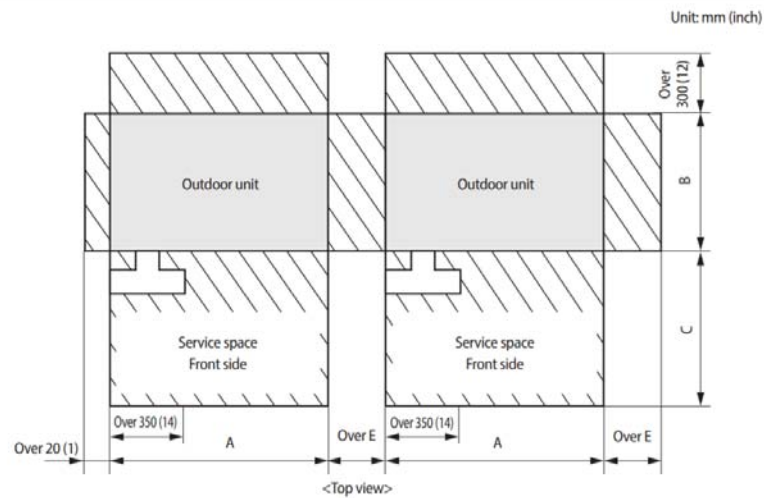


©2019 Samsung All rights reserved.

SAMSUNG

44

Water Cooled Clearance

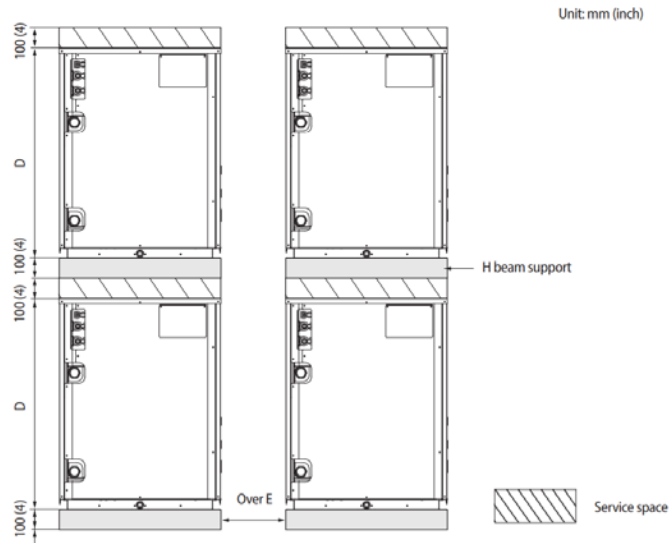

©2019 Samsung All rights reserved.

SAMSUNG

45

Outdoor Unit Placement Corrosive Atmospheres

- Avoid locations near bathroom and exhaust hood ventilators, boiler stacks or other corrosive atmospheres, etc.




©2019 Samsung All rights reserved.

SAMSUNG

46

Outdoor Unit Placement – Coastal Installations

- Outdoor units should never be installed in locations where direct sea/ocean breezes prevail
- In coastal locations, outdoor units should be installed behind the building, wall or other obstruction to protect against direct winds
- Refer to installation and technical guides for exact specifications

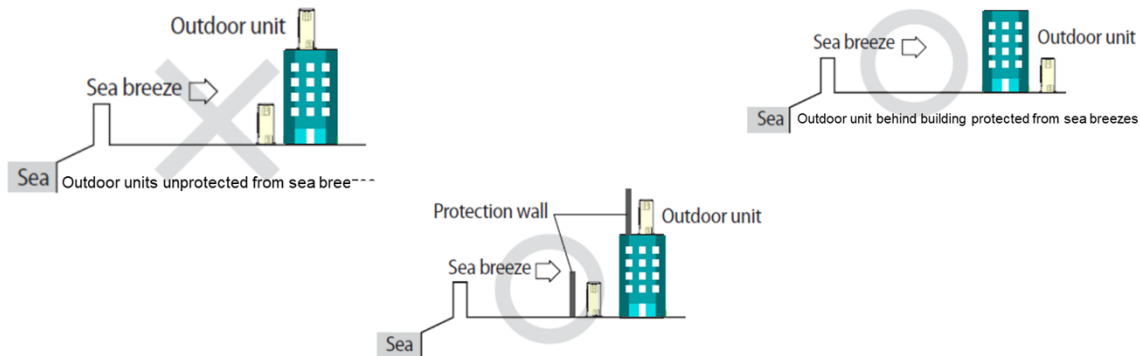


©2019 Samsung All rights reserved.

SAMSUNG

47

Outdoor Unit Wind/Hail Guards

- Protection from
 - high winds, Hail
 - Snow accumulation, Debris
- Single unit installation requires
 - Left, Right & Rear Guard required
- Modular systems
 - 1 left , 1 right guard, Multiple rear guards
- Top guard
 - May be installed facing forward or backward
 - Must be installed opposite of prevailing wind direction
- NOTE: Wire fan blade guard(s) must stay in place – do not remove

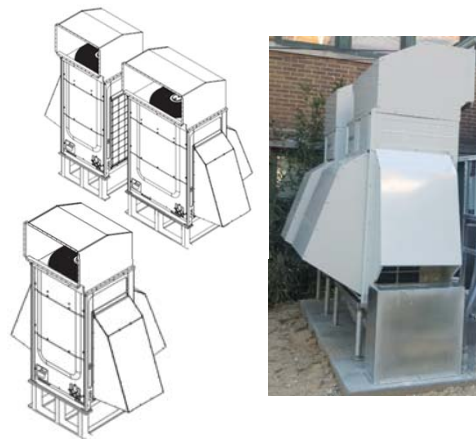

©2019 Samsung All rights reserved.

SAMSUNG

48

Outdoor Unit Low Ambient Cooling Hood Kit

- Operating range down to -13°F
- Includes
 - Side guards, Top hood, Damper assembly
 - Damper actuator, Control PCB
 - Control transformer
- 208/230vac 1 Ph power required
- ODU must be installed $\geq 22''$ above normal snow level
- Damper hood must be positioned away from prevailing wind
- NOTE: Wire fan blade guard(s) must be removed to reduced noise potential



©2019 Samsung All rights reserved.

SAMSUNG

49

Water Cooled Condenser Placement Guidelines

- DVMS Water condensers must be installed indoors only
 - Ambient temperature range: 33°F - 104°F <80% RH
 - Installation area must be ventilated
 - Condensers must be installed on a solid level surface
 - Minimum of 24 inch service clearance required in front of unit
- Refrigerant piping can be installed below or above condensers



©2019 Samsung All rights reserved.

SAMSUNG


50

Water Cooled Condenser Placement Guidelines

- Condenser(s) must be properly supported
- Condenser base pans have a condensate drain fitting to direct condensate removal during unit operation
- Drain piping does not require a trap



Solid level base

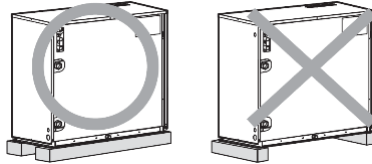

©2019 Samsung All rights reserved.

SAMSUNG

51

General Indoor Unit Installation Recommendations

- Always refer to the specific indoor unit Installation Manual for the proper clearances, placement and installation procedures
- Follow all national, state and local codes to insure installation compliance
- Every installation should be laid out onsite to insure proper placement of the indoor units and refrigerant lines
- Any indoor unit which is installed in an area where the temperature is above 80°F and the humidity rises above 80%, the body of the indoor unit should be insulated with a minimum of 3/8" insulation
- All indoor unit refrigerant flare connections must be completely insulated
- Indoor units must be installed level to insure proper condensate removal and float switch operation
- Proper service access must be provided for each indoor unit as indicated in the Installation Manuals

©2019 Samsung All rights reserved.

SAMSUNG

52

Indoor Unit Model Nomenclature

AM 0 F N * D C H / AA**

① Classification
AM = DVM S

② Capacity
3 digits x 1,000 Btu/h

③ Version
E = 2012
F = 2013
G = 2014
J = 2015
K = 2016
M = 2017
N = 2018

④ Product Type
N = Indoor Unit

⑤ Unit Type
1 = 1-Way Cassette
4 = 4-Way/360 Cassette
N = Mini 4-Way Cassette
L = Slim Duct
M = MSP Ducted
H = HSP Ducted
Q = Wallmount
C = Ceiling/Under Ceiling
Z = Multi-position AHU
G = Floor Standing
F = Concealed Floor Standing

⑥ System Orientation Type

⑦ Voltage
C = 1Ø, 208/230vac, 60Hz

⑧ Mode
H = Heat Pump


©2019 Samsung All rights reserved.

SAMSUNG

53

Indoor Unit Power Wiring

- Connect the 208-230vac 1Ø wires to the 1(L) and 2(N) terminals in each indoor unit
- Ensure the unit is properly grounded for proper operation and safety
- Do not connect the main ground at the same point where the indoor unit PCB is grounded

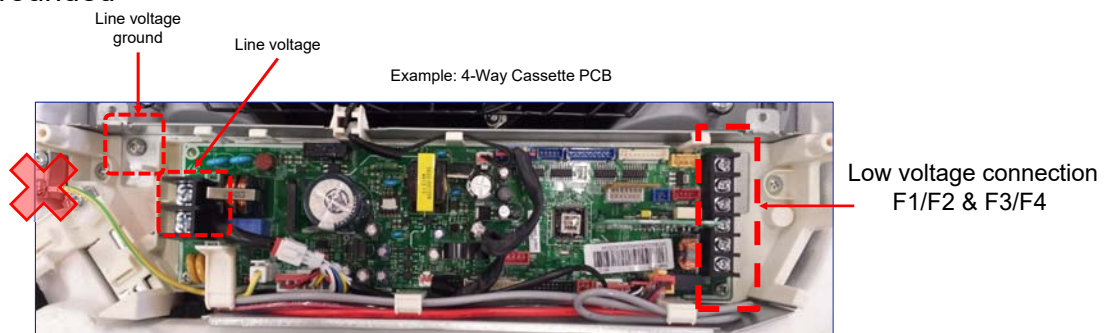



©2019 Samsung All rights reserved.

SAMSUNG

54

Indoor Unit Placement Documentation

- Document each unit's model, serial number and location and ID on a field supplied log form
 - Remove the model and serial sticker from the box
 - Place stickers on a field supplied log form to track location of units
 - SNET Pro 2 Service Software, can be viewed based on their serial number
 - Location can be edited in SNET Pro 2

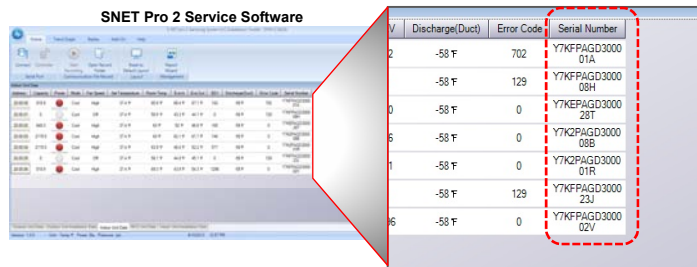

©2019 Samsung All rights reserved.

SAMSUNG

55

Cassette Features

Feature	Wind-Free™ 4 way	Wind-Free™ Mini 4 way	1 Way Wind-Free™
Capacity Mbtu	09,12,18,24,30,36,48	05,07,09,12,18,20	07,09,12
Controls	Wireless or wired	Wireless or wired	Wireless or wired
Louvers	4 x auto swing, independent control	4 x auto swing, independent control	Single powered discharge louver
Condensate	Built in pump 29" lift with check valve	Built in pump 29" lift with check valve	Built in pump 29" lift with check valve
Fan	3 speed	3 speed	3 Speed
Filter	Electrostatic washable air filter included. Optional MERV 13	Electrostatic washable air filter included	Electro-static washable
Facia Panel	Sold separately	sold separately	Sold separately
Metering device	Factory installed EEV	Factory installed EEV	Factory installed EEV



The Wind-Free™ unit delivers an air current that is under 0.15 m/s while in Wind-Free™ mode. Air velocity that is below 0.15 m/s is considered "still air" as defined by ASHRAE (American Society of Heating, Refrigerating, and Air-Conditioning Engineers).

©2019 Samsung All rights reserved.

SAMSUNG

56

Cassette Features

Feature	360	Under Ceiling/ Floor	Big Ceiling
Capacity Mbtu	09,12,18,24,30,36 & 48	18 & 24	36 & 48
Controls	Wireless or wired sold separately	Wireless or wired sold separately	Wireless or wired sold separately
Louvers	Bladeless air direction control	Powered air discharge louver	Motorized adjustable louver from 4° to 45°
Condensate	Built in pump 29" lift with check valve	Gravity condensate drain	Gravity condensate drain
Fan	3 Speed	3 Speed	3 Speed
Filter	Electrostatic washable air filter included	Electrostatic washable air filter included	Electrostatic washable air filter included
Facia Panel	Sold separately (white or black)	Included	included
Metering device	Factory installed EEV	Requires external EEV kit	Factory installed EEV






©2019 Samsung All rights reserved.

SAMSUNG

57

Basic Cassette Installation

- Layout position using included template
- Clearances
 - $\geq 5\text{ft.}$ from walls or smoke detectors
 - multiple cassettes $\geq 10\text{ft.}$ apart
- Maintain $\frac{1}{2}"$ to $\frac{3}{4}"$ gap between unit & ceiling
 - Refer to installation manual for specific requirements
- Installation
 - Recommended to use rubber vibration washers
 - Install double nuts on the threaded rod
 - For enclosed ceilings provide access panel(s) for future servicing (18"x18")
 - Hold cassette by the mounting brackets to avoid potential damage

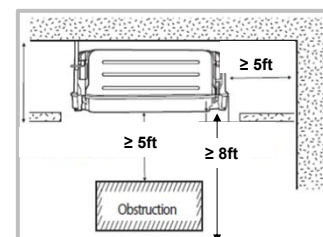


©2019 Samsung All rights reserved.

SAMSUNG

58

4-Way Cassette Fascia Panel Installation

- Fascia panel installation is similar for the 4-Way & Mini 4-Way cassettes
 - Remove the electrical box cover
 - Open the fascia return grille
 - Align the fascia panel in the correct position and lift up to the unit and use the 2 hooks to clip the panel to the body

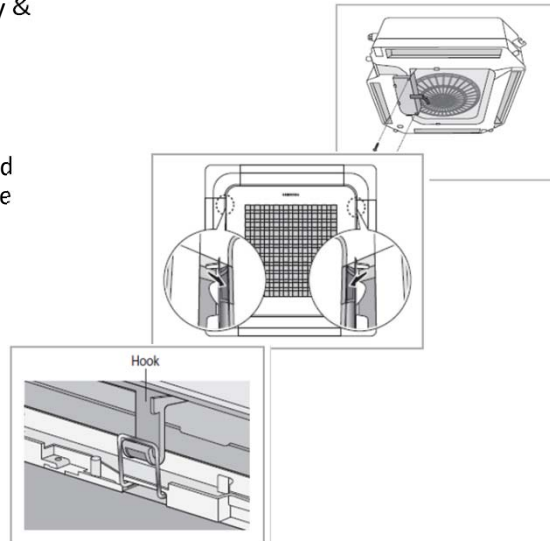


©2019 Samsung All rights reserved.

SAMSUNG

59

4-Way Cassette Fascia Panel Installation

- Remove the 4 corner trim pieces and install the 4 mounting bolts loosely
- Adjust each bolt to secure the fascia panel to the ceiling without any gaps
- Connect the 3 wire harnesses from the fascia panel into the unit electrical box
- Close the electrical box cover and tighten the screws
- Close the fascia return grille

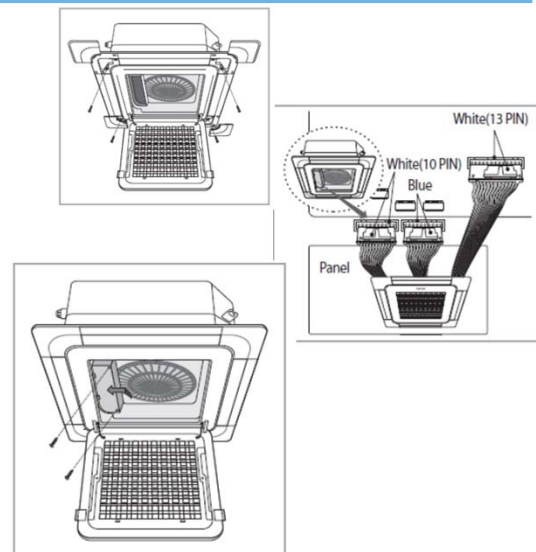


©2019 Samsung All rights reserved.

SAMSUNG

60

1-Way Ceiling Cassette Fascia Panel Installation

- After adjusting the unit height in relation to the ceiling with the included gauge:
- Orient the panel in the proper direction before lifting it into place
- Lift the panel up to the unit guiding the panel hooks into the openings on the unit chassis
- Guide the louver and display wires into the PCB box, making sure not to pinch or damage them
- Push upwards until the hooks catch in the provided openings

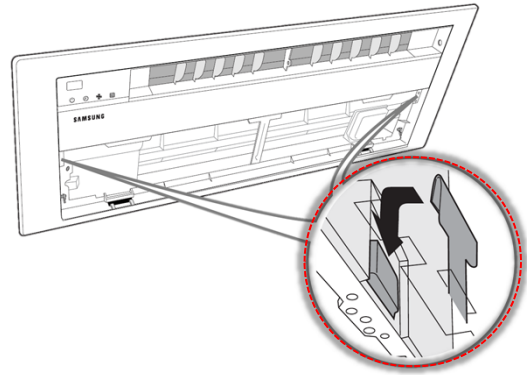


©2019 Samsung All rights reserved.

SAMSUNG

61

1-Way Ceiling Cassette Fascia Panel Installation

- Making electrical connections on one way cassette

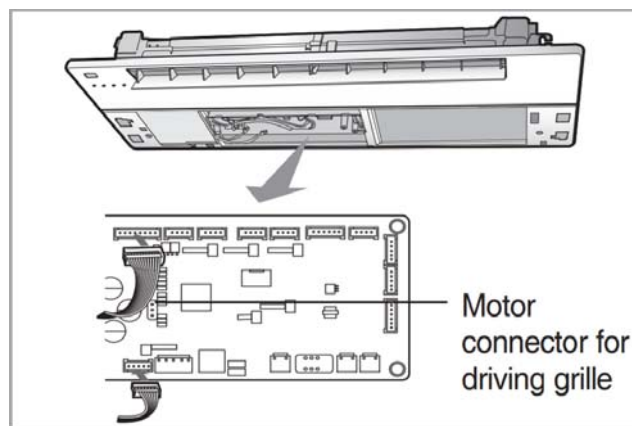


©2019 Samsung All rights reserved.

SAMSUNG

62

1-Way Ceiling Cassette Fascia Panel Installation

- With the provided hardware, screw the panel to the unit
- Take care not to overtighten to prevent damaging the panel
- Insure that the panel is snug to the ceiling to prevent air leakage and potential condensation issues
- Install the 3 white screw covers by the supply air outlet louver

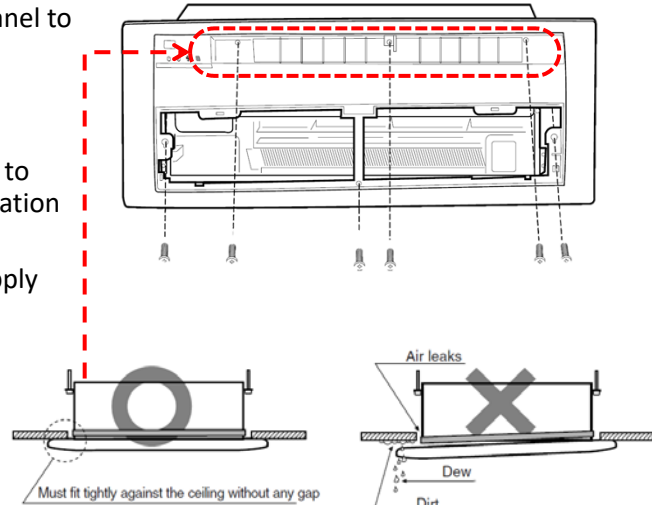


©2019 Samsung All rights reserved.

SAMSUNG

63

360 "Open Type" Fascia Panel Installation

- Raise the panel up onto the unit body and rotate clockwise to secure into place
- Adjust the unit so there is no gap between the panel and the ceiling

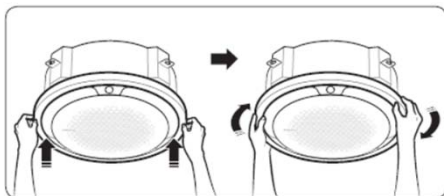


©2019 Samsung All rights reserved.

SAMSUNG

64

360 "Ceiling Type" Fascia Panel Installation

- Remove the 4 corner panels by pressing the 2 tabs on each panel
- Lift the fascia panel up and press each corner up until it clicks into place
- Press the center of each side into place one at a time until it clicks into place
- Insert the 4 screws into the panel front and adjust until there is no gap between the panel and ceiling
- Snap into place each corner panel to the fascia panel to complete the installation

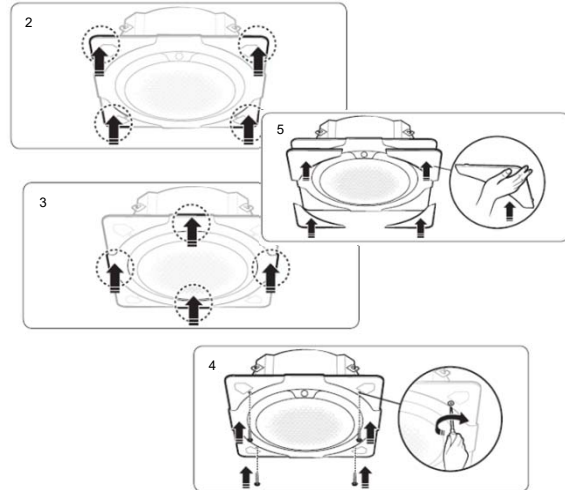


©2019 Samsung All rights reserved.

SAMSUNG

65

Ceiling Type & Big Ceiling Type Installation

- Ceiling Type & Big Ceiling Type units are installed horizontally under the ceiling
- Maintain at least 12" clearance on the sides and 2" on rear
- Pitch the unit backwards slightly for proper Condensate drainage

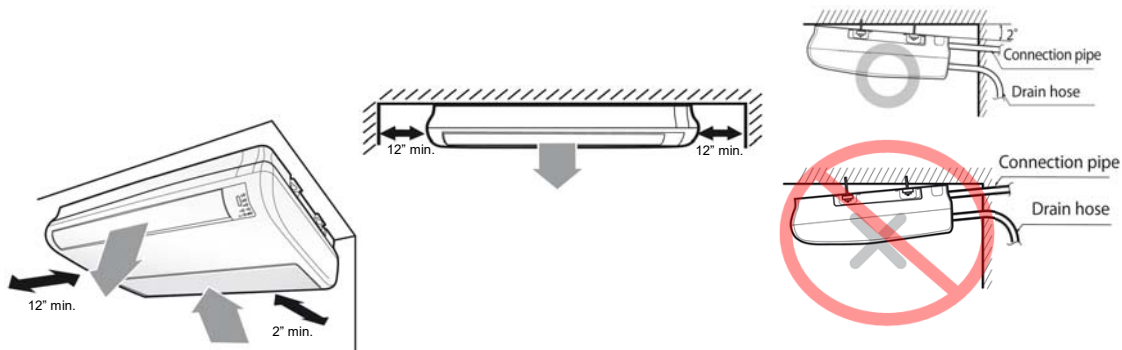


©2019 Samsung All rights reserved.

SAMSUNG

66

Ceiling Unit Clearances - Wall Installation

- When hanging the unit on the wall, use the supplied hanging brackets
- Unit must be installed level for proper condensate removal
- Connect to wall studs or backer plate

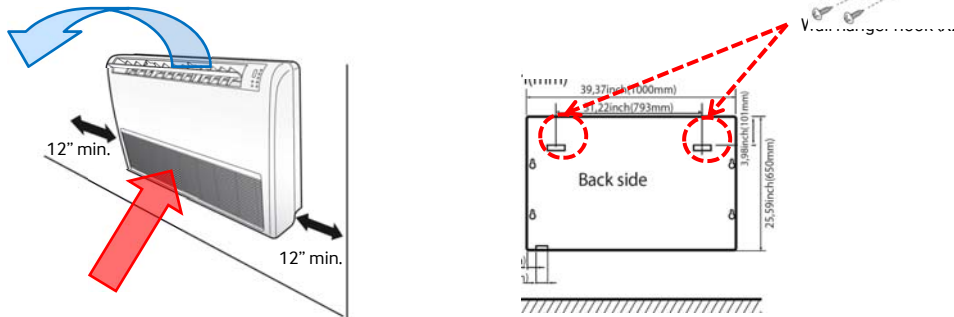

Note: Install unit high enough from floor to prevent damage from brooms, feet, vacuums, etc.


©2019 Samsung All rights reserved.

SAMSUNG

67

Ceiling Cassette Condensate Drain Piping

- Ceiling cassette have condensate lift pumps rated for a max 29" lift
 - from the bottom of the unit
- Inside diameter of the condensate drain outlet & riser piping must not exceed $\frac{3}{4}$ " ID
- The flexible hose should be installed level or bent downward
- Condensate piping installation must be in accordance with state and local codes
 - Condensate lines may require insulation in high humidity areas
 - The condensate lines must be properly supported with hangers every 40" to 60"

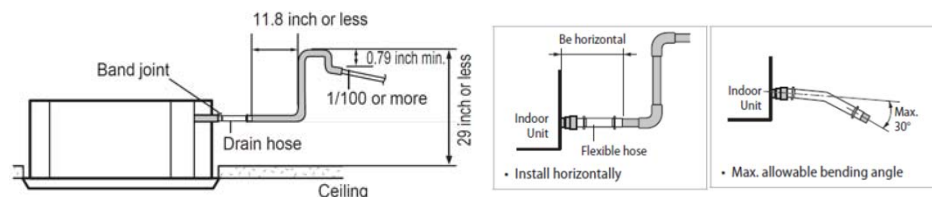

©2019 Samsung All rights reserved.

SAMSUNG

68

Condensate - Flexible Hose and Coupler



©2019 Samsung All rights reserved.

SAMSUNG

69

Multiple Cassette Condensate Drain Piping

- The individual drain lines must tap into the main drain line from the top only
- Failure to install the drain piping correctly may cause check valve and pump failure, including water leaks
- Condensate drain piping within the building must be properly insulated




©2019 Samsung All rights reserved.

SAMSUNG

70

Cassette Fresh Air

- Fresh air can supplied for all cassette units except for 1-Way and Under Ceiling/Low Wall Mount cassettes
 - 0" static unit, booster fan must be used
 - Fresh air must be pre-filtered
 - Optional MIM-B14 External Contact Controller can interlock the booster fan

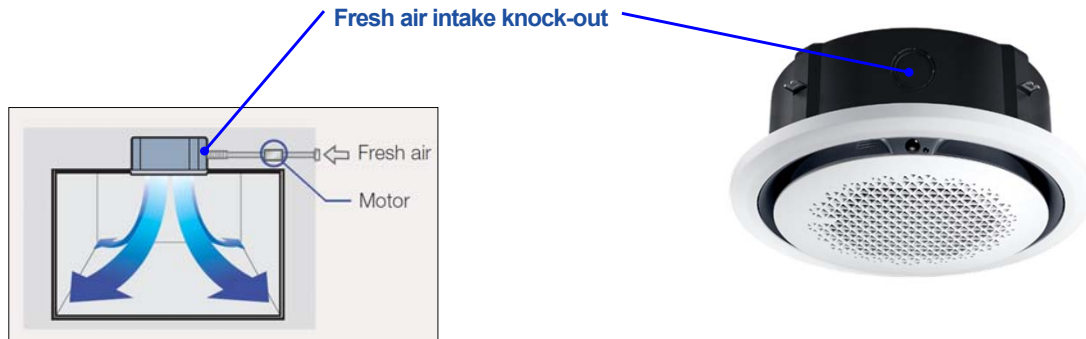

©2019 Samsung All rights reserved.

SAMSUNG

71

Cassette Fresh Air Allowances

Small Chassis		Medium Chassis		Large Chassis	
AM0**FNNDCH/AA		AM0 09/12/18/24 FN4DCH/AA		AM0 30/36/48 FN4DCH/AA	
P ("W.C.)	Q (CFM)	Q (CFM)	Q (CFM)	P ("W.C.)	Q (CFM)
0	0	0	0	0	0
0.02	5	0.04	14	0.04	17
0.04	7	0.08	21	0.08	31
0.05	9	0.12	27	0.12	44
0.08	13	0.16	32	0.14	50
0.10	15	0.20	37	0.16	55
0.12	17	0.24	42	0.20	66
0.14	18	0.28	47	0.24	76
0.16	20	0.31	52	0.28	85
				0.40	106



Small Chassis	
18, 24K	
P ("WC)	Q (CFM)
0.0	0.00
0.01	9.88
0.012	14.83
0.017	18.72
0.023	21.89
0.029	28.07
0.037	27.9

Large Chassis	
30K ~ 48K	
P ("WC)	Q (CFM)
0.0	0.00
0.01	9.53
0.012	14.48
0.017	18.01
0.023	21.19
0.029	24.37
0.037	27.19

©2019 Samsung All rights reserved.

SAMSUNG

72

Big Ceiling Fresh Air Allowances

Big Ceiling 36Mbtu	
" W.C	CFM
0	0
0.04	60.03
0.08	76
0.11	90
0.16	100
0.2	111
0.24	119
0.26	127
0.31	135
0.35	142
0.39	148
0.43	155
0.47	161



Big Ceiling 48 Mbtu	
" W.C	CFM
0	37
0.04	61
0.08	77
0.11	90
0.16	101
0.2	111
0.24	119
0.26	127
0.31	135
0.35	142
0.39	149
0.43	155
0.47	161



©2019 Samsung All rights reserved.

SAMSUNG

73

No Fresh Air Allowance



©2019 Samsung All rights reserved.

SAMSUNG

74

Wall Mount unit Features

Feature	MAX	Whisper
Capacity Mbtu	32	05,07,09,12,15,18,24 & 28
Controls	Sold Separately Integrated IR receiver Wireless/Optional wall controller	Sold Separately Integrated IR receiver Wireless/Optional wall controller
Louvers	Single powered louver	Single powered louver
Cabinet	Rectangular	Triangle
Fan	3 speed	3 speed
Condensate	Gravity condensate drain,	Gravity condensate drain,
Filter	Electro-static washable	Electro-static washable



©2019 Samsung All rights reserved.

SAMSUNG

75

General Wall mount Placement

- Recommended minimum clearances from air outlet to nearest obstruction:
 - 7,500 Btu/h – 10 ft.
 - 9,000-12,000 Btu/h – 15 ft.
 - 18,000 – 24,000 Btu/h – 25 ft.
- Eliminates potential for discharge air recirculation
- Wall mount unit must be installed at least 5ft above the floor




©2019 Samsung All rights reserved.

SAMSUNG


76

Whisper Wall mount Installation

- Removing the front cover
- The bottom cover panel must be removed by releasing the side hooks then the center and bottom hooks
- Refer to the Installation Manual for complete unit installation procedures

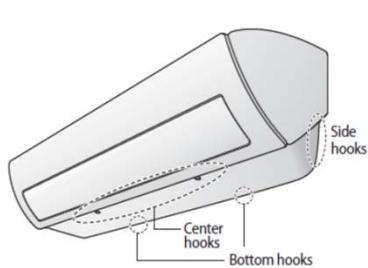

- * Caution (fragile)
 - Gently press the both side of the cover panel inwards (①) and release the hooks on both sides (②).



- * Caution (fragile)
 - Use both hands
 - Release each hook by pushing it up at an angle.



©2019 Samsung All rights reserved.

SAMSUNG

77

General Wall mount Placement

- Remove the Hangar plate from the unit
- Install the included wall bracket to the wall – must be level
- Secure to framing or use appropriate anchors
- Determine the exit point for the refrigerant tubing, condensate drain pipe and wiring
- When exiting through a wall drill a hole 2.5" to 3" **must be properly sealed**
 - The hole should have a downward slant

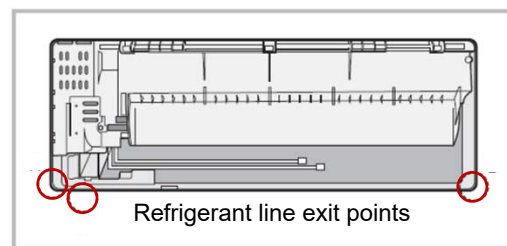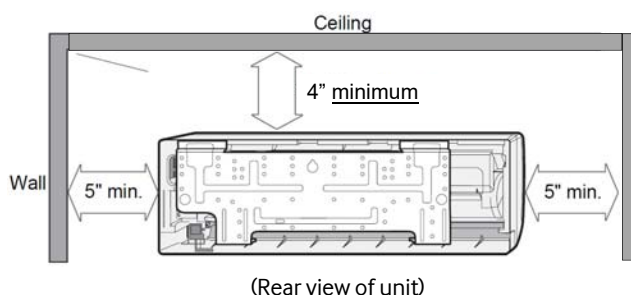

©2019 Samsung All rights reserved.

SAMSUNG

78

Wall mount Condensate Pump Installation





©2019 Samsung All rights reserved.

SAMSUNG

81

Wall mount Condensate Pump Installation

- Use the N.C. and common wires from the float switch to break the return air sensor, or external room sensor
 - This will generate a E121 code
- Do not interrupt the line voltage, or communication signal to the IDU
 - this will cause the entire system to shut down when the float switch opens
- **Condensate pumps that use a heated sensor instead of a float switch can not break the return air sensor, and will require the installation of the MIM-B14 external contact controller**

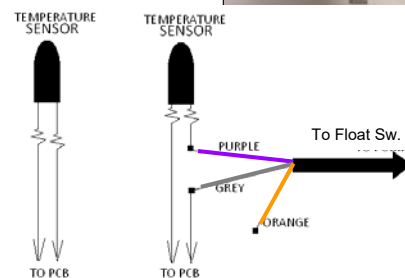

©2019 Samsung All rights reserved.

SAMSUNG

82

Ducted Units



Slim Duct



Outside Air Processor



Duct S



HSP Ducted



MPAH

©2019 Samsung All rights reserved.

SAMSUNG

83

Ducted Unit Features

Feature	Slim Duct	Duct S	HSP
Capacity Mbtu	07, 09, 12, 18, 24, 30, 36, 48	07,09,12,15,18, 24, 27,30, 36, 48	54
Controls	Wired control or IR Receiver and wireless remote, sold separately	Wired control or IR Receiver and wireless remote, sold separately	Wired control or IR Receiver and wireless remote, sold separately
Condensate	Gravity condensate drain (optional lift pump field installed)	Built-in condensate lift pump – max. 29" lift (No check valve) Includes float switch	Built-in condensate lift pump – max. 29" lift (No check valve) Includes float switch
Filter	Washable air filter screen	Washable air filter screen	optional filter box
Installation	Rear or bottom return air	Rear or bottom return air Optional air filter box	Front discharge air and rear return air Optional filter box
Ventilation	When adding fresh air to the return, do not use return air sensing	When adding fresh air to the return, do not use return air sensing	When adding fresh air to the return, do not use return air sensing
Static Pressure	0" to ".24"	0" to ".79" "Auto Air Volume" (ESP)	.12"-.59"
Additional	Discharge air temperature sensor	Discharge air temperature sensor	Discharge air temperature sensor
Fan access	Bottom	Top or Bottom	Bottom

©2019 Samsung All rights reserved.

SAMSUNG

84

Ducted Unit Features

Feature	HSP	OAP	MPAH
Capacity Mbtu	76 & 96	72 & 96	12, 18, 24, 30, 36, 48, 54, 60 & 72
Controls	Wired control or IR Receiver and wireless remote, sold separately	Wired control sold separately	Wired control sold separately
Condensate	Gravity condensate drain/optional Condensate pump	Gravity condensate drain/optional Condensate pump	Gravity condensate drain/requires properly sized Condensate pump
Filter	Optional filter box:	Optional filter box:	Optional filter box:
Installation	Front discharge air and rear return air	Applied to DVMS Heat Pump systems only	Up flow, Horizontal Right, Horizontal Left & Downflow
Ventilation	When adding fresh air to the return, do not use return air sensing	When adding fresh air to the return, do not use return air sensing	When adding fresh air to the return, do not use return air sensing
Static Pressure	76 = .20"-.98" 98 = .20 – 1.10"	.20 – 1.18	Standard ESP: .4" WC Max. ESP: 1.0" WC
Additional	Discharge air temperature sensor	Discharge air temperature sensor	Optional electric strip heat kits & filter bases
Fan Access	Bottom	Bottom	Front

©2019 Samsung All rights reserved.

SAMSUNG

85

Ducted Unit Optional Condensate Pumps

- Specifications
 - All models excluding MDP-G075SP installs inside ducted unit chassis (MDP-G075SP installs externally)
 - Powered and controlled by indoor unit PCB
 - Built-in float switch
 - Flexible hose outlet ≈ 1 1/4" OD
 - All optional pumps will require an installation option change (refer to installation manual)



Internal Installation Type
(actual product appearance may vary)

Model Number	Max. Lift	Compatible Indoor Unit Models
MDP-E075SEE3D	29"	All Slim Duct Models (AM0**FNLDCH/AA)
MDP-E075SEE3	29"	All FJM Slim Duct Models (AJ0**JNLDCH/AA)
MDP-M075SGU3D	29"	MSP Models: AM018FNMDCH/AA and AM024FNMDCH/AA
MDP-M075SGU1D	29"	MSP Models: AM030FNMDCH/AA and AM036FNMDCH/AA
MDP-M075SGU2D	29"	MSP Model: AM048FNMDCH/AA
MDP-N047SNC1D	18 1/2"	HSP Models: AM036FNHDCH/AA and AM048FNHDCH/AA
MDP-G075SP	29"	HSP Models: AM076FNHDCH/AA and AM096FNHDCH/AA OAP Models: AM072JNESCH/AA and AM096JNESCH/AA

©2019 Samsung All rights reserved.

SAMSUNG

86

Condensate - Flexible Hose and Coupler





©2019 Samsung All rights reserved.

SAMSUNG

87

Ducted Unit Installation

- Maintain a minimum of $\frac{3}{4}$ " clearance above & below the ducted unit to prevent noise transmission
- If the ducted unit is installed in an area above the ceiling with humidity conditions over 80%, the unit must be insulated with minimum $\frac{3}{8}$ " insulation
- Install the unit level and double nut the threaded rod under each mounting bracket
- Recommended to use rubber vibration washers
- Provide control side service access panel
 - 20" x 20" minimum

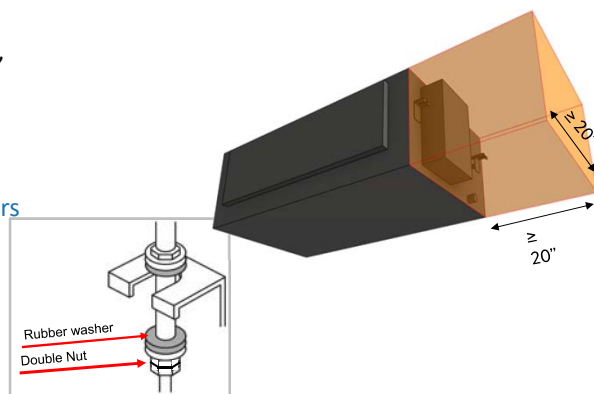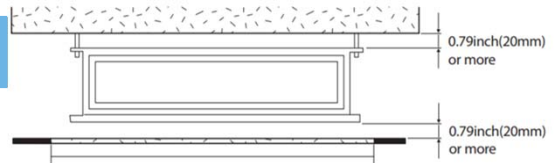


©2019 Samsung All rights reserved.

SAMSUNG

88

Ducted Unit Installation

- When installed above solid ceiling with no attic access, service access panel must be provided
- Service access must be equal to the units
 - width X depth + 4 inches

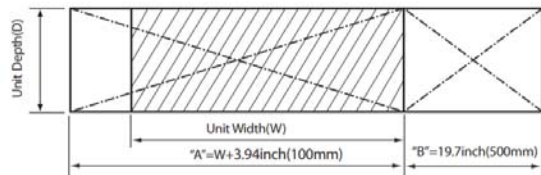


©2019 Samsung All rights reserved.

SAMSUNG

89

Ducted Unit Installation

- Ducted units must be installed with the mounting hooks at the top of the unit
- Installation with mounting hooks at the bottom of the unit will generate an E153 error (float switch) on units with a lift pump and will lead to water damage

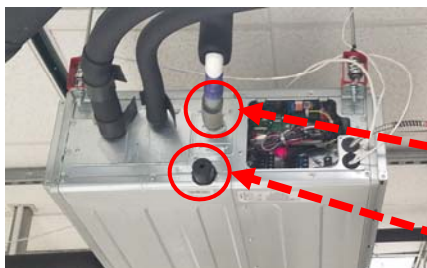

Lift Pump Connection

Gravity Drain Connection

©2019 Samsung All rights reserved.


SAMSUNG

90

Ducted Unit Installation



Correct

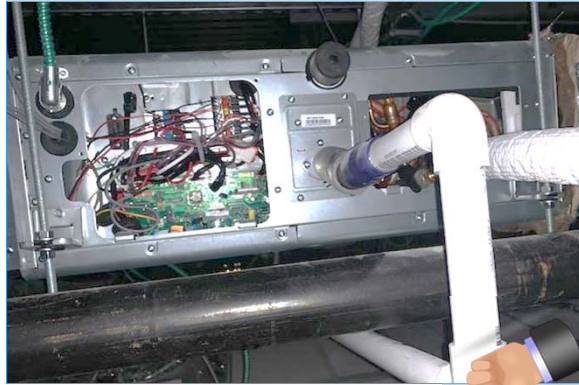

Incorrect



©2019 Samsung All rights reserved.

SAMSUNG

91

Ducted Unit Condensate Drains

- Gravity drain – requires drain line to downward slope 1/100 or more
 - Unplug Condensate pump when installing with a gravity drain
- Lift Pump - Inside diameter of the condensate drain outlet & riser piping must not exceed 3/4" ID
 - Max 29" lift from the bottom of the unit
- The flexible hose should be installed level or bent slightly downward
- The horizontal main condensate lines must be properly supported with hangers every 40" to 60".
- Condensate installation must be in accordance with state and local codes**

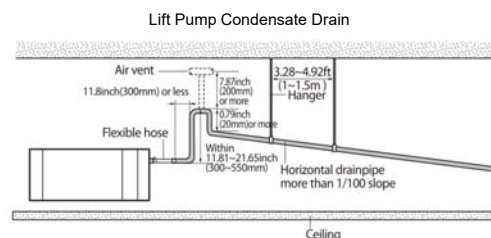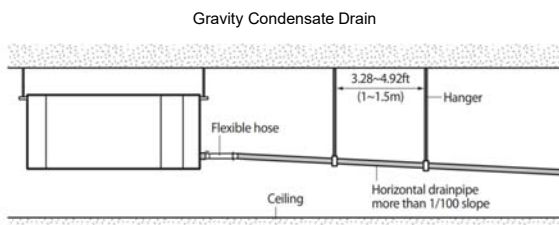


©2019 Samsung All rights reserved.

SAMSUNG

92

Ducted Unit Air Filters

- Slim Duct, Duct S & HSP Ducted units all have a washable electrostatic filter panel
- Duct S, HSP & OAP Ducted units are available with optional filter boxes
 - Filter boxes are assembled in the field and can be configured for 1" or 2" air filters

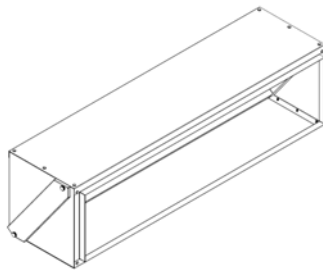

©2019 Samsung All rights reserved.

SAMSUNG

93

Ducted Unit Fresh Air Guidelines

- Up to 10% of outside fresh air can be introduced into the return side of the ducted units
- When using outside fresh air into the return do not use the ducted unit's return air sensor
 - Use the wired remote controllers, built-in sensor
 - Use the External Room Sensor



©2019 Samsung All rights reserved.


SAMSUNG

94

Ducted Unit Secondary Float Switch Installation

Gravity condensate drain application

- Connect the secondary drain pan float switch to the "FLOAT-SW" connector (CN411)
 - Pigtail harness is required (DB39-01263A)
- Option setting required to enable pump
- When the float switch contact is open, error E153 is generated

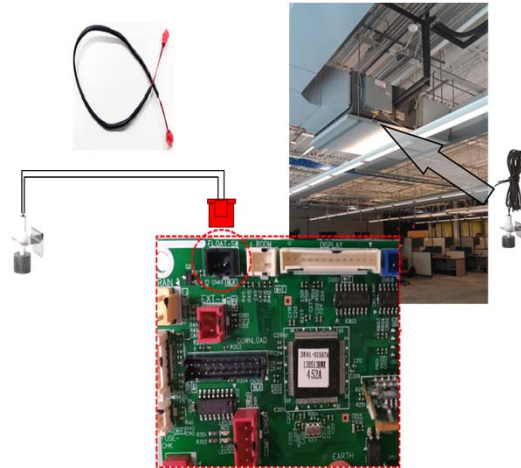

©2019 Samsung All rights reserved.


SAMSUNG

95

Ducted Unit Secondary Float Switch Installation

Factory condensate lift pump application

- Connect the secondary float switch leads in series with the built-in float switch connection CN411 black connector

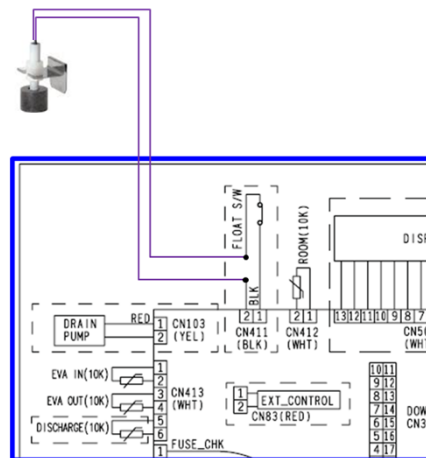

©2019 Samsung All rights reserved.

SAMSUNG

96

Multi-position AHU Installation

- Unit is shipped from the factory for upflow and horizontal left installation
- Unit can be field configured for
 - horizontal right installation
 - downflow installation
 - Downflow conversion kit is required
- Condensate Trap is required
- NOTE: For installations in non-conditioned airspace (attic or garage) unit must be insulated (1") and, or full dimension auxiliary drain pan. Refer to state and local codes for specific requirement




©2019 Samsung All rights reserved.

SAMSUNG


97

Multi-position AHU Installation

Horizontal Right Field Configuration

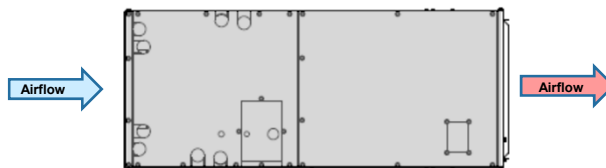

- Remove the indoor coil after disassembling the coil bracket & plate
- Relocate the condensate drain pan to the right side of the unit
- IMPORTANT:** Move the coil inlet sensor to the holder on the right side
- Reinstall the indoor coil
- Connect the condensate drain piping including P-trap
- Braze in the refrigerant lines using Dry Nitrogen purge
- All horizontal applications should include a full dimension secondary drain pan with an auxiliary float switch
- Always follow state and local codes for unit installation

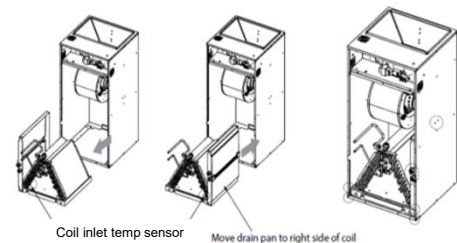


©2019 Samsung All rights reserved.

SAMSUNG



98

Multi-position AHU Installation

Downflow Position Configuration

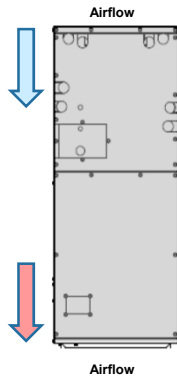

- Invert Air Handling unit 180° and reinstall the coil support rails.
- Evaporator coil must be installed in its original "A" configuration, and use the 2 self tapping screws to hold down the front brace to the unit.
- Reinstall the coil sensors in their original locations and plug the EEV connector back into the PCB.
- Install the room air temperature sensor HOLDER as noted below.
- Place the room temperature sensor onto the sensor HOLDER allowing the sensor to extend past the end of the sensor HOLDER. (approximately 1.5") Secure the sensor to the HOLDER with (3) wire ties.
- IMPORTANT: AM012-AM036 units will require a EEV extension cable which is sold separately







99 2019 Samsung All rights reserved.

SAMSUNG

99

Multi-position AHU Electric Heat Kit

- Heater kit includes circuit breaker and power pigtail leads
 - Install the heater assembly into the rectangular opening in the discharge air
 - Install the provided circuit breaker(s) in the front left of the control box
 - Install the heater power wires through the knockout on the cabinet
 - Connect the 6 pin male plug to the 6 pin female plug on the bottom of the control door
 - Place the heater kit adhesive backed wiring diagram to the blower housing

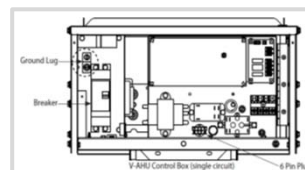

3,5,10,15 & 20Kw


©2019 Samsung All rights reserved.

SAMSUNG

100

Multi-position AHU Electric Heat Kit

- Install the heater unit temperature sensor to the lower section of the cabinet on the bottom of the gas pipe
- Designed for 0" clearances (sides & back) for units without electric heat
- For units with electric heat kit installed, 1" clearance is required for supply plenum and supply duct

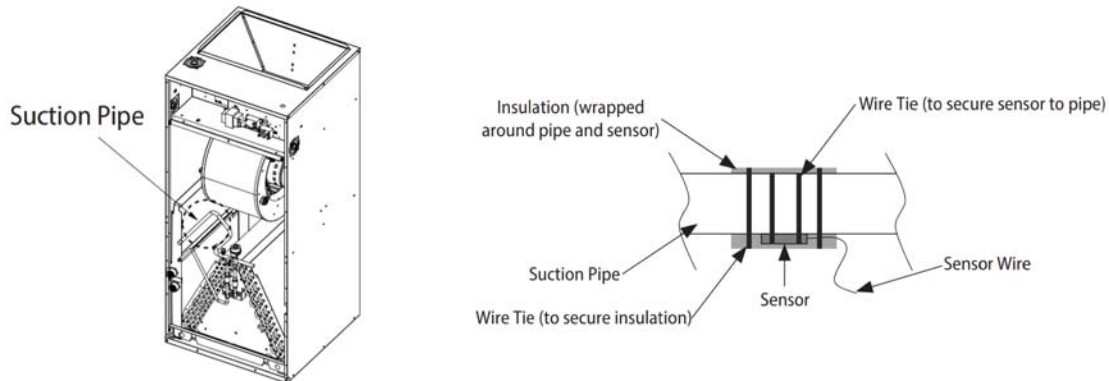

©2019 Samsung All rights reserved.

SAMSUNG

101

Multi position air handler Float Switch Installation

- **Factory installed MIM-B14 External Contact control module used for a float switch safety.**
- Remove jumper from terminals and connect the normally closed wires from the float switch
- With the float switch open, the air handler will turn off and the wired remote controller will be disabled.
- CAUTION: the switch contacts are for 0 volt application only.



©2019 Samsung All rights reserved.

SAMSUNG

102

Floor Standing Unit Features

Feature	Concealed	Floor Standing
Capacity Mbtu	06, 09, 12, 12 & 24	06, 09, 12, 12 & 24
Controls	Wired control or IR Receiver and wireless remote, sold separately	Wired control or IR Receiver and wireless remote, sold separately
Fan	3 speed	3 speed
Condensate	Gravity condensate drain	Gravity condensate drain
Facia Panel	included	NA
Filter	Electrostatic washable air filter included	Electrostatic washable air filter included



"Concealed" Floor Standing



"Cased" Floor Standing

©2019 Samsung All rights reserved.


SAMSUNG

103


Floor Standing Units - Installation

- Samsung floor standing units for under window or wall installations
- Concealed type can be installed on the floor or sidewall
- Units must be properly supported and level for condensate draining

Exposed Type

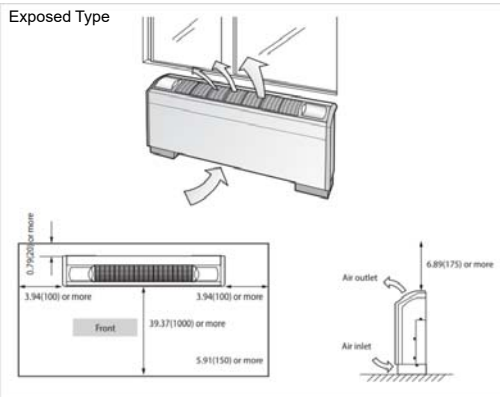

Concealed Type

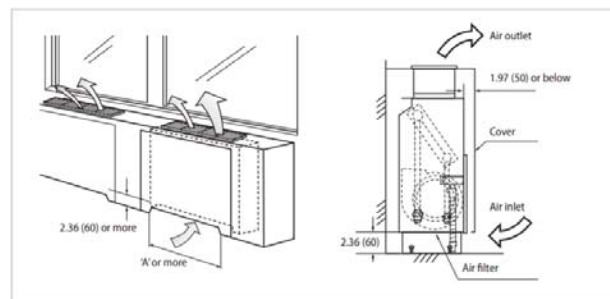


©2019 Samsung All rights reserved.

SAMSUNG

104

Mode Change Units - Features

- 1,2,4 & 6 port models
- Brazed pipe connections
- Main 3-pipe connection on both sides of MCU for series installation
 - Excl. S1NEK single port MCU – right side connection only

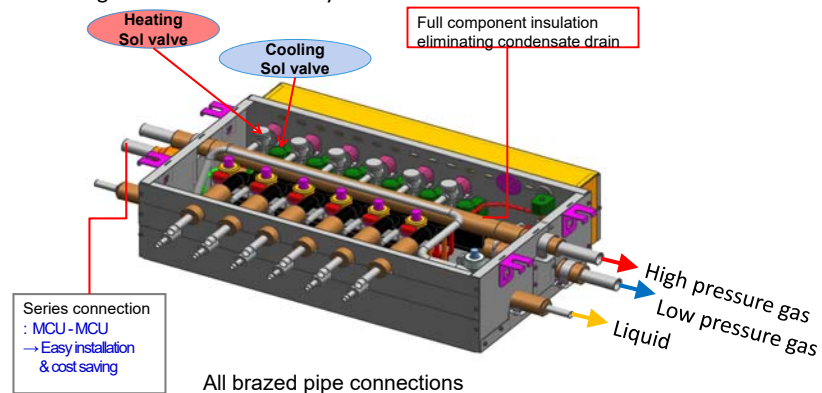


©2019 Samsung All rights reserved.

SAMSUNG

105

Mode Change Units - Features

- No condensate drain
- Auto Pairing
- Refrigerant pass through design 2,4&6 port models
- Up to 8 indoor unit connections per port
- Maximum 54 MBtu indoor unit capacity per port

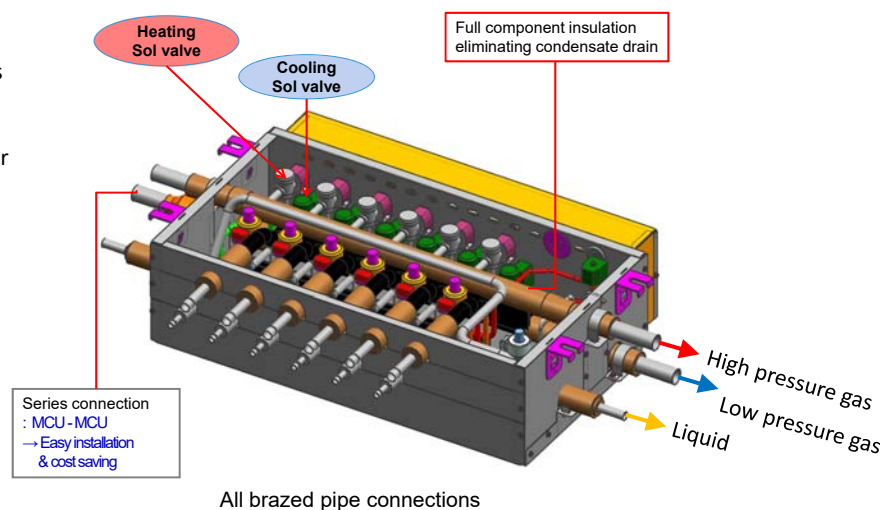


©2019 Samsung All rights reserved.

SAMSUNG

106

Mode Change Units - Features

- Maximum capacity in MCU series connections: 108 MBtu - 2 port / 216 MBtu - 4&6 port
 - Single port: Connected indoor units: Max. 54 MBtu
 - Total MBtu capacity is not increased in series connections only the number of IDU ports

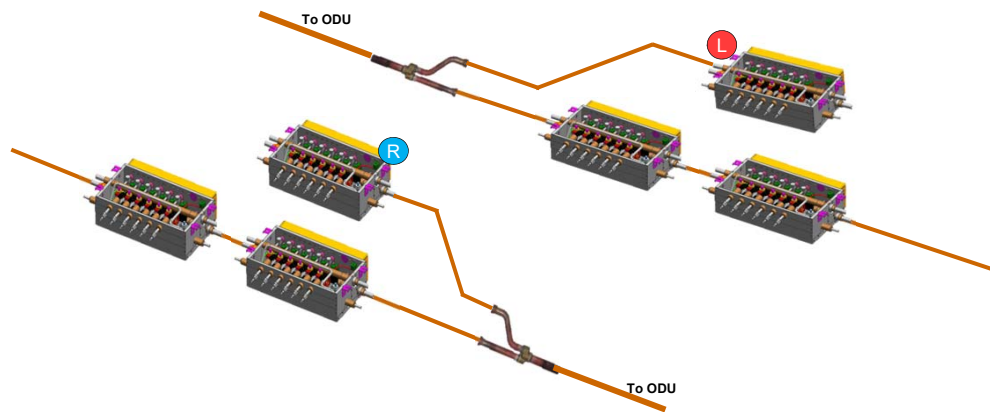


©2019 Samsung All rights reserved.

SAMSUNG

107

Mode Change Units - Features

- MCU's can be rotated 180° to allow branch piping to connect to either the left or right hand side.

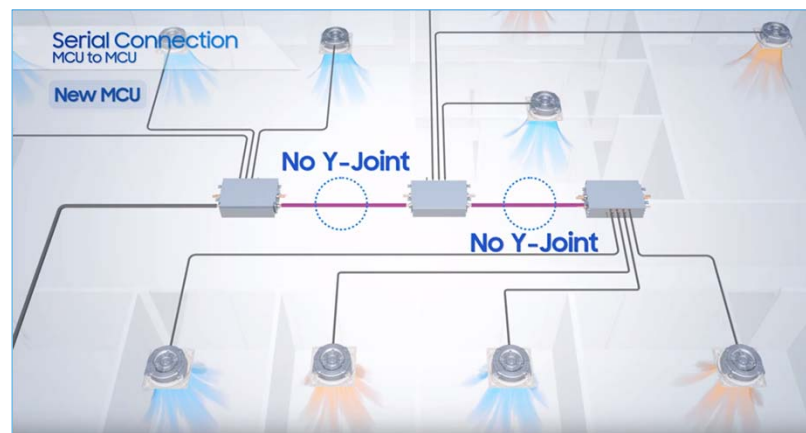


©2019 Samsung All rights reserved.

SAMSUNG


108

Mode Change Unit Specifications

MCU 1-port: single connection only

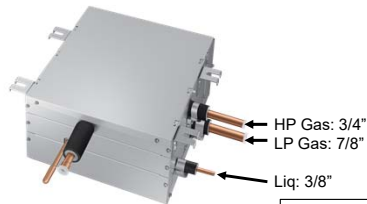

MCU 2,4&6 port: series connection possible

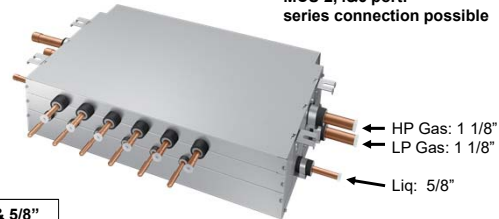

IDU port sizes: 3/8" & 5/8"

Model	WxHxD	Max. IDU per 1 Port	Max. IDU	Max. Capacity per 1 Port	Max. Total Capacity	Pipe Size
S1NEK	13.3x7.8x16	8	8	54 MBtu	54 MBtu	Hi: 3/4 Lo: 7/8 Liq: 3/8
S2NEK	28.6x7.8x18.5	8	16	54 MBtu	108 MBtu	Hi: 1 1/8 Lo: 1 1/8 Liq: 5/8
S4NEK	28.6x7.8x18.5	8	32	54 MBtu	216 MBtu	Hi: 1 1/8 Lo: 1 1/8 Liq: 5/8
S6NEK	28.6x7.8x18.5	8	32	54 MBtu	216 MBtu	Hi: 1 1/8 Lo: 1 1/8 Liq: 5/8


©2019 Samsung All rights reserved.

SAMSUNG

109

Mode Change Unit - Indoor Unit Port Assignment

- Manually Set the active ports by dip switch
- System Automatically matches the indoor units to port number

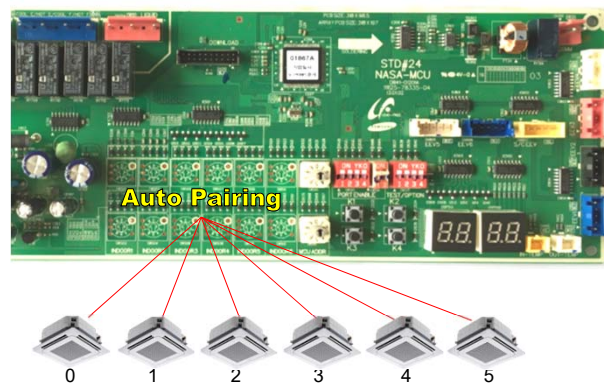


©2019 Samsung All rights reserved.

SAMSUNG

110

Multiple Unit Single Port Operation

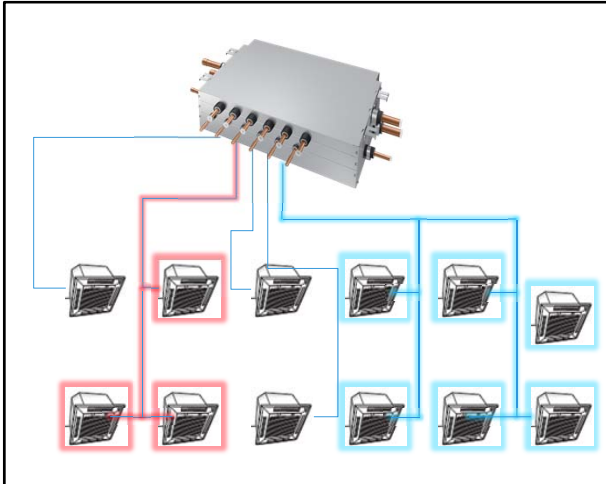

- When multiple units are on one port
 - Operation mode is determined by the first indoor unit Thermo-On
 - Opposite mode is prohibited
 - Mode change: all indoor units Thermo-Off – opposite mode selected


©2019 Samsung All rights reserved.

SAMSUNG

111

Cooling Only Unit Connection

- IDU connected directly to the liquid & low pressure piping for cool-only operation
 - Requires installation option setting
 - Total cooling-only IDU capacity: $\leq 50\%$

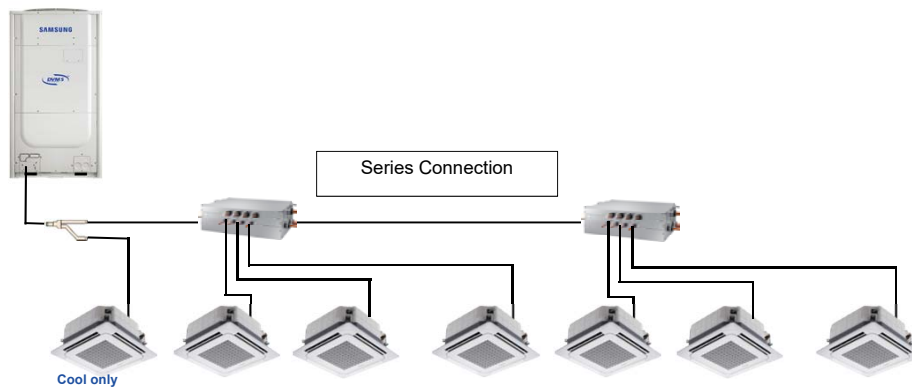


©2019 Samsung All rights reserved.

SAMSUNG

112

Mode Change Unit Installation

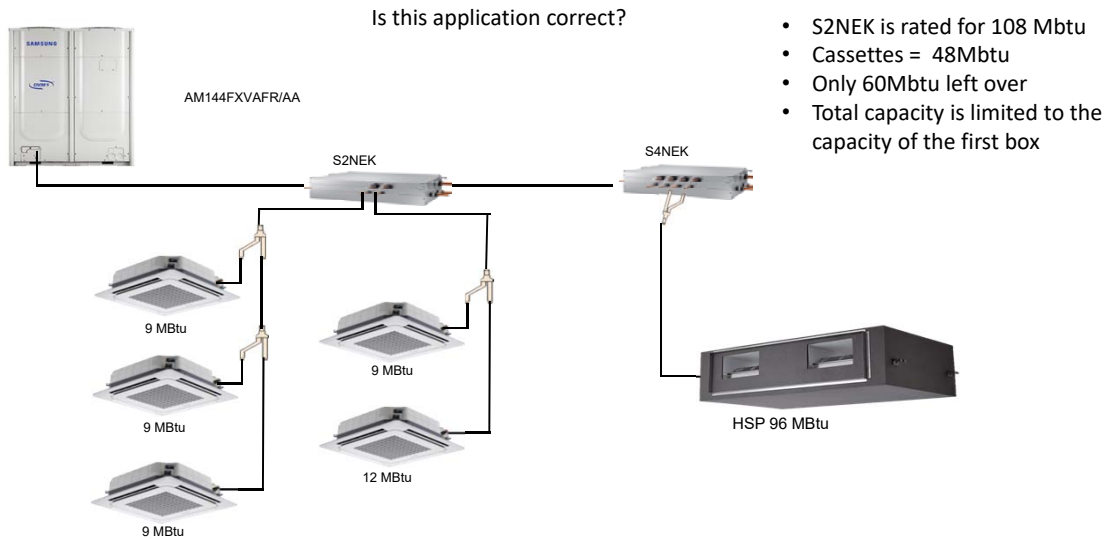

©2019 Samsung All rights reserved.





SAMSUNG

113

Mode Change Unit Placement

- MCU must be installed securely upright and level
- Recommendation:
 - Avoid installation over occupied areas
- Support refrigerant piping properly:
 - Refer to state and local code requirements
- MCU must have proper service access space

Preferred MCU Placement

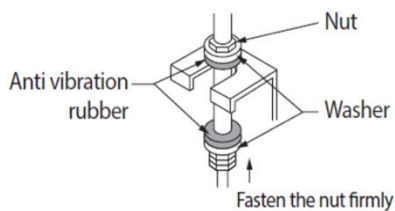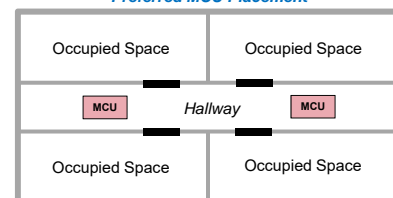

©2019 Samsung All rights reserved.

SAMSUNG

114

Under Ceiling Units External EEV Kit

- Under Ceiling EEV Kits available in
 - 1, 2 & 3 zone models
- Powered (208/230vac)
- Controlled from indoor unit PCB
- Maximum distance between unit and EEV:
 - Single $\leq 6.5'$
 - Multipoint $\leq 65'$
- Must install vertical
- Install included strainer on the inlet side
- Single kit includes 6.5' cable with connector
- Multipoint field installed 16/2 shielded cable to F1/F2
- Set rotary dials to address EEV'S




©2019 Samsung All rights reserved.

SAMSUNG

115

NASA Digital Control Layers

- F1 F2 – Set Layer:** ODU to IDU's & MCU'S (incl. EEV Kit) daisy chain connections 0.5 VDC
- F3 F4 – Local Layer:** Wired Remote Controller to indoor unit 12 VDC
- R1 R2 – Control Layer:** Outdoor Unit to DMS Centralized Control 5 VDC
- Control Wire:** 16/2 AWG stranded with shield
 - Never use solid core thermostat wire for digital communications

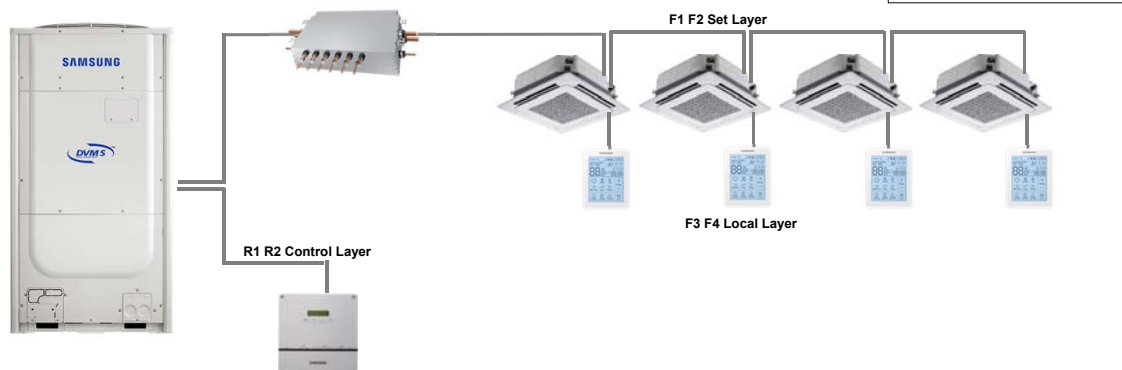


©2019 Samsung All rights reserved.

SAMSUNG

116

Control Circuit Grounding

- Bond the bare shield wire throughout the system (daisy chain)
 - Do not connect the F1 F2 shield wire to any indoor unit
- Ground the bare shield wire in the outdoor unit to a separate point than the main line voltage electrical service ground

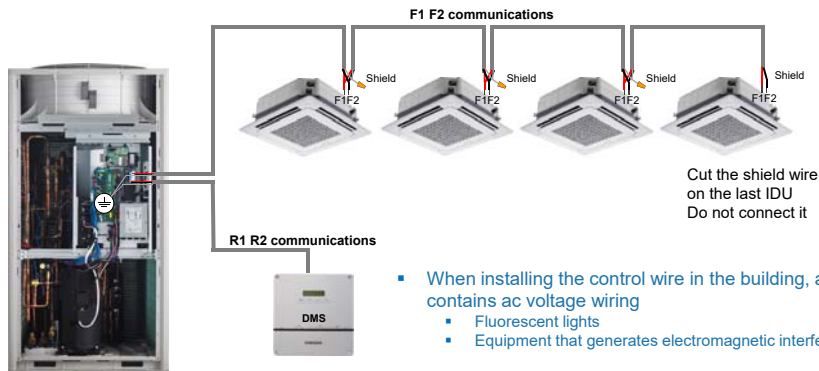

- When installing the control wire in the building, avoid contact with conduit which contains ac voltage wiring
 - Fluorescent lights
 - Equipment that generates electromagnetic interference (maintain 10 ft. clearance)


©2019 Samsung All rights reserved.

SAMSUNG

117

Control Wire Connections - Outdoor Unit

- **F1/F2**
 - Communication from the outdoor unit (Main) daisy chain to all indoor units, MCU's, and EEV Kits on the system
 - (Connection must be made on the main unit)
 - To Indoor Units
- **R1/R2**
 - Communication from outdoor unit (Main) to centralized controls: DMS2.5 Gateways, Touch Controller, etc.
- **OF1/OF2**
 - Communication from the Main outdoor unit in a modular system daisy chain to Sub 1 and Sub 2 ODU modules (3 ph. only)

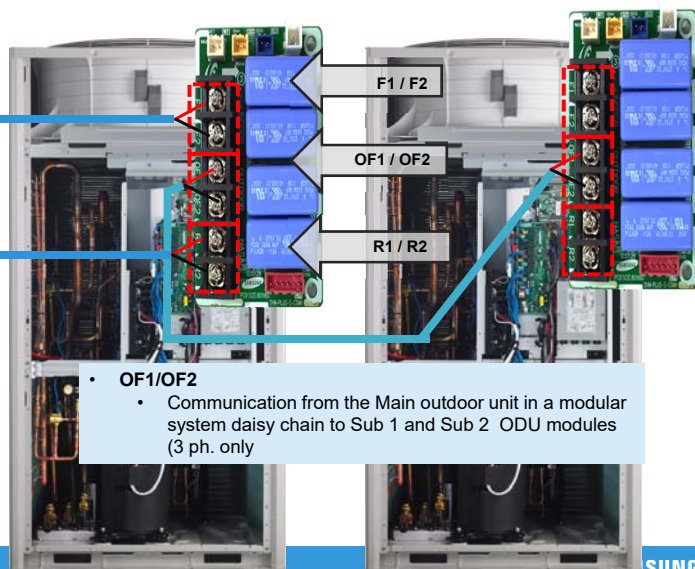



©2019 Samsung All rights reserved.

SUNG


118

Wired Remote Controller

- F3/F4
 - 16 AWG stranded, 2 conductor, shielded cable
 - Do Not connect to V1 V2
 - Maximum wire distance from remote controller to farthest indoor unit: 328ft.
- Single wired remote controller can be connected to 16 units
 - Communication and power
 - Daisy chain all F3-F4 terminals
 - Provides group control only

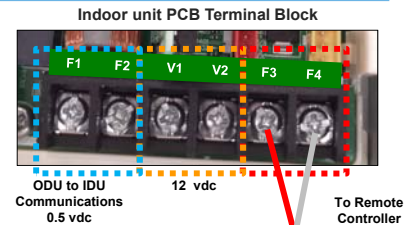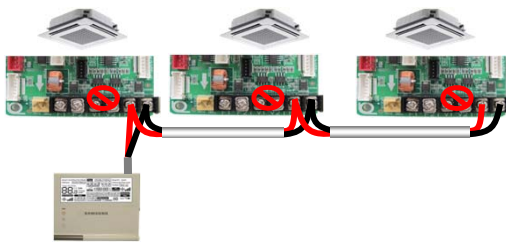

Example: MWR-WE13UN



©2019 Samsung All rights reserved.

SAMSUNG

119

Wired Remote Controller Installation

- Remote controller should be installed level and secure
- Do not install controller in direct sunlight
- Do not install controller on an outside wall
- Do not install controller near any heat source
- Do not install controller within supply air direction or drafts




©2019 Samsung All rights reserved.

SAMSUNG


120

Wired Remote Controller Installation

- **Cassette & Ducted**
 - locate F3/F4 screw terminal
 - Connect shielded wire to wired controller
- **MAX & Whisper Wall mount**
 - locate the tagged 2-wire harness
 - (F3 F4).
 - Clip the end and extend the wires to the remote controller terminals
- **MPAH**
 - locate the tagged 2-wire harness (F3 F4).
 - Clip the end and extend the wires to the remote controller terminals

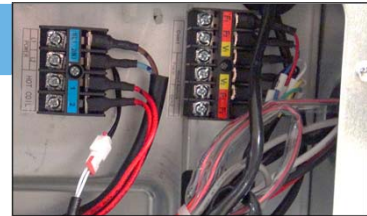

Cassette F3/F4



MAX & Whisper




MPAH

©2019 Samsung All rights reserved.

SAMSUNG

121

Remote Controller to Indoor Unit Examples

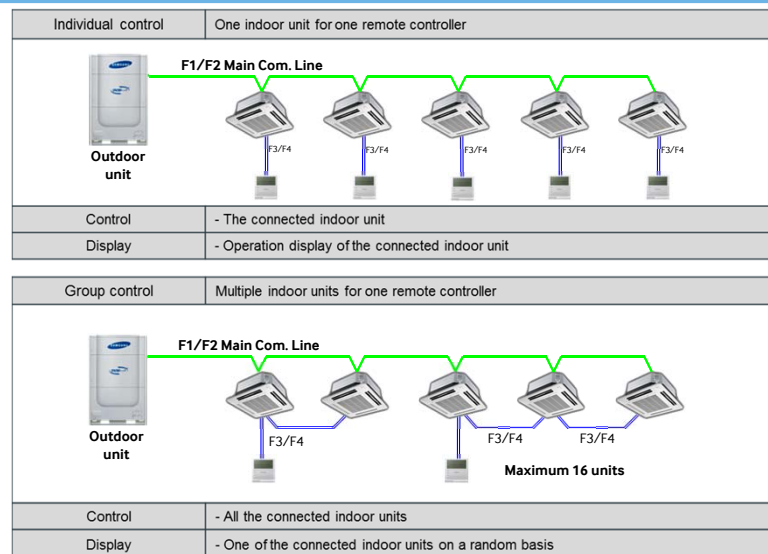


©2019 Samsung All rights reserved.

SAMSUNG

122

Remote Controller to Indoor Unit Examples

*When using more than one controller temperature will be sensed on the main controller

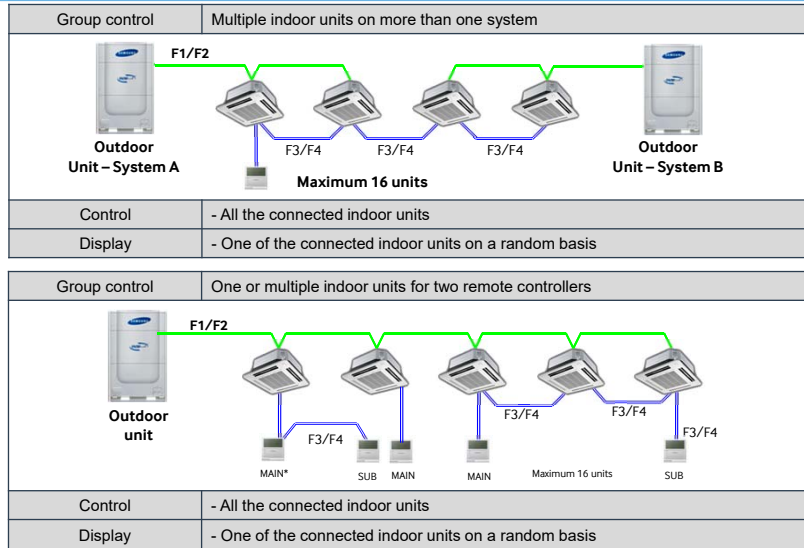


©2019 Samsung All rights reserved.

SAMSUNG

123

Remote Controller to Indoor Unit Examples

*When using more than one controller temperature will be sensed on the main controller

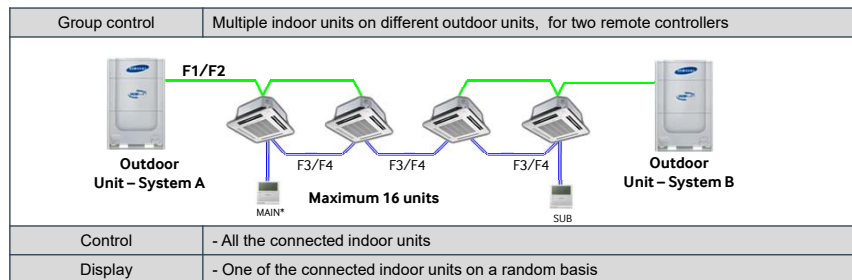

©2019 Samsung All rights reserved.

SAMSUNG

124

Communication Wiring Warnings

- Never run communication wiring in the same conduit as high voltage.
- Keep communication wires a minimum of 2 inches away from any high voltage wires.
- Make sure to tighten screws properly



©2019 Samsung All rights reserved.

SAMSUNG

125

Communication Wiring Warnings

- If going through bare metal hole make sure wire is protected from rubbing against metal of cabinet as not to wear through the wire.
- Wire may not be broken
- No Wire Nuts



©2019 Samsung All rights reserved.

SAMSUNG

126

DVMS Control Wiring Quiz & Exercises




127

DVMS Control Wiring Review Quiz

1. What is the DVMS control wire specification?

16/2 AWG stranded with shield



2. Indicate the communication terminal designations for the DVMS outdoor unit?

F1 F2 – OF1 OF2 – R1 R2



©2019 Samsung All rights reserved.

SAMSUNG

128

DVM S Control Wiring Review Quiz

3. Indicate the communication terminal designations for the MCU

F1 F2




4. Indicate the communication terminal designations for the Indoor Unit

F1 F2 – V1 V2 – F3 F4



5. What is the function of the **V1 V2** terminals ?

V1 V2 is a 12vdc power supply – not required for the “NASA” protocol wired remote controllers



6. Indicate the communication terminal designations for the MWR-WE13N “NASA” wired remote controller

F3 F4




©2019 Samsung All rights reserved.

SAMSUNG

129

DVM S Control Wiring Review Quiz

3 Zone Heat Pump System

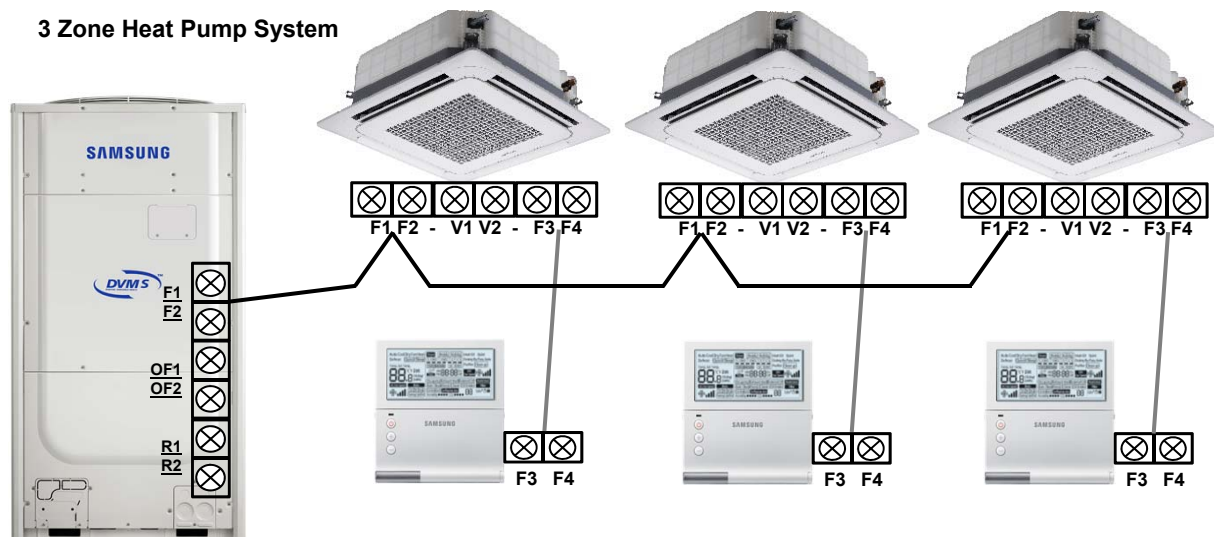


©2019 Samsung All rights reserved.

SAMSUNG

130

DVM S Control Wiring Review Quiz

Single Zone Heat Pump System

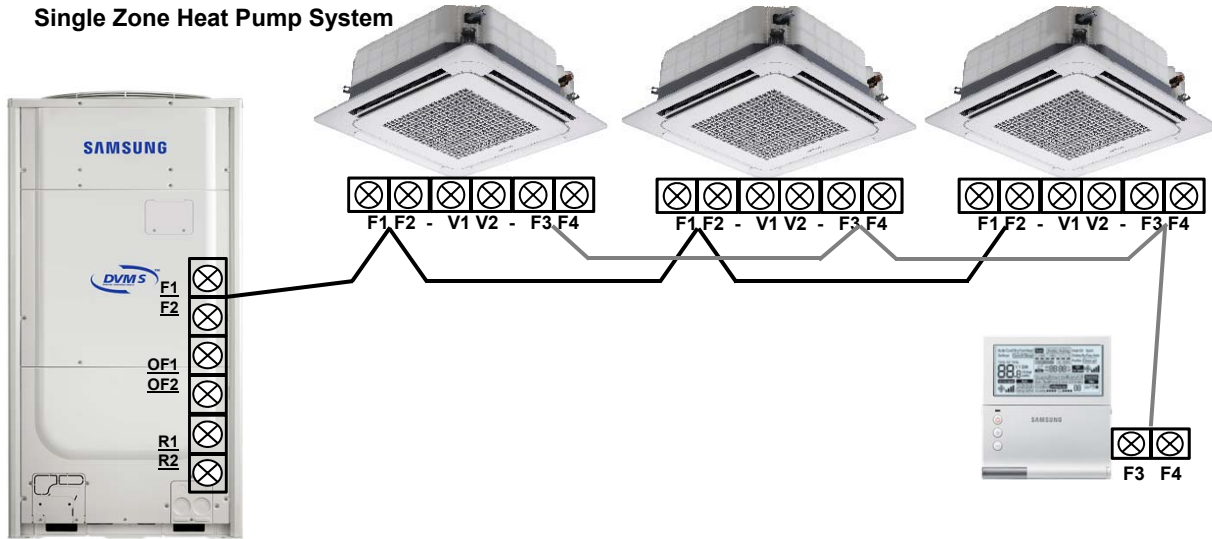


©2019 Samsung All rights reserved.

SAMSUNG

131

DVM S Control Wiring Review Quiz

Heat Recovery System

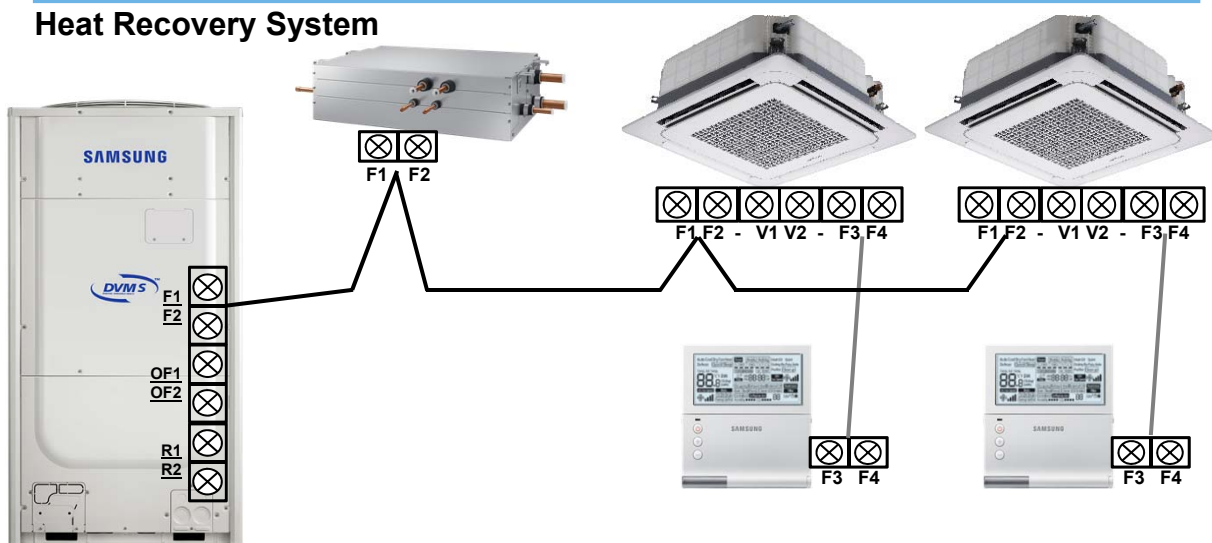


©2019 Samsung All rights reserved.

SAMSUNG

132

DVM S Control Wiring Review Quiz

Modular Heat Pump System – 3 outdoor units connected together

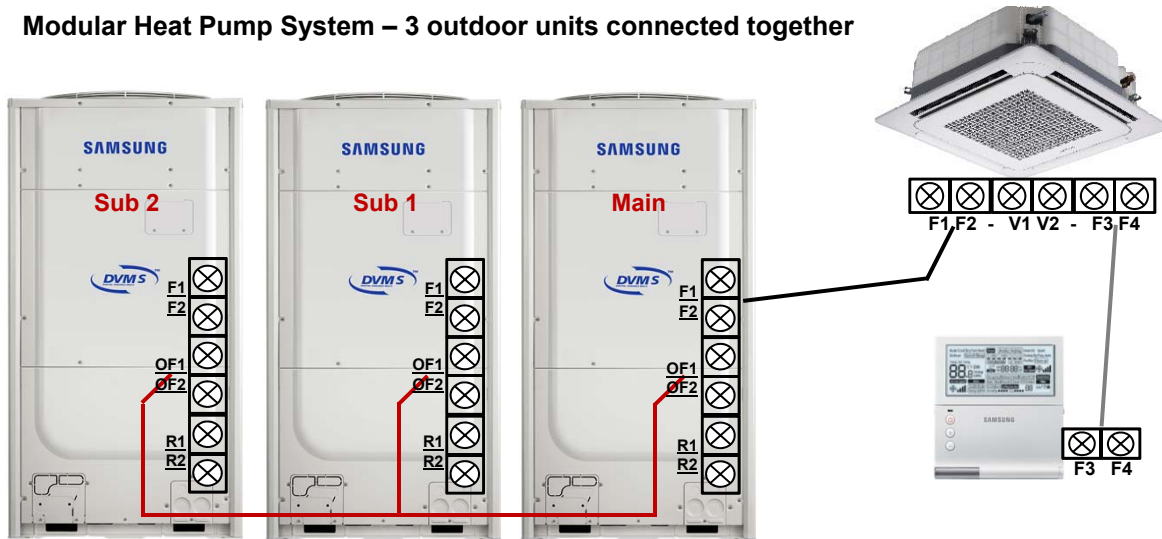


©2019 Samsung All rights reserved.

SAMSUNG

133

DVM S Control Wiring Review Quiz

Heat Pump System & Centralized Control

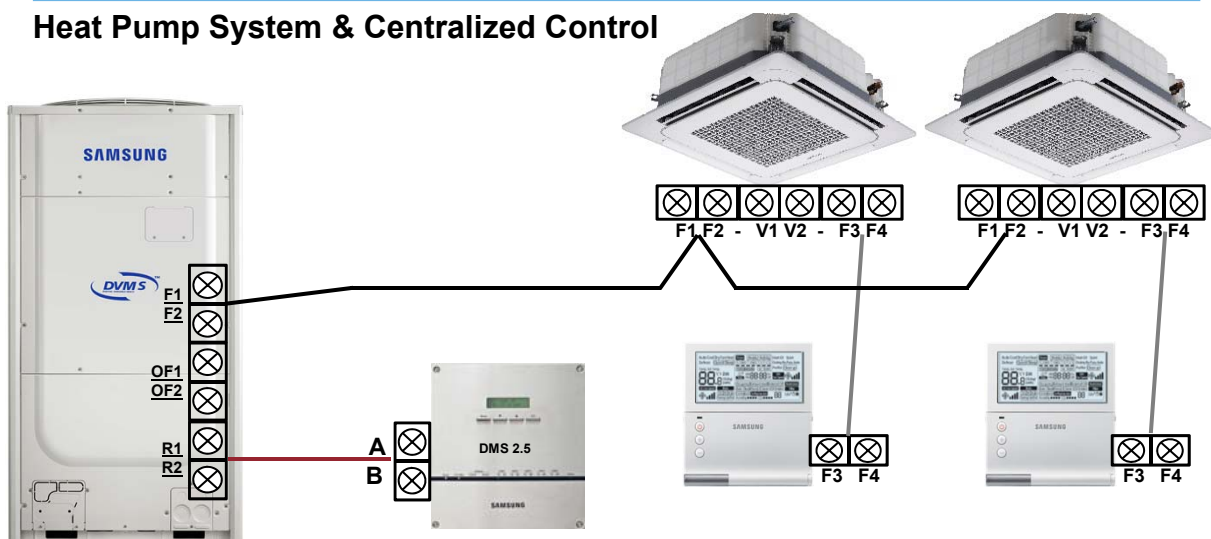


©2019 Samsung All rights reserved.

SAMSUNG

134

DVM S Control Wiring Review Quiz

Heat Recovery System
multiple MCU's

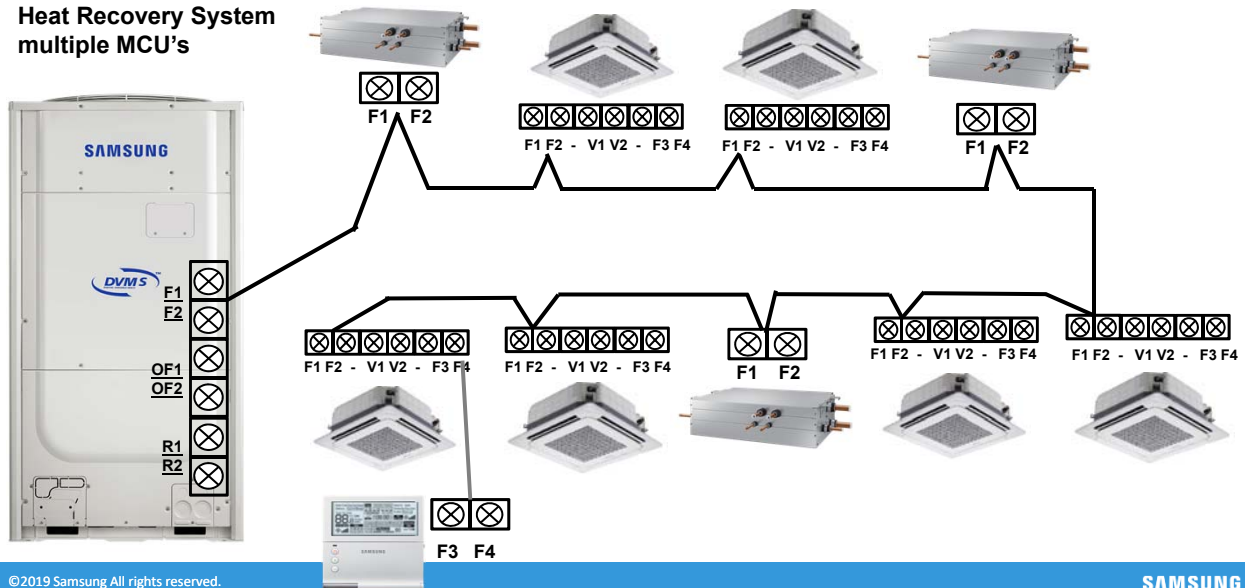

SAMSUNG

135

Basic Controls Overview



MR-EH00U
Simple schedule control



MWR-WE13UN
Multi-function Wired
Remote Controllers
Built-in room temp
sensor
4-Way, Mini 4-way
360 Cassette
Wind Free
Scheduling



MWR-WG00JN
Advanced Wired Controller

- Built-in room temp sensor
- Dual Set Point (DSP) Setting (for supported indoor units)
- 4-Way, Mini 4-way
- 360 Cassette
- Wind Free
- Scheduling



MR-KH00U 360 Cassette
Simple schedule control
Air flow direction control



MWR-SH11UN – Simple Touch Wired Controller

- Touchscreen control
- Built-in room temperature sensor
- Built-in infrared receiver
- Wind-Free



MRK-A10N – Wireless Signal Receiver

- Allows wireless control for concealed ducted units and the floor standing units
- On/Off control button
- Operation indication
- Error indication
- Filter replacement sign
- Recessed installation
- Includes interconnect cable

©2019 Samsung All rights reserved.

SAMSUNG

136

Basic Controls Overview



■ TADPT 2

- Can control 1 -2 DVMS indoor units (controlled as a group)
- operate indoor unit as primary or secondary heat source
- "Emergency Heat" output
- External contact input to disable unit – N.C. operation
- Supports 1 or 2 stages of Heat and Cool
- Requires field supplied 24vac class 2 transformer
 - one transformer per adaptor

MIM-H04UN – WiFi Adapter

- WiFi Adapter allows control and scheduling of the VRF system remotely through Android and Apple devices
- Configuration requires the Samsung "SmartThings" app.



MCM-C200 – Mode Selector Switch

- Manual system mode select – Heat Pump systems only
- Installed in outdoor unit or in building
- Max. 328ft of 3 conductor control wire from control to outdoor unit

©2019 Samsung All rights reserved.

SAMSUNG

137

Basic Controls Overview

MRW-TA – External Room Temperature Sensor

- Remote sense of room temperature when unit is installed in high ceiling
- outside fresh air ducted into the return,
- using a remote controller with no built-in space sensor



Multi-Tenant Function Controller – MCM-C210N

Used to keep a DVM S system online in the event of a power loss to a indoor unit



MIM-B14 – External Contact Controller

- Direct indoor unit control by external contact signal
- Emergency control with simple contact input
- Indoor unit option setting must be set to enable external control operation



©2019 Samsung All rights reserved.

SAMSUNG

138

Basic Controls Overview



Touch Controller MCM-A300N

Maximum:

- 64 indoor units, 1 system, and 16 MCU's when connected to F1/F2 (system/set layer)
- 128 indoor units and 16 systems when connected to R1/R2 (control layer)



DMS Data Management Server 2.5 MIM-D01AUN

Easy Control & Monitoring Through Web Browser
Schedule Control Function Through Web Browser
Advanced Programmable Control Logic
Advanced Heat Pump Auto Changeover Logic
External Contact Interface
Energy Management / Power Distribution Function
History Management



BACnet Gateway 2.5 MIM-B17BUN

DMS 2.5 + built in BACnet gateway



LonWorks Gateway 2.5 MIM-B18BUN

DMS 2.5 + built in LonWorks gateway

©2019 Samsung All rights reserved.

SAMSUNG

139

Refrigerant Piping Introduction

- Samsung piping installation guidelines and restrictions must be strictly followed
- Failure to follow Samsung piping guidelines may result in poor system performance, premature component failure, and reduced system service life
- Always refer to the DVM Pro piping diagram and mechanical prints when laying out the refrigerant piping system


©2019 Samsung All rights reserved.

SAMSUNG

140

DVM S Piping

- **“Main Pipe”** refrigerant pipes that enter the building from the outdoor(s) unit to the first Y-joint, EEV kit, or MCU (single MCU systems)

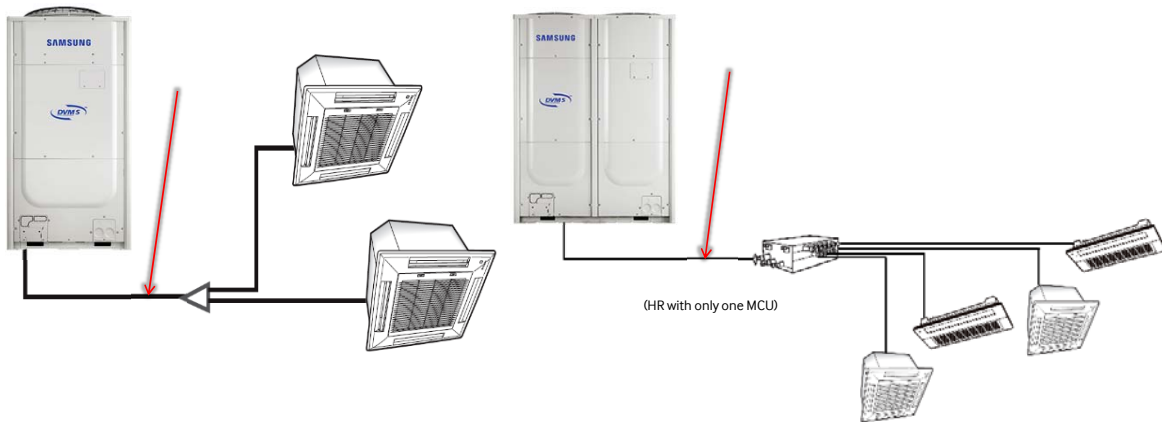

©2019 Samsung All rights reserved.


SAMSUNG

141


DVM S Piping – Branch Fittings

- MXJ-Y Y-joint (HR & HP)
 - Y joints split refrigerant pipes to indoor units or MCU'S
 - Y joints twin ports from MCU'S
 - Y-joint sizes based on system and indoor unit capacities
 - Kit includes
 - liquid & gas fittings
 - Insulation
 - pipe reducers
 - Heat recovery systems will require the additional GAS HR fitting

Heat Pump Y-joint kit



Heat Recovery Applications

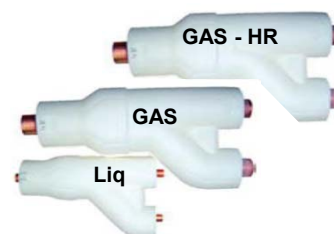

©2019 Samsung All rights reserved.

SAMSUNG

142

DVM S Piping Y-joint Installation

- Samsung Y-Joint fitting kits will include the necessary reducers to connect to various pipe sizes
- All Y-Joint fittings are installed horizontal level
 - ($\pm 15^\circ$ of horizontal plane)
- Or vertical up / down



Improper Installation Using a electricians level this is 30° off level



©2019 Samsung All rights reserved.

SAMSUNG

143

DVM S Piping Y-joint Installation

- **Required**
 - To avoid turbulence and potential noise in the Y-joint refrigerant piping, space 90° elbows at least $20''$ from the Y-Joint inlet,
 - Y-Joints are not to be connected together
- **Recommended**
 - maintain $36''$ between Y-Joint fittings
 - Allow a minimum of $20''$ on the branch side

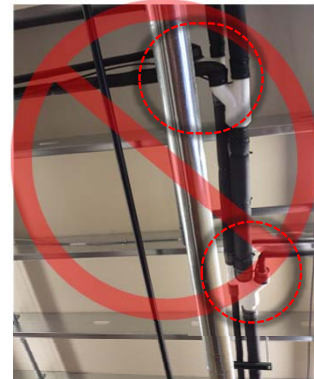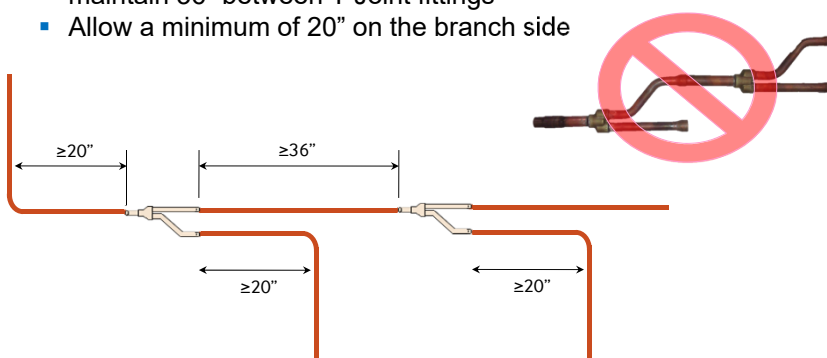


©2019 Samsung All rights reserved.

SAMSUNG

144

DVM S Piping Y-joint Installation

- Care must be taken to ensure that the refrigerant piping is not inserted too far into the Y-joint before brazing
- If the Y-joint fitting does not have a groove to stop the copper pipe from entering too far, measure and mark the pipe at 5/8" from the end
- If the pipe is inserted too far, turbulence is created and increase noise potential



- Some Y-joint fittings have selectable end segments to facilitate multiple pipe diameters
 - Cut the segment from 3/8" to 5/8" from the end



©2019 Samsung All rights reserved.

SAMSUNG

145

DVM S Piping Y-joint Installation

- Install a support before and after each Y-joint to prevent sagging and stress on the brazed connections (within 18" of the inlets and outlets)



- Refer to state and local codes for piping support compliance

©2019 Samsung All rights reserved.


SAMSUNG

146

DVM S Piping - Header Fittings

- MXJ-H Header kits
 - Always connect the largest capacity unit to the first port on the header
 - Are used at the end of the line to distribute refrigerant to multiple indoor units
 - Y joints or additional headers may not be connected to the header
 - Includes fitting, cap and insulation
 - Headers sized based on system and indoor unit capacities
 - Headers are only used on heat pump systems

Heat Pump systems only
4,6&8 port models available

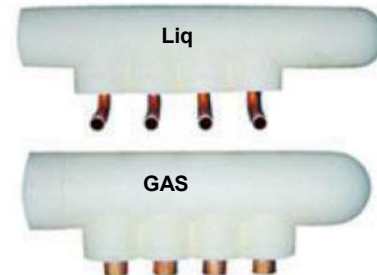

Example: 4-port header kit

©2019 Samsung All rights reserved.

SAMSUNG

147

DVM S Piping Header Installation

- Header joint kits will include a liquid fitting, gas fitting, reducers and insulation
- The liquid fitting is open at both ends to allow left or right installation
- Braze the included plug on the open end after the incoming refrigerant pipe is connected




- Pinch and braze any unused ports
- The outlet ports (liquid and gas) can only connect to a single indoor unit, never a Y-joint or Multi-port EEV kit

©2019 Samsung All rights reserved.


SAMSUNG

148


DVM S Piping Header Installation

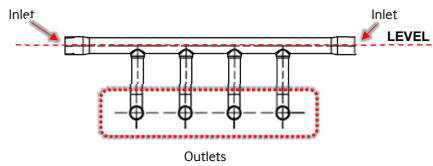


Liquid Header

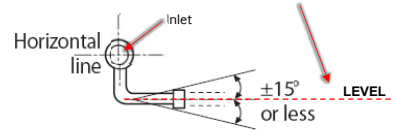


Both the liquid and gas headers must be installed level



Back of suction header fitting once installed



Gas Header

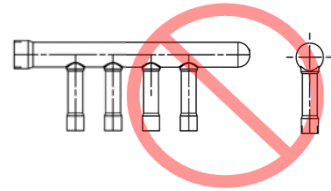



©2019 Samsung All rights reserved.

SAMSUNG

149

DVM S Piping Header Installation

Liquid and gas headers must be supported to eliminate any stress on brazed connections

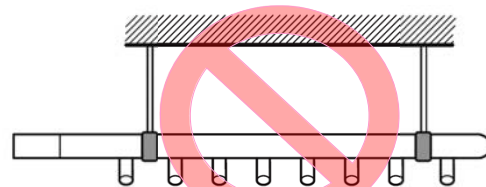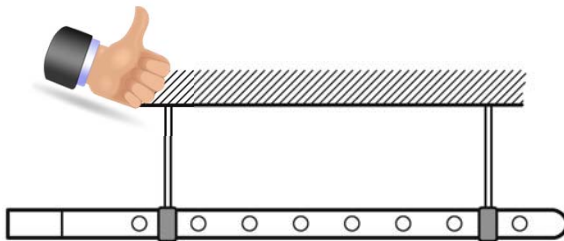

(Gas ports pointing down)

©2019 Samsung All rights reserved.



SAMSUNG

150

DVM S Piping Tee's

MXJ-TA****M

- Tees are used in modular systems to make 2 or 3 outdoor units piped together for one system
 - 2-module system requires 1 heat pump fitting kit (Liq & Gas)
 - 3-module system requires 2 heat pump fitting kits
 - Heat recovery requires the heat pump kit plus the HR Hot Gas Tee
 - Outdoor unit branch fittings are installed level only, never vertical

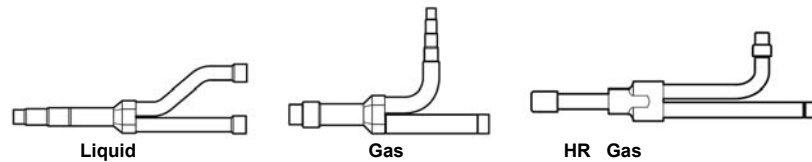

NOTE: Identification examples only

©2019 Samsung All rights reserved.

SAMSUNG



151

DVM S Piping Connections

- Single unit systems (Heat Pump & Heat Recovery)
- Refrigerant pipes may enter from the front, or bottom of unit



One pipe shown for example only

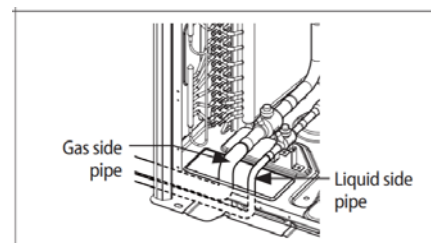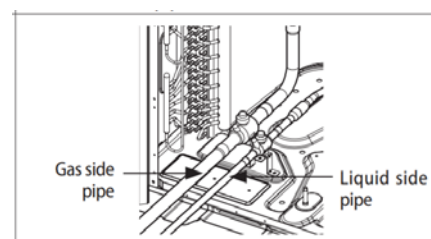


©2019 Samsung All rights reserved.

SAMSUNG


152

DVMS Piping Connections

- Modular systems (2 or 3 ODU's) outdoor unit piping (Heat Pump & Heat Recovery)
- Main refrigerant piping must be connected at the same or lower level to each outdoor unit

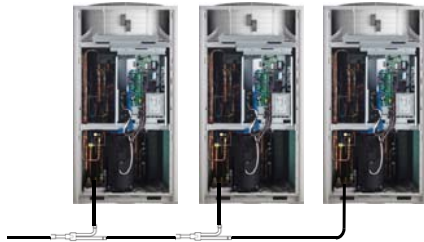

NOTE: Outdoor connections shown vertical for simple viewing
All outdoor fittings must be installed horizontally
One pipe shown for example only


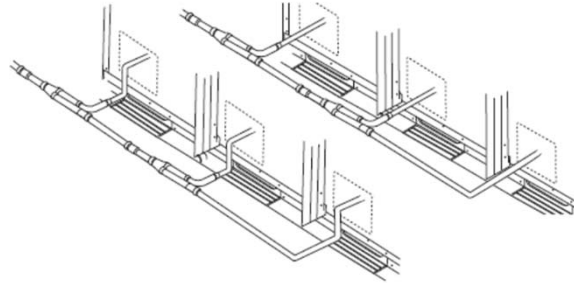


©2019 Samsung All rights reserved.

SAMSUNG

153

DVMS Piping Connections

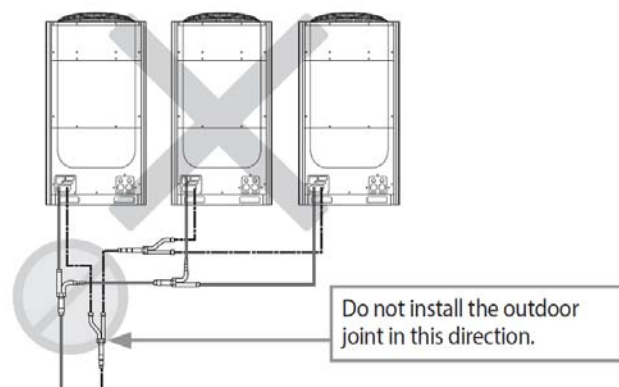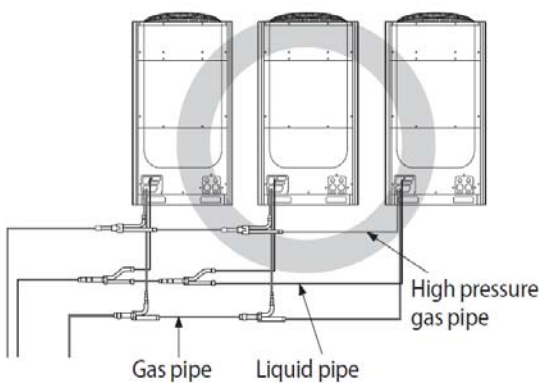

* High pressure gas pipe only applies to the H/R product.

©2019 Samsung All rights reserved.

SAMSUNG

154

DVMS Piping Connections



In modular systems all piping must be parallel with the units, these images are improper installation


©2019 Samsung All rights reserved.

SAMSUNG

155

DVM S Piping Isolation Valves

- Isolation valves must be installed directly after a Y-joint, Header port or MCU port
- Service port must be located on the indoor unit side
- Allows future indoor unit service, replacement or additional installation to be done easier
- May allow main system operation during IDU service or replacement
- General Specifications
 - Full port, Bi-flow, Service port, Rated up to 750psi

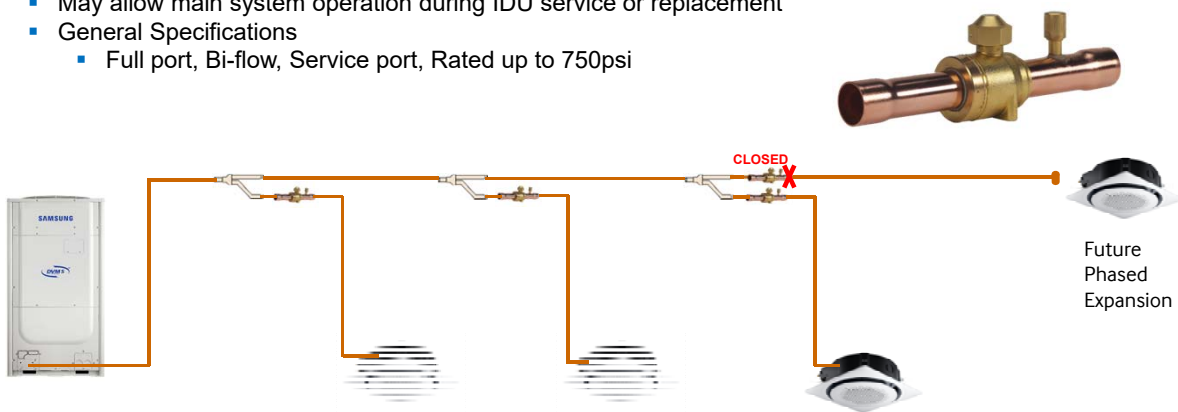


©2019 Samsung All rights reserved.

SAMSUNG

156

DVM S Piping Isolation Valves Heat Recovery Example

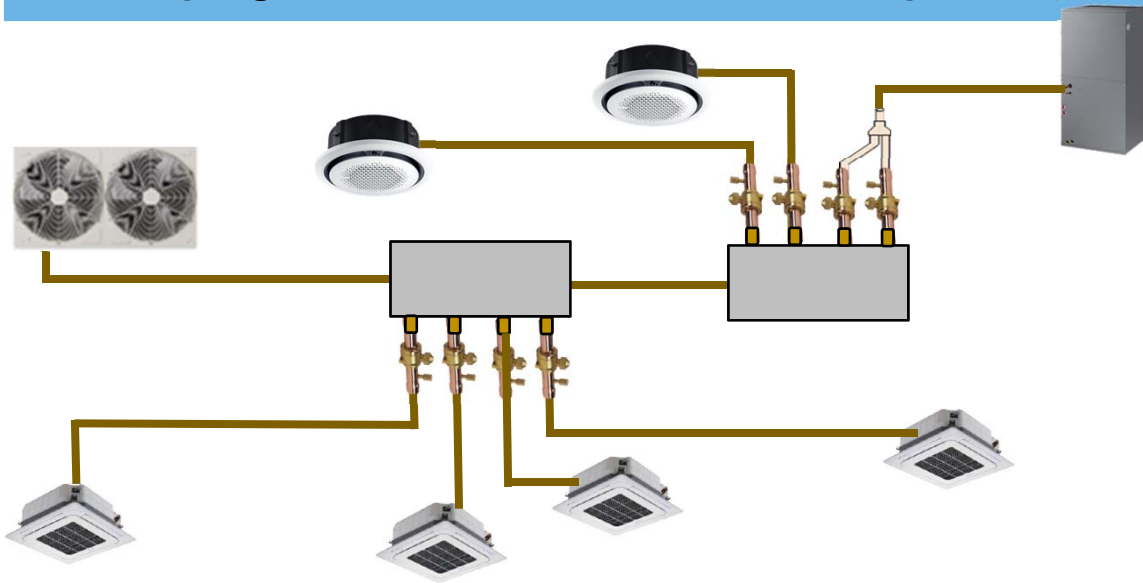


©2019 Samsung All rights reserved.

SAMSUNG

157

DVM S Piping - Inverted Traps

- Modular systems (2 or 3 ODU's) outdoor unit piping
- When the piping length between outdoor unit and branch joint exceeds 6 1/2ft. An inverted trap is required
 - Trap rise: 8 to 12 inches
 - Trap Width = 1/2H

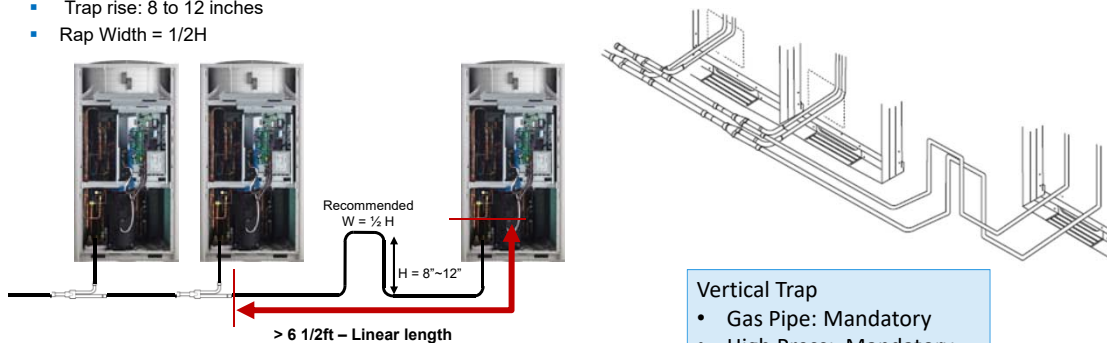

Vertical Trap

- Gas Pipe: Mandatory
- High Press: Mandatory
- Liquid Pipe: Optional

NOTE: Outdoor connections shown vertical for simple viewing. All outdoor fittings must be installed horizontally. One pipe shown for example only.

©2019 Samsung All rights reserved.

SAMSUNG


158

DVM S Piping - Inverted Traps

Example 1. From branch joint1 to Sub2
 - Sum pipe length : $5+5+4=14$
 \therefore Inverted trap required

Example 4. From branch joint1 to branch joint 2
 - Sum pipe length : 7
 \therefore Inverted trap required

Example 3. From branch joint2 to Main
 - Sum pipe length : $6+1=7$
 \therefore Inverted trap required

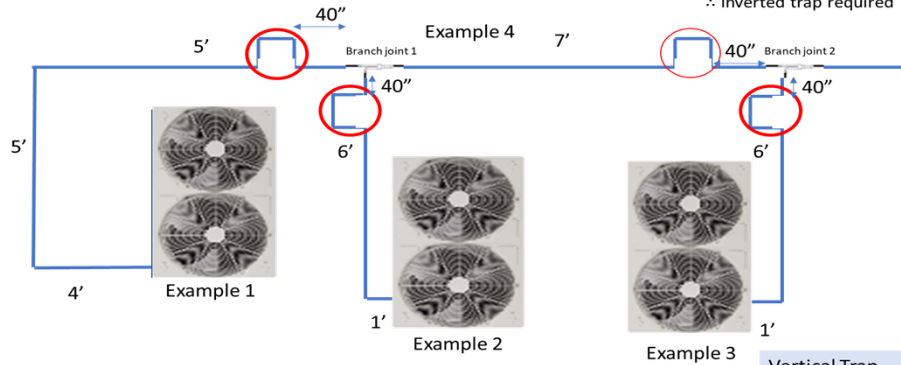

Install traps 40" from any Tee connection,
 Traps must be 8 – 12 " in height
 Vertical position only

Example 2. From branch joint1 to Sub1
 - Sum pipe length : $6+1=7$
 \therefore Inverted trap required


Vertical Trap
 • Gas Pipe: Mandatory
 • High Press: Mandatory
 • Liquid Pipe: Optional

©2019 Samsung All rights reserved.

SAMSUNG

159

Heat Pump General Piping Limitations

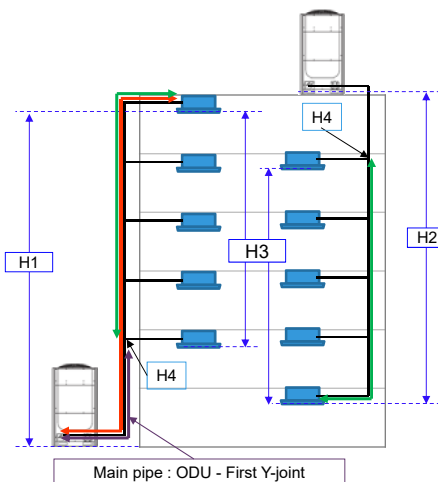

Classification	Pipe	Length
Max length	Total piping length	3281'
	ODU – IDU (equivalent)	656'(722')
	ODU-ODU(equivalent)	33'(43')
	1 st branch joint - farthest IDU H4	148'/295'
Level difference	ODU~IDU H1	131'/361'
	ODU~IDU H2	164'/361'
	IDU~IDU H3	164'
	ODU~ODU	0'


- 1) The pipe size(Liquid & Low pressure gas) shall be increased by one grade over 148'
- 2) PDM kit may be required over 164'.
- 3) Pipe size up is required according to condition

©2019 Samsung All rights reserved.

SAMSUNG

160

Heat Recovery General Piping Limitations

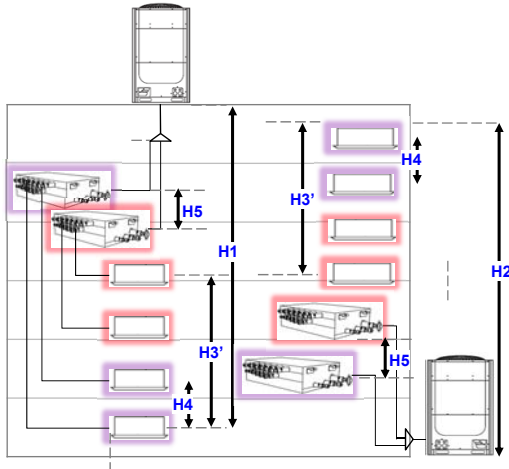

Classification	Pipe	Length
Max length	Total piping length	3281'
	ODU – IDU (equivalent)	656'(722')
	MCU - Indoor unit	148'
	ODU-ODU(equivalent)	33'(43')
	1 st branch joint - farthest IDU	148'/295'
Level difference	ODU~IDU H1	164'/361'
	ODU~IDU H2	131'/361'
	IDU~IDU in different MCU H3	131'
		49' for highwall with internal EEV
	IDU-IDU or IDU-MCU in one MCU H4	49'
	MCU-MCU H5	98'
	MUC-MCU in series	16'
	ODU~ODU	0'

- 1) The pipe size(Liquid & Low pressure gas) shall be increased by one grade over 148'
- 2) PDM kit may be required over 164'.
- 3) Pipe size up is required according to condition

©2019 Samsung All rights reserved.

SAMSUNG

161

Water Cooled Refrigerant Piping

AM072/096/120/192HXWA (HP& HR)

Liquid service valve

Dual pressure hot gas service valve

HR – Suction gas service valve

Heat Pump Valve (open)
HR- Closed



©2019 Samsung All rights reserved.


SAMSUNG

162

Water Cooled Refrigerant Piping

Modular systems

- The refrigerant piping can be installed above the condensers
 - Heat Pump – Install an inverted trap ($\geq 8"$) in the dual pressure gas piping
 - Heat Recovery – Install an inverted trap ($\geq 8"$) in the dual pressure gas and suction gas piping

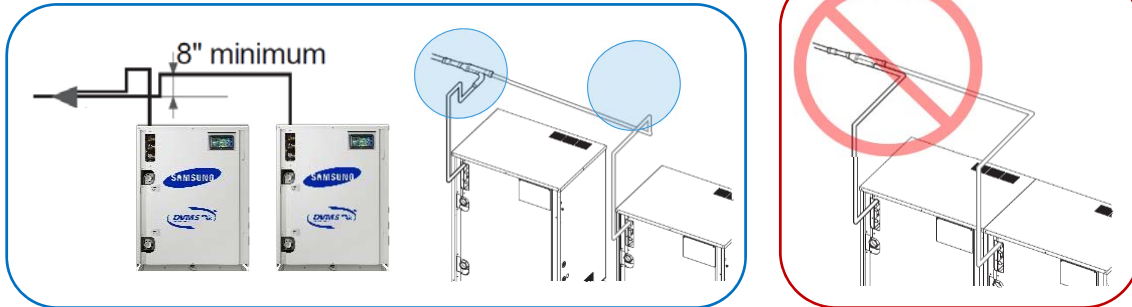

©2019 Samsung All rights reserved.


SAMSUNG

163

Water Cooled Refrigerant Piping

Modular systems

- The refrigerant piping can be installed horizontally below the condensers
- Refrigerant piping must not block the front service panel
- The condenser branch "Tee" fittings must be installed horizontal level, never vertical

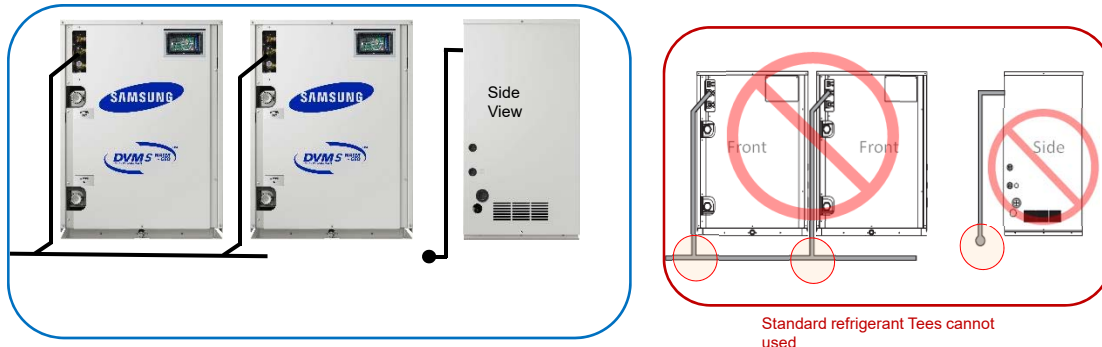

©2019 Samsung All rights reserved.

SAMSUNG



164

Water Cooled Refrigerant Piping Connections

Modular systems

When the refrigerant piping is installed horizontally below the condensers and there is a piping length between condenser module and branch fitting of 6.5' or more:

- An inverted trap must be installed in the gas piping

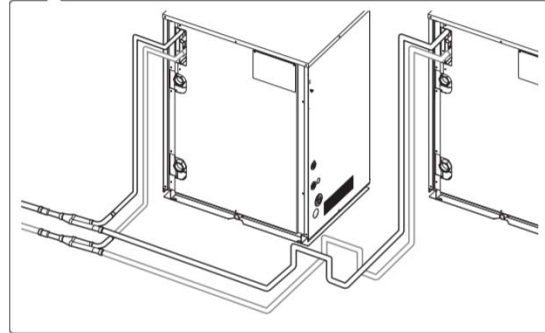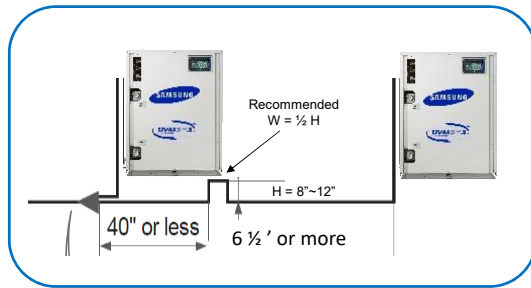

©2019 Samsung All rights reserved.


SAMSUNG

165

Water Cooled Piping Limitations

Piping limitations

- Total Pipe length : 1640ft
- Max pipe length : 558ft (equivalent 623ft)
- Max pipe length(ODU~ODU) 33ft (equivalent 43ft)
- Max level difference(ODU~IDU)
 - 164ft when ODU is highest
 - 131ft when ODU is lowest
- Max level difference(IDU~IDU) : 164ft
- Max pipe length from 1st branch joint to furthest indoor unit : 148ft 295ft under special conditions (note 1)
- HR Max level difference (MCU – MCU) : 98ft
- HR Max level difference IDU - IDU in one MCU 49ft
- HR Max level difference IDU - IDU in one system : 131ft

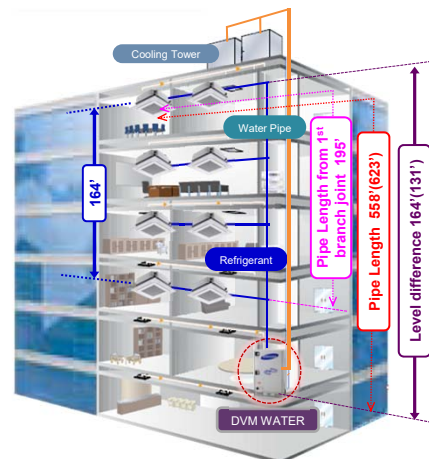

※ Standard Water Pressure : 284 psi or less

1) Pipe size must be increased one size

©2019 Samsung All rights reserved.

SAMSUNG

166



Water Side System Components - Field Supplied

Closed loop flow switch – **Mandatory**

- Prove water flow through the closed loop and plate heat exchanger
 - Flow switch must be carefully installed according to manufacturer's installation instructions

Closed loop inlet strainer 50 Mesh – **Mandatory**

- Required to filter the water entering the plate heat exchanger



©2019 Samsung All rights reserved.

SAMSUNG

167

Recommended System Components - Field Supplied

Recommended water side components

- Closed loop supply & return temperature gauges
 - Monitor water ΔT through the PHE
- Closed loop supply & return pressure gauges
 - Monitor pressure drop through the PHE
- Closed loop supply & return ball style service valves
- Refer to the Installation Manual and the Water Guide Manual for specific guidelines on the closed loop design and requirements



©2019 Samsung All rights reserved.

SAMSUNG

168

Field Piping Components

Refrigerant Components Not To Be Used in DVM S Systems

- Liquid line drier
- Liquid sight glass
- Copper Tee's
- Aluminum tubing




©2019 Samsung All rights reserved.

SAMSUNG

169

Field Piping Components

- Required Refrigerant Components
- ACR – dehydrated and sealed copper tubing – Soft & Hard drawn
- Field piping insulation – Wall thickness from 1/2" up to 1 1/2"
- Always follow state and local codes for insulation requirements

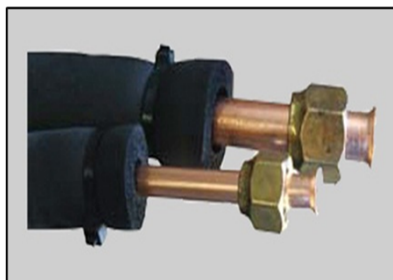

©2019 Samsung All rights reserved.

SAMSUNG

170

Required Refrigerant Components

Field Piping Support

- Horizontal support hangers and clamps should be secured around the piping insulation and not the copper pipe
- Vertical piping must be secured with the correct clamp specifically for that purpose
- Always follow state and local codes for proper pipe support



Vertical clamp example



©2019 Samsung All rights reserved.

SAMSUNG

171

Required Installation & Service Tools

- Use a dedicated R-410A manifold set, for DVM S systems only
 - Oil Compatibility
 - PVE/POE
 - (5/16" flare recommended)
- Vacuum rated hoses recommended for system evacuation
- Maintain Hoses for dependability
 - replace as needed




©2019 Samsung All rights reserved.

SAMSUNG

172

Required Installation & Service Tools

- Always use the appropriate size tubing cutters with a sharp cutting wheel
- When cutting copper tubing the cut ends must be de-burred to provide a square end to provide a perfectly flat and smooth surface for making good flares
- To properly remove the cut burrs, a “deburring” tool is preferred to provide a smooth and square cut end in the tubing



©2019 Samsung All rights reserved.

SAMSUNG

173

Required Installation & Service Tools

- Use a burnishing or eccentric - burnishing type 45° R-410A rated flare tool for high quality flares
 - Burnished flare cones provide a superior seal
- Samsung DVMS indoor units provide the proper flare nuts

Preferred



Eccentric – Burnishing 45° Flare Tool

- Off-center cone rolls copper into a 45° burnished flare
- Handle clutch releases to avoid excessive torque on the tubing and flare
- 1/4" to 3/4" flares



©2019 Samsung All rights reserved.

SAMSUNG

174

Making A Good R-410A Flare

- After cutting and deburring the copper tube, place the flare nut onto the copper pipe
- Set the copper pipe into the flare block and adjust the height
- Apply any synthetic oil to the flare cone inner and outer surfaces only
 - Pen style applicators allow better oil distribution
- Run the flare handle in twice for a well polished flare cone
- Do not lubricate the flare threads
- Verify correct flare diameter by using a flare gauge
- Do not use any type of thread sealant on the flare threads
- Always use a torque wrench with a backup wrench to properly tighten flare nut connections
- Refer to the unit Installation Manual for flare nut torque specifications by flare nut size

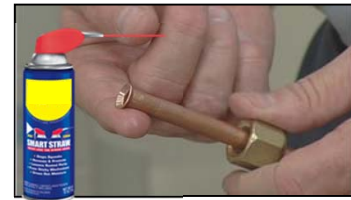

©2019 Samsung All rights reserved.

SAMSUNG

175

Required Installation & Service Tools

Vacuum Pump

- Pump capacity should be a minimum of 6 cfm
- Vacuum pump must have a built-in check valve
- Pump must be kept properly maintained
- Start the evacuation process with new pump oil
 - Large systems may require additional oil changes



©2019 Samsung All rights reserved.

SAMSUNG

176

Required Installation & Service Tools

Digital Vacuum Gauge

- it is imperative to properly evacuate the system to remove all moisture
- All Samsung DVMS systems must be triple evacuated down to 500 microns or less
 - The moisture level can only be determined with an accurate micron gauge
 - Micron gauge should be connected to the system as far from the vacuum pump as possible for an accurate reading
- **Never evacuate a refrigeration system without a micron gauge**



©2019 Samsung All rights reserved.

SAMSUNG

177

Required Installation & Service Tools

- A good quality digital scale must be used to properly weigh in the liquid R-410A refrigerant
- DVMS systems are charged with liquid R-410A refrigerant by weight based on the length of the liquid lines and the indoor unit models
- All liquid lines should be measured as accurately as possible during installation to insure the proper refrigerant charge calculation
 - Using accurate liquid line lengths, the DVM Pro Design tool will calculate the amount of additional refrigerant required for the system



©2019 Samsung All rights reserved.

SAMSUNG

178

Required Installation & Service Tools



Metric Hex Keys



Adjustable Wrench or
Wrench Set



High Pressure Nitrogen Regulator

Torque Wrench Set



1/4 to 5/16 Adaptor

©2019 Samsung All rights reserved.

SAMSUNG

179

Recommended Installation & Service Tools



1/4 to 5/16 core removable tool
(vacuum rated)



Inverter checker



SNET converter



Tubing Swaging Kit



Low Pressure Nitrogen
Regulator



Tubing Bender

©2019 Samsung All rights reserved.

SAMSUNG

180

Required Piping Practices - Brazing



15% Silver-Phosphorus brazing rods are the recommended brazing material for all Samsung DVMS systems

Never use a brazing material that requires flux to be applied


©2019 Samsung All rights reserved.

SAMSUNG

181

Required Piping Practices - Nitrogen Purge

- A dry nitrogen purge is required for the entire brazing process (Pressure regulated up to 3 psi)
- Using a flow regulator, maintain 2 – 3 PSI of dry nitrogen pressure
- If you are having difficulty maintaining this, partially cover the opposite end of the pipe with tape to maintain pressure
- If flow is too low, oxidation will still form within the tubing
- If flow is too high, it will be difficult to make a quality brazed connection
- Maintain nitrogen flow after brazing is complete until piping cools

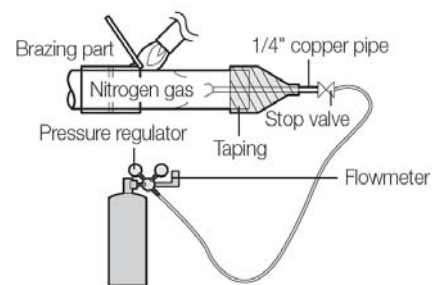

©2019 Samsung All rights reserved.

SAMSUNG

182

Required Piping Practices - Nitrogen Purge

- The nitrogen purge displaces oxygen and prevents oxidation from forming inside the tubing preventing contamination of the refrigerant piping network
- Problems caused include:
 - Plugged up EEV's, filter screens & orifices
 - Contamination of compressor oil
 - Compressor damage



©2019 Samsung All rights reserved.

SAMSUNG

183

Required Piping Practices

- Do NOT cool off the joint immediately after brazing
- Allow joint to cool down naturally as to not stress the bonding of the fill metal.
- After checking with mirror and light, cool with wet rag
- Do Not Lap Fill Metal Over Holes



©2019 Samsung All rights reserved.

SAMSUNG

184

Good Piping Practices

- During the course of installation the piping should be blown out with nitrogen to clear out any debris
- When the refrigerant lines are not connected to the Indoor and outdoor units during construction the piping ends should be pinched off and brazed to properly seal the piping
- Maintaining a dry nitrogen charge in the dormant lines is recommended



Pinched & brazed



Capped or taped not recommended

©2019 Samsung All rights reserved.


SAMSUNG

185

Required Piping Practices – Proper Pipe Routing

Piping around obstacles

- When an obstacle, such as a beam or concrete structure, is in the path of the planned refrigerant pipe run, it is best practice to route the piping over the obstacle or under.
- If adequate space is not available to route the insulated pipe over the obstacle, then route the pipe under the obstacle.
- In either case, it is imperative the length of the horizontal section of pipe above or below the obstacle be a minimum of three (3) times the longest vertical rise (or fall) at either end of the segment.

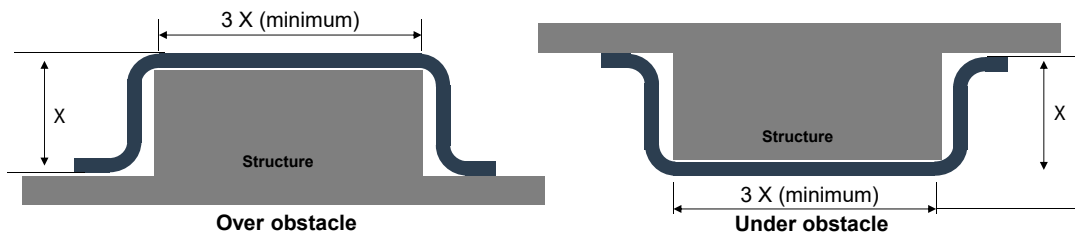

©2019 Samsung All rights reserved.


SAMSUNG

186

High Pressure Leak Test

- Samsung requires a 3 step high pressure nitrogen leak test on the completed system
- All field refrigerant piping is installed and connected to the Outdoor and Indoor units
 - ODU stop valves are closed

1. Pressurize the system to 100 psi for 5 minutes
2. Increase the pressure to 300 psi for 5 minutes
3. Increase the pressure to 600 psi and hold for 24 hours

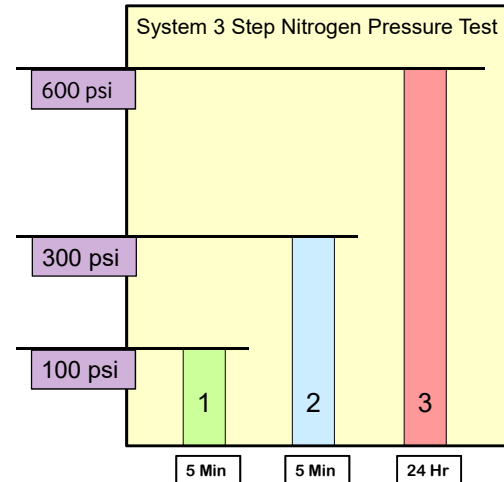

©2019 Samsung All rights reserved.

SAMSUNG

187

Leak Test Pressure Drop

- Nitrogen pressure is subject to pressure fluctuation above 300 psi, based on ambient temperature changes
 - Use this formula to compensate for temperature changes from one day to the next when performing the 24 hour pressure test
- The following formula will determine system pressure drop caused by low ambient temperature change

Record the **Temperature** when the system is **pressurized** (**Tp**)
 Subtract the **Temperature** when the pressure is **checked** (**Tc**)
 Multiply by a factor of 0.80 to get the **Pressure Drop** (**PD**)

$$(T_p - T_c) \times 0.80 = \text{Pressure Drop}$$


©2019 Samsung All rights reserved.

SAMSUNG

188

High Pressure Leak Test

- To properly check for leaks in the piping network during the high pressure test, use only commercial liquid gas leak detector
- Never use household liquid soap for leak detection
- Never use a refrigerant dye for leak detection
- Never use an injectable refrigerant leak sealant



©2019 Samsung All rights reserved.

SAMSUNG

189

System Triple Evacuation Procedure

- **Evacuate the system down to 4000 microns**
 - Break vacuum with dry nitrogen – Hold for 15 minutes
- **Evacuate the system down to 1500 microns**
 - Break vacuum with dry nitrogen – Hold for 15 minutes
- **Evacuate the system down to 500 microns or less**
 - Hold the vacuum for 60 minutes
 - **DO NOT** remove manifold gauges with system under vacuum
 - **DO NOT** leave system under vacuum
- **Use the system vacuum to draw in the additional refrigerant charge as calculated by DVM Pro**



©2019 Samsung All rights reserved.

SAMSUNG

190




191



192

SNET Pro 2 Introduction

- SNET Pro 2 Service Software is used to monitor and program all Samsung DVM S systems
- DVM S system commissioning and configuration can be performed through the local remote controllers however, use of the SNET Pro 2 is easy and strongly recommended
- This section will cover the basic use and operation of the SNET Pro 2 software

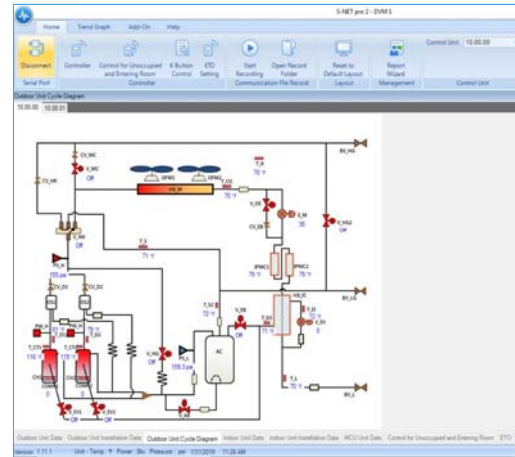

©2019 Samsung All rights reserved.

SAMSUNG

193

SNET Pro 2 Communication Converter

- **MIM-C02N** – Includes the communication converter, USB cable, and firmware update cable, field supplied 16/2 stranded/ shielded cable is required to connect to the main PCB
 - The firmware update cable is used to connect to a PCB and reprogram the MICOM with new firmware

S-Converter



USB Cable



Firmware Update Cable



Control wire - Field supplied



NOTE: Software and driver can be downloaded from www.samsunghvac.com

©2019 Samsung All rights reserved.


SAMSUNG

194

SNET Pro 2 Introduction

MIM-C02N Components

RS232-to-RS485 S-Converter bottom view

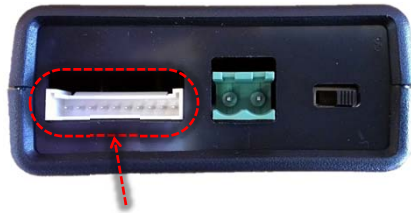

Firmware update cable



- Equipment/control PCB update cable connection
- Included cable will allow connection of the converter to IDU & ODU controller PCB's for firmware updates
- This is one of two ways to reprogram a PCB with updated firmware

©2019 Samsung All rights reserved.

SAMSUNG

195

SNET Pro 2 Introduction


USB cable

- Connect the USB cable to the Laptop computer and the S-Converter
- After connection wait 30 seconds before opening software, this allows Windows to configure COM port

RS485 Communication

- Connect TX+ and TX- on the S-Converter to F1 and F2 at any F1/F2 connection point with field-provided control wire

Run S-NET Pro 2

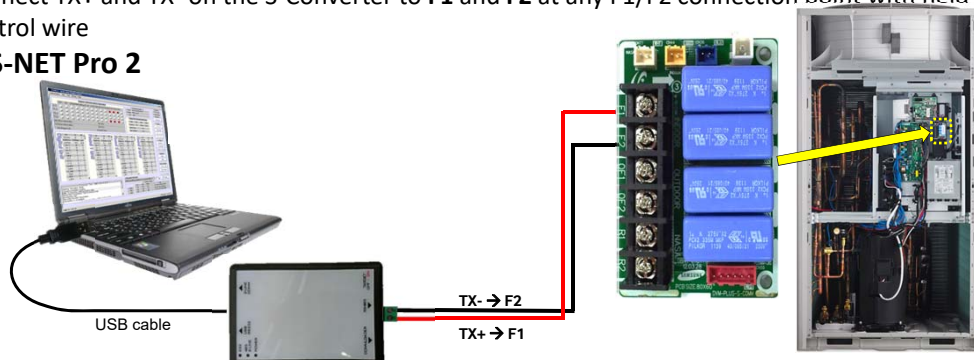


©2019 Samsung All rights reserved.

SAMSUNG

196

SNET Pro 2 Introduction

- SNET Pro 2 version 1.4.6 or newer will allow connection to **R1 R2** on the ODU communication terminal block
 - This will allow connection of multiple systems on a central controller **R1 R2** communication line

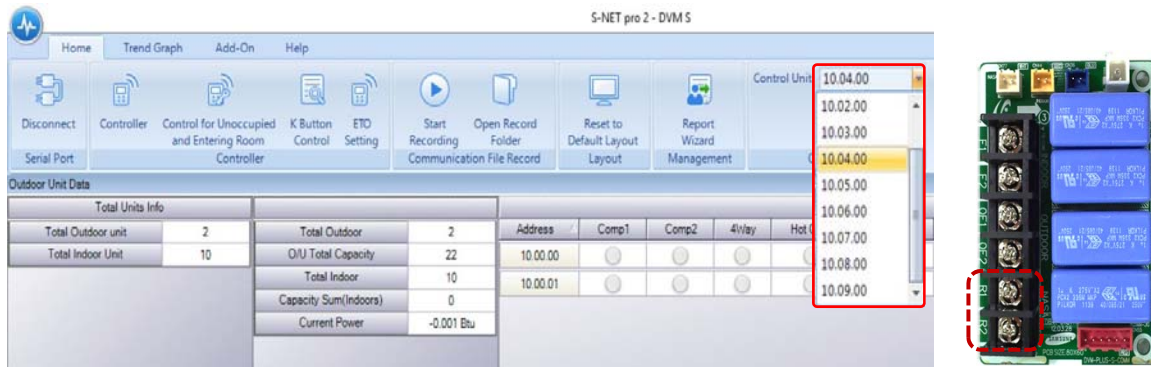


©2019 Samsung All rights reserved.

SAMSUNG

197

SNET Pro 2 Introduction

Status LED's

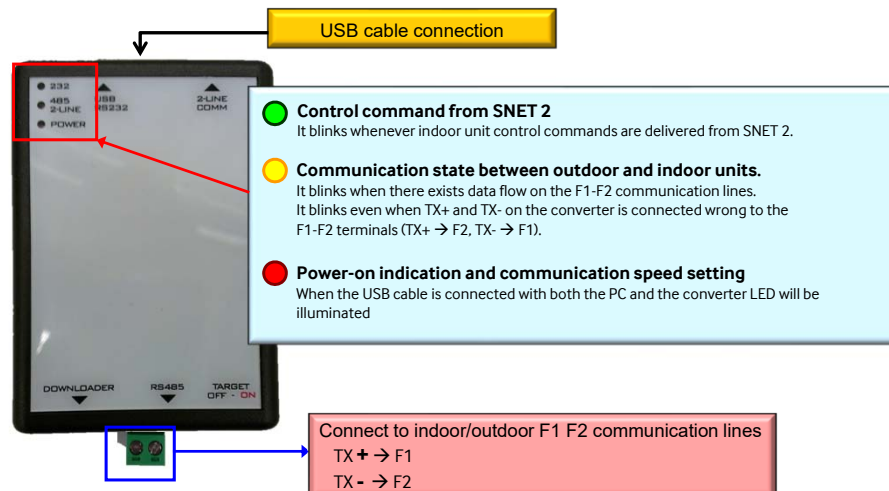

©2019 Samsung All rights reserved.

SAMSUNG

198

Main Screen - Basic Layout

The screenshot shows the main interface of the S-NET Pro 2 software. Key components are labeled with red dashed boxes and arrows:

- Configuration**: Points to the top-left menu bar.
- Main menu**: Points to the top-right menu bar.
- Automatic start-up report generation to PDF file**: Points to a button in the top-right area.
- SNET Pro 2 connection**: Points to the 'Connect' button in the top-left area.
- Indoor unit control panel**: Points to the 'Control for Unoccupied and Entering Room' button.
- Layout initialization**: Points to the 'Reset to Default Layout' button.
- Replay data file location opening**: Points to the 'Open Record Folder' button.
- Data backup 1. Comm. data 2. Excel data**: Points to the 'Start Record' and 'Record File Location' buttons.
- Software version**: Points to the 'Report Wizard' button.
- Communication state (flickering)**: Points to the 'COM' status indicator in the bottom-right corner.

The main display area shows a table of installed units with columns for Address, Outdoor Units, and Indoor Units. It also displays various system parameters like Total Outdoor, CPU Total Capacity, and Current Power.

©2019 Samsung All rights reserved.

SAMSUNG

199

Configuration

The screenshot shows the 'Configuration' window of the S-NET Pro 2 software. Key components are labeled with red dashed boxes and arrows:

- 1.**: Points to the 'Configuration' button in the top-left corner of the main window.
- Configuration**: Points to the title bar of the configuration window.
- Regional Setting**: Points to the 'Language' and 'Market Region' dropdowns.
- Unit of Measure**: Points to the 'Temperature', 'Power', and 'Pressure' units.
- Data Recording**: Points to the 'Record Folder', 'Excel Write Interval', and 'Record Folder Max Size' fields.
- Options**: Points to the 'Options' button in the bottom-right corner of the configuration window.

The configuration window includes sections for Regional Setting, Unit of Measure, and Data Recording. The 'Data Recording' section is highlighted with a red dashed box.


©2019 Samsung All rights reserved.

SAMSUNG

200


Configuration

Click **“Connect”** to initiate communication with the **DVM S** system

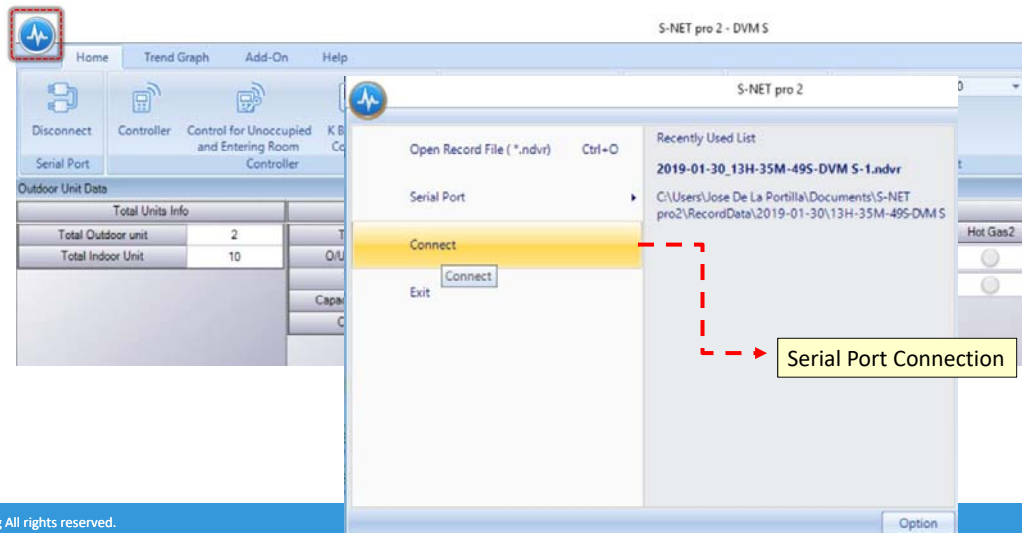

201

Main Screen

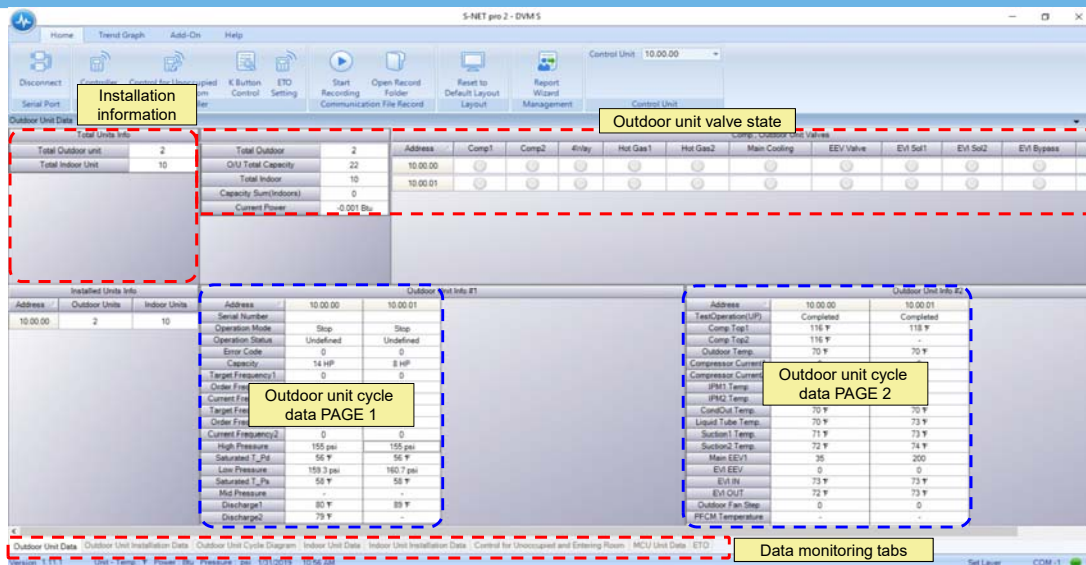

202

Main Screen

The screenshot displays the S-NET pro 2 - DVMS Main Screen. The interface includes a top menu bar with options like Home, Trend Graph, Add-On, and Help. Below the menu is a toolbar with various control icons. The main area is divided into several sections:

- Total Units Info:** A table showing Total Outdoor unit (2) and Total Indoor Unit (10). A red dashed box highlights the 'Total Outdoor' value, with an arrow pointing to a label 'Total number of outdoor units'.
- Installed Units Info:** A table showing Outdoor Units (2) and Indoor Units (10). A red dashed box highlights the 'Outdoor Units' value, with an arrow pointing to a label 'Total number of indoor units'.
- Outdoor Unit Info #1:** A detailed table for the first outdoor unit, including fields like Address, Serial No., Operation Mode, Operation Status, Error Code, Capacity, Target Frequency, Order Frequency, Current Frequency, High Pressure, Saturated T_{ps}, Low Pressure, Saturated T_{ps}, Mid Pressure, Discharge1, and Discharge2.
- Outdoor Unit Info #2:** A detailed table for the second outdoor unit, including fields like Address, Serial No., Operation Mode, Operation Status, Error Code, Capacity, Target Frequency, Order Frequency, Current Frequency, High Pressure, Saturated T_{ps}, Low Pressure, Saturated T_{ps}, Mid Pressure, Discharge1, and Discharge2.
- Outdoor unit control panel:** A red dashed box highlights the 'Outdoor Unit Info #1' table, with an arrow pointing to a label 'Outdoor unit control panel'.

©2019 Samsung All rights reserved.

SAMSUNG

203

Main Screen

The screenshot displays the S-NET pro 2 - DVMS Main Screen. The interface includes a top menu bar with options like Home, Trend Graph, Add-On, and Help. Below the menu is a toolbar with various control icons. The main area is divided into several sections:


- Total Units Info:** A table showing Total Outdoor unit (2) and Total Indoor Unit (10). A red dashed box highlights the 'Total Outdoor' value, with an arrow pointing to a label 'Main outdoor unit'.
- Installed Units Info:** A table showing Outdoor Units (2) and Indoor Units (10). A red dashed box highlights the 'Outdoor Units' value, with an arrow pointing to a label 'Sub 1 Outdoor unit'.
- Outdoor Unit Info #1:** A detailed table for the first outdoor unit, including fields like Address, Serial Number, Operation Mode, Operation Status, Error Code, Capacity, Target Frequency, Order Frequency, Current Frequency, High Pressure, Saturated T_{ps}, Low Pressure, Saturated T_{ps}, Mid Pressure, Discharge1, and Discharge2.
- Outdoor Unit Info #2:** A detailed table for the second outdoor unit, including fields like Address, Serial Number, Operation Mode, Operation Status, Error Code, Capacity, Target Frequency, Order Frequency, Current Frequency, High Pressure, Saturated T_{ps}, Low Pressure, Saturated T_{ps}, Mid Pressure, Discharge1, and Discharge2.
- Outdoor unit control panel:** A red dashed box highlights the 'Outdoor Unit Info #1' table, with an arrow pointing to a label 'Sub 2 Outdoor unit if present'.

©2019 Samsung All rights reserved.

SAMSUNG

204

Main Screen

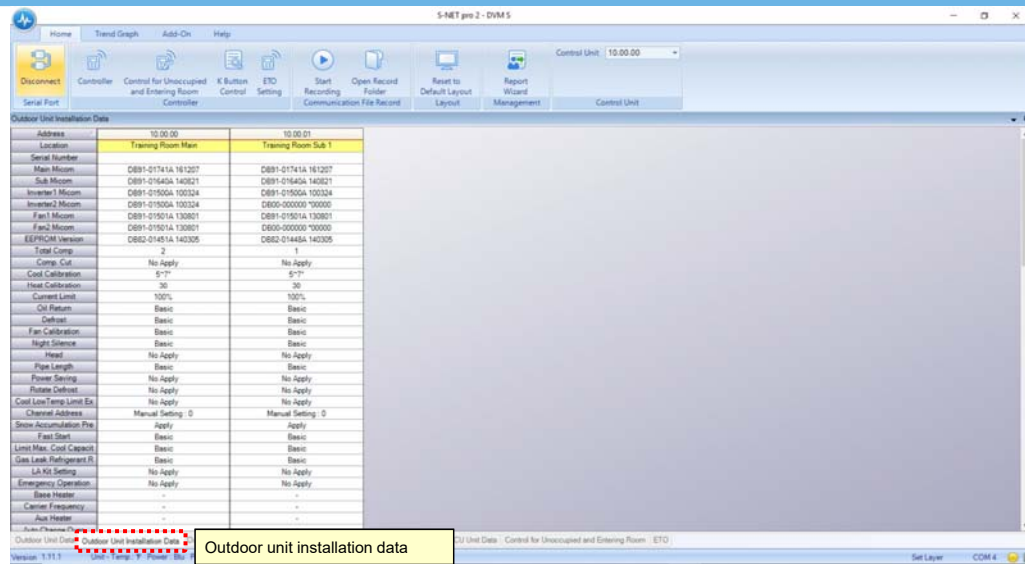


©2019 Samsung All rights reserved.

SAMSUNG

205

Changing The Outdoor Unit Name - Video

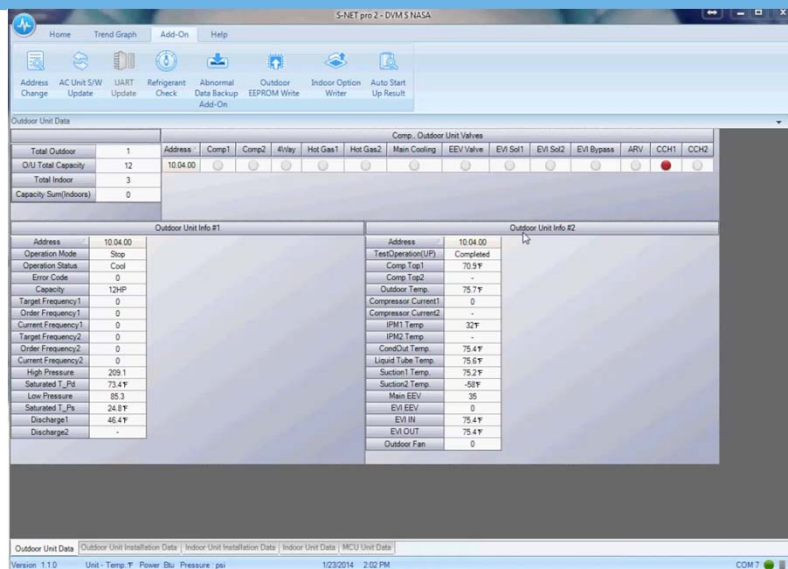

©2019 Samsung All rights reserved.

SAMSUNG

206

Indoor Unit Data Screen

Address	Capacity	Power	Mode	Fan Speed	Set Temperature	Room Temp	Eva In	Eva Out	EEV	Discharge(Duct)	Error Code	Serial Number	MTFC Status
0	7538.5		Cool	High	37.4°F	66.2°F	37.5°F	45.9°F	230	45°F	0	Y75APAGD400005K	
1	8728.7		Cool	High	37.4°F	63.5°F	41.5°F	40.6°F	233	-58°F	0	Y75APAGD700030J	
2	37295.5		Cool	High	37.4°F	66.4°F	69.4°F	67.1°F	0	66.2°F	0	Y7KBPALD700030J	
3	7538.5		Cool	High	37.4°F	61.9°F	36.3°F	47.5°F	331	-58°F	0	B112P3HF100002R	
4	11902.8		Cool	High	37.4°F	60.4°F	39.9°F	43.2°F	327	-58°F	0	Y75APAGD800002R	
5	7538.5		Cool	High	37.4°F	63.7°F	42.8°F	45°F	302	-58°F	0	Y7KBPAGD800002R	
6	17457.5		Cool	High	37.4°F	61.2°F	43.2°F	43.3°F	313	-58°F	0	Y7JHPAGD400001B	

Item	Description
Capacity	Indoor unit capacity (variable depending on heat load)
Mode	Operation mode
Speed	Fan speed
Set temp	Set temperature
Intemp	Room temperature
EVA IN	Evaporator inlet temperature
EVA OUT	Evaporator outlet temperature
EEV	EEV open position
Discharge (Duct)	Duct unit discharge air temperature, Cassette and wall units will display "-58" at all times.
MTFC Status	Multi-Tenant Function Controller Status (MCM-S210N)

©2019 Samsung All rights reserved.

SAMSUNG

207

Indoor Unit Installation Data Screen

Address	Model	RMC	Location	Product Option	Installation Option	Installation Option2	Main Micom	MTFC
0	Global 4inlay	00	-	[0]1404F-[1]980C7-[2]04848-[3]30000	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01507A 13/01/23	
1	NeoPorte	01	-	[0]10044-[1]1648F-[2]04848-[3]30020	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01508A 13/01/23	
2	Global 4inlay	02	-	[0]1404F-[1]980C7-[2]04848-[3]30000	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01507A 13/01/23	
3	NeoPorte	03	-	[0]10044-[1]1648F-[2]04848-[3]30020	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01508A 13/01/23	
4	NeoPorte	04	-	[0]10044-[1]1744D-[2]02323-[3]30000	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01508A 13/01/23	
5	NeoPorte	05	-	[0]10044-[1]1648F-[2]04848-[3]30020	[0]20010-[1]00000-[2]00000-[3]00000	[0]80000-[1]00000-[2]00000-[3]00000	DB91-01508A 13/01/23	
6	NeoPorte	06	-	[0]10044-[1]1648F			DB91-01508A 13/01/23	
7	Global 4inlay	07	-	[0]1404F-[1]980C7			DB91-01507A 13/01/23	

©2019 Samsung All rights reserved.

SAMSUNG

208

Indoor Unit Installation Data Screen

Address	Model	RMC	MCU ADDRESS	MCU PORT	Location	Product Option	Installation Option	Installation Option2	Main Micom	Error History1	Error History2	Error History3
0	Big Duct	22	0	A	72 HSP	[011054-1]95097-2300000-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 170417	000	000	000
1	Slim Triley	05	2	C	Wind Free Triley	[017044-1]180C3-2301616-2300010	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01688A 170406	201	213	201
2	Big Ceiling	AB	2	A	Big Ceiling	[013054-1]12479-2300969-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01684A 161227	000	000	000
3	Duct	21	2	F	Slim Duct	[010054-1]21913-2301C 1C-2301110	[020010-1]10000-2300006-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 170417	000	000	000
4	Duct	06	2	D	Duct S	[010054-1]85065-2301616-2301101	[020010-1]10000-2300006-2300000	[030000-1]00000-2300000-2300000	DB91-01688A 170309	000	000	000
5	RAC	00	1	F	Inhaler	[012044-1]9949C-2301C 1C-2301000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01674A 170215	000	000	000
6	Ceiling	20	1	E	Ceiling	[014054-1]95000-2301212-2300010	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 170417	000	000	000
7	Ceiling	20	1	E	Ceiling	[014054-1]95000-2301212-2300010	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 170417	000	000	000
8	360CST	20	2	B	360	[01006F-1]95009-2301212-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01742A 161222	000	000	000
9	Global 4inlay	04	2	E	Wind Free 4 inlay	[01404F-1]95097-2302323-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01742A 161222	201	213	201

©2019 Samsung All rights reserved.

SAMSUNG

209

Changing Indoor Unit Name - Video

Address	Model	RMC	Location	Product Option	Installation Option	Installation Option2	Main Micom	MTFC
18	Slim Triley	7		[017044-1]180C3-2301616-2300010	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 130123	
53	Global 4inlay	53		[01404F-1]95097-2302323-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 130123	
57	Global 4inlay	57		[01404F-1]95097-2302323-2300000	[020010-1]00000-2300000-2300000	[030000-1]00000-2300000-2300000	DB91-01507A 130123	


©2019 Samsung All rights reserved.

SAMSUNG

210

Add-on - Indoor Unit Option Writer

- In the Add-On tab, click **"Indoor Option Writer"** to change indoor basic option settings, advanced option settings, and factory option codes

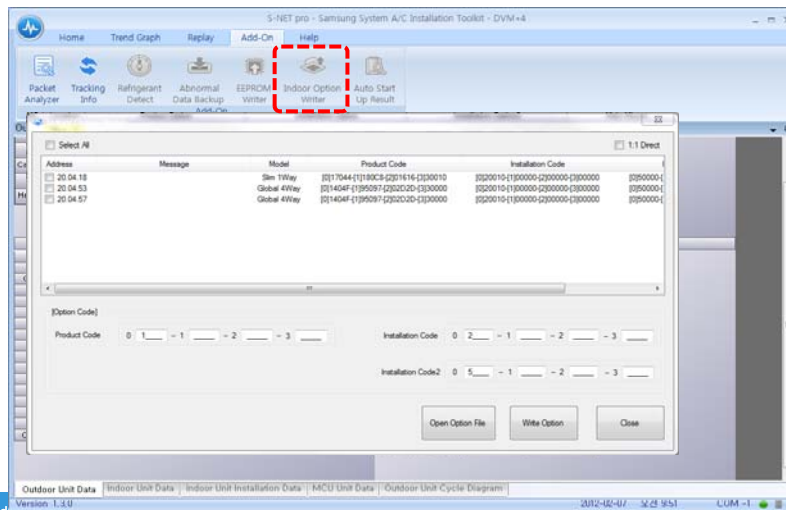

©2019 Samsung All rights reserved

SAMSUNG

211

MCU Tab

[illegible]

©2019 Samsung All rights reserved.

SAMSUNG

212

Main Screen - Controller

• Set layer network reset
• This will completely reset the system
• Equivalent to pressing K3 in outdoor unit
• Resets system like cycling power to outdoor unit

• Limit Controller
• Adjust or clear all upper and lower limits

©2019 Samsung All rights reserved.

SAMSUNG

213

Backup

If the system has disabled itself due to a system error and the system has not been manually reset, data leading up to the error code can be retrieved

- If data is available, the “EEPROM Backup” icon will be available
- Click and follow prompts to save data for review

Download of 30-minute backup data before system error
File name: Modelname_EEPROM_Date_Time.xls
File save location:
1. Default: C:\...My Documents\S-NET pro\RecordData
2. User-set location


©2019 Samsung All rights reserved.

SAMSUNG

214

Trend Graph

1. Click "Add" to create a new window
2. Click "Add" to add items/monitor points to that window

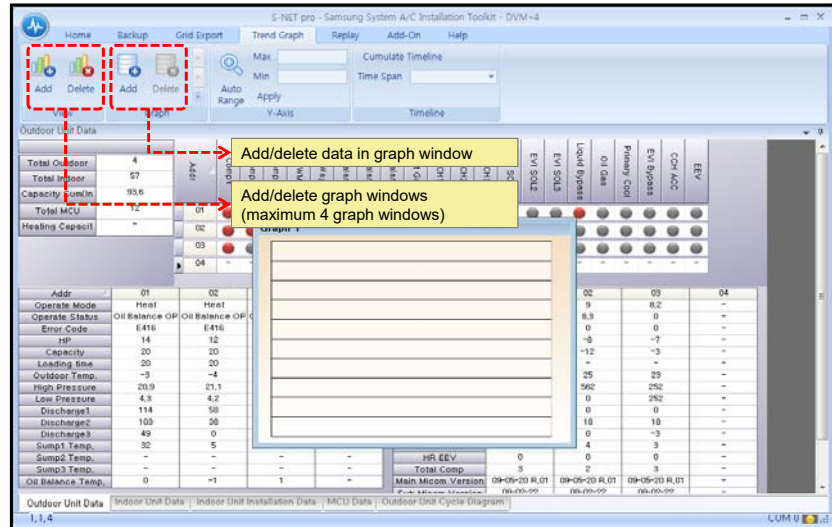


©2019 Samsung All rights reserved.

SAMSUNG

215

Replay

- In the Replay tab, you can view the current position during recorded file viewing
- Here you can also speed up the playback, rewind, or fast forward

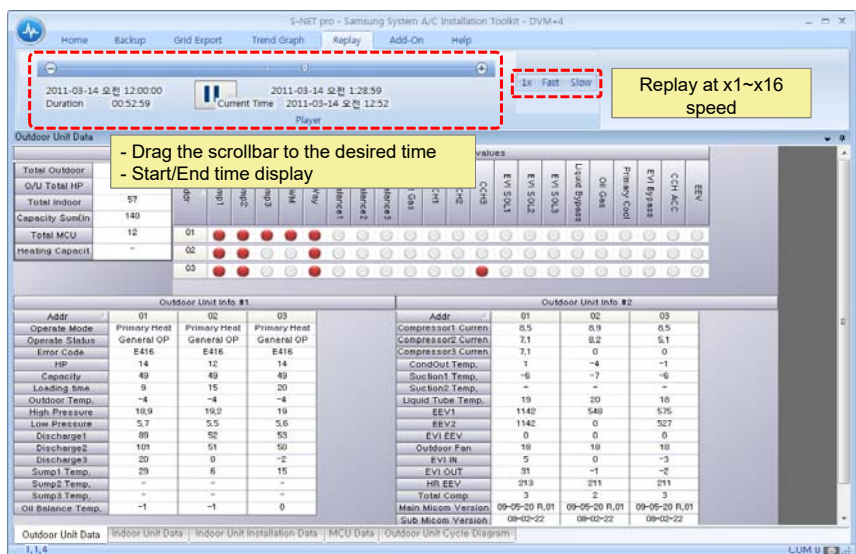


©2019 Samsung All rights reserved.

SAMSUNG

216

Main Menu - Help

In the “**Help**” tab, click “**Error Codes**” to view all error codes with a brief description

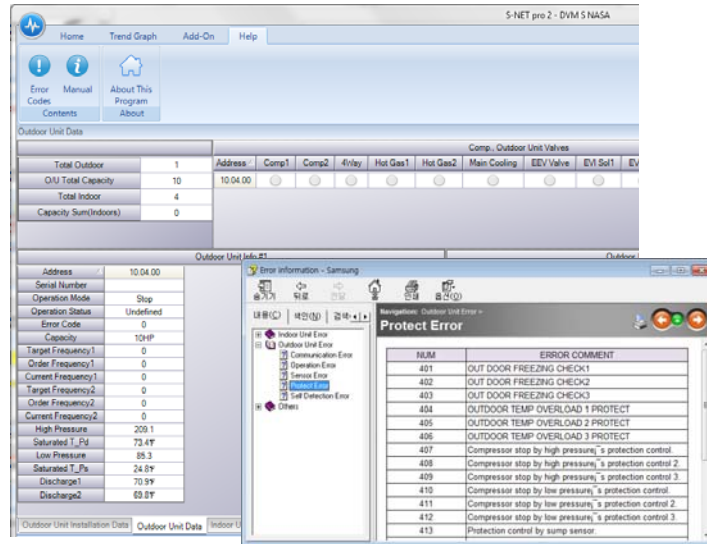


©2019 Samsung All rights reserved.

SAMSUNG

217

Main Menu - Manual

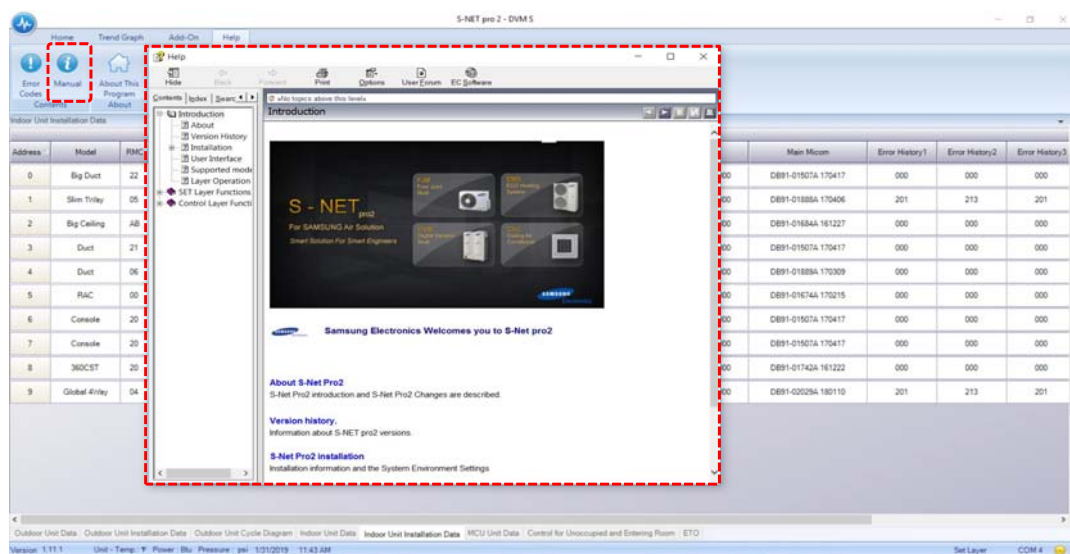

©2019 Samsung All rights reserved.

SAMSUNG

218


Air Cooled Commissioning



219

System Power Up

- Recommended for system commissioning – Power up Indoor units before the outdoor unit(s)
- Outdoor unit(s) should be powered up for a minimum of 3 hours before operation to insure no liquid refrigerant in the compressor crankcase
 - When the outdoor temperature is low, power the outdoor unit(s) at least 6 hours before operation
- Before operating the compressors, all of the service panels must be in place on the outdoor unit(s)
 - Main PCB display and “K” buttons can be accessed through PCB inspection door on front of the unit

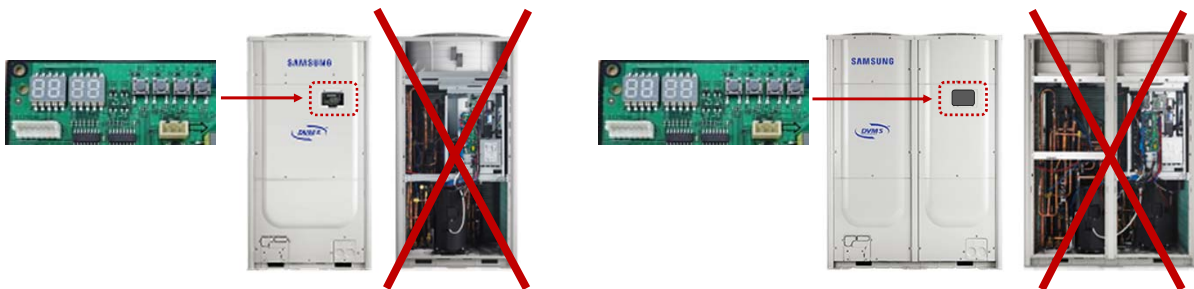



©2019 Samsung All rights reserved.

SAMSUNG


220

MCU Setup

MCU's must be addressed for the system components to communicate

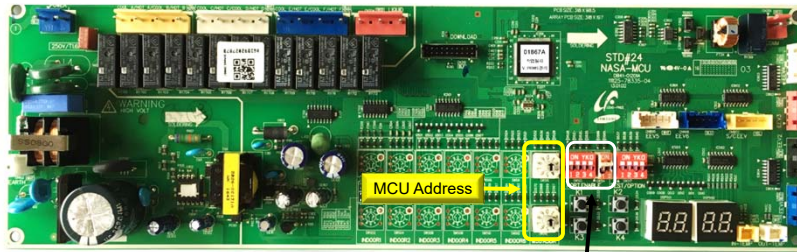


Set a unique address for each MCU in the system

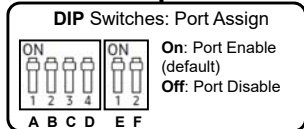

Assign ports to be enabled on each MCU in the system

Example: 6-Port MCU
Individual port connection

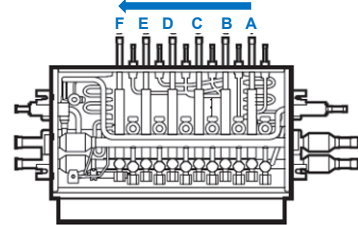

Unused MCU ports must be set to disable before commissioning the system, or an E216 will be generated


©2019 Samsung All rights reserved.

SAMSUNG

221

MCU Setup


Twinning MCU Ports

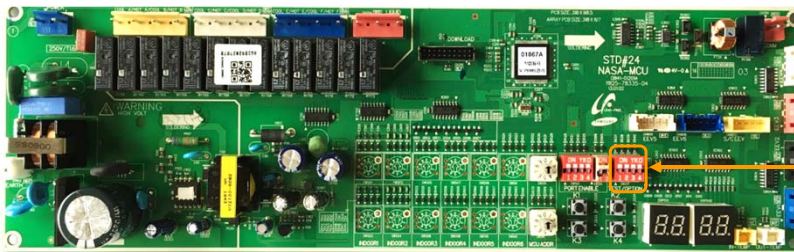



S/W Option DIP Switches
S/W Option



Y-Joint Dual Port Assign



S/W Option DIP switch No.	ON (Default) (Individual connection)	OFF (Shared connection)
1	Each of ports A and B	Pairing port A and B
2	Each of ports C and D	Pairing port C and D
3	Each of ports E and F	Pairing port E and F
4	N/A	N/A

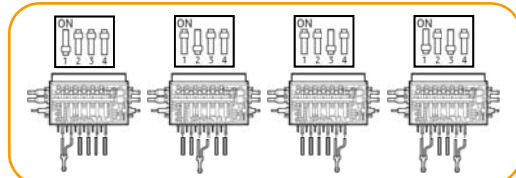

Be sure to cycle power to the MCU'S after changing DIP switch position, or changes will not be saved


©2019 Samsung All rights reserved.

SAMSUNG

222

Outdoor Unit Setup

- K1, K2, K3, and K4 buttons are used to put the system into various service and commissioning modes
- Also used for service mode operations and operation data display

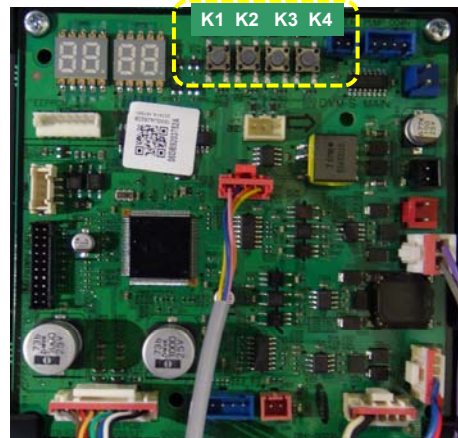



©2019 Samsung All rights reserved.

SAMSUNG

223

Outdoor Unit Setup

- When power is applied to the system, the outdoor unit will display Ad 00 indicating it is awaiting the tracking process
- If the outdoor unit is powered before the indoor units, error codes will appear but will go away once all system components are powered up




Sequence	Display	Details
1		Check display segment <ul style="list-style-type: none"> • Digit "8" flicker consecutively from left to right
2		Starting Tracking <ul style="list-style-type: none"> - "Ad" means starting tracking

©2019 Samsung All rights reserved.

SAMSUNG

224

Outdoor Unit Setup

Sequence	Display	Details
3		The PCB display will indicate "od nd" stating that the unit has not been set as a main or sub unit
4		Press and hold K1 & K2 simultaneously to enter the setting mode. "od" = Outdoor Unit "od 00" = One outdoor unit (Main when more than 1 ODU)
5		Press and release the K4 button to set main or sub for each outdoor unit : "od 00" = Main "od 01" = Sub1 unit "od 02" = Sub2 unit Confirm setting: Press and hold the K2 button, settings are saved This procedure is performed on each outdoor unit

©2019 Samsung All rights reserved.

SAMSUNG


225

Outdoor Unit Setup

Confirm multiple outdoor unit communications

- When the outdoor units are properly set the display indicates the communication status on the Main outdoor unit PCB
- "C" (communication) blinks when outdoor units communicate
- The first sub unit PCB display will be flashing C9/C8 indicating that it is the first sub in the system
- The second sub unit PCB will be flashing CA/C8 indicating it is the second sub in the system

Unit	Main MICOM
Main	8
Sub 1	9
Sub 2	A

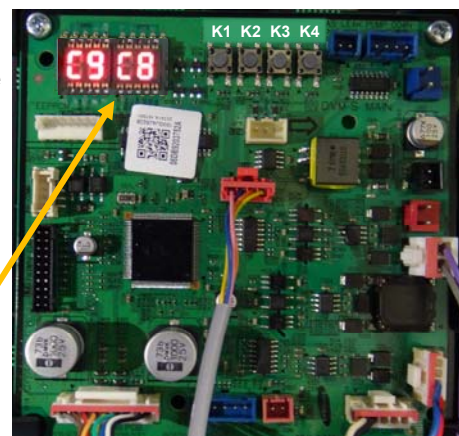


©2019 Samsung All rights reserved.

SAMSUNG

226

Outdoor Unit Settings

- Quantity of Indoor Units
 - Enter the option setting mode
 - Press and hold **K1** & **K2** for 2 seconds
 - Enter the “Indoor Unit Quantity” setting mode:
 - Press **K1** once
 - Manual setting mode
 - Press **K4**: ones
 - Press **K2**: 10's
 - Press and hold **K2** for 2 seconds to save the count display back to normal
 - Automatic setting mode (Preferred)
 - Press and hold **K4** for 2 seconds
 - This is the preferred method, if you install 10 units, but auto only finds seven you know three units are not communicating,
 - SNET can be used to determine which units are not communicating based on missing serial numbers
 - Refer to your plans, and go directly to the units not communicating.

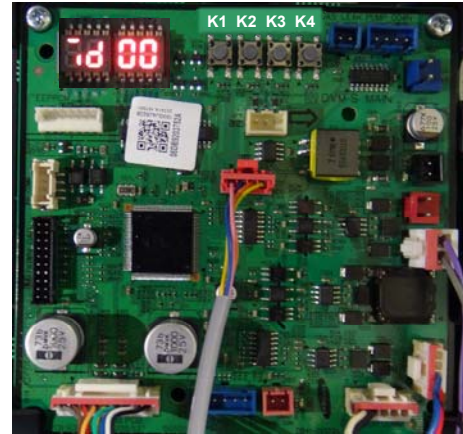


©2019 Samsung All rights reserved.

SAMSUNG

227

MCU Settings

- MCU Quantity
 - Enter the option setting mode
 - Press and hold **K1** & **K2** for 2 seconds
 - Enter the setting mode: Indoor Unit Quantity
 - Press **K1**
 - Enter setting mode: MCU Quantity
 - Press **K1**
 - Manual setting mode
 - Press **K4**: ones
 - Press **K2**: 10's
 - Press and hold **K2** for 2 seconds to save the count display back to normal
 - Automatic setting mode (preferred)
 - Press and hold **K4** for 2 seconds
 - This is the preferred method, if you install 4 MCU'S, but auto only finds 2 you know 2 MCU'S are not communicating,
 - SNET can be used to determine which MCU'S are not communicating based on found MCU addresses
 - Refer to your plans, and go directly to the units not communicating.

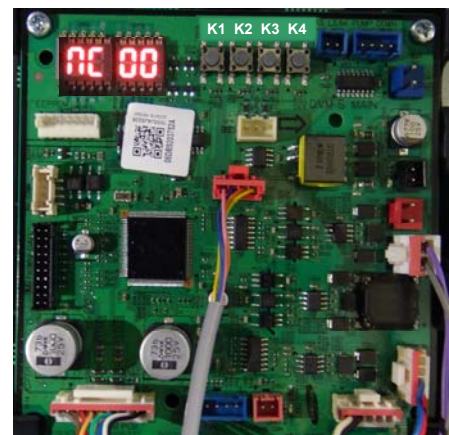

©2019 Samsung All rights reserved.

SAMSUNG


228

MCU Auto Pipe Pairing

You can use the Automatic pipe-pairing setting operation to automatically set the address of each MCU port that is connected to an indoor unit.

To run the Auto Pipe Pairing operation, take the following steps:

1. Press the **K2 button 13 times** on the main PBA of the outdoor unit to start the Auto pipe pairing operation.
2. The display will start with Kh-00 and run through 10 steps (Kh-10) in the pairing process
3. Upon completion the display will show END
4. The operation takes about 25 to 55 minutes normally depending on the number of indoor units connected.(Max 2hours)

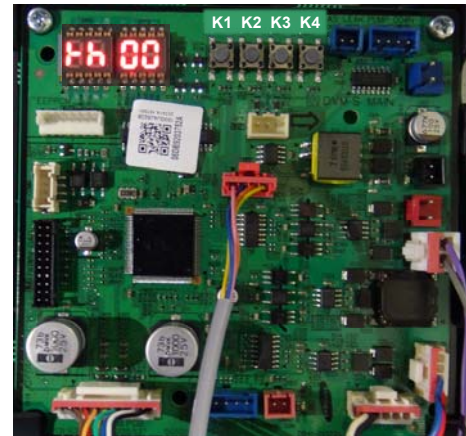


©2019 Samsung All rights reserved.

SAMSUNG

229

Heat Recovery – Auto Pipe Pairing

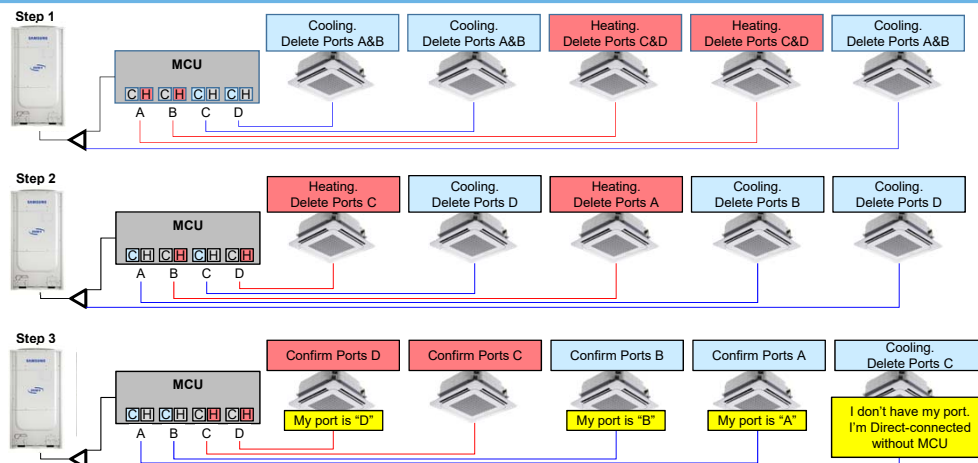

Cooling only units will require an install option code change Segment 3 of the 05 option settings must be changed to 2

©2019 Samsung All rights reserved.

SAMSUNG

230

Auto-Trial Operation

Auto-Trial Operation

- Press and hold K1 on condenser (main) for 5 seconds
 - “UP” – “UnPrepared” displayed
 - Press and hold K1 for 5 seconds to clear
 - “KK” is displayed
 - The condenser will run through various system checks including indoor unit and outdoor sensors
 - When Auto-Trial is complete, unit will stop and display connected equipment addresses



©2019 Samsung All rights reserved.

SAMSUNG

231

Auto-Trial Operation

Heating or Cooling trial operation

Heating Trial Operation: Press K1 two times

Cooling Trial Operation: Press K2 two times

- Operate in Heating or Cooling trial operation to allow the system to stabilize
- The system will operate the indoor units with extreme set temperatures that are normally not available (cooling set temperature = 37°F, heating high temperature of 104°F)
- Depending on the outdoor and indoor conditions, the system should operate at a high capacity
- Wired and wireless controller signals are ignored during this operation
- Maximum time: 10 hours

©2019 Samsung All rights reserved.

SAMSUNG



232



233

System Power Up

- Recommended for system commissioning – Power up Indoor units before the outdoor unit(s)
- Outdoor unit(s) should be powered up for a minimum of 3 hours before operation to insure no liquid refrigerant in the compressor crankcase
 - When the outdoor temperature is low, power the outdoor unit(s) at least 6 hours before operation
 - Main PCB display and “K” buttons can be accessed through PCB inspection door on front of the unit







©2019 Samsung All rights reserved. **SAMSUNG**

234


MCU Setup

MCU's must be addressed for the system components to communicate

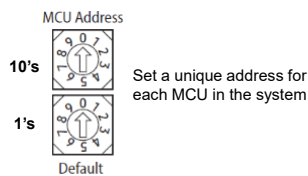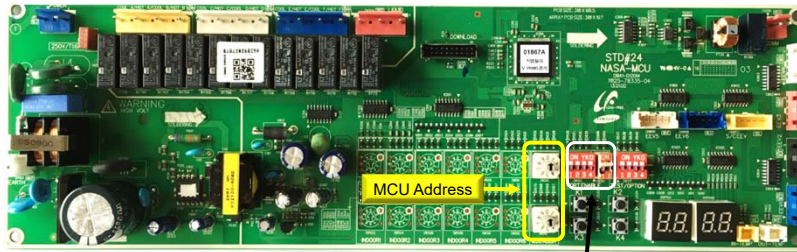

Assign ports to be enabled on each MCU in the system

Example: 6-Port MCU
Individual port connection

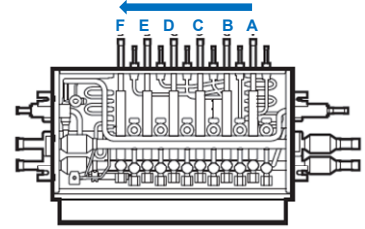

Unused MCU ports must be set to disable before commissioning the system, or an E216 will be generated



©2019 Samsung All rights reserved.

SAMSUNG



235

MCU Setup

Twinning MCU Ports

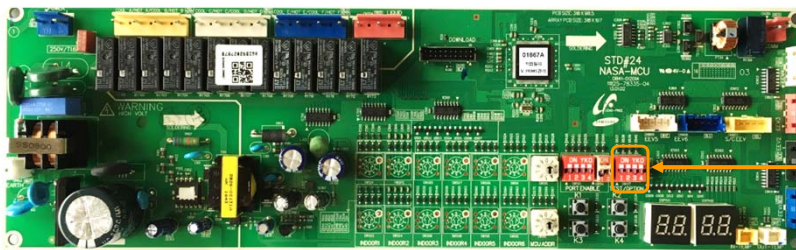

S/W Option	S/W option DIP switch No.	ON (Default) (Individual connection)	OFF (Shared connection)
ON	1	Each of ports A and B	Pairing port A and B
	2	Each of ports C and D	Pairing port C and D
	3	Each of ports E and F	Pairing port E and F
	4	N/A	N/A

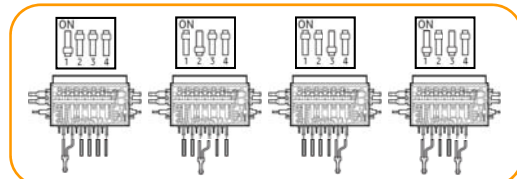

Be sure to cycle power to the MCU'S after changing DIP switch position, or changes will not be saved


©2019 Samsung All rights reserved.

SAMSUNG

236

Outdoor Unit Setup

- K1, K2, K3, and K4 buttons are used to put the system into various service and commissioning modes
- Also used for service mode operations and operation data display

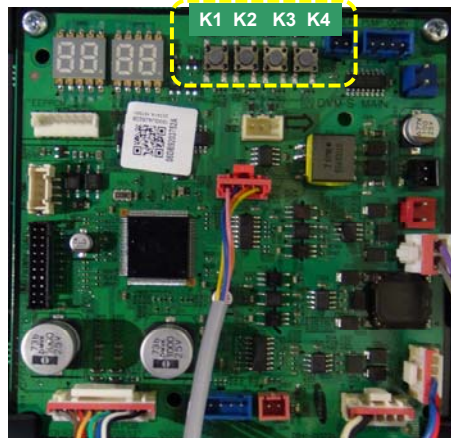


©2019 Samsung All rights reserved.

SAMSUNG

237

Outdoor Unit Setup

- Standard closed loop entering water temperature range: 50°F to 113°F
 - Below 50°F down to 23°F requires antifreeze and PCB option setting
 - Below 23°F down to a 14°F requires antifreeze and PCB option setting
- Press and hold K2 to enter option setting
- Press K1 to change SEG 1&2: to "2","0" Circulating Fluid Flow
- Press K2 to change SEG 3&4: "0","0" = water
- "0","1" Antifreeze – Min 23°F
- "0","2" Antifreeze - Min 14°F

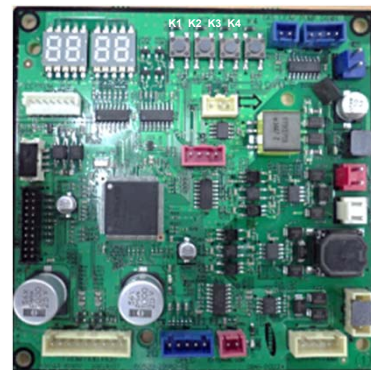

©2019 Samsung All rights reserved.

SAMSUNG

238

System Power Up

- Before starting the system up the unit must be field configured for Heat Pump or Heat Recovery operation
- For heat pump operation the Heat pump valve must remain open
- For Heat Recovery operation the heat pump valve must be closed
- Heat recovery requires "K" tactile setting
- Press and hold K1 & K2 for two seconds to enter setting mode
 - Press K1 three time to set as
 - "ht 01" for heat recovery

Liquid service valve
Dual pressure hot gas service valve
HR – Suction gas service valve
Heat Pump Valve (open)
HR- Closed





©2019 Samsung All rights reserved.

SAMSUNG

239

Outdoor Unit Setup

- When power is applied to the system, the outdoor unit will display Ad 00 indicating it is awaiting the tracking process
- If the outdoor unit is powered before the indoor units, error codes will appear but will go away once all system components are powered up




Sequence	Display	Details
1		Check display segment <ul style="list-style-type: none"> Digit "8" flicker consecutively from left to right
2		Starting Tracking - "Ad" means starting tracking

©2019 Samsung All rights reserved.

SAMSUNG

240

Outdoor Unit Setup

Sequence	Display	Details
3		The PCB display will indicate "od nd" stating that the unit has not been set as a main or sub unit
4		Press and hold K1 & K2 simultaneously to enter the setting mode. "od" = Outdoor Unit "od 00" = One outdoor unit (Main when more than 1 ODU)
5		Press and release the K4 button to set main or sub for each outdoor unit : "od 00" = Main "od 01" = Sub1 unit "od 02" = Sub2 unit Confirm setting: Press and hold the K2 button, settings are saved This procedure is performed on each outdoor unit

©2019 Samsung All rights reserved.

SAMSUNG


241

Outdoor Unit Setup

Confirm multiple outdoor unit communications

- When the outdoor units are properly set the display indicates the communication status on the Main outdoor unit PCB
- "C" (communication) blinks when outdoor units communicate
- The first sub unit PCB display will be flashing C9/C8 indicating that it is the first sub in the system
- The second sub unit PCB will be flashing CA/C8 indicating it is the second sub in the system

Unit	Main MICOM
Main	8
Sub 1	9
Sub 2	A

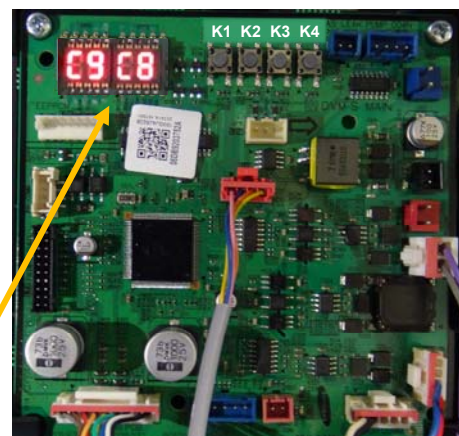


©2019 Samsung All rights reserved.

SAMSUNG

242

Outdoor Unit Settings

- Quantity of Indoor Units
 - Enter the option setting mode
 - Press and hold **K1** & **K2** for 2 seconds
 - Enter the “Indoor Unit Quantity” setting mode:
 - Press **K1** once
 - Manual setting mode
 - Press **K4**: ones
 - Press **K2**: 10's
 - Press and hold **K2** for 2 seconds to save the count display back to normal
 - Automatic setting mode (Preferred)
 - Press and hold **K4** for 2 seconds
 - This is the preferred method, if you install 10 units, but auto only finds seven you know three units are not communicating,
 - SNET can be used to determine which units are not communicating based on missing serial numbers
 - Refer to your plans, and go directly to the units not communicating.

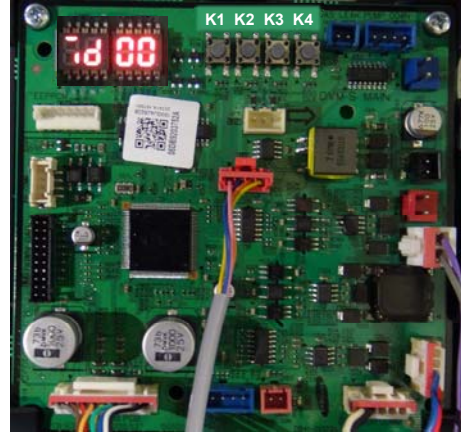


©2019 Samsung All rights reserved.

SAMSUNG

243

MCU Settings

- MCU Quantity
 - Enter the option setting mode
 - Press and hold **K1** & **K2** for 2 seconds
 - Enter the setting mode: Indoor Unit Quantity
 - Press **K1**
 - Enter setting mode: MCU Quantity
 - Press **K1**
 - Manual setting mode
 - Press **K4**: ones
 - Press **K2**: 10's
 - Press and hold **K2** for 2 seconds to save the count display back to normal
 - Automatic setting mode (preferred)
 - Press and hold **K4** for 2 seconds
 - This is the preferred method, if you install 4 MCU'S, but auto only finds 2 you know 2 MCU'S are not communicating,
 - SNET can be used to determine which MCU'S are not communicating based on found MCU addresses
 - Refer to your plans, and go directly to the units not communicating.

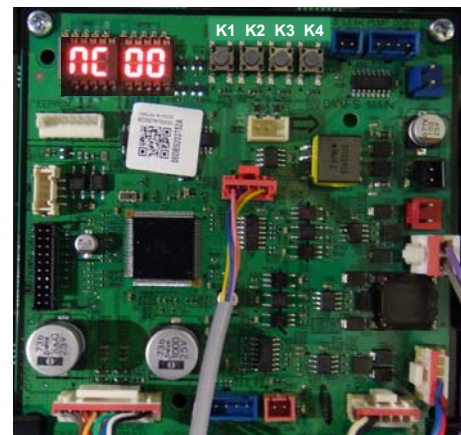

©2019 Samsung All rights reserved.

SAMSUNG


244

MCU Auto Pipe Pairing

You can use the Automatic pipe-pairing setting operation to automatically set the address of each MCU port that is connected to an indoor unit.

To run the Auto Pipe Pairing operation, take the following steps:

1. Press the **K2 button 12 times** on the main PBA of the outdoor unit to start the Auto pipe pairing operation.
2. The display will start with Kh-00 and run through 10 steps (Kh-10) in the pairing process
3. Upon completion the display will show END
4. The operation takes about 25 to 55 minutes normally depending on the number of indoor units connected.(Max 2hours)

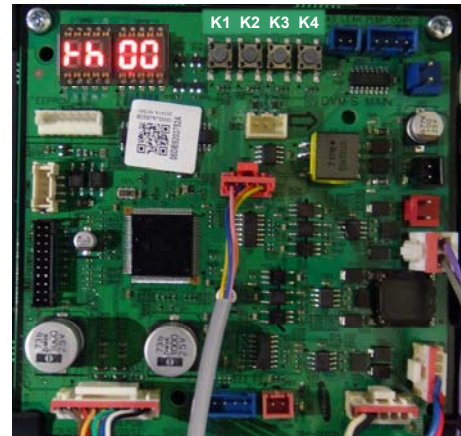


©2019 Samsung All rights reserved.

SAMSUNG

245

Heat Recovery – Auto Pipe Pairing

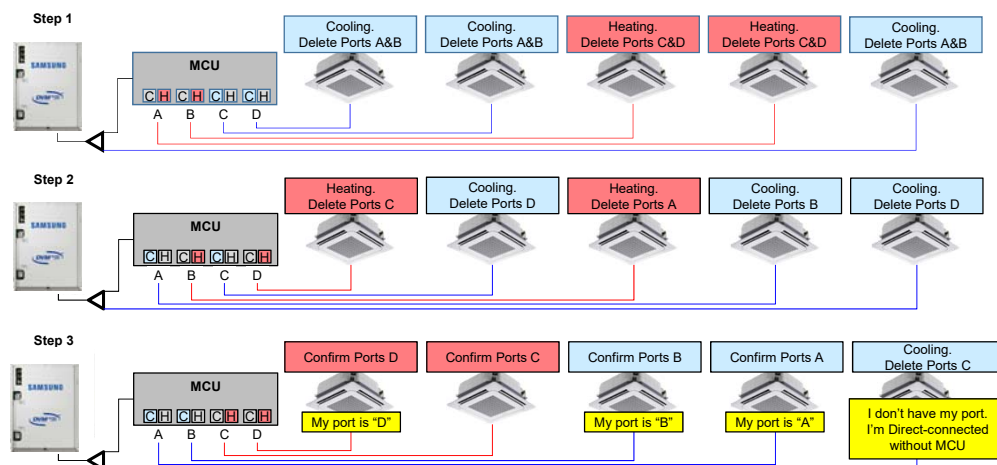

Cooling only units will require an install option code change Segment 3 of the 05 option settings must be changed to 2

©2019 Samsung All rights reserved.

SAMSUNG

246

Auto-Trial Operation

Auto-Trial Operation

- Press and hold K1 on condenser (main) for 5 seconds
 - “UP” – “UnPrepared” displayed
 - Press and hold K1 for 5 seconds to clear
 - “KK” is displayed
 - The condenser will run through various system checks including indoor unit and outdoor sensors
 - When Auto-Trial is complete, unit will stop and display connected equipment addresses



©2019 Samsung All rights reserved.

SAMSUNG

247

Auto-Trial Operation

Heating or Cooling trial operation

Heating Trial Operation: Press K1 two times

Cooling Trial Operation: Press K2 two times

- Operate in Heating or Cooling trial operation to allow the system to stabilize
- The system will operate the indoor units with extreme set temperatures that are normally not available (cooling set temperature = 37°F, heating high temperature of 104°F)
- Depending on the outdoor and indoor conditions, the system should operate at a high capacity
- Wired and wireless controller signals are ignored during this operation
- Maximum time: 10 hours


©2019 Samsung All rights reserved.

SAMSUNG

248



249

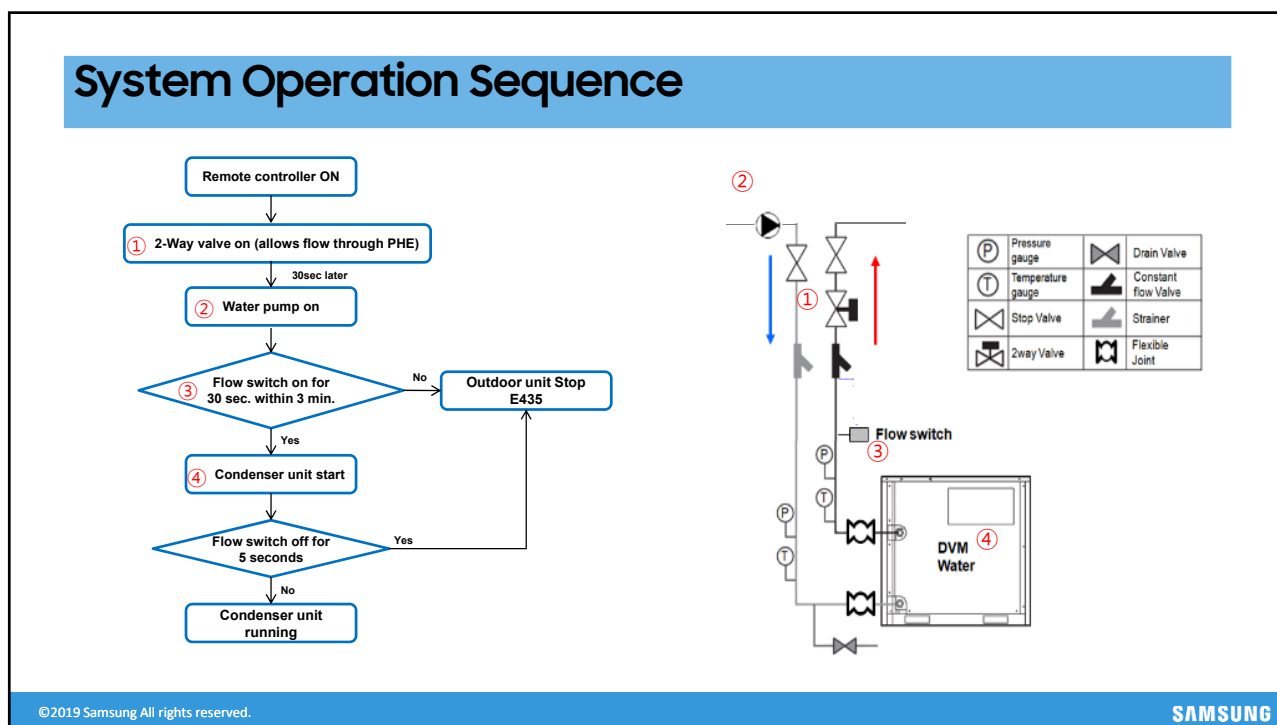


250

2-Way Solenoid Valve Control


2-way solenoid valve control configurations – Condenser PCB

- 2WAY V/V output: Dry Contact
- 2WAY V/V Power output: 208/230vac (max. 0.2A – 250v)

Example 1: External 208/230v. power source to solenoid valve

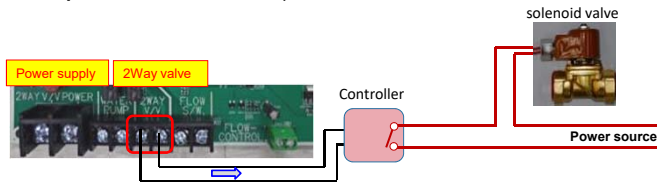

Example 2: PCB power source to solenoid valve (208/230v.)

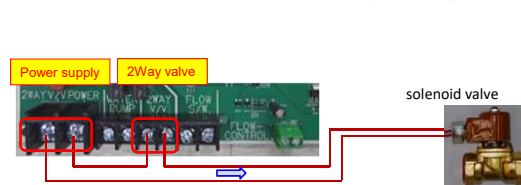

Remote controller	Contact signal	Water valve	Remark
On	→ Close	→ Valve open	-
Off	→ Open(after 40sec from off)	→ Valve close	Delay for PHE & pump

©2019 Samsung All rights reserved.


SAMSUNG

251

Closed Loop Pump Control

Condenser pump operation interlock

- WATER PUMP terminals output: Dry contact

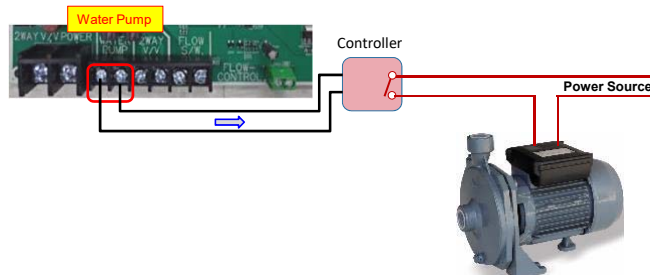

Remote controller	Contact signal	Water pump	Remark
On	→ Close (after 30 sec. from on)	→ Pump on	Delay for water pump
Off	→ Open (after 30 sec. from off)	→ Pump stop	Delay for PHE


©2019 Samsung All rights reserved.

SAMSUNG

252

Flow Switch Control

- Flow switch is required for system operation
 - FLOW-CONTROL terminals: Dry contact
 - When flow is not detected during system “on” status, error E435 is generated with system stop

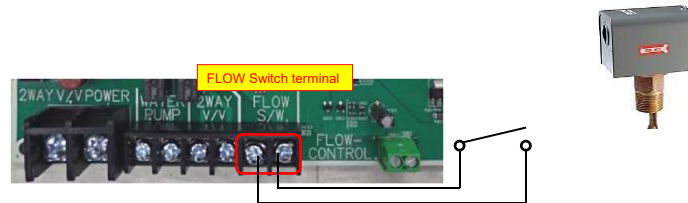

©2019 Samsung All rights reserved.

SAMSUNG


253

Flow Control Valve


Flow Control Valve Configurations – Condenser PCB

- FLOW CONTROL output: 0 – 10volts
 - Requires option setting during commissioning
- 2WAY V/V POWER output: 208/230vac. (max. 0.2A 250v)

Example 1:
External power to
flow control valve

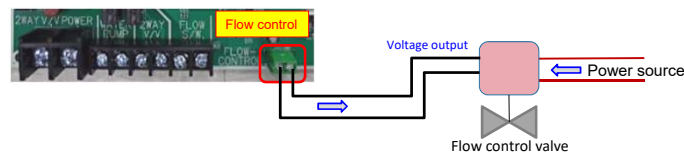

Example 2:
Power from
condenser PCB

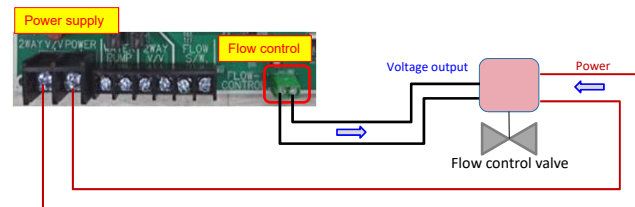

©2019 Samsung All rights reserved.

SAMSUNG

254

Flow Control Valve Logic


Control range

- Outdoor option setting
- Below 3 volts is not stable (minimum is 3V)

Seg 1, 2	Seg 3, 4	Control Range
15	00	Not used
	01	7~10V
	02	5~10V
	03	3~10V

Operation

- Control starts 10 minutes after compressor starts
- Flow rate decrease
- Current condition = "voltage down condition for 20 mins"
→ Output = current value - 1V
- Flow rate increase (full open)
Any protection control → Output = 10V (immediately)




Voltage down condition				
Water Temp.	< 50°F	< 68°F	< 95°F	< 122°F
For Cooling	< (Max. Comp Hz) X 0.8	< (Max. Comp Hz) X 0.6	< (Max. Comp Hz) X 0.4	< (Max. Comp Hz) X 0.2
For Heating	< (Max. Comp Hz) X 0.2	< (Max. Comp Hz) X 0.4	< (Max. Comp Hz) X 0.6	< (Max. Comp Hz) X 0.8
Time	Keep the condition for 20 minutes			

©2019 Samsung All rights reserved.

SAMSUNG

255

Outdoor Unit Option Settings

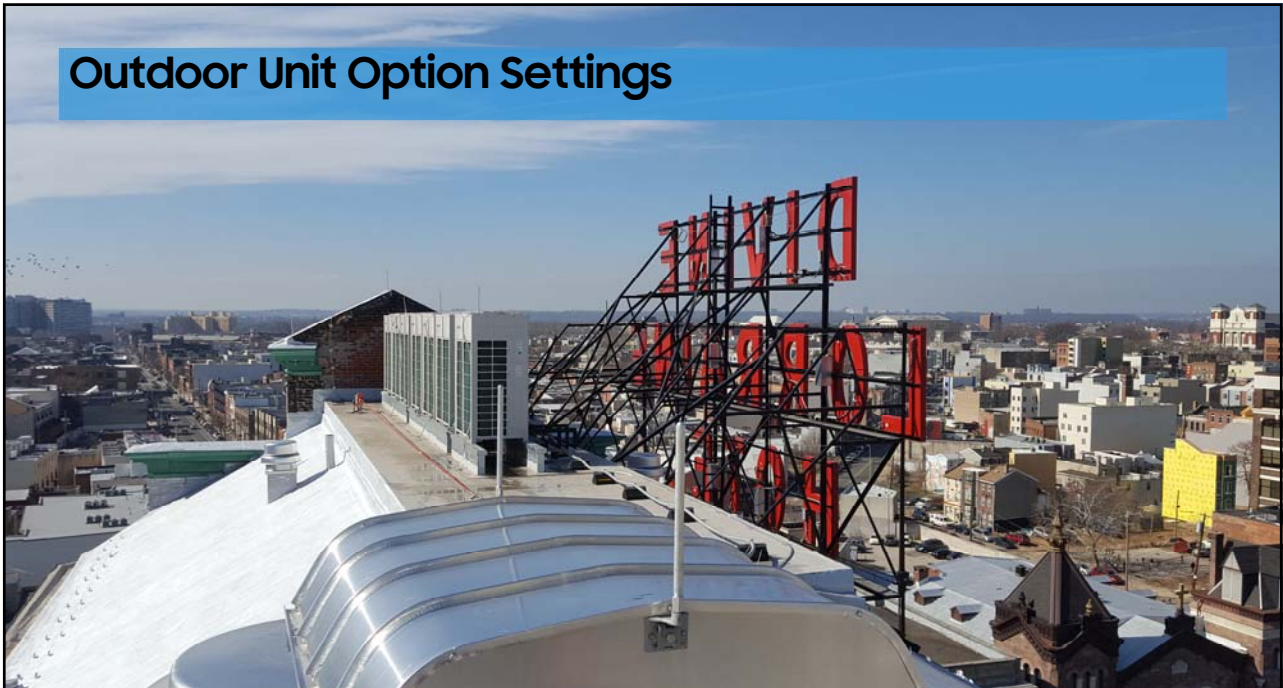

©2019 Samsung All rights reserved.

SAMSUNG

256

Outdoor Unit Option Settings

1. Press and hold the **K2** button to enter Option Settings mode
System must not be in operation




2. Press **K1** repeatedly to change SEG1, SEG2 option numbers



3. Press **K2** repeatedly to change SEG3, SEG4 option value



4. Press and hold **K2** to store the changed option code
All of the segments blink to indicate the changed option has been stored

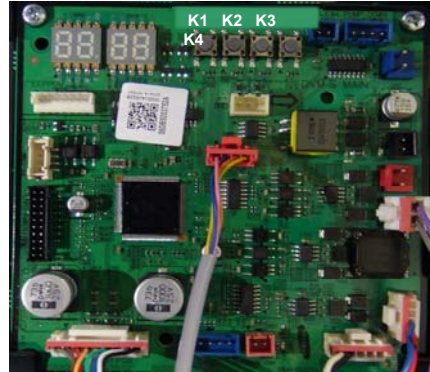

NOTE: During the option setting mode, the setting value can be reset to the previous setting by pressing and hold the **K1** button
To restore option setting to factory default press and hold **K4** during the option setting mode – Press and hold **K2** during tracking mode to save setting

Refer to the Outdoor Unit Installation Manual for all of the outdoor unit option settings that can be configured per main and sub units.

©2019 Samsung All rights reserved.

SAMSUNG

257

Option Settings – Rotation Defrost HR

- Heat Recovery manifolded outdoor units (2 or 3)
- Full system defrost after final rotation defrost cycle
- Continuous heat operation during defrost cycles
- During rotation defrost indoor units in the heat mode shift the fan speed to low



Rotation defrost (HR only)	Main	1	1	0	0	Disabled (Factory default)
				0	1	Enabled

Master	Sub 1	Sub 2
Heating	Heating	Heating
Defrost	Heating	Heating
Heating	Defrost	Heating
Heating	Heating	Defrost
Heating	Heating	Heating

} Full
defrost
cycle

©2019 Samsung All rights reserved.

SAMSUNG



258

Option Settings - Defrost Temperature

Temperature to trigger defrost operation setting

- Increase the temperature setting to initiate defrost operation in high humidity areas

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Temperature to trigger defrost operation	Main	0	5	0	0	Factory default	
				0	1	Apply setting when the product is being installed in humid area such as near river or lake	

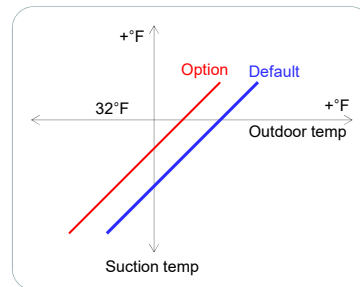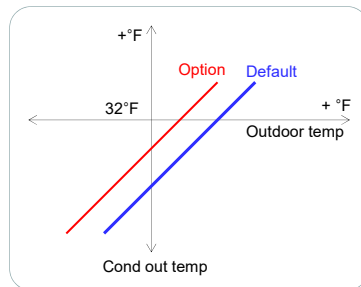

©2019 Samsung All rights reserved.

SAMSUNG

259

Energy Savings / Snow Accumulation Prevention

Energy Savings – Heat Mode

- Energy savings mode triggers when the room temperature is within 4°F of the setpoint temperature
 - Target high pressure is reduced
- Note: Heating capacity is also reduced to save energy

Energy control Operaton (B Type PBA)	Main	1	0	0	0	Basic (Factory default)
				0	1	Energy saving
				0	2	Power

Snow Accumulation Prevention

- When the outdoor ambient temperature is at or below 41°F the outdoor fan(s) will run for 60 seconds once every 30 minutes
- NOTE: The outdoor fan(s) may run when the system is not in operation

Snow accumulation prevention control	Main	1	4	0	0	Enabled (Factory default)
				0	1	Disabled

©2019 Samsung All rights reserved.

SAMSUNG

260

Channel Address

Outdoor unit address for R1 R2 connection to centralized/ upper level control – DMS 2.5

Channel address	Main	1	3	A	U	Automatic setting (Factory default)	Address for classifying the product from upper level controller (DMS, S-NET 3, etc.)
				0 ~ 15		Manual setting for channel 0~15	

©2019 Samsung All rights reserved.

SAMSUNG

261


Option Settings – High Head Pressure Condition

High-head Condition Setting

- To optimize system refrigerant flow control based on the distance of vertical separation between the Outdoor Unit to the highest or lowest Indoor unit
 - EEV and other refrigerant control devices adjust quickly to compensate for the system high pressure

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
High-head condition setting	Main	0	8	0	0	Disabled (Factory default)	
				0	1	Level 1 of height difference type 1 (Indoor unit is lower than outdoor unit)	When outdoor unit is located 40~80m above the indoor unit (131' ~262')
				0	2	Level 2 of height difference type 1 (Indoor unit is lower than outdoor unit)	When outdoor unit is located over 80m above the indoor unit (262')
				0	3	Height difference type 2 (Outdoor unit is lower than indoor unit)	When indoor unit is over 30 m above the outdoor unit (98')

- Case 1: EEV step is less than normal
- Case 2: EEV step is greater than normal

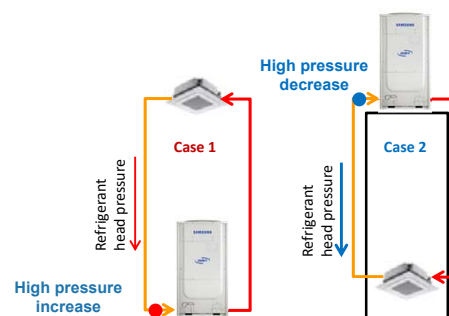

©2019 Samsung All rights reserved.

SAMSUNG

262

Long Piping Condition

Long Piping Condition Setting

- Optimize system refrigerant control based on the distance between the farthest IDU and the ODU

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Long-piping condition setting (Setting is unnecessary if high-head condition is set)	Main	0	9	0	0	Disabled (Factory default)	
				0	1	LEVEL 1	When equivalent length of farthest indoor unit from the outdoor unit is between 100~170m (328'-558')
				0	2	LEVEL 2	When equivalent length of farthest indoor unit from the outdoor unit is over 170m(558')



©2019 Samsung All rights reserved.

SAMSUNG

263

Cooling Capacity Correction

Cooling capacity correction

- System cooling capacity can be changed from the factory default setting by changing the indoor coil (evaporator) target temperature values

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Cooling capacity correction	Main	0	1	0	0	7-9 (Factory default)	Targeted evaporation temperature [°C]. (When low temperature value is set, discharged air temperature of the indoor unit will decrease)
				0	1	5-7	
				0	2	9-11	
				0	3	10-12	
				0	4	11-13	
				0	5	12-14	
				0	6	13-15	

©2019 Samsung All rights reserved.

SAMSUNG

264

Heating Capacity Correction

Capacity Correction For Heating Setting

- System heating capacity can be changed from the factory default setting by changing the target high pressure values at the indoor coil

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Capacity correction for heating	Main	0	2	0	0	435 Default	Target High Pressure PSI
				0	1	363	
				0	2	377	
				0	3	392	
				0	4	406	
				0	5	421	
				0	6	450	
				0	7	464	
				0	8	479	

©2019 Samsung All rights reserved.

SAMSUNG


265

Oil Return Interval

Oil Collection Interval

- To change the oil return operation interval from the factory default of 7 hrs. cumulated run time to 3 ½ hours

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Oil collection interval	Main	0	4	0	0	Factory default	
				0	1	Shorten the interval by 1/2	

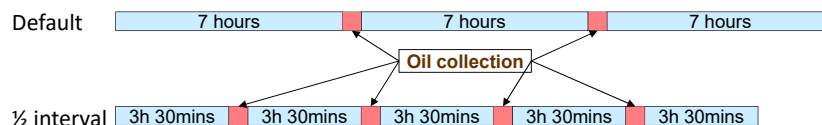

©2019 Samsung All rights reserved.

SAMSUNG

266

Outdoor Fan Speed Increase

Fan speed correction for outdoor unit Setting

- Increase outdoor fan speed to accommodate ducted fan discharge (.32")
- In modular systems, each module must be programmed with this setting

Optional item	Input unit	SEG1	SEG2	SEG3	SEG4	Function of the option	Remarks
Fan speed correction for outdoor unit	Individual	0	6	0	0	Factory default	
				0	1	Increase fan speed	Increase the outdoor unit's fan speed to maximum value



©2019 Samsung All rights reserved.

SAMSUNG



267

Emergency Operation - IDU Communication Error

Emergency Operation Option Setting

- Temporarily restore system operation when IDU error code E201 occurs
- This function must be field enabled in Main outdoor unit


Optional item	Input unit	SEG 1	SEG 2	SEG 3	SEG 4	Option Function	Remarks
Emergency operation during indoor unit communication error	Main ODU	2	2	0	0	Disabled (factory default)	When set, emergency operation is possible even if an indoor communication error occurs.
				0	1	Indoor high humidity condition (operating for up to 12hours)	
				0	2	Indoor low humidity condition (operating for up to 24hours)	

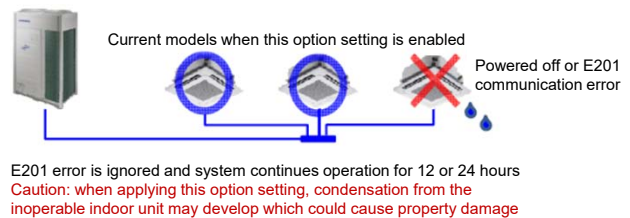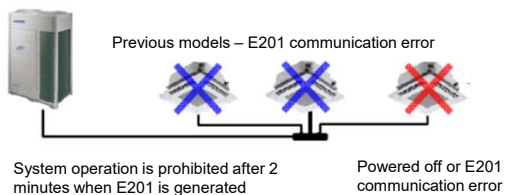

©2019 Samsung All rights reserved.

SAMSUNG

268

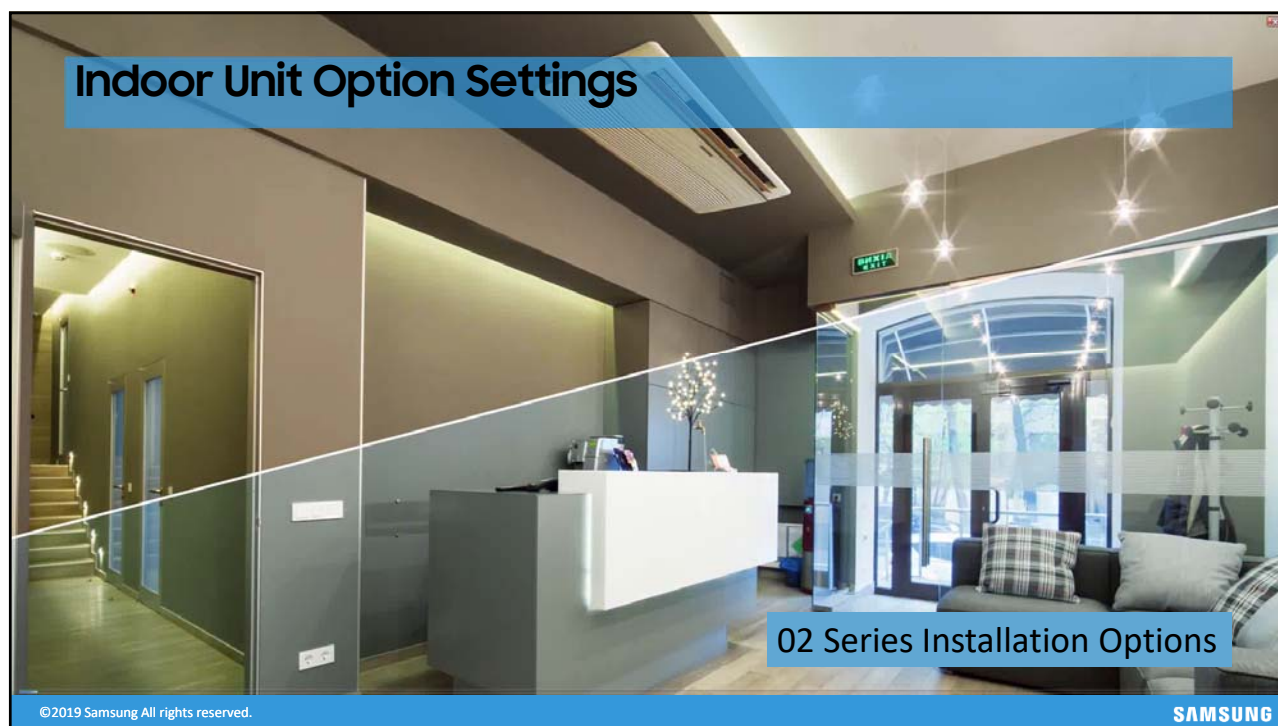

269

Indoor Unit Option Setting Codes

02XXXX – 1XXXXX – 2XXXXX – 3XXXXX


1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24

- Samsung indoor units use a 24 segment code for indoor unit option programming
- Based on the indoor unit option settings, the 24 segment code may vary
- Installer option settings start with “02”
- Segments 1, 7, 13, and 19 are “page numbers” and are always “0”, “1”, “2”, and “3”
- Each segment represents a different indoor option (excluding segments: 1, 2, 7, 13, 19, and 24)
- These codes are available in the installation manuals
- ** Varies per unit type, refer to indoor installation manual for specific setting

©2019 Samsung All rights reserved. SAMSUNG

270

Indoor Unit Option Setting Codes

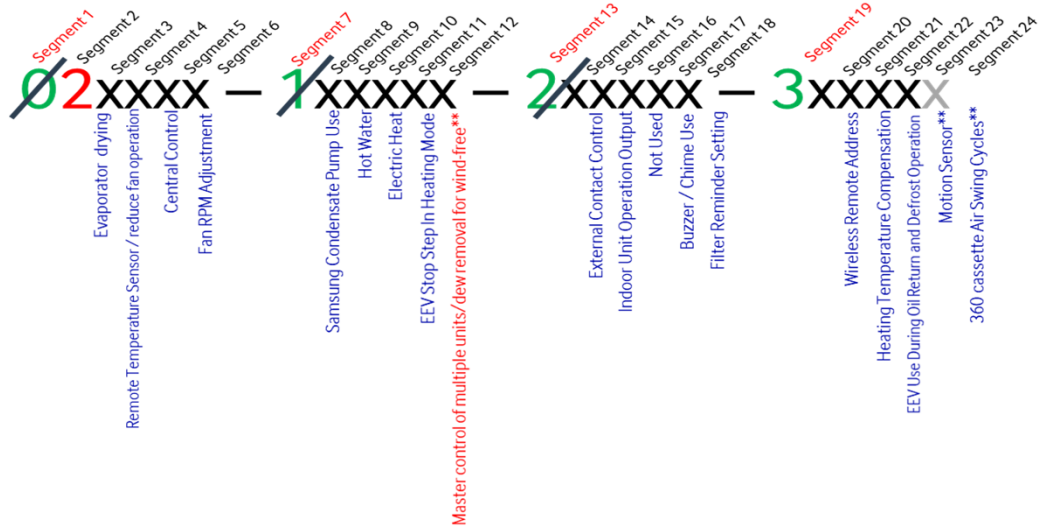

©2019 Samsung All rights reserved.

SAMSUNG

271

Optional Indoor Unit Settings

Indoor Unit Programming Options

- To program indoor unit option settings, the following can be used:
 - SNET Pro 2 is the easiest and recommended method for programming indoor unit option settings

SNET Pro 2 service
software **Preferred**



Wired controllers



Wireless controllers




©2019 Samsung All rights reserved.

SAMSUNG

272

SNET Add-on Tab - Indoor Unit Option Writer

- The indoor option setting section allows quick change of product and installation codes
 - Using the product or install options tables from indoor unit installation manuals,
 - Enter the settings in the appropriate box (all 24 segments must be entered)
 - Select the indoor unit(s) that need code change

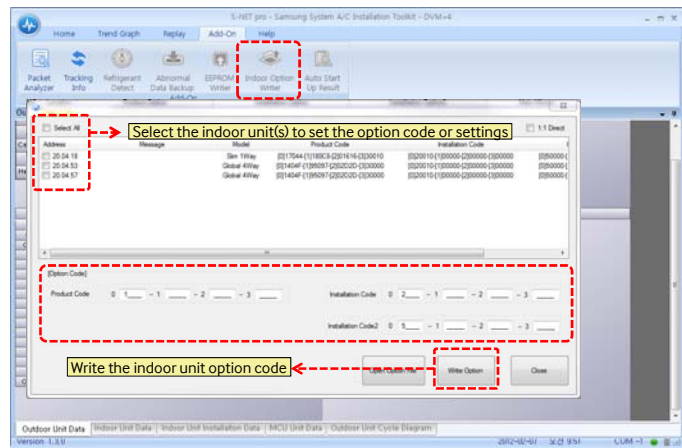

©2019 Samsung All rights reserved.

SAMSUNG

273

Indoor Unit Option Writing Example - Video SNET

Address	Model	RMC	MCU ADDRESS	MCU PORT	Location	Product Option	Installation Option	Installation Option2	Main Micom	Error History1	Error History2	Error History3
0	Slim TriVay	05	2	C	Video Hi-Fi 7070	[0]17044-[1]180C8-[2]01616-[3]00010	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01888A.170406	101	109	101
1	Big Ceiling	AB	1	C	Big Ceiling	[0]13054-[1]C2479-[2]00869-[3]00000	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01888A.161227	000	000	000
2	Big Duct	22	0	S	72 HSP	[0]11054-[1]09007-[2]00C0C-[3]01110	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01507A.170417	000	000	000
3	Duct	21	2	F	Slim Duct	[0]10054-[1]01913-[2]01C1C-[3]01110	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01507A.170417	000	000	000
4	Duct	06	2	D	Duct S	[0]10054-[1]05960-[2]01616-[3]01101	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01888A.170309	000	000	000
5	RAC	00	1	F	Video Hi-Fi 7070	[0]12044-[1]0945C-[2]01C1C-[3]010000	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01674A.170216	000	000	000
7	Console	20	0	S	Con Floor	[0]14054-[1]09000-[2]01212-[3]00010	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01507A.170417	000	000	000
8	Console	20	2	C	Cased	[0]14054-[1]09000-[2]01C1C-[3]00010	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01507A.170417	000	000	000
9	360CST	20	2	B	360	[0]1006F-[1]0900E-[2]01211-[3]00000	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-01742A.161222	000	000	000
12	Global 4Way	04	2	E	Video Hi-Fi 7070	[0]1404F-[1]09097-[2]02323-[3]00000	[0]0010-[1]00000-[2]00000-[3]00000	[0]00000-[1]00000-[2]00000-[3]00000	DB91-02029A.180110	101	109	101


©2019 Samsung All rights reserved.

SAMSUNG

274

Indoor Unit Option Settings - Wired Controller

- **MWR-WE13UN** wired controller menu 4, sub menu 3 is where indoor unit option settings can be reviewed/changed
- **MWR-SH11UN** wired controller Menu 4, sub menu 5 is where indoor unit option settings can be reviewed/changed

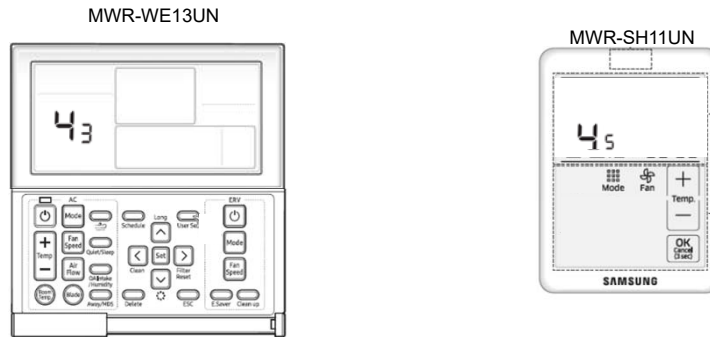


©2019 Samsung All rights reserved.

SAMSUNG

275

Option Settings Mode - Wired Controller

Press and hold the "Set" & "Delete" buttons simultaneously for 3 seconds – MWR-WE13UN

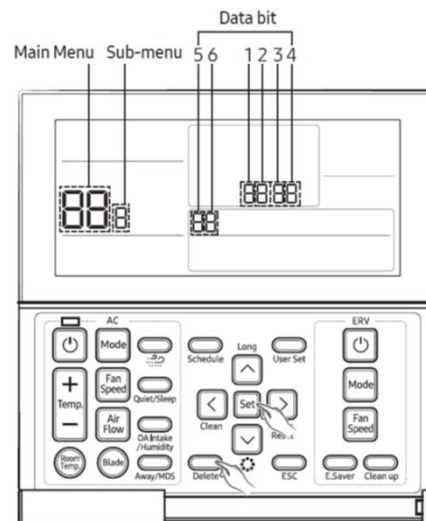

©2019 Samsung All rights reserved.

SAMSUNG


276

Indoor Unit Option Settings - MWR-WEI3UN

- As you scroll through each segment using the ">" button, the pages will change
- Changes can be made to each segment to make the desired indoor unit changes
- Default indoor unit options displayed below

Option changes made in example below:

- Factory condensate pump (ducted unit)
- Indoor unit MASTER
- External control output: Thermo ON/OFF
- Chime off
- 2,000 hour filter reminder

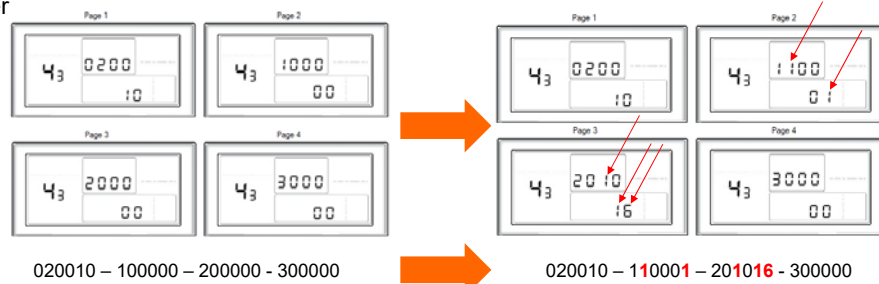

©2019 Samsung All rights reserved.

SAMSUNG


277

Indoor Unit Option Settings - MWR-WEI3UN

Video


Option changes made in example below:

- Factory condensate pump (ducted unit)
- Indoor unit MASTER
- External control output: Thermo ON/OFF
- Chime off
- 2,000 hour filter reminder

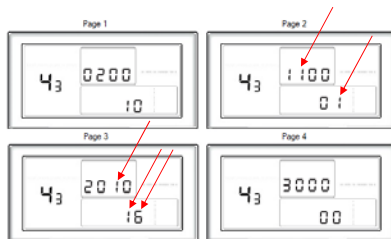

Code Entered:

020010 - 110001 - 201016 - 300000

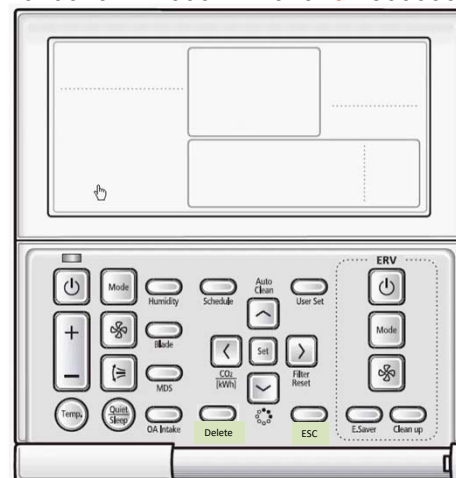


©2019 Samsung All rights reserved.

SAMSUNG

278

Indoor Unit Option Settings - MWR-SH11UN

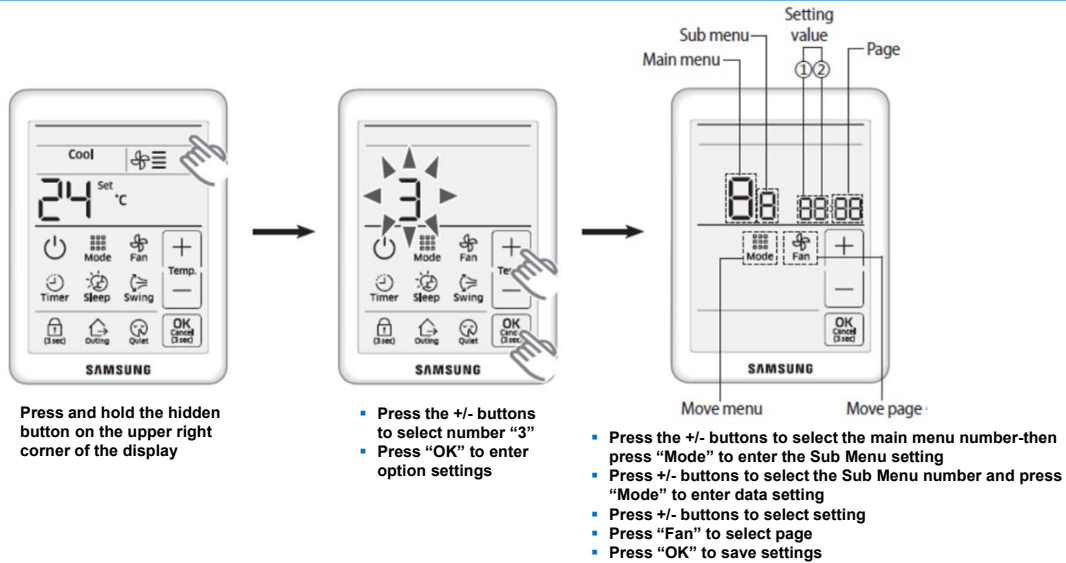

©2019 Samsung All rights reserved.

SAMSUNG

279

Heat Pump Mode Master - Wired Remote Controller

Set the Mode Master: Press and hold the "Mode" button for 5 seconds



MWR-WE13UN

Set the Mode Master: Program option setting



MWR-SH11UN

Main menu	Sub menu	Function description		Value
	2	Mode master indoor unit checking	Mode master indoor unit address (Example : 20 02 10)	
7	3	Mode master indoor unit setting checking	Mode master indoor unit setting 6)*	0-No use, 1-Use, 2-Release 7)*

To set a heat pump mode master the system must be in standby mode (not running)

©2019 Samsung All rights reserved.

SAMSUNG

280

Wireless Remote Control - Indoor Unit Option Example

Option	SEG1	SEG2	SEG3	SEG4	SEG5	SEG6
Explanation	PAGE	MODE	Use of robot cleaning	Use of external room temperature sensor	Use of central control	FAN RPM compensation
Remote Controller Display						
Indication and Details	Indication: 0 Details: 0	Indication: 0 Details: 0	Indication: 0 Details: 0	Indication: 0 Details: 0	Indication: 0 Details: 0	Indication: 0 Details: 0
Option	SEG7	SEG8	SEG9	SEG10	SEG11	SEG12
Explanation	PAGE	Use of drain pump	Use of hot water heater	Use of electronic heater	EEV Step when heating stops	Master / Slave
Remote Controller Display						
Indication and Details	Indication: 1 Details: 1	Indication: 1 Details: 1	Indication: 1 Details: 1	Indication: 1 Details: 1	Indication: 1 Details: 1	Indication: 1 Details: 1
Option	SEG13	SEG14	SEG15	SEG16	SEG17	SEG18
Explanation	PAGE	Use of external control	Setting the output of external control	S-Plasma ion	Buzzer control	Number of hours using filter
Remote Controller Display						
Indication and Details	Indication: 2 Details: 2	Indication: 2 Details: 2	Indication: 2 Details: 2	Indication: 2 Details: 2	Indication: 2 Details: 2	Indication: 2 Details: 2

Option	SEG19	SEG20	SEG21	SEG22	SEG23	SEG24
Explanation	PAGE	Individual control of a remote controller	Heating setting compensation	EEV Step of stopped unit during oil return / default mode	Motion detect sensor	-
Remote Controller Display						-
Indication and Details	Indication: 3 Details: 3	Indication: 3 Details: 3	Indication: 3 Details: 3	Indication: 3 Details: 3	Indication: 3 Details: 3	-

Example: Ducted unit with MRW-TA external temperature sensor, Samsung condensate pump installed, and 2000 hour filter reminder.

Full settings code: **020110 110000 200006 300000**


©2019 Samsung All rights reserved.

SAMSUNG

281

Indoor Unit Option Settings - Wireless

- When programming indoor units, a single option setting or multiple option settings can be changed at a time
- Let's discuss changing a single option with a wireless controller

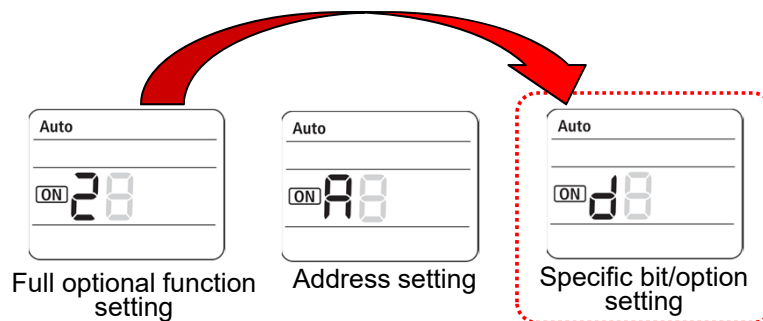


©2019 Samsung All rights reserved.

SAMSUNG

282

Indoor Unit Option Settings - Wireless

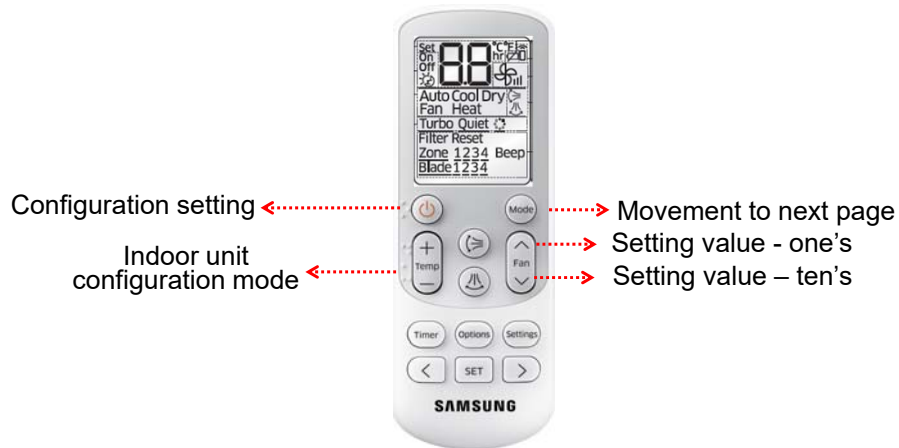

©2019 Samsung All rights reserved.

SAMSUNG

283


Indoor Unit Option Settings - Wireless

Entering option setting mode with a wireless controller

1. Remove a battery
2. While holding both the temperature up and temperature down buttons, put the battery back in



3. Press the fan speed UP/DOWN button to change each bit.




©2019 Samsung All rights reserved.

SAMSUNG

284

Indoor Unit Option Settings - Wireless

4. Press the Mode button to go to next "page".

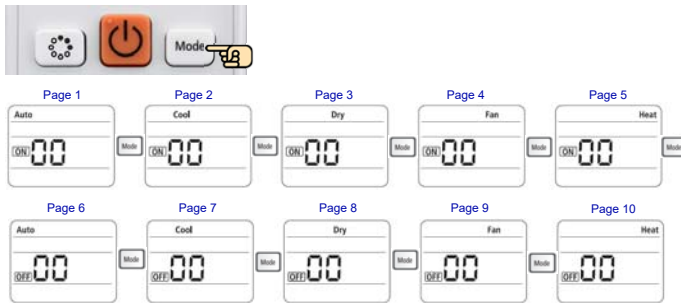

5. Press the On/Off button two times to set the option setting.



6. When finished, remove a battery then replace to return to normal use



©2019 Samsung All rights reserved.

SAMSUNG

285

Indoor Unit Option Settings - Wireless


VIDEO

- Entering an option setting code to change a single option with a wireless controller
- This example shows the code used to change the chime setting on an indoor unit to OFF
- AUTO, COOL, DRY, FAN, HEAT, and ON/OFF display signifies current "page"

0D2171 - 1XXXXX - 2XXXXX - 3XXXXX

D2171


D2 17 1

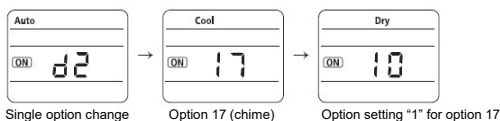

©2019 Samsung All rights reserved.

SAMSUNG

286

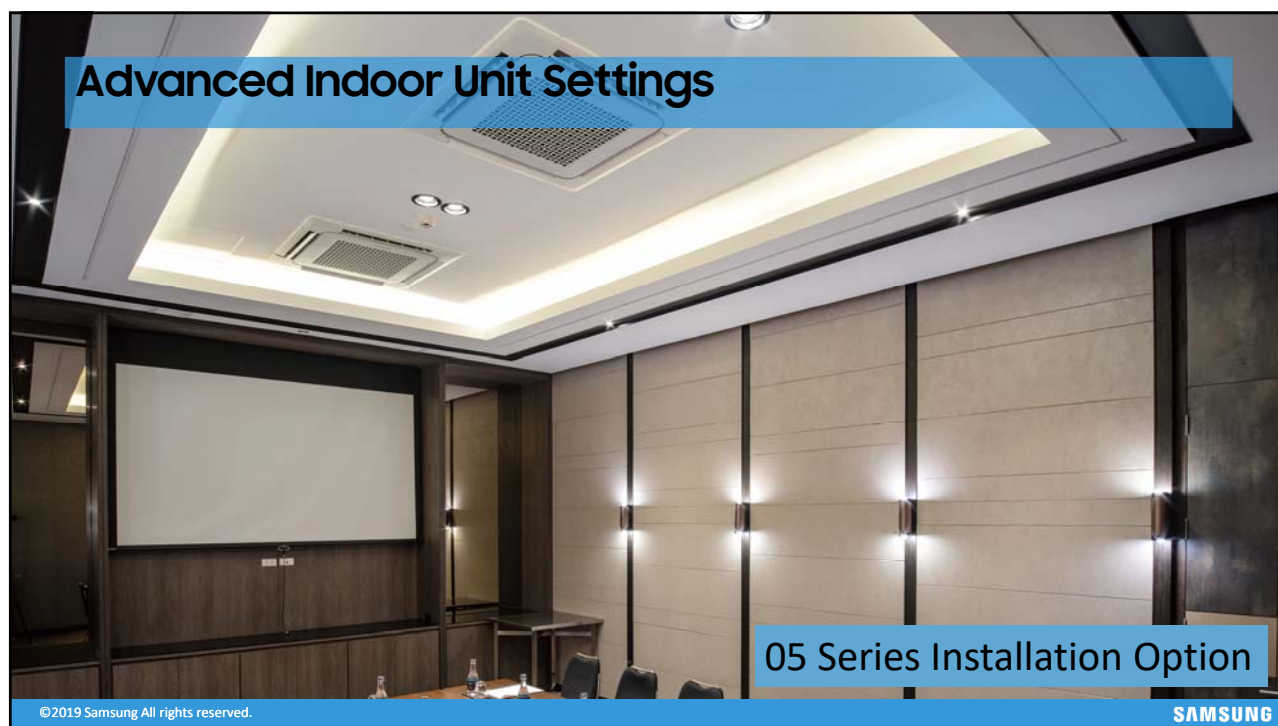

287

Advanced Indoor Unit Option Settings


Options "Page" number	Options "Page" number	Options "Page" number	Options "Page" number
Option setting type/series	Option setting type/series	Option setting type/series	Option setting type/series
05XXXXX	1XXXXXX	2XXXXXX	3XXXXXX
Segment 1	Segment 7	Segment 13	Segment 19
Segment 2	Segment 8	Segment 14	Segment 20
Segment 3	Segment 9	Segment 15	Segment 21
Segment 4	Segment 10	Segment 16	Segment 22
Segment 5	Segment 11	Segment 17	Segment 23
Segment 6	Segment 12	Segment 18	Segment 24
HR systems – use of special AUTO mode programming	HR systems – auto changeover ΔT , cooling to heating	Reserved	AHU kit capacity setting
HR systems – auto changeover standard heat temp. offset	HR systems – auto changeover, time delay	Reserved	AHU kit fan feedback setting
HR systems – auto changeover standard cooling temp. offset	Compensation for long pipe distance or vertical separation	Reserved	AHU kit defrost signal setting
HR systems – auto changeover ΔT , heating to cooling	MTFC enable (Multi Tenant Function Controller)	Reserved	AHU kit – prevent cold air blowing in heat mode
	Reserved	External heat control temperature offset and time delay	Reserved

©2019 Samsung All rights reserved. SAMSUNG

288

Advanced Indoor Unit Option Settings

Heat Recovery Indoor unit auto changeover setting



Initial determination

Cooling	Heating
$Tr \geq Ts + A + 1$	$Tr < Ts - A - 1$

Mode change

Cooling → Heating	Heating → Cooling
$Tr < Ts + B - 1$ for T & $Tr < Ts - D$	$Tr \geq Ts - A + 1$ for T & $Tr \geq Ts + C$

Thermo On/Off

Cooling	Heating
Thermo on : $Tr \geq Ts + B + 1$ Thermo off : $Tr \leq Ts + B - 1$	Thermo on : $Tr < Ts - A - 1$ Thermo off : $Tr \geq Ts - A + 1$

Tr = room temperature
 Ts = set temperature

		Setting Number and Details								
		0	1	2	3	4	5	6	7	
SEG1	0									
SEG2	5									
SEG3	1	Standard	Custom							
SEG4	A	0	0.9	1.8	2.7	3.6	4.5	5.4	6.3	Setting Details
SEG5	B	0	0.9	1.8	2.7	3.6	4.5	5.4	6.3	
SEG6	C	1.8	2.7	3.6	4.5	5.4	6.3	7.2	8.1	
SEG8	D	1.8	2.7	3.6	4.5	5.4	6.3	7.2	8.1	
SEG9	T	5	7	9	11	13	15	20	30	

A, B, C, D = ° F

T = minutes

Segment 1: Always "0"

Segment 2: Always "5"

Segment 3: Use factory auto change programming or use custom programming

Segment 4 (A): Heating temperature offset

Segment 5 (B): Cooling temperature offset

Segment 6 (C): Temperature difference when changing from heating to cooling

Segment 8 (D): Temperature difference when changing from cooling to heating

Segment 9: Time required for mode change


©2019 Samsung All rights reserved.

SAMSUNG

289

Advanced Indoor Unit Option Settings

HR Indoor unit auto changeover example

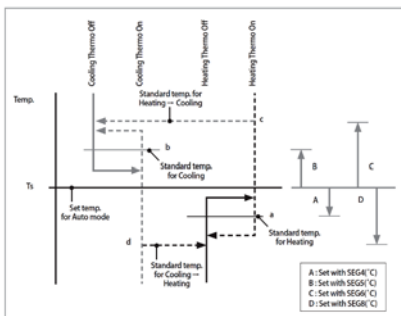

		Setting Number and Details								
		0	1	2	3	4	5	6	7	
SEG1	0									
SEG2	5									
SEG3	1	Standard	Custom							
SEG4	A	0	0.9	1.8	2.7	3.6	4.5	5.4	6.3	Setting Details
SEG5	B	0	0.9	1.8	2.7	3.6	4.5	5.4	6.3	
SEG6	C	1.8	2.7	3.6	4.5	5.4	6.3	7.2	8.1	
SEG8	D	1.8	2.7	3.6	4.5	5.4	6.3	7.2	8.1	
SEG9	T	5	7	9	11	13	15	20	30	

Segment 2: 5 = advanced option settings
Segment 3: 1 = Use custom changeover settings
Segment 4: 1 = 0.9° F heating offset
Segment 5: 1 = 0.9° F cooling offset
Segment 6: 3 = 4.5° F offset when changing from heating to cooling
Segment 8: 3 = 3.6° F offset when changing from cooling to heating
Segment 9: 4 = 13 minute delay before changing modes

Segment 1 - Page number
Segment 2
Segment 3
Segment 4
Segment 5
Segment 6
Segment 7 - Page number
Segment 8
Segment 9
051113-124000-200000-300000

©2019 Samsung All rights reserved.

SAMSUNG

290

Indoor Product Option Code Settings



©2019 Samsung All rights reserved.

SAMSUNG

291

Product Option Code Settings

Product options codes are used to change the ESP value on ducted units

Example: AM076FNHDC/AA: Change from 0.2" ESP to 0.6" ESP using SNET Pro



S-NET pro 2 - DVM S

Home Trend Graphs Add-On Help

Address Change No-Fi Kit Address Change AC Unit S/W Update UART Update Device Firmware Update Outdoor EEPROM Write Indoor Option Writer Abnormal Data Backup Auto Start Up Result Refrigerant Check Refrigerant Check

Indoor Unit Installation Data

Address	Model	RNC	MCU ADDRESS	MCU PORT	Location	Product Option	Installation Option	Installation Option2	Main Micron	Error History1	Error History2	Error History3
0	Slim Trinity	05	2	C	Used Floor Trolley	[017044-1]180C9-2201616-2300010	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01888A 170406	101	109	101
1	Big Ceiling	AB	1	C	Big Ceiling	[013054-1]1C2479-2300009-2300000	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01684A 161227	000	000	000
2	Big Duct	22	0	D	72 HSP	[011054-1]190091-230000C-2301110	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01507A 170417	000	000	000
3	Duct	21	2	F	Slim Duct	[010054-1]121913-23011C-2301110	[020010-1]110000-2300006-1300000	[030000-1]100000-2300000-1300000	DB91-01507A 170417	000	000	000
4	Duct	06	2	D	Duct S	[010054-1]195060-2301616-2301101	[020010-1]110000-2300006-1300000	[030000-1]100000-2300000-1300000	DB91-01888A 170309	000	000	000
5	RAC	00	1	F	Yehseer	[012044-1]19545C-23011C-2301000	[020010-1]110000-2300006-1300000	[030000-1]100000-2300000-1300000	DB91-01674A 170215	000	000	000
7	Console	20	0	D	Can Floor	[014054-1]195000-2301212-2300010	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01507A 170417	000	000	000
8	Console	20	2	C	Cased	[014054-1]195000-23011C-2300010	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01507A 170417	000	000	000
9	360CST	20	2	B	360	[01006F-1]195009-230121-2300000	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-01742A 161222	000	000	000
12	Global Entry	04	2	E	Used Floor Trolley	[01404F-1]195097-230223-2300000	[020010-1]100000-2300000-1300000	[030000-1]100000-2300000-1300000	DB91-02029A 180110	101	109	101

Outdoor Unit Data Outdoor Unit Installation Data Outdoor Unit Cycle Diagram Indoor Unit Data Indoor Unit Installation Data Control for Unoccupied and Entering Room MCU Unit Data ETD

Version: 1.1.1 Unit: Temp: °F Power: Bu: Pressure: psi 1/30/2019 2:33 PM Set Layer COM 4


©2019 Samsung All rights reserved.

SAMSUNG

292

Product Option Code Settings

Example: AM076FNHDCH/AA: Change from default 0.6" ESP to 0.98" ESP using MWR-WE13N



Original option code:
011054-1950E8-20DCDC-331110

New option code:
011054-19549F-20DCDC-331110

Page 1

4 ₂	0110	
	54	

Page 2

4 ₂	1950	
	E8	

Page 3

4 ₂	20dC	
	dC	

Page 4

4 ₂	3311	
	10	

Page 1

4 ₂	0110	
	54	

Page 2

4 ₂	1954	
	9F	

Page 3

4 ₂	20dC	
	dC	

Page 4

4 ₂	3311	
	10	

©2019 Samsung All rights reserved.

SAMSUNG

293

System Start-up - Common Errors



©2019 Samsung All rights reserved.

SAMSUNG

294

Outdoor Unit PCB Commissioning - Error Display

- During initial system start or normal operation, the system has hundreds of checkpoints that are constantly monitored to ensure proper operation and system safety
- If at any time a checkpoint is outside of its programmed range, an error code will display
- Depending on the error code, the indoor units and/or outdoor units may or may not stop operation
- Error code meanings can be found in the outdoor unit Installation manual, service manuals, SNET Pro 2 service software, and the DVM Mobile app.

©2019 Samsung All rights reserved.

SAMSUNG

295

Outdoor Unit PCB Commissioning - Error Display

Common Errors

- Some lower priority error codes will appear due to higher priority system error codes
- Fix higher priority error codes first before dealing with low level error codes
- Wired controllers might not turn on initially until all addressing related error codes are resolved

EXAMPLE:

E-604: No communication between wired remote controller and indoor unit(s)

This error might display on wired controllers while the system displays E201 (addressing related error code, seen on ODU and SNET Pro 2)

©2019 Samsung All rights reserved.

SAMSUNG

296

Outdoor Unit PCB Commissioning - Error Display

- The most common error codes will start with “E” and will be followed with three numbers (example: E153)
- After the “E_ _ _” error code, additional error status codes may appear.
- If an indoor unit error code is displayed, it will be followed up with “A0 _ _”. The last two digits represent the indoor unit with the error. The error code and unit code will repeat.

Error display method	Display example*
Error # → Indoor unit address → Error #, repeat display	E153 → A002 → E153 → A002 →

* The example above displays an error code for the indoor unit with main address “02”.




©2019 Samsung All rights reserved.

SAMSUNG

297

Outdoor Unit PCB Commissioning - Error Display

Common errors

Error Code	Display	Details / Items to check
E201		“E201”: Indoor unit quantity settings error <ul style="list-style-type: none"> ▪ The outdoor unit found more/less indoor units than specified on the MAIN outdoor unit's indoor unit quantity setting dials ▪ Verify that indoor unit quantity is set properly ▪ Make sure all indoor units have power and have F1/F2 connected ▪ Check indoor unit address overlapping
E213		“E213”: Assigned indoor unit address does not exist on an MCU PCB NOTE: This error will temporarily appear after “UP” is displayed until the Auto Pairing test is performed <ul style="list-style-type: none"> ▪ Check indoor unit address overlapping ▪ Check communication cable status.
E203		“E203”: Communication error between main unit and sub units <ul style="list-style-type: none"> ▪ Check which outdoor unit has problem (U200, U201, U202... error code details on next page) ▪ Check the communication cable and power cable to outdoor units

©2019 Samsung All rights reserved.

SAMSUNG

298

Outdoor Unit PCB Commissioning - Error Display

First error code digit meaning

E	P	U	A	C
<ul style="list-style-type: none"> 101 ~ 700 Displayed when an error is decided by self diagnosis 	<ul style="list-style-type: none"> 701 ~ 800 Display an item that requires more than 2 detections for deciding whether it is an error or not during the 1st detection 	Displays the outdoor unit address where an error has occurred. U200 : Main Outdoor Unit U201 : Sub1 Outdoor Unit U202 : Sub2 Outdoor Unit	<ul style="list-style-type: none"> Displays the indoor unit address where an error has occurred. Ex) A000 : An error has occurred at indoor unit address 00 Ex)A047 : An error is occurred at number 47 address indoor unit 	<ul style="list-style-type: none"> Displays the PCB code where a communication error has occurred. C001 = Hub PCB C002 = Fan PCB C003 = Inverter1 PCB C004 = Inverter2 PCB

Type	Error display method	Display example
Indoor unit error display	Error # → Indoor unit address → Error #, repeat display	E153 → A002 → E153 → A002
Outdoor unit error display	Error # → Outdoor unit address → Error #, repeat display	E438 → U200 → E438 → U200 → E206 → C002 → E206 → C002

Animation:
E296 = Low Pressure Sensor Error
U200 = Error in MAIN outdoor unit




©2019 Samsung All rights reserved.

SAMSUNG

299

System Operation Key Mode - Main ODU

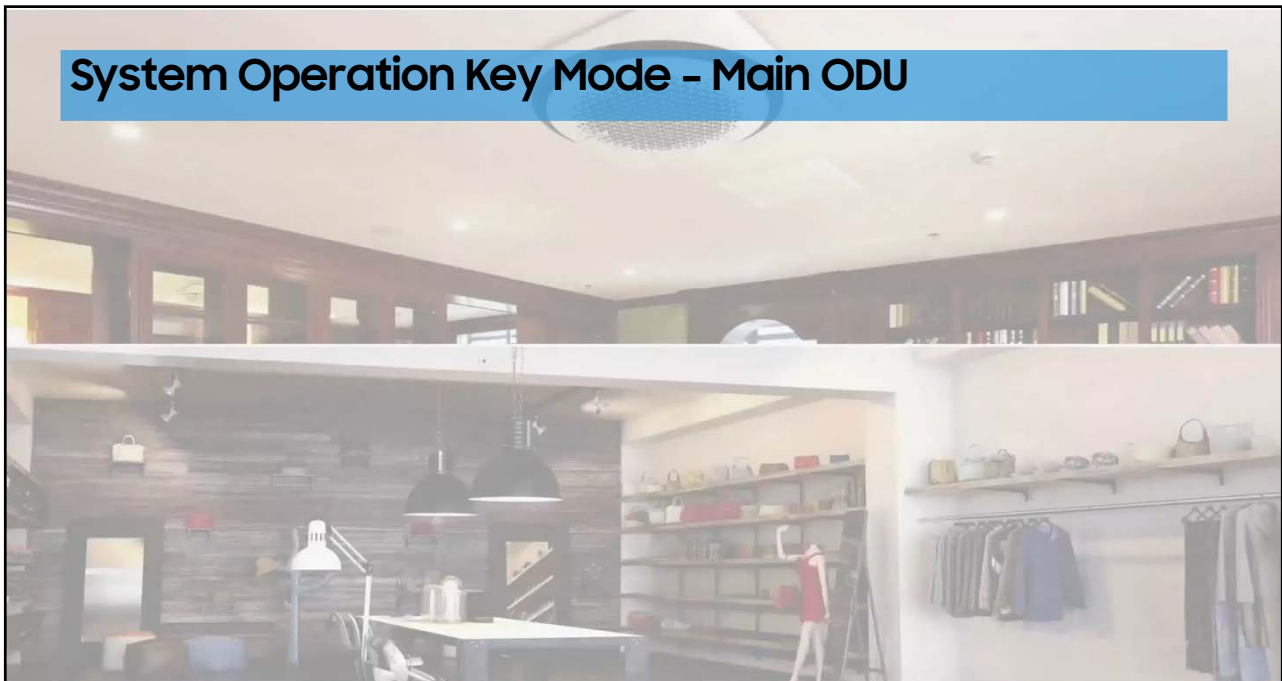


©2019 Samsung All rights reserved.

SAMSUNG

300

SNET Pro 2 - Recording System Data

- Before starting heating or cooling commissioning modes begin to record system information with SNET Pro 2 software
- Stop recording and restart between various tests during equipment start-up
- Save this data for later reference if service issues arise

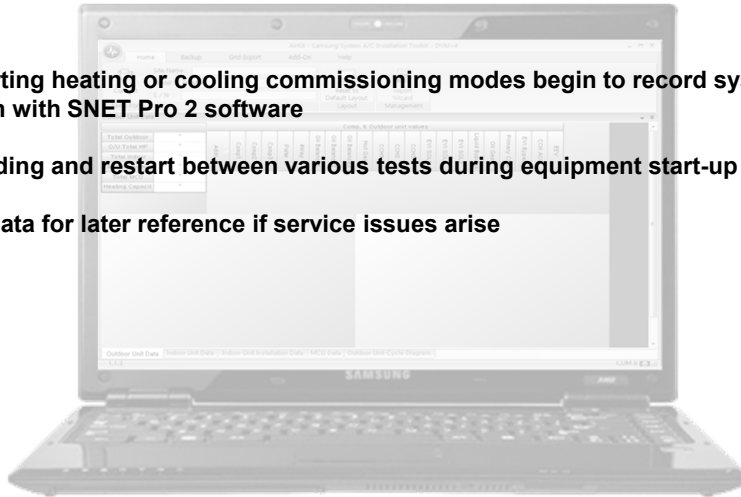


©2019 Samsung All rights reserved.

SAMSUNG

301

System Auto Trial Operation

- “UP” = “UnPrepared”
- To clear UP status, hold **K1** button for 5 seconds
- The display will show “KK” and the unit will run in either heating or cooling depending on various conditions.
- The outdoor unit will run through various outdoor unit and system checks (service valves, sensors, EEV’s, fan, reversing valve, etc.)
- The unit will also look at indoor unit sensors, outdoor temperature, etc.
- When complete, the unit will stop and display will scroll connected equipment addresses

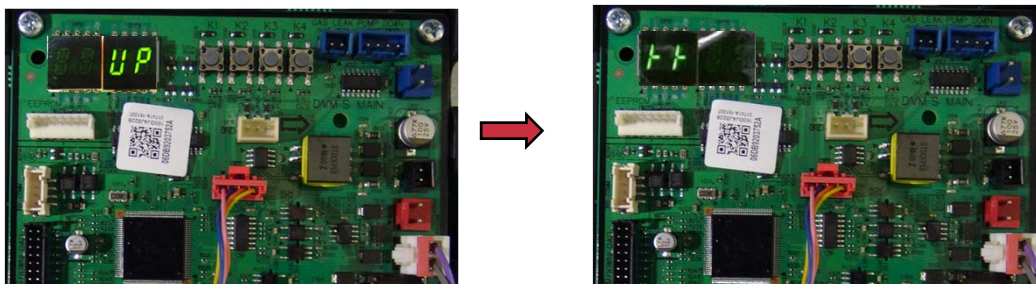

©2019 Samsung All rights reserved.

SAMSUNG

302

SNET Pro 2 - Auto Trial Display Example

Step 1

Before/during Auto-trial operation		After Auto-trial operation	
Address	10.00.00	Address	10.00.00
Serial Number	-	Serial Number	-
Operation Mode	AutoInspect	Operation Mode	Stop
Operation Status	Cool	Operation Status	Cool
Error Code	0	Error Code	0
Capacity	8HP	Capacity	8HP
Target Frequency1	41	Target Frequency1	41
Order Frequency1	50	Order Frequency1	50
Current Frequency1	33	Current Frequency1	33
Target Frequency2	0	Target Frequency2	0
Order Frequency2	0	Order Frequency2	0
Current Frequency2	0	Current Frequency2	0
High Pressure	317.2	High Pressure	247.5
Saturated T _{Pd}	100.4°F	Saturated T _{Pd}	84.2°F
Low Pressure	200.5	Low Pressure	166.4
Saturated T _{Ps}	71.6°F	Saturated T _{Ps}	59°F
Discharge1	112.3°F	Discharge1	164.3°F
Discharge2	-	Discharge2	-
TestOperation(UP)	Not Completed	TestOperation(UP)	Completed
Comp Top1	74.7°F	Comp Top1	123.4°F
Comp Top2	-	Comp Top2	-
Outdoor Temp.	79.3°F	Outdoor Temp.	81.1°F
Compressor Current1	4	Compressor Current1	0
Compressor Current2	-	Compressor Current2	-
IPM1 Temp	91.4°F	IPM1 Temp	91.4°F
IPM2 Temp	-	IPM2 Temp	-
CondOut Temp.	80.6°F	CondOut Temp.	90.9°F
Liquid Tube Temp.	81.9°F	Liquid Tube Temp.	93.6°F
Suction1 Temp.	73°F	Suction1 Temp.	63.3°F
Suction2 Temp.	-58°F	Suction2 Temp.	-58°F
Main EEV	2000	Main EEV	0
EVI EEV	0	EVI EEV	0
EVI IN	78.8°F	EVI IN	64.8°F
EVI OUT	79.2°F	EVI OUT	100.6°F
Outdoor Fan	12	Outdoor Fan	14

©2019 Samsung All rights reserved.

SAMSUNG

303

Heat / Cool Test Operation Mode

Step 2

Heat or Cool test operation is initiated from the outdoor unit (main) control PCB

Heating Trial Operation: Press **K1** two times

Cooling Trial Operation: Press **K2** two times

- Operate in Heating or Cooling trial operation to allow the system to stabilize
- The system will operate the indoor units with extreme set temperatures that are normally not available (cooling set temperature = 37° F, heating high temperature of 104° F)
- Depending on the outdoor and indoor conditions, the system should operate at a high capacity
- Wired and wireless controller signals are ignored during this operation
- Maximum time: 10 hours

You must use K3 to take the unit out of test mode or the system will operate in test mode for 10 hours

©2019 Samsung All rights reserved.

SAMSUNG

304

System Startup Basic Operating Data

During Start up observe the following conditions

- Compressor discharge temperature
- Condenser outlet temperature
- High and Low pressure
- Compressor current
- Indoor unit EEV (cool)
- Indoor unit EEV (heat)
- Startup report



©2019 Samsung All rights reserved.

SAMSUNG

305

System Operation Data

Compressor discharge temperature

- **Discharge temperatures should be between 140° F - 221° F during normal operation**
 - If over 221° F, check for low refrigerant and verify liquid service valve is open.
- **Compressor will stop if discharge temperature reaches 248° F**
 - If below 140° F for long periods, the system is most likely overcharged.
- **Heating trial operation discharge temperature - high pressure saturated temperature \geq 54° F**
 - If this condition is not satisfied the system may be overcharged. Check refrigerant volume, outdoor EEV, outdoor liquid bypass valve, and EVI_EEV.

©2019 Samsung All rights reserved.

SAMSUNG

306

System Operation Data

- **Condenser outlet temperature (CondOut Temp)**
 - CondOut range: 86° F ~ 131° F under standard conditions and normal operation.
 - Low or high ambient temperatures can extend this range down or up.
 - Cooling CondOut should be between 5° F ~ 36° F greater than outside ambient temperature.
 - Heating CondOut: should be at least 2° F lower than outside ambient temperature.
- **Subcooler outlet temperature (Liquid Tube Temp)**
 - Liquid tube temp: 68° F ~ 122° F under standard conditions and normal operation.
 - Low or high ambient temperatures can extend this range down or up.
- **System Superheat**
 - (Suction temp - Suction saturated temp) = 0 ~ 12.6° F
- **Outdoor EEV (Main EEV)**
 - During cooling operation, outdoor EEV should be at 2,000 steps

©2019 Samsung All rights reserved.

SAMSUNG

307

System Operation Data

High / Low pressure

- Low pressure range during cooling test operation: 85 ~ 128 PSI.
 - When outdoor temperatures and indoor loads are high, this value may be higher.
- Low pressure range during heating test operation: 71 ~ 106 PSI.
 - This is a basic reference as ambient temperatures will change this value.
- High pressure range during cooling test operation: 355 ~ 469 PSI.
 - This value can increase with ambient temperatures (max. 512 PSI)
- High pressure range during heating test operation: 355 ~ 455 PSI.
 - This value can decrease when outside ambient temperature is below 32° F or indoor temperature is below 68° F.

IPM Temperatures – Inverter PCB Temp (IPM1 Temp / IPM2 Temp)

- When IPM board temperatures $\geq 194^{\circ}$ F the system will modify operation to prevent overheating.
- No errors will occur until temperatures reach 212° F.
- Capacity can decrease during protection without any visual indication of protection occurring if below 212° F

©2019 Samsung All rights reserved.

SAMSUNG

308

System Operation Data

Indoor Unit EEV (Cool mode)

- EVA_IN temperature
 - Under normal operation and conditions, temperature should be between 45° F - 57° F for all indoor units.
- EVA_OUT temperature
 - Under normal operation and conditions, temperature should be between 45° F - 57° F for all indoor units.
- Indoor Unit Superheat (EVA OUT - EVA IN)
 - should equal approximately 0 ~ 7 after sufficient system operation times.
 - This value will vary initially based on outdoor conditions and indoor conditions.
- Indoor EEV steps 0 ~ 2,000
 - Under normal operation and conditions the indoor unit EEV(s) should stay within 250 ~ 1400 steps.
 - If more than 50% of indoor unit EEV's SH > 11° F and EEV step of those units > 1400, the system maybe undercharged.
 - If a small percentage of indoor unit EEV steps are > 1400 under standard operating and space conditions, verify the distance from the first Y-joint to each unit is within Samsung pipe limitations.

©2019 Samsung All rights reserved.

SAMSUNG

309

System Operation Data

Indoor Unit EEV (Heat mode)

- EVA_OUT temperature
 - Under normal operation and conditions, temperature should be between 113° F - 194° F for all indoor units.
- EVA_IN temperature
 - Under normal operation and conditions, temperature should be between 91° F - 122° F for all indoor units.
- Supply Air Temperature
 - Under normal operation and conditions, temperature should be 105° F or greater.
- EEV position
 - will vary based on indoor and outdoor conditions.
 - If all indoor unit EVA_IN temperatures are lower than 91.4° F, outside ambient temperature is below 41° F, and high pressure is below 356 PSI, the system maybe oversized or overcharged
 - If only a small number of indoor unit EVA_IN and EVA_OUT temperatures are lower than normal under standard operating and space conditions, verify the distance from the first Y-joint to each unit is within Samsung pipe limitations.

©2019 Samsung All rights reserved.


SAMSUNG

310

System Operation Data Report

After proper system operation has been confirmed, create a system report in SNET Pro 2

1. In the “Home” tab, click “Report Wizard”

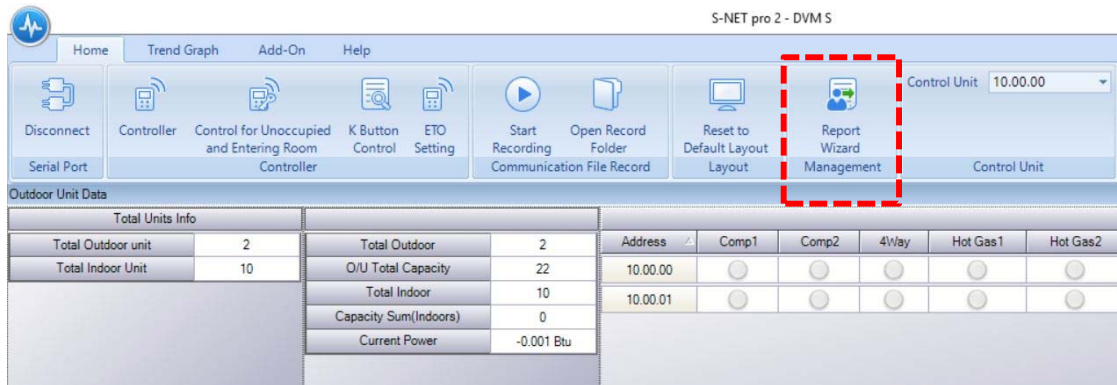



©2019 Samsung All rights reserved.

SAMSUNG

311

System Operation Data Report

2. Enter site name, equipment location, etc. All fields with must have data entered.
3. After all data is entered and the “% Received” has reached 100% and displays “Status: Complete”, click the “Next” button

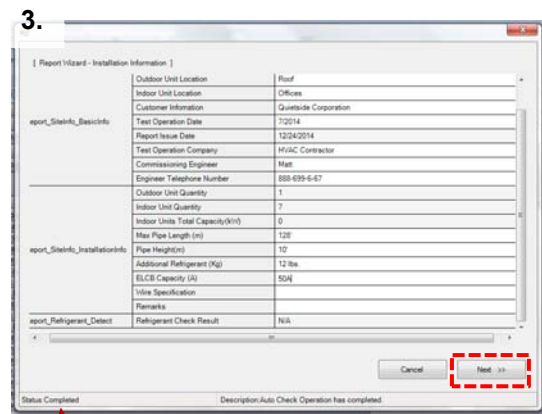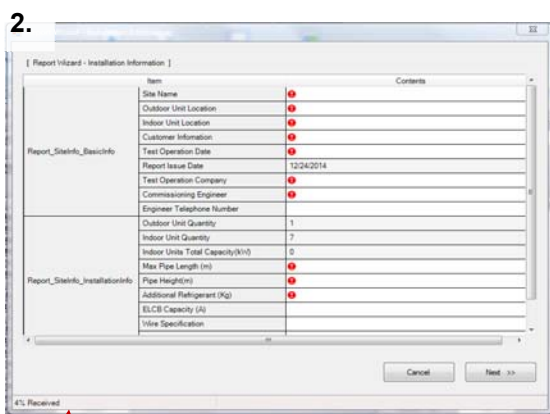



©2019 Samsung All rights reserved.

SAMSUNG

312

System Operation Data Report

- The next window will display the indoor unit addresses, type, and serial number and outdoor unit model, serial number, main MICOM and sub MICOM versions. Click "Next"
- The next window will display the Auto-trial results from "UP" mode.

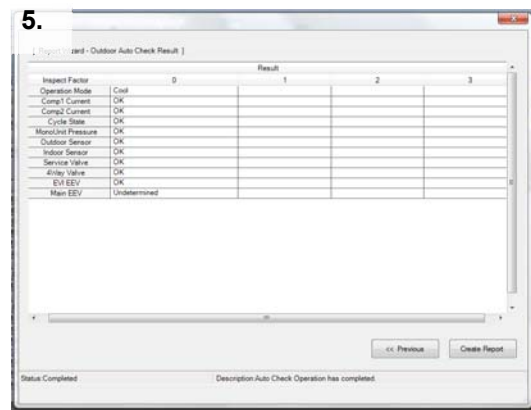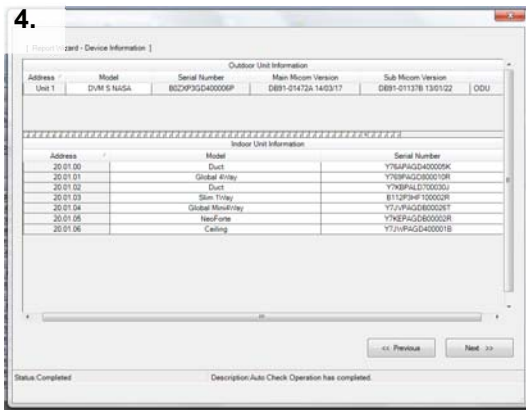


©2019 Samsung All rights reserved.

SAMSUNG

313

System Operation Data Report

- Click "Create Report" and specify where you would like to save the PDF report

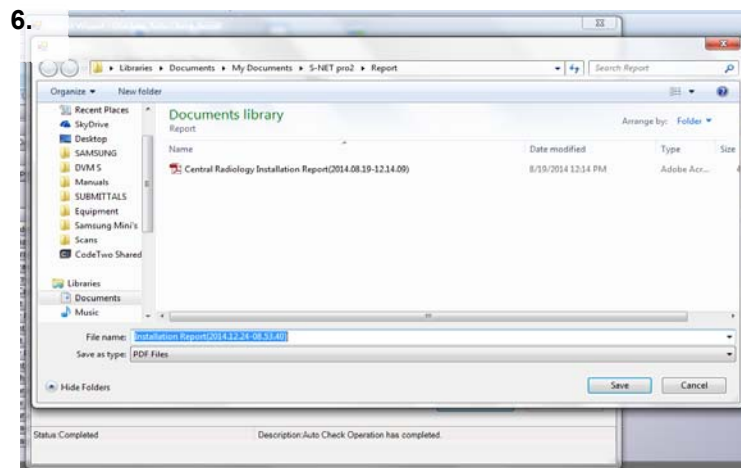

©2019 Samsung All rights reserved.

SAMSUNG

314

System Operation Data Report

Page 1 – Basic system data, Auto-trial results, and outdoor unit serial and firmware versions.

Installation Information

Site Name: 18 Training Lab
Outdoor Unit Location: Roof
Customer Information: Quanta Corporation
Test Operator: 10274
Report Issue Date: 12/24/14
Test Operator Company: HVAC Contractor
Commissioning Engineer: MAF
Engineer Telephone Number: 888-628-6427
Outdoor Unit Location: 1
Indoor Unit Quantity: 7
Indoor Unit Total Capacity (BTU): 9
Rise Pipe Length (ft): 125
Purge/Recharge: 12 Rea
R134a Capacity (lb): 504
R134a Specification: R134a
Refrigerant Check Result: 95%

Auto Start Up Result - Outdoor Unit

Insert Factor: 0, 1, 2, 3
Operation Mode: Cool
Compressor: OK
Fan Motor: OK
Blower Motor: OK
Outdoor Sensor: OK
Indoor Sensor: OK
Remote Valve: OK
Rise Valve: OK
COP (EER): OK
Note: OK

Outdoor Unit Information

Address	Model	Serial Number	Main Board Version	Sub Board Version
Unit 1	Y76PAGD000000P	Y76PAGD000000P	DBP1-010719 10/11/12	DBP1-010719 10/11/12

Ver 1.1.5 Page 1 of 5 Created on 12/24/2014 8:53

Page 2 – Indoor unit address, type, and serial number

Indoor Unit Information		
Address	Model	Serial Number
20 01 00	Duct	Y76PAGD000000P
20 01 01	Global 4in/4y	Y76PAGD000000P
20 01 02	Duct	Y76PAGD000000P
20 01 03	Slit Trivay	B112P3HF 100000R
20 01 04	Global Mini4in/4y	Y76PAGD000000P
20 01 05	NoaForo	Y76PAGD000000P
20 01 06	Ceiling	Y76PAGD000000P

Page 3 – Outdoor Unit operation details from Auto Trial operation

Outdoor Unit 1 Detail

Ver 1.1.5 Page 3 of 5 Created on 12/24/2014 8:53

©2019 Samsung All rights reserved.

SAMSUNG

315

System Operation Data Report

Page 4 - Indoor unit address, type, "Location" (name given with SNET Pro 2), factory program code, basic option settings, advanced options settings, MICOM firmware version and MTFC installation status for each indoor unit.

Indoor Unit Installation Data										
Address	Model	RAC	MCU ADDRESS	MCU PORT	Location	Product Option	Installation Option	Installation Option2	Main Micom	Error History1
0	Big Duct	22	0	A	72 HSP	[011054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01507A 170417	000
1	Slit Trivay	05	2	C	Wind Free Trivay	[011054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01888A 170406	201
2	Big Ceiling	AB	2	A	Big Ceiling	[011054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01888A 161227	000
3	Duct	21	2	F	Slit Duct	[011054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01507A 170417	000
4	Duct	06	2	D	Duct S	[011054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01888A 170309	000
5	RAC	00	1	F	Highspeed	[012044-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01874A 170215	000
6	Console	20	1	E	Can Floor	[014054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01507A 170417	000
7	Console	20	1	E	Ceased	[014054-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01507A 170417	000
8	360CST	20	2	B	360	[01100F-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-01742A 161222	000
9	Global 4in/4y	04	2	E	Wind Free 4in/4y	[01404F-1]195000-220000-030000	[020010-1]000000-020000-030000	[030000-1]000000-020000-030000	DBP1-02028A 160110	201

Indoor Unit MICOM firmware version must be "161222" or higher

©2019 Samsung All rights reserved.

SAMSUNG

316

System Operation Data Report

MCU Unit Data																													
																												Main Model	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 161222	
																												DB91-01867A 16122	

Page 5 - MCU address, valve status, MICOM version, and firmware version for each MCU.

©2019 Samsung All rights reserved.

SAMSUNG

317

System Operation Data Report

To register for warranty

- Locate the Report wizard files from your documents
 - Excel & PDF
- Email the complete reports to your rep or distributor

Installation Information		A/C Auto Start Up Report	
Item		Contents	
Table Name		11 Training.xls	
Outdoor Unit Location		Pool	
Indoor Unit Location		Office	
Customer Information		Quintessence Corporation	
Technician Name		110719	
Report Issue Date		12/24/2014	
Technician Company		HVAC Contractor	
Commissioning Engineer		N/A	
Engineer Telephone Number		888-888-6627	
Outdoor Unit Quantity		1	
Indoor Unit Quantity		1	
Indoor Units Total Capacity(BTU)		8	
Heat Pipe Length (ft)		128	
Pipe Roughness		12	
Outdoor Refrigerant (kg)		12 lbs	
R/CB Capacity (kg)		N/A	
Unit Specification		R410A	
Remarks			
Report Refrigerant Status		Refrigerant Check Result	
		N/A	
Auto Start Up Result - Outdoor Unit			
Inspected Factor		Result	
Operation Mode		Cool	
Compressor		OK	
Compressor		OK	
Compressor		OK	
Compressor		OK	
Manual Pressure		OK	
Outdoor Sensor		OK	
Indoor Sensor		OK	
Remote Valve		OK	
R/CB Valve		OK	
R/CB ECU		OK	
R/CB ECU		OK	
R/CB ECU		OK	
Outdoor Unit Information			
Address	Model	Serial Number	Micro Model Version
Unit 1	DHW 3 NGA	822F9220688MP	DB91-01867A 161222
			DB91-01867A 161222
Ver 1.1.5 Page 1 of 5 Created on 12/24/2014 8:53			

©2019 Samsung All rights reserved.

SAMSUNG

318


External Controls



319

External Contact Controller - MIM-B14

- Direct indoor unit control by external contact signal
- External contact input load: 5v – 5,A
- Output terminals are open/close contacts 0 volts
- Maximum load rating on the Operation & Error terminals: 250vac, 3A
- Emergency control with simple contact input
- Compatible with all DVM S indoor fan coil units
- External heat control

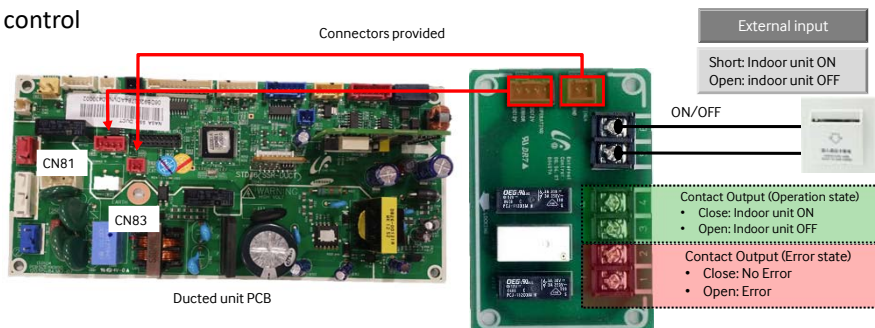


©2019 Samsung All rights reserved.

SAMSUNG

320

External Contact Controller - MIM-B14

Direct indoor unit On & Off control by external contact signal 02 Series Installation Options

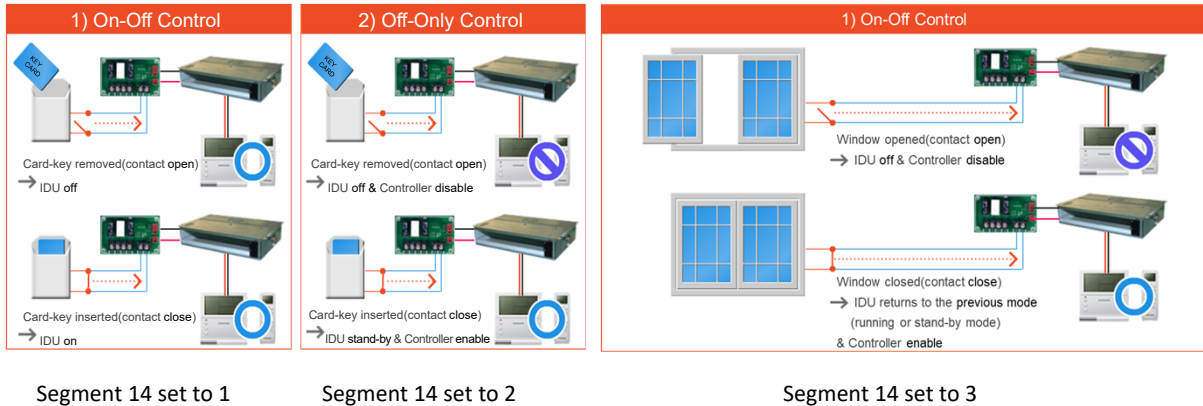

©2019 Samsung All rights reserved.


SAMSUNG

321

External Contact Controller - MIM-B14

Indoor unit operation state output through relay contacts

- 02 Series Installation Options Segment 15
 - (0) Thermo On/Off
 - Output based on connected indoor unit's current operation
 - Heating/Cooling trying to condition the space
 - Satisfied set point and in a "Thermo-Off" state
 - (1) Operation On/Off
 - Output based on power status of connected indoor unit
 - (On or Off including fan)
 - Fan mode – contact open

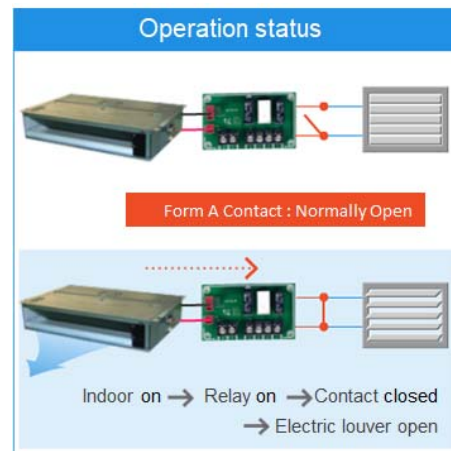


©2019 Samsung All rights reserved.

SAMSUNG

322

External Contact Controller - MIM-B14

- Error state output through relay contacts
 - Once the MIM-B14 is enabled terminal 1 & 2 will be active
 - When the system is active with no error code the contacts will be closed
 - When an error occurs the contact will open
 - Maximum load rating on the Error terminals: 250vac, 3A

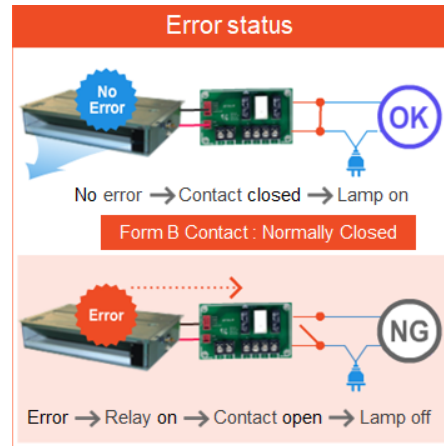


©2019 Samsung All rights reserved.

SAMSUNG

323

Multi-Tenant Controller - MCM-C210N

- When supply voltage to an indoor unit is disabled, MCM-C210N will provide auxiliary 12V DC and 5V DC power to the indoor unit PCB to keep "awake" (see table for indoor unit operation details)
- When supply voltage to an indoor unit is supplied normally, MCM-C210N will cut auxiliary power to the indoor unit PCB allowing normal operation.
- This also prevents property damage inside due to ice/water accumulation/dripping from a stopped indoor unit (open EEV, no fan → "ice formation")

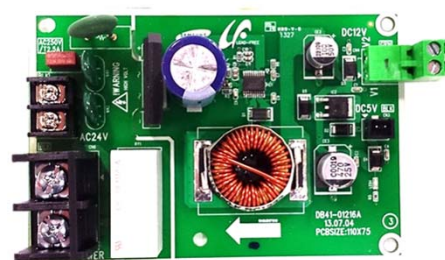


©2019 Samsung All rights reserved.

SAMSUNG

324

Multi-Tenant Controller - MCM-C210N

- MCM-C210N will monitor supply voltage to an indoor unit and provide power to that unit's PCB when supply voltage is removed to prevent full system failure due to offline unit.
- The 24V transformer must be powered by a different circuit than the indoor units. The controller could be powered by the outdoor unit circuit

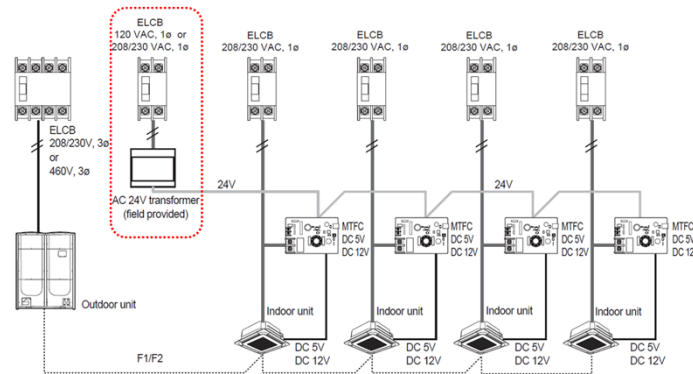


©2019 Samsung All rights reserved.

SAMSUNG

325

Multi-Tenant Controller - MCM-C210N

- When indoor units are powered from individual tenant power supply/meter where there is a risk of power loss to individual indoor units
- When indoor unit supply power is enabled/disabled for simple indoor unit ON/OFF control

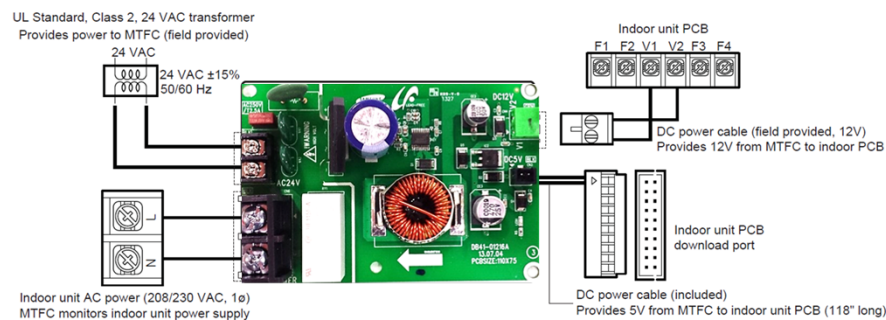



©2019 Samsung All rights reserved.

SAMSUNG

326

Multi-Tenant Controller - MCM-C210N

- Wired remote controllers (MWR-WE13N, MWR-SH00N, MWR-SH10N) connected to multiple indoor units should not be connected to indoor units using MCM-C210N that are powered from different sources
- 5V DC indoor unit connection cable length: 118"
- MCM-C210N must be installed in an NEC approved enclosure (field provided)

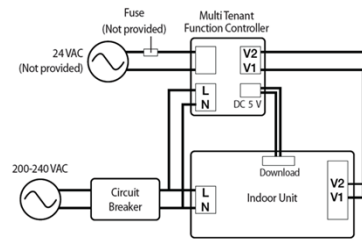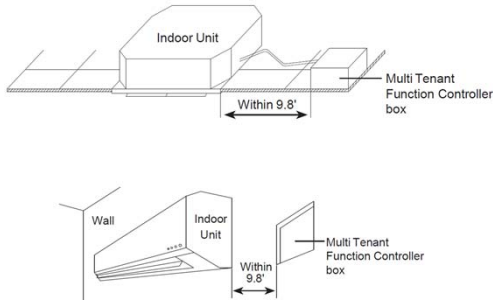

©2019 Samsung All rights reserved.

SAMSUNG

327

Multi-Tenant Controller - MCM-C210N

Indoor unit operation details when powered by MCM-C210 MTFC

Item	Indoor Unit Operation	Details
Indoor unit operation	OFF	Indoor unit will display OFF status and cannot be turned ON
Indoor unit expansion valve	Close	Operation OFF In heat mode the EEV will operate the same as "noise reduction" control option, momentarily opening and closing EEV at fixed intervals to prevent refrigerant migration
Self error diagnosis	Functional	Indoor unit can still detect some errors (ex: EEV close/open error)
Error display on panel	Partial operation	The indoor unit will display its own errors but not other system errors
Connected wired controller	OFF	Power is removed, will not function
Panel display	All OFF	All LED's on indoor unit are disabled (except during error display)
Input outdoor unit key mode (test mode)	OFF, no operation	All other indoor units will operate that have supply power
Control from central control devices	OFF, no operation	Indoor unit will remain OFF, operation is not possible
Setting option/program codes	Not possible	Option settings from wireless controller, wired controller, SNET Pro 2, and S-Checker is not possible
Recognition of MTFC status	Possible through Pro 2 SNET	SNET Pro 2 service software will allow monitoring of MTFC status
Indoor unit chime/beep	OFF	The indoor unit will not provide audible operation notifications
Condensate Pump	Not possible	Without high voltage Condensate pumps cannot run

©2019 Samsung All rights reserved.

SAMSUNG

328


Multi-Tenant Controller - MCM-C210N

Indoor Unit Settings

- MTFC must be enabled by changing the advanced indoor unit option setting segment "11" to "2"
 - "0" = Disable MTFC (Default)
 - "2" = Enable MTFC

Segment: 1 2 3 4 5 6 7 8 9 10 11 12 13 14 15 16 17 18 19 20 21 22 23 24 25 26 27 28 29 30 31 32 33 34 35 36 37 38 39 40 41 42 43 44 45 46 47 48 49 50 51 52 53 54 55 56 57 58 59 60 61 62 63 64 65 66 67 68 69 70 71 72 73 74 75 76 77 78 79 80 81 82 83 84 85 86 87 88 89 90 91 92 93 94 95 96 97 98 99 100

050000 100000 200000 300000

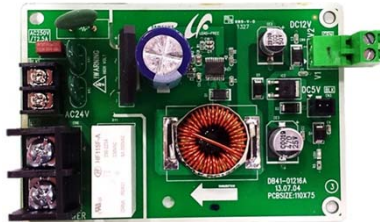

©2019 Samsung All rights reserved.

SAMSUNG

329

Controls Accessories




©2019 Samsung All rights reserved.

SAMSUNG

330

Wi-Fi Adapter - MIM-H04UN

- WiFi Kit allows control and scheduling of the DVMS system remotely through Android and Apple devices
- Configuration requires the Samsung **"SmartThings"** app.
- 2.4 GHZ or 5 GHZ WI-FI
- One WiFi kit can be registered to a maximum of 5 users

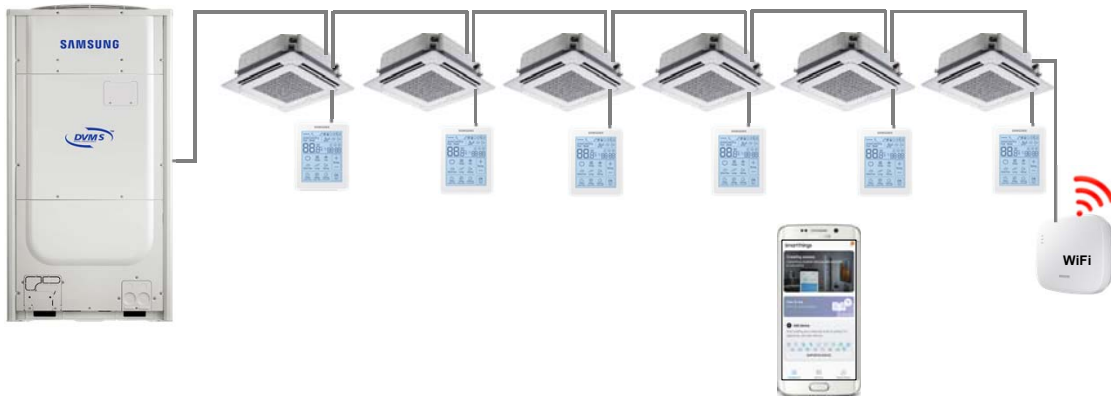

©2019 Samsung All rights reserved.

SAMSUNG

331

Wi-Fi Adapter - MIM-H04UN

- 4-wire connection to an indoor unit – **F1 F2** communications **V1 V2** 12vdc power from indoor unit
- WiFi adapter should be installed as close to the wireless router as possible
- For the indoor units with no **V1 V2** terminals use the external control wires – Org to **V1** & Blk to **V2**



Refer to the WiFi Kit Installation Manual for step by step setup and configuration procedures


©2019 Samsung All rights reserved.

SAMSUNG

332

Thermostat Adapter - TADPT2

- Adapter can control one or two DVMS indoor units
 - Two connected indoor units are controlled as a group
- Can be configured to operate indoor unit as primary or secondary heat source
- Can be configured for cooling only with heat from external source
- "Emergency Heat" output
- External contact input to disable unit – N.C. operation
- Supports 1 or 2 stages of Heat and Cool
 - Stage 1 & 2 Heat and Cool temperature setpoints
- Configurable fan operations
 - Low, medium, and high
- Each adaptor requires its own field supplied 24vac class 2 transformer

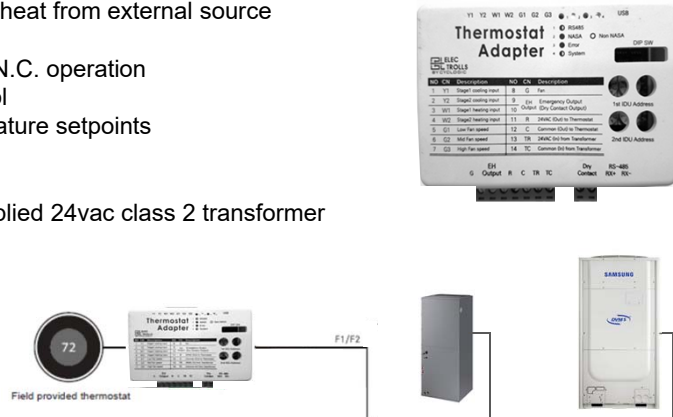


©2019 Samsung All rights reserved.

SAMSUNG

333

Thermostat Adapter - TADPT2

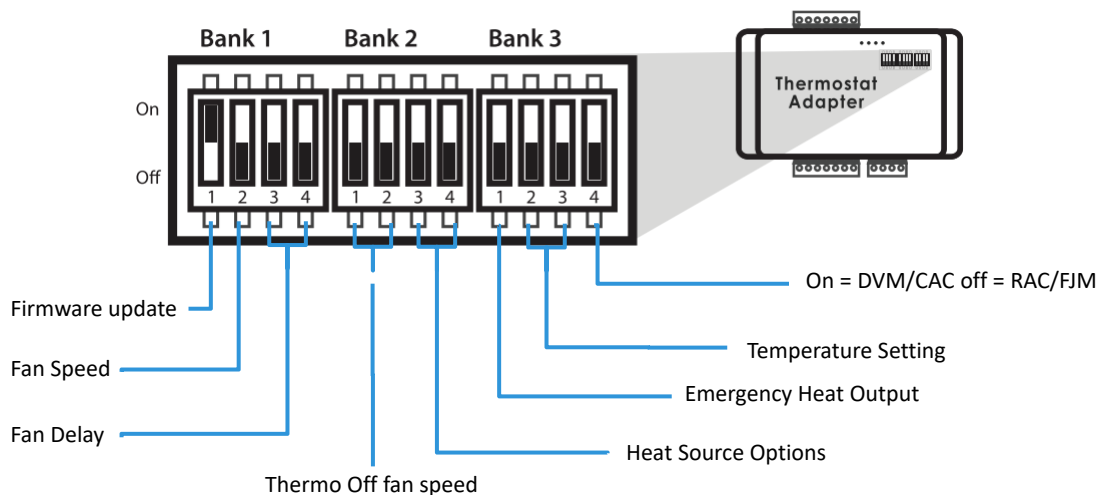

©2019 Samsung All rights reserved.

SAMSUNG

334

Motion Detect Sensors

- MCR-SMA Motion Sensor
 - Standard Mini 4-Way Cassette
- MCR-SMC Motion Sensor
 - Wind-Free™ 4 Way Cassette
- MCR-SMD Motion Sensor
 - Wind-Free™ Mini 4 Way
- MCR-SME Motion Sensor
 - 360 Cassette



©2019 Samsung All rights reserved.

SAMSUNG

335

Motion Detect Sensors

MCR-SMA Motion Sensor – Mini 4-Way Cassette

Mode	Soft Off (minutes)	Hard Off (minutes)	Function Description
Standard	20	30	SOFT OFF: turns off indoor unit but can restart with motion detection before HARD OFF.
	40	60	
	80	120	HARD OFF: Turns unit off but will not turn back on after motion is sensed. Unit will need to be power ON with a unit controller.
	120	180	
Premium	20	30	SOFT OFF and HARD OFF are the same as Standard Mode.
	40	60	
	80	120	Samsung comfort functions are activated.
	120	180	



Samsung Comfort Logics (activated in “Premium” mode)

Comfort Flow:

- MDS prevents cassette from blowing directly on occupants by changing air flow direction

Comfort Temperature:

- When the temperature difference between the upper and lower parts of the room is large, the supply air louvers will lower to direct air downward

Comfort Saving:

- When no motion is detected, MDS will adjust set temperature to reduce energy consumption (maximum +3.6° F in cooling, and -3.6° F in heating)

©2019 Samsung All rights reserved.

SAMSUNG

336

Motion Detect Sensors

MCR-SMC,D,E Motion Sensor – Mini 4-Way Cassette

Mode	Soft Off (minutes)	Hard Off (minutes)	Function Description
Standard	20	30	SOFT OFF: turns off indoor unit but can restart with motion detection before HARD OFF.
	40	60	
	80	120	HARD OFF: Turns unit off but will not turn back on after motion is sensed. Unit will need to be power ON with a unit controller.
Premium	20	30	SOFT OFF and HARD OFF are the same as Standard Mode.
	40	60	
	80	120	Samsung comfort functions are activated.



Samsung Comfort Logics (activated in “Premium” mode)

Comfort Flow:

- MDS prevents cassette from blowing directly on occupants by changing air flow direction

Comfort Temperature:

- When the temperature difference between the upper and lower parts of the room is large, the supply air louvers will lower to direct air downward

Comfort Saving:

- When no motion is detected, MDS will adjust set temperature to reduce energy consumption (maximum +3.6° F in cooling, and -3.6° F in heating)

©2019 Samsung All rights reserved.


SAMSUNG

337

Motion Detect Sensors

MCR-SMA Motion Sensor – Mini 4-Way Cassette

Power On/Off

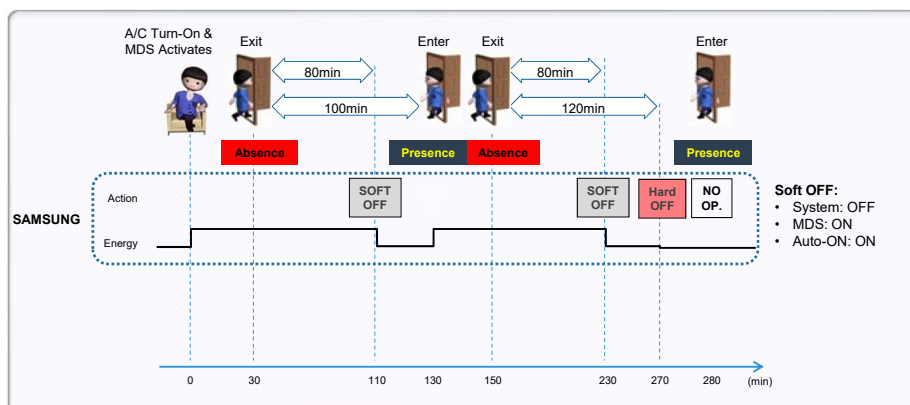

©2019 Samsung All rights reserved.

SAMSUNG


338

Motion Detect Sensors


MCR-SMA Motion Sensor – Mini 4-Way Cassette

Pattern Learning Function Details

- Pattern Learning Function is implemented with ON/OFF function baseline (default OFF times)
- Pattern Learning Function is 3rd step
- If there is a pattern of leaving and not returning, the MDS will slowly decrease the amount of time for Soft OFF and Hard OFF saving energy with shortened operation times.

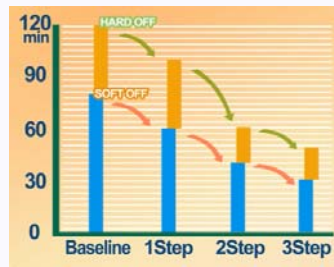

*ON/OFF Function 120min

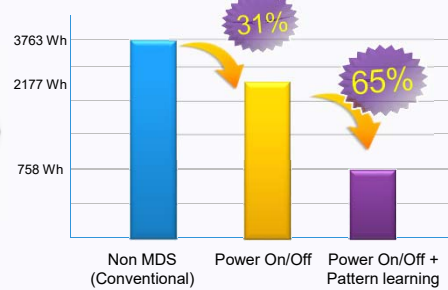

*Cooling set point 64.4° F, 18,000 btu/h Mini 4way 1 set

©2019 Samsung All rights reserved.

SAMSUNG


339

Motion Detect Sensors


MCR-SMA Motion Sensor – Mini 4-Way Cassette

Indirect Air Flow

- People sensing O → avoid direct air flow
- People sensing X → direct air flow
- ⇒ Feeling comfortable

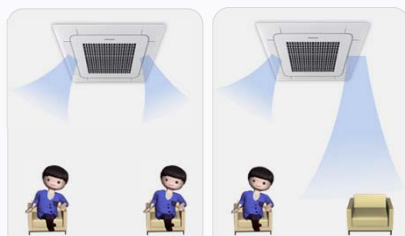

Floor Temperature Sensing

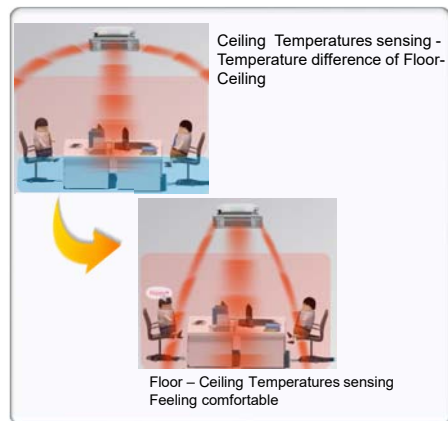

©2019 Samsung All rights reserved.

SAMSUNG

340

External Heat Control



341

External Heat Control

- When a system is operating in heat mode and an indoor unit cannot reach or maintain desired set temperature, the indoor unit can activate supplemental auxiliary heat (EX: -12°F outside temperature). Although Samsung DVM S systems are designed to heat effectively at low ambient temperatures, some projects might require an additional heat source.
- This is not designed to be used as “emergency heat”. If the outdoor unit stops due to low ambient conditions but not an error code, the indoor unit will still operate its fan and auxiliary heat output connection (outdoor temperature must be -22°F or greater). If outside conditions are low enough to cause an error code, external heater control is not guaranteed (EX: low suction error code caused by low outside temperatures).
- When indoor units are configured to use the auxiliary heat control output, the outdoor unit compressor will still operate as this control option is simply supplemental heat control.

©2019 Samsung All rights reserved.

SAMSUNG

342

External Heat Control

External Heat Concept

All Multi-position air handlers models AM0**JNZDCH will have this firmware or newer and will have an electric heat accessory option. When using accessory VHK-*** electric heat kits, the indoor unit is configured using the HOT COIL output from the PCB. The heat kits will plug into the vertical air handler electric heat plug and will not require additional relays, etc. See details in the electric heat kit installation instructions.

ATTENTION

Samsung cannot guarantee indoor unit fan operation in the event of an error or fan issue. Samsung cannot guarantee sufficient airflow for heaters in the supply duct outlet as duct design, filter selection, and filter status will directly effect this. When controlling an auxiliary heat source with a Samsung indoor unit, make sure that all required thermal protection devices are present per national, local, and ASHRAE standards.

External heat control output is not designed to control electric heat options that were not provided by Samsung. Do not use Samsung indoor unit auxiliary heat control output to enable/disable electric heat in the supply duct.

©2019 Samsung All rights reserved.

SAMSUNG

343

External Heat Control

Applicable Indoor Unit Firmware Versions

Indoor unit type	Indoor Model Number	Version / date code
Neo Forte (wall mount)	AM0**FNTDCH/AA	DB91-01508A, date code (14/06/13) and newer
	AM0**HNQDCH/AA	
Cassette	AM0**FN4DCH/AA	DB91-01507A, date code (14/06/13) and newer
	AM0**FN1DCH/AA	
	AM0**FNNDCH/AA	
Ducted	AM0**FNLDCH/AA	
	AM0**FNMDCH/AA	
	AM0**FNHDCH/AA	
Under Ceiling / Low-Wall	AM0**FNCDCH/AA	DB91-01509A, date code (14/06/13) and newer
Vertical Air Handler / AHU Kit	AM0**GNVQCH	
	MXD-K***AN	

Use SNET Pro 2 Service Software to view the installed firmware version of an indoor unit.

Indoor Unit Installation Data							
Address	Model	RMC	Location	Product Option	Installation Option	Installation Option2	Main Menu
0	Duct	04	Slim Duct	[0]10054-[1]25001-[2]01616-[3]01110	[0]00310-[1]21000-[2]10000-[3]00000	[0]50000-[1]00000-[2]00009-[3]00000	DB91-01507A 14/06/13
1	Global 4-in/4-out	03	4" V-Wall	[0]1404F-[1]95097-[2]01A1A-[3]03000	[0]20310-[1]121000-[2]10000-[3]00000	[0]50000-[1]00000-[2]00009-[3]00000	DB91-01507A 14/06/13
2	Duct	06	MSP Duct	[0]10054-[1]25E44-[2]0665E-[3]01110	[0]20310-[1]121000-[2]10000-[3]00000	[0]50000-[1]00000-[2]00009-[3]00000	DB91-01507A 14/06/13
3	Slim V-Wall	02	1" V-Wall	[0]17064-[1]100C3-[2]01616-[3]03000	[0]20310-[1]121000-[2]10000-[3]00000	[0]50000-[1]00000-[2]00009-[3]00000	DB91-01507A 14/06/13

©2019 Samsung All rights reserved.

SAMSUNG

344

External Heat Control

Connection

Depending on the model of unit that is installed, the indoor unit can connect to and control an auxiliary heat source one of two ways:

1. MIM-B14 external contact control (recommended method)
2. "HOT WATER" coil connection (ducted models only)

- When using MIM-B14, its operation output terminals will be used to control an external heat source. This connection provides a 0 volt switch to control the auxiliary heat source (maximum 250V, 3A at this terminal). Using MIM-B14 is the preferred method of external heat control.
- The HOT WATER terminal in a duct unit supplies a high voltage control signal. One terminal supplies 120 VAC constantly and the other terminal supplies an additional 120 VAC (same as supply voltage) to activate the auxiliary heat source. A field-provided, 230 VAC relay must be used. Never power a device from the HOT WATER output, only use to control external devices.


©2019 Samsung All rights reserved.

SAMSUNG

345

External Heat Control

External Heat Connection Example

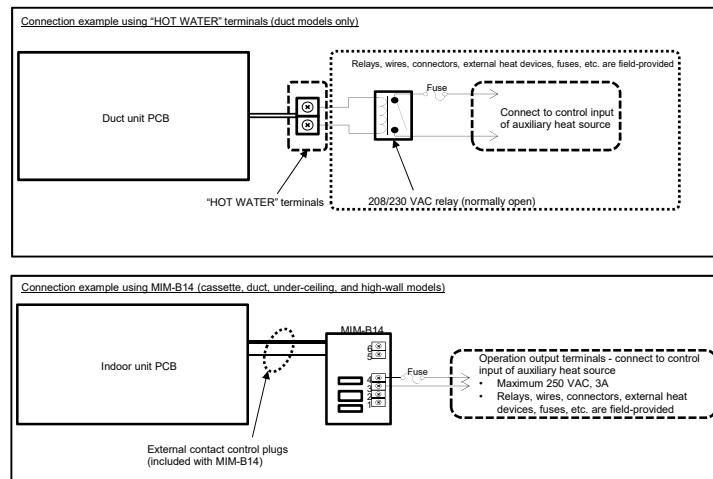

©2019 Samsung All rights reserved.

SAMSUNG

346

External Heat Control

External Heat Control Programming

If controlling auxiliary heat with the HOT COIL output, you must enable this function for that ducted unit.

02 Series Installation Options Settings (basic options), segment 09		
Use of HOT WATER output	Details	Segment 9 option setting
Do not use	DEFAULT - Do not use	0
Use	Use, fan operation is interlocked with auxiliary heat signal	1
Use	Use, fan is OFF when auxiliary signal ON for cooling only indoor units (install MCM-C200 mode selector switch in the outdoor unit and set to cool mode for this option).	3

If the external heat source is controlled by MIM-B14, indoor unit option 15 of the basic indoor unit option settings (02 series) must be enabled.

02 Series Installation Options Settings (basic options), segment 15		
External control output	Details	Segment 15 option setting
THERMO-ON/OFF	DEFAULT - Output terminals open/close based on standard THERMO-ON/OFF settings (1° C)	0
Operation ON/OFF	Output terminals open/close based on indoor unit power ON/OFF	1
Use*	Use, fan operation is interlocked with auxiliary heat signal	2
Use*	Use, fan is OFF when auxiliary signal ON for cooling only indoor units (install MCM-C200 mode selector switch in the outdoor unit and set to cool mode for this option).	3

* When this option is enabled, this output cannot be used for normal THERMO-ON/OFF, only auxiliary heat control.

©2019 Samsung All rights reserved.

SAMSUNG

347

External Heat Control

External Heat Control Programming

- After programming the indoor unit for the desired auxiliary heat control output, you can specify how and when you would like to enable the external heat control signal.
- Below is a table that details the temperature difference between set temperature and room temperature and an optional 10 or 20 minute time delay.

05 Series Installation Options Settings (advanced options), segment 18			
Heater signal on (H)	Time delay (T)		
	No delay	10 minute delay	20 minute delay
THERMO-ON (1.8° F, 1° C, can vary depending on other settings)	0	1	2
2.7° F (1.5° C)	3	4	5
5.4° F (3° C)	6	7	8
8.1° F (4.5° C)	9	A	B
10.8° F (6° C)	C	D	E

©2019 Samsung All rights reserved.

SAMSUNG


348



349

Multi-unit EEV Setup

- Multi-unit EEV Kit Addressing
- EEV kits will address similar to the MCU's
- Set the main address of the units connected to A, B, and C (C is only used with 3 zone EEV kits)
- EEV Kits require 208/230V AC power
- Also require connection of F1/F2 to system

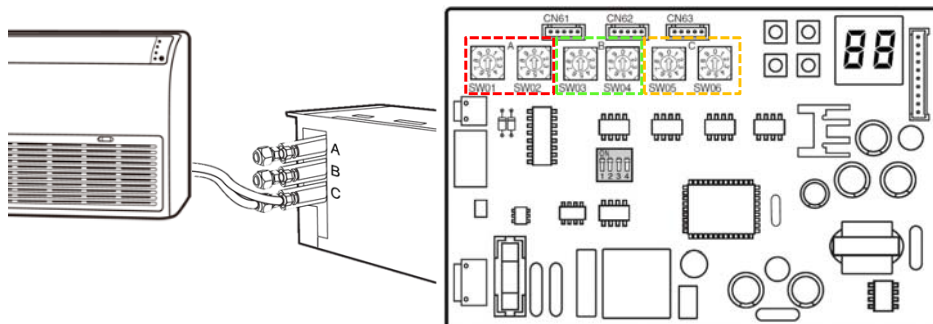


©2019 Samsung All rights reserved.

SAMSUNG

350

Multi-unit EEV Kit Setup

Set the EEV kit dials according to the address of the connected indoor units, Use SNET Pro or the units controller to determine the indoor unit address

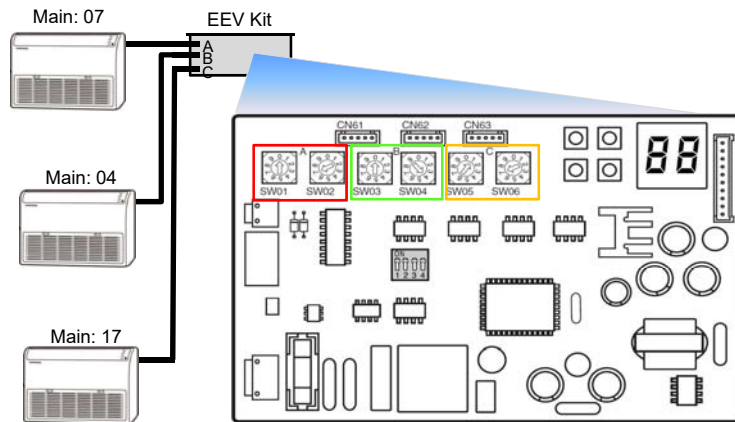

©2019 Samsung All rights reserved.

SAMSUNG