


Battery Backup Systems With All-Pole Disconnection

Single-Phase Battery Backup System

Schematic Diagram of the Automatic Transfer Switch

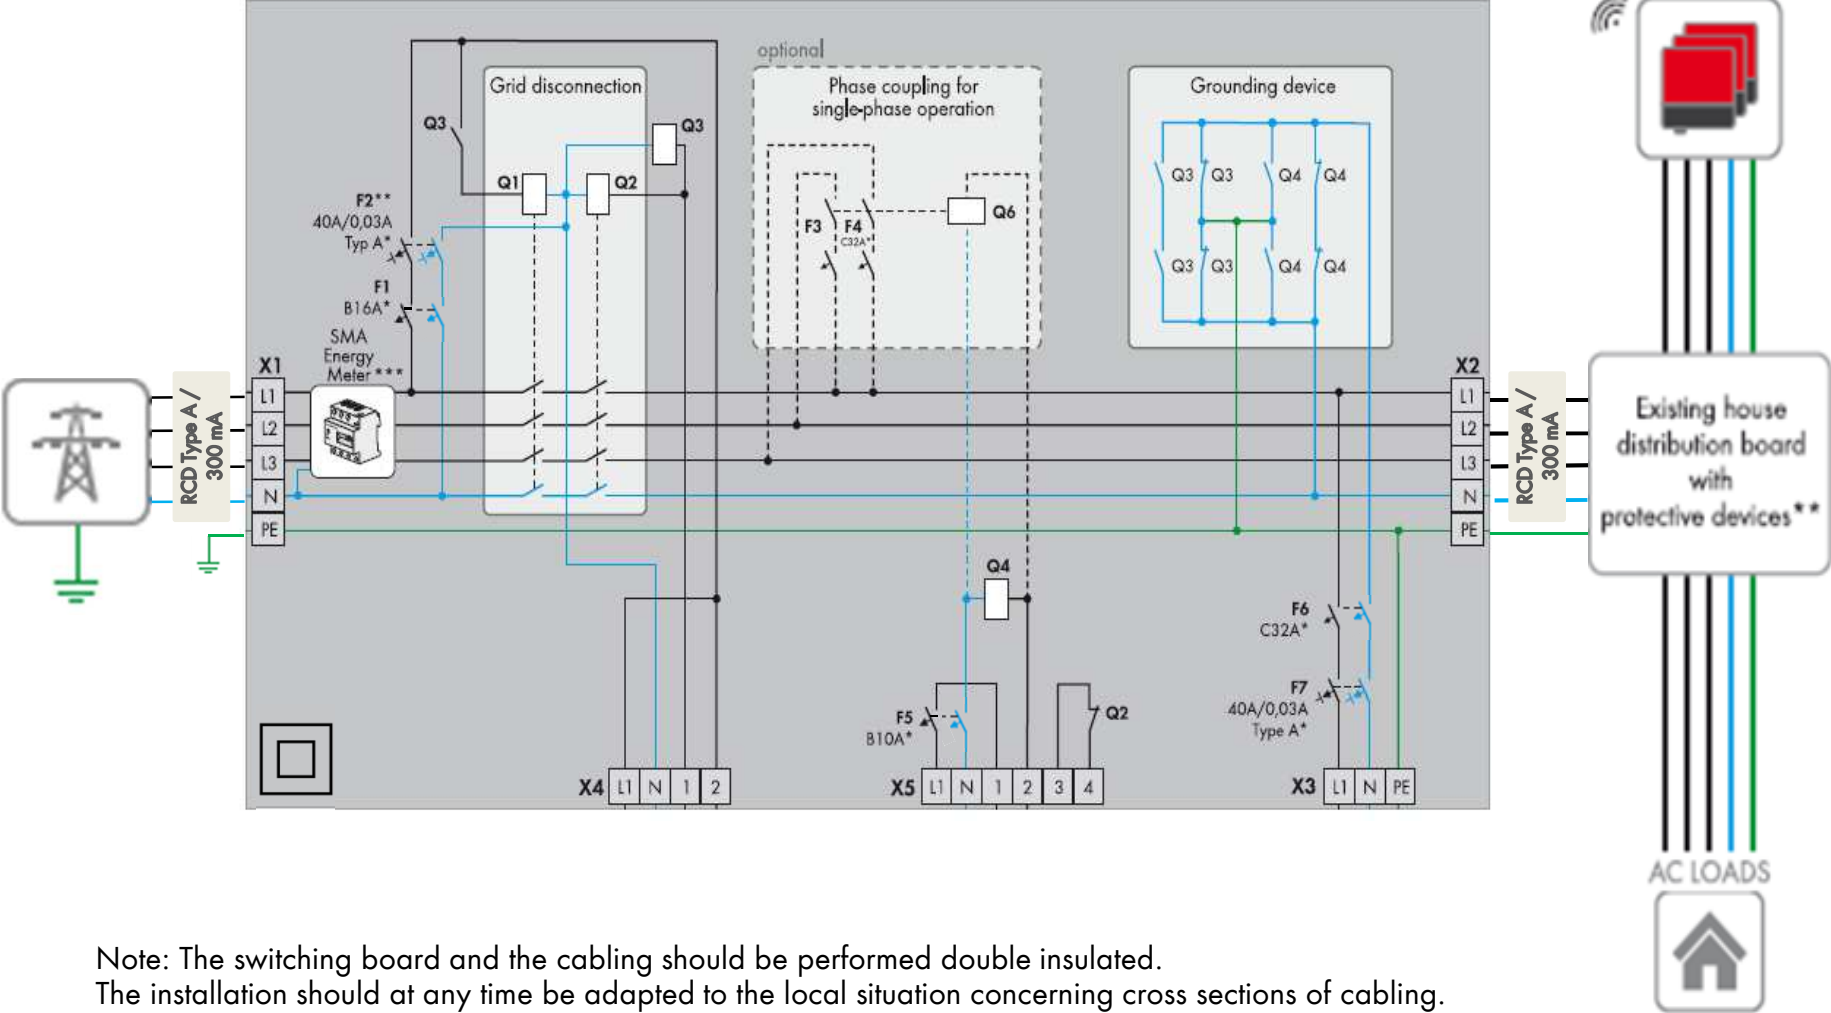

Note: The switching board and the cabling should be performed double insulated. The installation should at any time be adapted to the local situation concerning cross sections of cabling.