

# Stationary Battery Check Report

## 1. Basic Information

Print Date : 6/19/2012

Site Name : Facility ABC  
 String Name : TEST BANK  
 Manufacturer : Company ABC  
 Model(Mfg.Date) : Model XYZ  
 Capacity : 100  
 Std. Resistance : 10 (mΩ)  
 Measured Place : Eagle Eye  
 Measured Date : 4/6/2012

S  
I  
G  
N

|  |  |  |
|--|--|--|
|  |  |  |
|  |  |  |

Measured by



(Sign)

## 2. String(Bank) Average Value

Applied reference value : 10 (mΩ)

| Average | Voltage(V) | Resistance(mΩ) | Temperature(F) | Remark |
|---------|------------|----------------|----------------|--------|
|         | 12.6       | 12.798         |                |        |

## 3. Cell(Jar) Property Graph

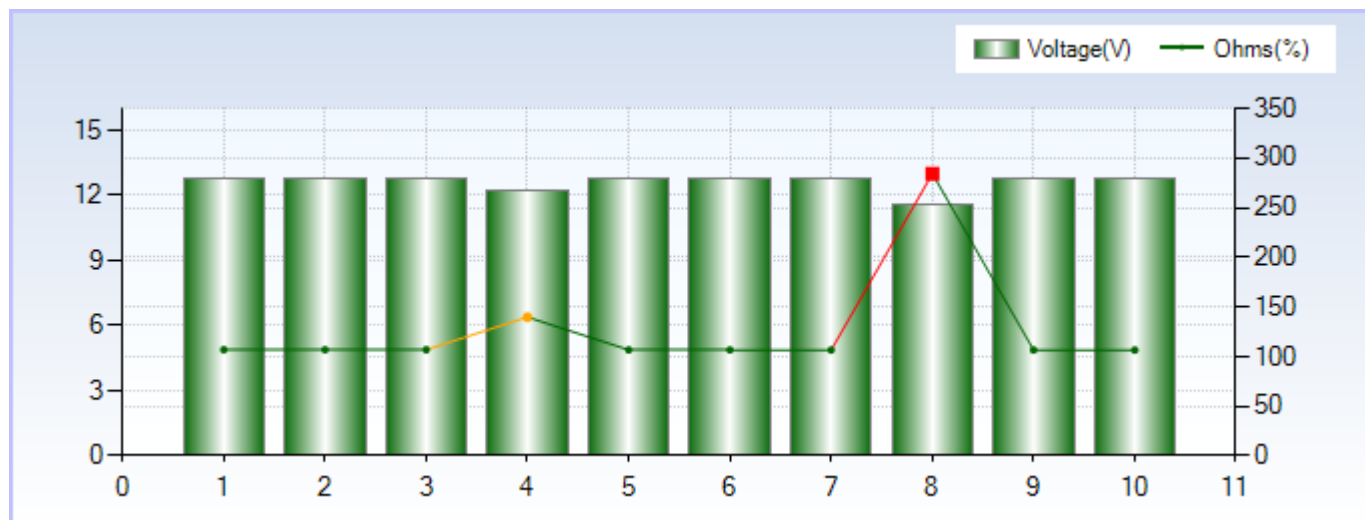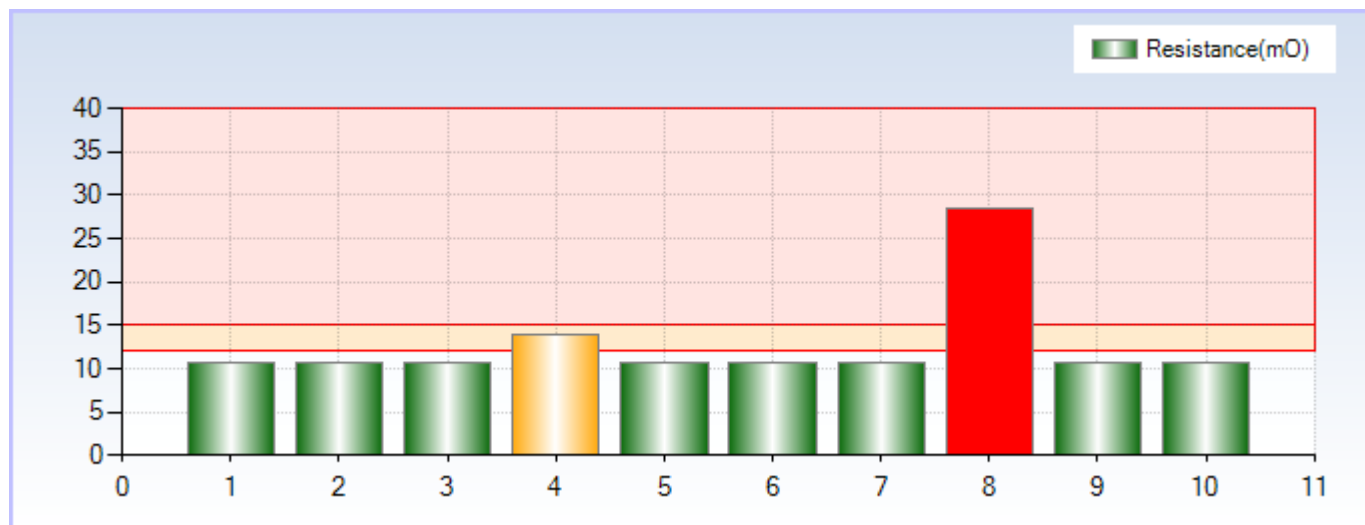

4. Cell(Jar) Property Data

| Cell(Jar) | Voltage(V) | Resistance(mO) | Ohmic(%) | Temp(F) | Status  |
|-----------|------------|----------------|----------|---------|---------|
| 1         | 12.78      | 10.709         | 107.09   | -       | Normal  |
| 2         | 12.78      | 10.703         | 107.03   | -       | Normal  |
| 3         | 12.78      | 10.709         | 107.09   | -       | Normal  |
| 4         | 12.18      | 13.985         | 139.85   | -       | Warning |
| 5         | 12.78      | 10.694         | 106.94   | -       | Normal  |
| 6         | 12.78      | 10.691         | 106.91   | -       | Normal  |
| 7         | 12.78      | 10.683         | 106.83   | -       | Normal  |
| 8         | 11.61      | 28.447         | 284.47   | -       | Fail    |
| 9         | 12.78      | 10.684         | 106.84   | -       | Normal  |
| 10        | 12.78      | 10.676         | 106.76   | -       | Normal  |

Memo

Check Battery #4  
Replace Battery #8