

1. DETERMINE MOUNTING HEIGHT AND INSTALL UNIT(S) INTO T6 CHASSIS. UNIT(S) MAY BE INSTALLED FROM TOP OR BOTTOM.
2. GROUND BONDING OF T6 HOUSING IS ACHIEVED BY MOUNTING SCREWS. BE SURE TO INSTALL SPECIFIED HARDWARE AND TIGHTEN TO SPEC.



T6-LB-AC SERIES INSTALLATION INSTRUCTIONS

244 Bergen Boulevard, Woodland Park, NJ 07424, Phone: 973.785.4347 - Fax: 973.785.4207


INPUT RATING: 125 VAC 15A 60Hz

OUTLET OUTPUT RATING: 15 AMPS MAXIMUM TOTAL CURRENT DRAW, EACH OUTLET IS ALSO INDIVIDUALLY RATED FOR 15 AMPS

USB OUTPUT RATING:

T6-LB-AC2CH: 2 x 12 WATT

T6-LB-AC1CH: 2 x 10 WATT (UPPER USB PORTS), 2 x 5 WATT (LOWER USB PORTS)

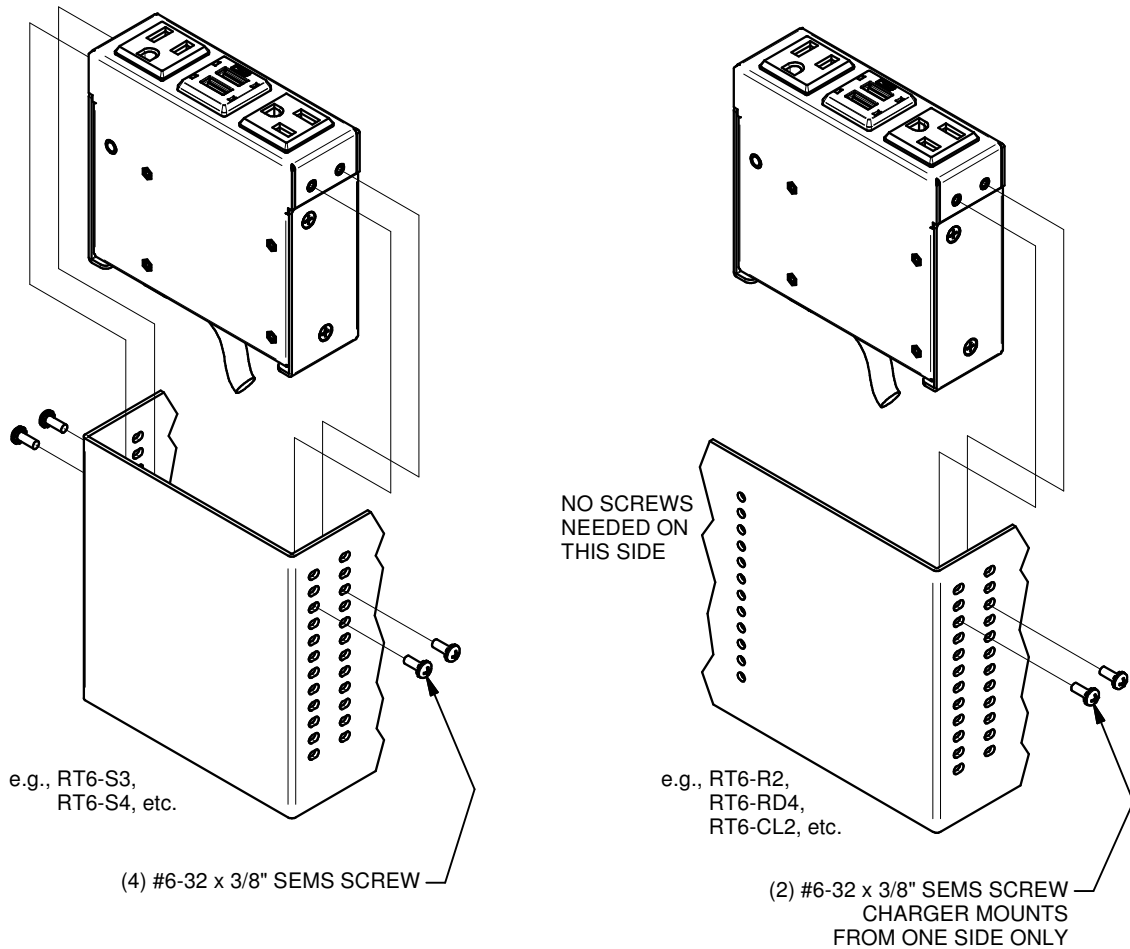

1. DETERMINE MOUNTING HEIGHT AND INSTALL UNIT(S) INTO CHASSIS. UNIT(S) MAY BE INSTALLED FROM TOP OR BOTTOM.
2. GROUND BONDING OF HOUSING IS ACHIEVED BY MOUNTING SCREWS. BE SURE TO INSTALL SPECIFIED HARDWARE AND TIGHTEN TO SPEC.