

Manual Supplement

Manual Title:	Power Log PC Application Software	Supplement Issue:	1
Part Numbers:	---	Part Number:	4822 872 30880
Print Date:	September 2012	Issue Date:	September 5, 2012
Revision/Date:	September 2012	Page Count:	4

This supplement contains information about release V3.3 of the PowerLog PC Application software.

Connecting to a Power Quality Instrument

V3.3 Compatible Instruments:


✓	434-II, 435-II, 437-II firmware V03.05 or later *)
✓	434, 435
✓	1710
✓	345
✓	1735

*) V3.3 is compatible with Fluke 430-II firmware V03.05 for downloading via USB.


V3.3 is compatible with Fluke 430-II firmware V03.00 and later for reading measurement data from SD Card directly.

Fluke 430-II:


①



②




③

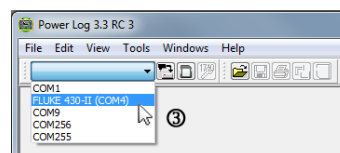


Downloading Logged Data to a PC:

USB:



①

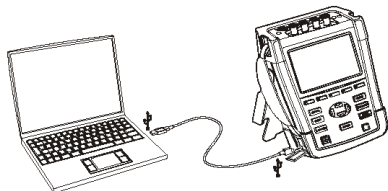


②

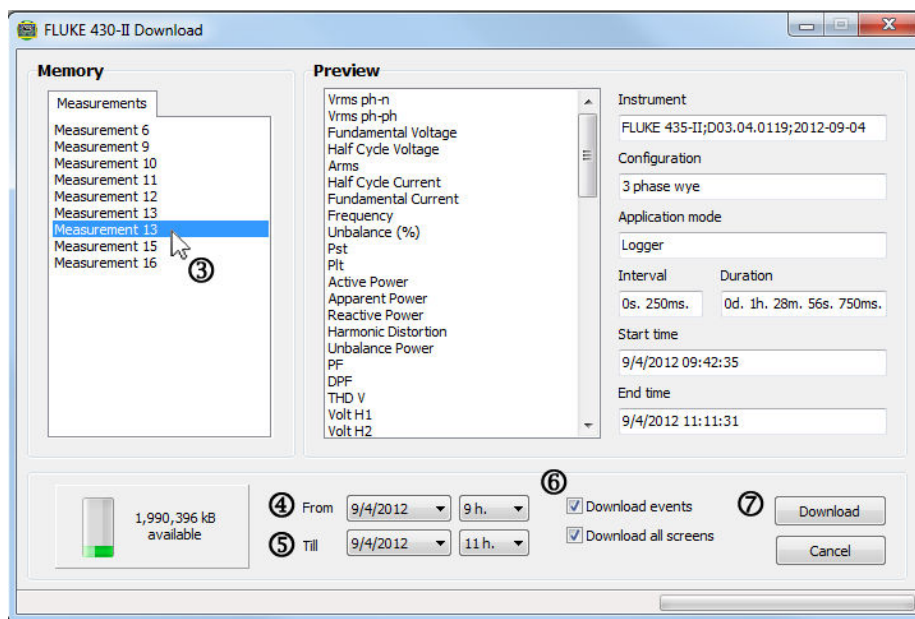

③ + ④ + ⑤ + ⑥ + ⑦

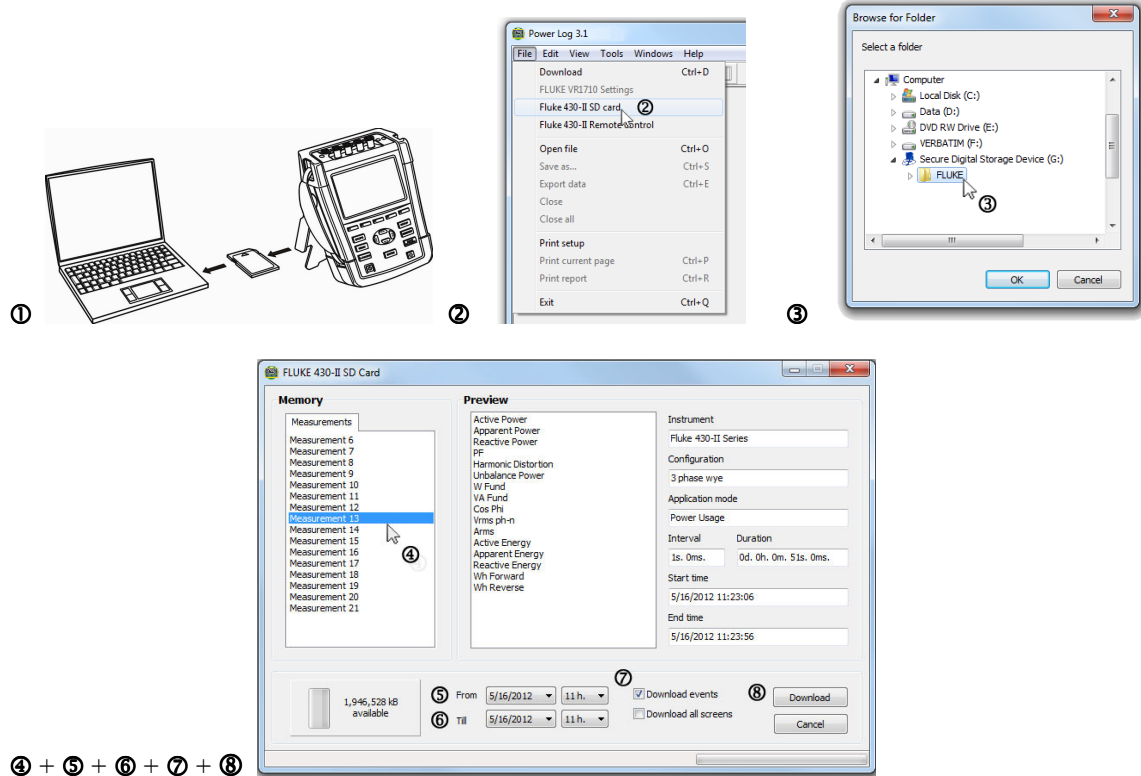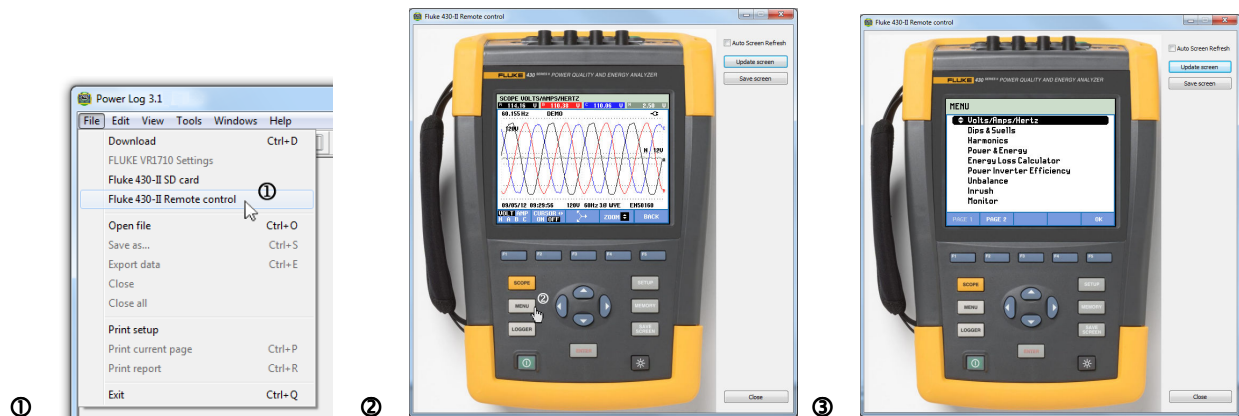
New SD-CARD:**New Remote Control Fluke 430-II:**

New Statistics

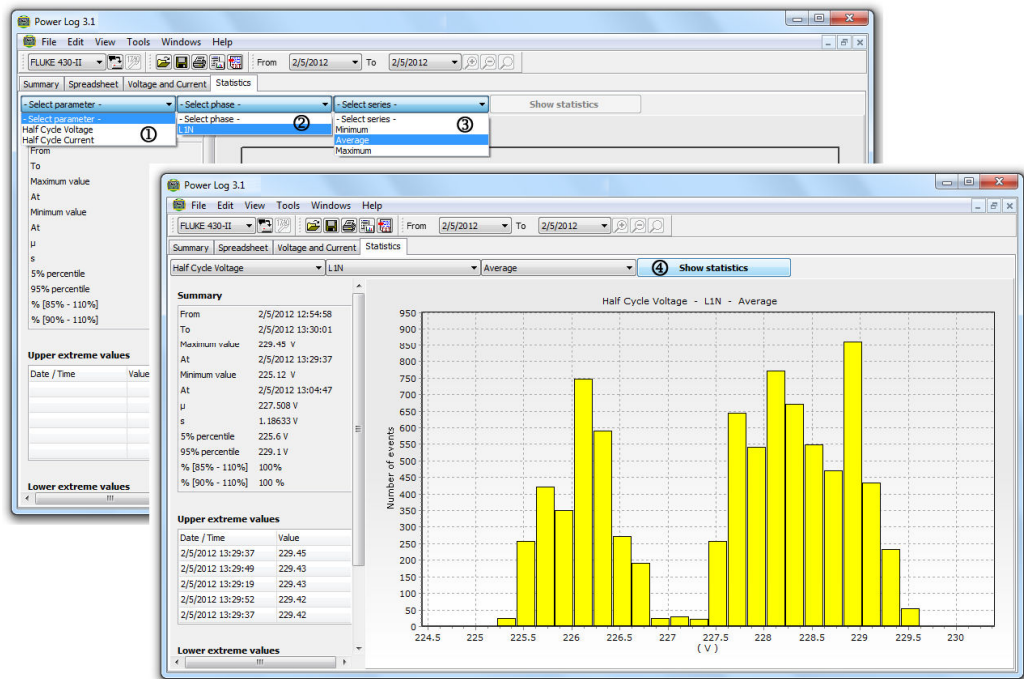


① ② ③ ④

New Dips and Swells

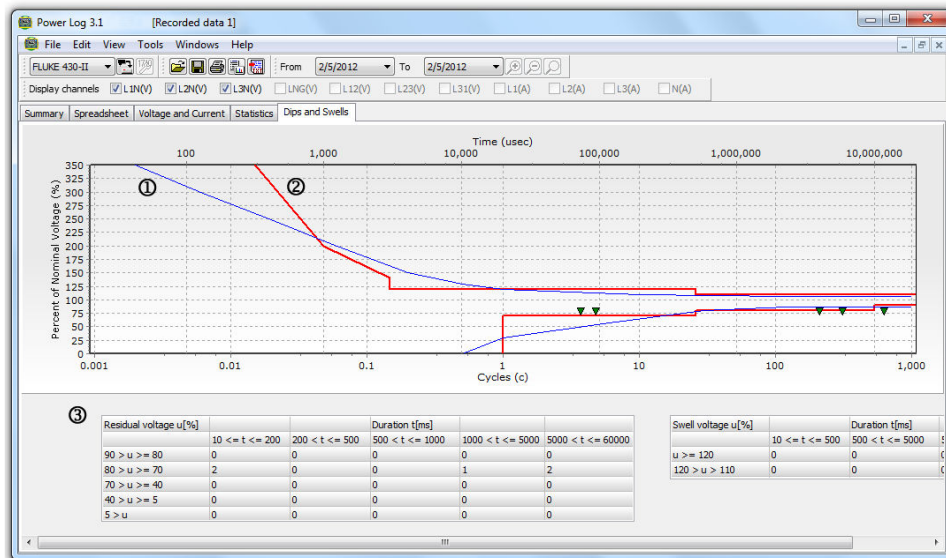


- ① CEBEMA curve plot
- ② ITIC curve plot
- ③ EN50160 2009 Dips and Swells classification table

New Events

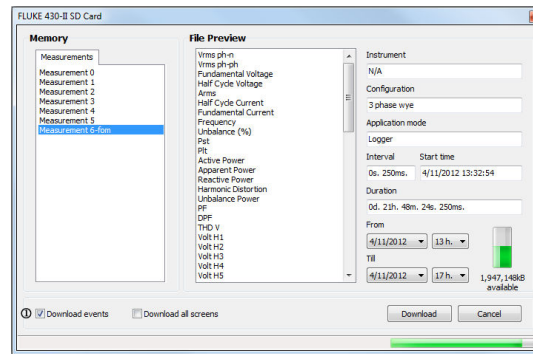

① Include event data with Download

One second of waveform data for each event

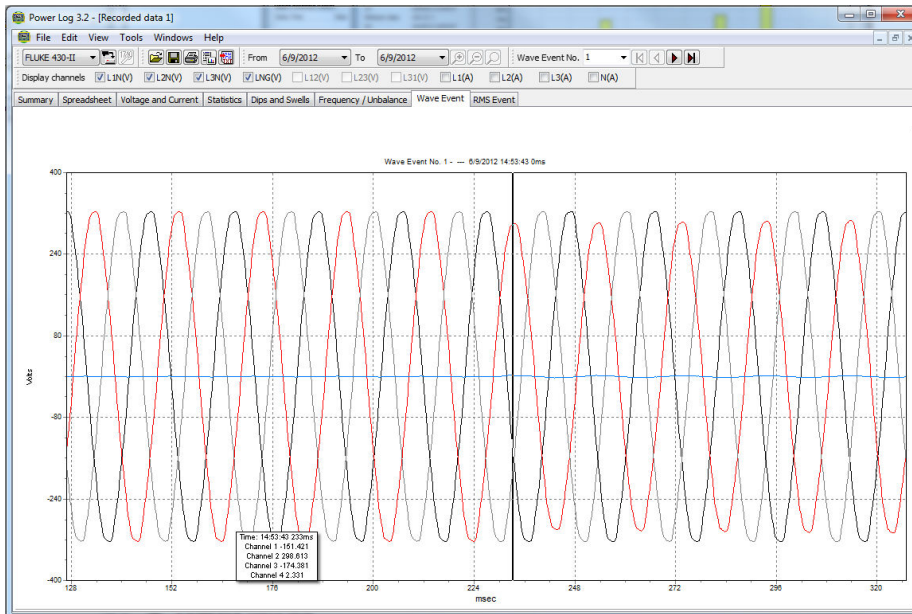

Seven seconds of $\frac{1}{2}$ cycle rms data for each event

