

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

3-349-932-03
6/3.19

- Measurement in **AC/DC systems**
- Measurement of **internal system resistance and fault loop resistance** with high test current up to 690 V AC / 800 V DC without tripping RCD types A and B
- **Low-resistance measurement** for protective and equipotential bonding conductors with 200 mA, automatic polarity reversal and 25 A
- **Testing of RCD** types A, AC, F, B, B+, EV, MI and G/R, SRCDS and PRCDs
- **Combined RCD test** with continuously rising ramp, time to trip, tripping current
- **Insulation measurement** up to 1000 V with rising ramp
- Testing of **RCMs** and **IMDs**
- Measurement of **leakage and differential current**
- Measurement of **temperature and humidity**
- **Testing for dielectric strength 2.5 kV AC, 500 VA** with **PROFITEST PRIME AC** standard sequence, ramp function and pulse control mode
- **PROFITEST PRIME AC:** work safety concept for inspector per DIN EN 50191 and EN 61557-14 with indicator lamp, emergency stop switch and key switch
- **Mains and battery operation** (with limited functionality)
- Bluetooth (i. a. for connecting a keyboard) and USB interfaces
- **Push-print function** – transmission of measured value after measurement



CAT IV



CE



Applications

The **PROFITEST PRIME** is the first all-in-one test Instrument for electrical equipment in AC and DC systems for testing the effectiveness of protective measures and more.

- Machinery manufacturing
- Switchgear fabrication
- Industrial systems up to 690 V
- Wind power turbines up to 690 V
- E-mobility – charging infrastructure, AC/DC systems
- IT networks up to 690 V
- Insulation monitors up to 690 V
- High voltage / insulation measurement up to 100 GΩ

Features

Display with Selectable Language

The LCD panel consists of a backlit dot matrix at which menus, setting options, measurement results, tables, instructions and error messages, as well schematic diagrams appear.

The display can be set to the desired language depending on the country in which the test instrument is used.

Operation

Device functions are selected directly with the help of a rotary selector switch. Softkeys allow for convenient selection of sub-functions and parameter settings. Unavailable functions and parameters are automatically prevented from appearing at the display.

Schematic diagrams, measuring ranges and help texts can be displayed for all basic functions and sub-functions.

Error Indication

- The instrument automatically detects instrument-to-system **connection errors**, which are indicated in a connection pictograph.
- **Errors within the electrical system** (no mains or phase voltage, tripped RCD) are indicated at 4 LEDs and by means of pop-up windows at the display.

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Battery Monitoring and Self-Test

Battery monitoring is conducted while the instrument is subjected to an electrical load. Results are displayed both numerically and with a symbol. Test images can be called up one after the other, and LEDs can be tested during the self-test. The tester is shut down automatically when the batteries are depleted.

RS 232 Port

Barcode scanners or temperature/humidity sensors can be connected to the RS 232 port.

USB and Bluetooth Communication Interfaces

Measurement data are transmitted to a PC via the integrated interfaces, at which they can be printed in report form and archived.

User PC Software

This software offers a wide variety of support options for data acquisition and management.

- Amongst other things, the software acquires all important data for reports per IEC 60364-6/DIN VDE 0100, part 600.
- Test reports (ZVEH) can be generated automatically.
- Distribution structures with electrical circuit and RCD data can be individually defined.
- Created structures can be saved to memory and loaded to the test instrument as required via the USB port.

Software Update

The test instrument can always be kept current thanks to firmware which can be updated via the USB port. Software is updated during the course of recalibration by our service department, or directly by the customer.

Optional Remote Control

The active Z506T (4 m) or Z506U (12 m) probes makes it possible to control the test instrument over considerable distances.

The probe is equipped with **Start-Stop / I_N / Save-Send** and measuring point illumination keys. Integrated LEDs indicate the current status of the measurement and permit limit value evaluation.

| PROFITEST... (article number) | PRIME (M506A) | PRIME AC (M506C) |
|---|------------------|---------------------|
| Voltage and Frequency Measurement up to 1 kV | | |
| In single-phase AC/DC systems | X | X |
| In 3-phase systems (UL1-L3, UL1-L2, UL2-L3) | X | X |
| Phase sequence testing | X | X |
| Measurement of Protective Conductor Resistance RLO | | |
| With 0.2 A measuring current: constant/ramp, polarity and test time can be selected | X | X |
| With 25 A measuring current | X | X |
| Measurement of Insulation Resistance RINS | | |
| With constant DC test voltage (50 ... 1000 V) | X | X |
| With DC ramp function | X | X |
| Testing of Residual Current Devices | | |
| General and selective including RCD, SRCD, PRCD, G/R and RCBO variants | X | X |
| Testing of AC/DC sensitive RCDs, types B, B+ and EV | X | X |
| Measurement of fault voltage without tripping the RCD | X | X |
| Tripping current measurement with ramp function | X | X |
| Measurement of time to trip | X | X |

| PROFITEST... (article number) | PRIME (M506A) | PRIME AC (M506C) |
|---|------------------|---------------------|
| Simultaneous measurement of tripping current and time to trip with "intelligent ramp" | X | X |
| Loop Impedance Measurement | | |
| Measurement with full-wave, test current: 10 A AC/DC | X | X |
| Measurement in 690 V systems | X | X |
| Measurement in DC systems | X | X |
| Without tripping the RCD (type AC, A) by means of "DC saturation process" | X | X |
| Combined process without tripping the RCD: "impedance Z + R" | X | X |
| Without tripping the RCD: 15 mA process | X | X |
| Display of permissible fuse types in a table | X | X |
| Residual Voltage Test | | |
| Testing of Insulation Monitoring Devices (IMDs) | | |
| Testing of Residual Current Monitoring Devices (RCMs) | | |
| Leakage Current Measurement (direct) | | |
| Current Measurement (with optional current clamp sensor) | | |
| Measurement of Temperature and Atmospheric Humidity | | |
| Voltage Drop Measurement ΔU | | |
| Documentation of Charging Station Tests | | |
| Documentation of Fault Simulations at PRCDs with the Profitest/PRCD Adapter | | |
| HV AC Testing for Dielectric Strength 2.5 kV / 200 mA | | |
| With test voltage AC constant | — | X |
| Breakdown voltage measurement with ramp function | — | X |
| Defect location with pulse control mode | — | X |
| Features | | |
| Automatic test sequence function | X | X |
| Selectable menu language: D, GB, F, NL, I, E, CZ, NO | X | X |
| Push-print function (storage or transmission via Bluetooth) | X | X |
| Database (max. 30,000 objects can be saved) | X | X |
| Operation via optional control probe: (Start/I _N /Save/Light) | 0 | 0 |
| RS 232 port for RFID/barcode reader | X | X |
| Interface for data transmission via Bluetooth® | X | X |
| Interface for data transmission via USB | X | X |
| IZYTRONIQ BUSINESS Starter database and report software for PC | X | X |
| Measuring category for basic measuring functions: 600 V CAT III / 300 V CAT IV | X | X |
| HV AC terminals: 2.5 kV / 200 mA | — | X |
| DAkkS calibration certificate | X | X |

X: included

0: available as option

—: not available

PROFITEST PRIME, PRIME AC


Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Sample Displays


PROFITEST PRIME Test Instruments

Softkeys allow for convenient selection of sub-functions and parameter settings. Unavailable sub-functions and parameters are automatically prevented from appearing at the display.


RCD Measurement Display

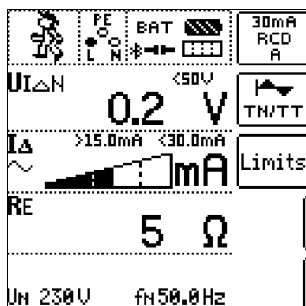


Loop Resistance Display

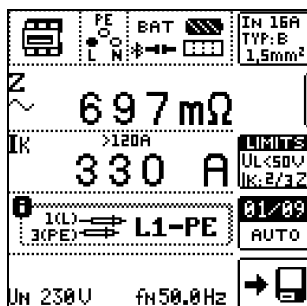


Low-Resistance Display, 0.2 A

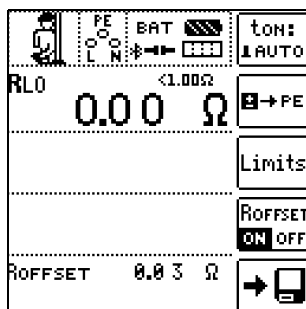


Low-Resistance Display, 25 A

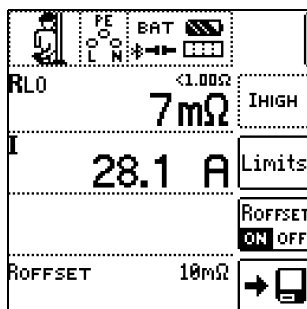


Insulation Measurement Display

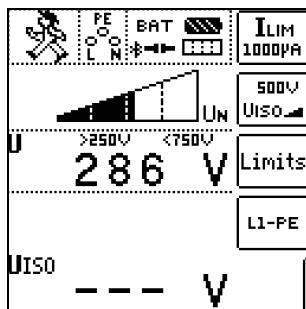


Voltage Measurement Display

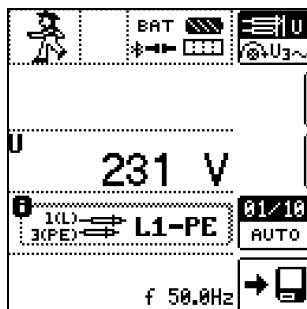

IMD Test Display

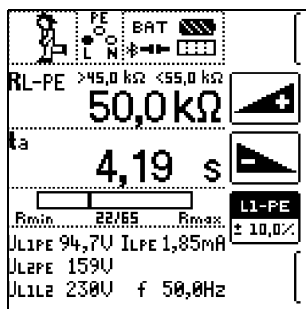

Residual Voltage Display

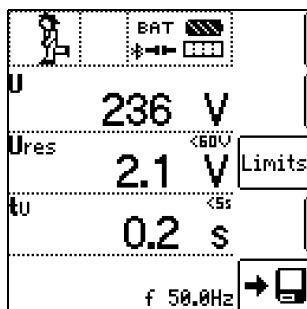

Applicable Regulations and Standards

| | |
|---|--|
| IEC 61010 DIN EN 61010 VDE 0411 | Safety requirements for electrical equipment for measurement, control and laboratory use Part 1: General requirements (IEC 61010-1:2010 + Cor.:2011) Part 2-030: Particular requirements for testing and measuring circuits Part 031: Safety requirements for hand-held probe assemblies for electrical measurement and test Part 2-032: Particular requirements for hand-held and hand-manipulated current sensors for electrical test and measurement |
| IEC 61557 DIN EN 61557 VDE 0413 | Electrical safety in low voltage distribution systems up to 1000 V AC and 1500 V DC – Equipment for testing, measuring or monitoring of protective measures Part 1: General requirements (IEC 61557-1:2007) Part 2: Insulation resistance (IEC 61557-2:2007) Part 3: Loop impedance (IEC 61557-3:2007) Part 4: Resistance of earth connection and equipotential bonding (IEC 61557-4:2007) Part 6: Effectiveness of residual current devices (RCD) in TT, TN and IT systems (IEC 61557-6:2007) Part 7: Phase sequence (IEC 61557-7:2007) Part 10: Electrical safety in low voltage distribution systems up to 1000 V AC and 1500 V DC – Equipment for testing, measuring or monitoring of protective measures (IEC 61557-10:2000) Part 14: Equipment for testing the safety of electrical equipment of machinery |
| DIN EN 61326 VDE 0843-20 | Electrical equipment for measurement, control and laboratory use – EMC requirements Part 1: General requirements Part 2-2: Particular requirements – Test configurations, operational conditions and performance criteria for portable test, measuring and monitoring equipment used in low-voltage distribution systems |
| IEC 60364-6 VDE 0100-600 | Low-voltage electrical installations – Part 6: Tests |
| EN 50110-1 VDE 0105-100 | Operation of electrical installations – Part 100: General requirements |
| IEC 60364-7-710 VDE 0100-710 | Low-voltage electrical installations – Requirements for special installations or locations – Part 710: Medical locations |
| IEC 61439-1 DIN EN 61439-1 VDE 0660-600-1 | Low-voltage switchgear and controlgear assemblies Part 1: General rules |
| IEC 60204-1 DIN EN 60204-1 VDE 0113-1 | Safety of machinery – Electrical equipment of machines Part 1: General requirements |
| DIN EN 60060-1, HD 588.1 VDE 0432-1 | High-voltage test techniques Part 1: General definitions and test requirements |
| DIN VDE 0472 | Testing of cables, wires and flexible cords |

PROFITEST PRIME, PRIME AC



Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Characteristic Values

| Function | Measured Quantity | Display range | Resolution | Input Impedance / Test Current | Measuring Range | Nominal Values | Measuring Uncertainty | Intrinsic Uncertainty | Connections | | | | | |
|------------------------------|---|--|---|---|---|--|---|--|-------------|------|-------|-------|--------------|--------------|
| | | | | | | | | | 1(L) | 2(N) | 3(PE) | Clamp | Other | |
| U | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | 5 MΩ | 2.0 ... 99.9 V _{RMS} 100 ... 999 V _{RMS} | | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | ● | | ● | | | |
| | U _{3~} | 0.0 ... 99.9 V 100 ... 999V | 0.1 V 1 V | | 2.0 ... 99.9 V _{RMS} 100 ... 999 V _{RMS} | | ±(3% rdg.+5d) ±(3% rdg. + 1 d) | ±(2% rdg.+5d) ±(2% rdg.+1d) | ● | ● | ● | | | |
| | f | DC; 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1Hz 1Hz | | DC, 15.4 ... 420 Hz | | ±(0.2%rdg.+1d) | ±(0.1%rdg.+1d) | ● | | ● | | | |
| RLO 0.2 A | RLO | 0.00 ... 9.99 Ω 10.0 ... 99.9 Ω 100 ... 199 Ω | 0.01 Ω 0.1 Ω 1 Ω | I ≥ 200 mA DC I < 260 mA DC | 0.10 ... 5.99 Ω 6.00 ... 99.9 Ω | U _q = 4.5 V | ±(4% rdg. + 2d) | ±(2% rdg. + 2d) | ● | | ● | | PRCD adapter | |
| | ROFFSET | 0.00 ... 9.99 Ω | 0.01 Ω | I ≥ 200 mA DC I < 260 mA DC | 0.10 ... 5.99 Ω 6.00 ... 9.99 Ω | | | | | | | | | |
| RLO 25 A | RLO | 1 m ... 999 mΩ 1.00 ... 9.99 Ω 10.0 ... 20.0 Ω | 1 mΩ 0.01 Ω 0.1 Ω | I ≥ 25 A AC ¹ I < 25 A AC ¹ | 10 mΩ ... 50 mΩ 51 mΩ ... 20.0 Ω | U _q < 8.8 V AC | ±(4% rdg. + 2d) | ±(2% rdg. + 2d) | ● | | ● | | | |
| | ROFFSET | 1 m ... 999 mΩ | 1 mΩ | I ≥ 25 A AC ¹ | 10 mΩ ... 50 mΩ 51 mΩ ... 999 mΩ | | | | | | | | | |
| RINS | RINS | 1 ... 999 kΩ 1.00 ... 9.99 MΩ 10.0 ... 49.9 MΩ | 1 kΩ 0.01 MΩ 0.1 MΩ | I _K < 1.6 mA (for U _{INS} = 15 V ... 1.00 kV) | 50 ... 999 kΩ 1.00 ... 49.9 MΩ | U _N = 50 V I _N = 1 mA | ±(5% rdg.+10d) ±(5% rdg. + 2d) | ±(3% rdg.+10d) ±(3% rdg.+1d) | ● | | ● | | | |
| | | 1 ... 999 kΩ 1.00 ... 9.99 MΩ 10.0 ... 99.9 MΩ | 1 kΩ 0.01 MΩ 0.1 MΩ | | 50 ... 999 kΩ 1.00 ... 99.9 MΩ | U _N = 100 V I _N = 1 mA | ±(5% rdg.+10d) ±(5% rdg. + 2d) | ±(3% rdg.+10d) ±(3% rdg.+1d) | | | | | | |
| | | 1 ... 999 kΩ 1.00 ... 9.99 MΩ 10.0 ... 99.9 MΩ 100 ... 200 MΩ | 1 kΩ 0.01 MΩ 0.1 MΩ 1 MΩ | | 50 ... 999 kΩ 1.00 ... 200 MΩ | U _N = 250 V I _N = 1 mA | ±(5% rdg.+10d) ±(5% rdg. + 2d) | ±(3% rdg.+10d) ±(3% rdg.+1d) | | | | | | |
| | | 1 ... 999 kΩ 1.00 ... 9.99 MΩ 10.0 ... 99.9 MΩ 100 ... 999 MΩ 1.00 ... 1.20 GΩ | 1 kΩ 0.01 MΩ 0.1 MΩ 1 MΩ 0.01 GΩ | | 50 ... 999 kΩ 1.00 ... 499 MΩ 500 MΩ ... 1.20 GΩ | U _N = 325 V U _N = 500 V U _N = 1000 V I _N = 1 mA | ±(5% rdg.+10d) ±(5% rdg. + 2d) ±(10% rdg. + 2d) | ±(3% rdg.+10d) ±(3% rdg.+1d) ±(6% rdg.+1d) | | | | | | |
| | U U _{INS} | 10 ... 999 V- 1.00 ... 1.19kV | 1 V 0.01 kV | 25 V ... 1.19 kV | U _N = 50, 100, 250, 325, 500, 1000 V DC | ±(3% rdg. + 1d) | ±(1.5% rdg. + 1d) | | | | | | | |
| RINS | U U _{INS} | 10 ... 999 V- 1.00 ... 1.19kV | 1 V 0.01 kV | I _K < 1.6 mA | 25 V ... 1.19 kV | U _N = 50, 100, 250, 325, 500, 1000 V | ±(3% rdg. + 1d) | ±(1.5% rdg. + 1d) | ● | | ● | | | |
| RCD IF | U _{ΔN} | 0.0 ... 70.0V | 0.1 V | 0.33 · I _{ΔN} I _{ΔN} = 10 mA ... 1000 mA | 5.0 ... 70.0V | | + (1% rdg. + 1d) ... + (10% rdg.+1d) | + (1% rdg.+1d) ... + (9% rdg.+1d) | | | | | | |
| | R _E | 10 ... 999 Ω 1.00 ... 6.51 kΩ | 1 Ω 0.01 kΩ | I _{ΔN} = 10 mA · 1.05 | Value calculated from R _E = U _{ΔN} / I _{ΔN} | U _{ΔN} = 25, 50, 65 V | | | | ● | ● | 2 | ● | PRCD adapter |
| | | 3 ... 999 Ω 1.00 ... 2.17 kΩ | 1 Ω 0.01 kΩ | I _{ΔN} = 30 mA · 1.05 | | | | | | | | | | |
| | | 1 ... 651 Ω | 1Ω | I _{ΔN} = 100 mA · 1.05 | | | | | | | | | | |
| | | 0.3 ... 99.9 Ω 100 ... 217 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 300 mA · 1.05 | | | | | | | | | | |
| | | 0.2 ... 9.9 Ω 10 ... 130 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 500 mA · 1.05 | | | | | | | | | | |
| 0.2 ... 9.9 Ω 10 ... 65 Ω | 0.1 Ω 1 Ω | I _{ΔN} =1000 mA·1.05 | | | | | | | | | | | | |
| I _Δ | 3.0 ... 99.9mA 100 ... 999mA 1.00 ... 2.50A | 0.1 mA 1 mA 0.01 A | (0.3 ... 1.3) x I _{ΔN} (0.3 ... 1.4) x I _{ΔN} (0.2 ... 2.5) x I _{ΔN} I _{ΔN} = 10 mA ... 1000 mA | 3.0 mA ... 2.50 A | U _N = 120/230/400 V f _N = 16.7/50/60/ 200/400 Hz | ±(5% rdg.+3d) | ±(3.5% rdg. + 2 d) | | | | | | | |
| U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | 5 MΩ | 2.0 ... 99.9V 100 ... 440 V | I _{ΔN} = 10/30/100/ 300/500/1000 mA | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | | | | | | | |
| f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1Hz 1Hz | | 15.4 ... 420 Hz | | ±(0.2% rdg.+1d) | ±(0.1% rdg.+1d) | | | | | | | |




PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

| Function | Measured Quantity | Display range | Resolution | Input Impedance / Test Current | Measuring Range | Nominal Values | Measuring Uncertainty | Intrinsic Uncertainty | Connections | | | | | | | |
|---|---|---|---|---|---|--|---|--|--|--------------------------------|-------|----------------|-------|-----------------|--|--|
| | | | | | | | | | 1(L) | 2(N) | 3(PE) | Clamp | Other | | | |
| RCD I _{ΔN} | U _{IΔN} | 0.0 ... 70.0V | 0.1 V | 0.33 · I _{ΔN} I _{ΔN} = 10 mA ... 1000 mA | 5.0 ... 70.0V | U _{IΔN} = 25, 50, 65 V | +1% rdg. + 1 d ... +10% rdg. + 1 d | +(1% rdg.+1d) ... +(9% rdg.+1d) | ● | ● ² | ● | | | PRCD adapter | | |
| | R _E | 10 ... 999 Ω 1.00 ... 6.51 kΩ | 1 Ω 0.01 kΩ | I _{ΔN} = 10 mA · 1.05 | Value calculated from R _E = U _{IΔN} / I _{ΔN} | | U _{IΔN} = 25, 50, 65 V | | | | ● | ● ² | ● | | | |
| | | 3 ... 999 Ω 1.00 ... 2.17 kΩ | 1 Ω 0.01 kΩ | I _{ΔN} = 30 mA · 1.05 | | | | | | | | | | | | |
| | | 1 ... 651 Ω | 1 Ω | I _{ΔN} = 100 mA · 1.05 | | | | | | | | | | | | |
| | | 0.3 ... 99.9 Ω 100 ... 217 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 300 mA · 1.05 | | | | | | | | | | | | |
| | | 0.2 ... 9.9 Ω 10 ... 130 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 500 mA · 1.05 | | | | | | | | | | | | |
| | | 0.2 ... 9.9 Ω 10 ... 65 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 1000 mA · 1.05 | | | | | | | | | | | | |
| | I _T | | | 0.5x: 0.95 · 0.5 · I _{ΔN} 1x: 1.05 · I _{ΔN} 1.4x: 1.47 · I _{ΔN} 2x: 2.1 · I _{ΔN} 5x: 5.25 · I _{ΔN} | | | U _N = 120/230/400 V f _N = 16.7/50/60/ 200/400 Hz | (0.5·I _{ΔN}) -10% ... +0% | (0.95·0.5·I _{ΔN}) ±3.5% | | | | | | | |
| t _a | 0 ... 999 ms | 1 ms | 0.5x, 1x, 2x, 5x 0.5x, 1x 5 1x | 0 ... 999 ms | | ±4 ms | ±3 ms | | | | | | | | | |
| U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | 2.0 ... 99.9V 100 ... 440 V | I _{ΔN} = 10/30/100/ 300/500/1000 mA | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | | | | | | | | | |
| f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | I _{ΔN} = 10 mA ... 1000 mA | 15.4 ... 420 Hz | | ±(0.2%rdg.+1d) | ±(0.1% rdg.+1d) | | | | | | | | | |
| RCD I _F + I _{ΔN} | U _{IΔN} | 0.0 ... 70.0V | 0.1 V | 0.33 · I _{ΔN} I _{ΔN} = 10 mA ... 1000 mA | 5.0 ... 70.0V | U _{IΔN} = 25, 50, 65 V | +1% rdg. + 1 d ... +10% rdg.+1d) | +(1% rdg.+1d) ... +(9% rdg.+1d) | ● | | ● | | | PRCD adapter | | |
| | R _E | 10 ... 999 Ω 1.00 ... 6.51 kΩ | 1 Ω 10 Ω | I _{ΔN} = 10 mA · 1.05 | Value calculated from R _E = U _{IΔN} / I _{ΔN} | | U _{IΔN} = 25, 50, 65 V | | | | ● | | ● | | | |
| | | 3 ... 999 Ω 1.00 ... 2.17 kΩ | 1 Ω 0.01 kΩ | I _{ΔN} = 30 mA · 1.05 | | | | | | | | | | | | |
| | | 1 ... 651 Ω | 1 Ω | I _{ΔN} = 100 mA · 1.05 | | | | | | | | | | | | |
| | | 0.3 ... 99.9 Ω 100 ... 217 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 300 mA · 1.05 | | | | | | | | | | | | |
| | | 0.2 ... 9.9 Ω 10 ... 130 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 500 mA · 1.05 | | | | | | | | | | | | |
| | | 0.2 ... 9.9 Ω 10 ... 65 Ω | 0.1 Ω 1 Ω | I _{ΔN} = 1000 mA · 1.05 | | | | | | | | | | | | |
| | t _a | 0 ... 999 ms | 1 ms | | 0 ... 999 ms | | U _N = 120/230/400 V f _N = 16.7/50/60/ 200/400 Hz | ±4 ms | ±3 ms | | | | | | | |
| I _Δ | 3.0 ... 99.9mA 100 ... 999mA 1.00 ... 1.30A | 0.1 mA 1 mA 0.01 A | (0.3 ... 1.3) x I _{ΔN} | 3.0 mA ... 1.30 A | | ±(5% rdg.+3d) | ±(3.5% rdg.+2d) | | | | | | | | | |
| U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | I _{ΔN} = 10 mA ... 1000 mA | 2.0 ... 99.9V 100 ... 440 V | I _{ΔN} = 10/30/100/ 300/500/1000 mA AC | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | | | | | | | | | |
| f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 420 Hz | | ±(0.2%rdg.+1d) | ±(0.1% rdg.+1d) | | | | | | | | | |
| ZLOOP AC/DC  | Z | 0 ... 999 mΩ 1.00 ... 9.99 Ω | 1 mΩ 0.01 Ω | ≥ 10 A AC/DC for U=120V (-0%) U=230V (-0%) U=400V (-0%) U=690V (-0%) U=850V DC (-0%) | 50 ... 999 mΩ 1.00 ... 5.00 Ω ³ | U _N = 120/230 V 400/690 V AC U _N = 850 V DC f _N = DC/16.7/50/ 60/200/400 Hz | ±(10% rdg.+10d) ±(6% rdg. +4 d) | ±(5% rdg.+10d) ±(3% rdg.+3d) | ● | | ● | | | | | |
| | I _k | 0.0 ... 9.9A 10 ... 999A 1.00 ... 9.99kA 10.0 ... 50.0kA | 0.1 A 1 A 0.01 kA 0.1 kA | | Value calculated from I _k = U/Z | | | Value calculated from I _k = U/Z | Value calculated from I _k = U/Z | | | | | | | |
| | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | | | 2.0 ... 99.9V 100 ... 725 V AC 100 ... 850 V DC | | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | | | | | | |
| | f | DC; 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | | | DC; 15.4...420 Hz | | ±(0.2%rdg.+1d) | ±(0.1% rdg.+1d) | | | | | | |
| ZLOOP DC+  | Z | 0 ... 999 mΩ 1.00 ... 9.99 Ω 10.0 ... 29.9 Ω | 1 mΩ 0.01 Ω 0.1 Ω | ≥ 10 A AC for U=120V (-0%) U=230V (-0%) U=400V (-0%) and 0.5 A DC (DC-L) 2.5 A DC (DC-H) | 250 ... 999 mΩ 1.00 ... 5.00 Ω | U _N = 120/230 V 400 V f _N = 16.7/ 50/ 60/ 200/ 400 Hz | ±(18%rdg.+30d) ±(10% rdg.+5 d) | ±(6% rdg.+50d) ±(6% rdg.+5 d) | ● | ● | ● | | | | | |
| | I _k | 0.0 ... 9.9A 10 ... 999A 1.00 ... 9.99kA 10.0 ... 50.0kA | 0.1 A 1 A 0.01 kA 0.1 kA | | Value calculated from I _k = U/Z | | | Value calculated from I _k = U/Z | Value calculated from I _k = U/Z | | | | | | | |
| | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | | | 2.0 ... 99.9V 100 ... 440 V | | ±(2% rdg.+5d) ±(2% rdg. + 1 d) | ±(1% rdg.+5d) ±(1% rdg.+1d) | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | | | 15.4 ... 420 Hz | | ±(0.2%rdg.+1d) | ±(0.1% rdg. +1d) | | | | | | |




PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

| Function | Measured Quantity | Display range | Resolution | Input Impedance / Test Current | Measuring Range | Nominal Values | Measuring Uncertainty | Intrinsic Uncertainty | Connections | | | | | |
|---|-------------------------------|---|--|--|--|---|--|--|-------------|------|-------|-------|-------------------------|--|
| | | | | | | | | | 1(L) | 2(N) | 3(PE) | Clamp | Other | |
| ZLOOP Z+RLO  | Z | 0.00 ... 9.99 Ω 10.0 ... 99.9 Ω | 0.01 Ω 0.1 Ω | $I_{LN} \geq 10 \text{ A AC}$ for $U=120V(-0\%)$ $U=230V(-0\%)$ $U=400V(-0\%)$ $I_{NPE} = I_{\Delta N}/2$ | 0.50 ... 9.99 Ω 10.0 ... 99.9 Ω | $U_N = 120/230 \text{ V}$ 400 V $f_N = 16.7/50/60/200/400 \text{ Hz}$ | $\pm(10\% \text{ rdg.} + 10 \text{ d})$ $\pm(8\% \text{ rdg.} + 2 \text{ d})$ | $\pm(4\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | Ik | 0.0 ... 9.9A 10 ... 999A 1.00 ... 9.99kA 10.0 ... 50.0kA | 0.1 A 1 A 0.01 kA 0.1 kA | | Value calculated from $I_k = U/Z$ | | Value calculated from $I_k = U/Z$ | Value calculated from $I_k = U/Z$ | | | | | | |
| | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | 2.0 ... 99.9V 100 ... 440 V | | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(1\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 99.9 Hz 100 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| ZLOOP  | Z | 0.6 ... 99.9 Ω 100 ... 999 Ω | 0.1 Ω 1 Ω | $I_{\Delta N}/2$ | 10.0 ... 99.9 Ω 100 ... 999 Ω | $U_N = 120/230 \text{ V}$ 400 V $f_N = 16.7/50/60/200/400 \text{ Hz}$ | $\pm(10\% \text{ rdg.} + 10 \text{ d})$ $\pm(8\% \text{ rdg.} + 2 \text{ d})$ | $\pm(2\% \text{ rdg.} + 2 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | Ik | 0.10 ... 9.99A 10.0 ... 99.9A 100 ... 999A | 0.01 A 0.1 A 1 A | | Value calculated from $I_k = U/Z$ | | Value calculated from $I_k = U/Z$ | Value calculated from $I_k = U/Z$ | | | | | | |
| | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | 2.0 ... 99.9V 100 ... 440 V | | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(1\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| Ures | U, Ures | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | 5 MΩ | 2.0 ... 99.9V 100 ... 999 V | DC; 15.4 ... 99.9 Hz 100 ... 420 Hz | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(1\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | DC; 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 100 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | t _U | 0.0 ... 99.9 s | 0.1 sec. | | 0.4 ... 99.9 s | | $\pm(2\% \text{ rdg.} + 2 \text{ d})$ | $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| IMD | RL-PE ⁶ | 15.0 ... 99.9 kΩ 100 ... 574 kΩ 2.50 MΩ | 0.1 kΩ 1 kΩ 0.01 MΩ | | 15.0 ... 199 kΩ 200 ... 574 kΩ 2.50 MΩ | $U_{N-IT} = 120/230 \text{ V}$ 400/690 V $f_N = 16.7/50/60/200/400 \text{ Hz}$ | $\pm 7\%$ $\pm 17\%$ $\pm 3\%$ | $\pm 5\%$ $\pm 15\%$ $\pm 2\%$ | | | | | | |
| | ta | 0.00 ... 9.99 s 10.0 ... 99.9 s | 0.01 sec. 0.1 sec. | | 0.00 ... 9.99 s 10.0 ... 99.9 s | | $\pm(2\% \text{ rdg.} + 2 \text{ d})$ | $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | UL1PE, UL2PE, UL1L2 | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | 2.0 ... 99.9V 100 ... 690 V | | $\pm(3\% \text{ rdg.} + 5 \text{ d})$ $\pm(3\% \text{ rdg.} + 1 \text{ d})$ | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | IL-PE | 0.00 ... 9.99mA 10.0 ... 99.9mA | 0.01 mA 0.1 mA | | 0.10 ... 9.99mA 10.0 ... 25.0mA | | $\pm(6\% \text{ rdg.} + 2 \text{ d})$ | $\pm(3.5\% \text{ rdg.} + 2 \text{ d})$ | | | | | | |
| RCM | U _{ΔN} | 0.0 ... 70.0V | 0.1 V | $0.33 \cdot I_{\Delta N}$ $I_{\Delta N} = 10 \text{ mA} \dots 1000 \text{ mA}$ | 5.0 ... 70.0V | $U_N = 120/230/400 \text{ V}$ $f_N = 16.7/ 50/60/200/400 \text{ Hz}$ $I_{\Delta N} = 10/30/100/300/500/1000 \text{ mA}$ | $\pm(1\% \text{ rdg.} + 1 \text{ d})$... $\pm(10\% \text{ rdg.} + 1 \text{ d})$ | $\pm 1\% \text{ rdg.} + 1 \text{ d}$... $\pm(9\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | RE | 10 ... 999 Ω 1.00 ... 6.51 kΩ | 1 Ω 0.01 kΩ | $I_{\Delta N} = 10 \text{ mA} \cdot 1.05$ | Value calculated from $R_E = U_{\Delta N} / I_{\Delta N}$ | | | | | | | | | |
| | | 3 ... 999 Ω 1.00 ... 2.17 kΩ | 1 Ω 0.01 kΩ | $I_{\Delta N} = 30 \text{ mA} \cdot 1.05$ | | | | | | | | | | |
| | | 1 ... 651 Ω | 1 Ω | $I_{\Delta N} = 100 \text{ mA} \cdot 1.05$ | | | | | | | | | | |
| | | 0.3 ... 99.9 Ω 100 ... 217 Ω | 0.1 Ω 1 Ω | $I_{\Delta N} = 300 \text{ mA} \cdot 1.05$ | | | | | | | | | | |
| | 0.2 ... 9.9 Ω 10 ... 130 Ω | 0.1 Ω 1 Ω | $I_{\Delta N} = 500 \text{ mA} \cdot 1.05$ | | | | | | | | | | | |
| | ta | 0.0 ... 10.0 s | 0.1 sec. | | 0.5 ... 10.0 s | | $\pm(2\% \text{ rdg.} + 2 \text{ d})$ | $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | I _Δ | 0.0 ... 99.9mA 100 ... 999mA 1.00 ... 2.50A | 0.1 mA 1 mA 0.01 A | $I_{\Delta N} = 10 \text{ mA} \dots 1000 \text{ mA}$ | 3.0 mA ... 2.50 A | | $\pm(5\% \text{ rdg.} + 3 \text{ d})$ | $\pm(3.5\% \text{ rdg.} + 2 \text{ d})$ | | | | | | |
| | UL1PE, UL2PE, UL1L2 | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | $\frac{5}{5} 0.5x, 1x$ $\frac{5}{5} 0.5x, 1x$ | 2.0 ... 99.9V 100 ... 440 V | | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(1\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 99.9 Hz 100 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| IL | IL | 1 ... 999 μA 1.00 ... 9.99mA 10.0 ... 16.0mA | 1 μA 0.01 mA 0.1 mA | $R_s = 2 \text{ k}\Omega \pm 20 \Omega$ | 15 μA ... 999 μA 1.00 mA ... 9.99 mA 10.0 mA ... 16.0 mA | | $\pm(3\% \text{ rdg.} + 4 \text{ d})$ | $\pm(2\% \text{ rdg.} + 3 \text{ d})$ | | | | | | |
| | f | 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | 15.4 ... 99.9 Hz 100 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
|  $\leq 1V \approx \frac{4}{4}$ | IL/AMP | 0.00 ... 9.99mA | 0.01 mA | 337 kΩ | 0.20 ... 9.99mA | | $\pm(15\% \text{ rdg.} + 4 \text{ d})$ | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ | | | | | PROFITEST CLIP 100mV/mA | |
| T % r.h. | ∅ | -99.9 ... 99.9 °C | 0.1 °C | | -10.0 °C ... +50.0 °C | | $\pm 2 \text{ °C}$ | $\pm 2 \text{ °C}$ | | | | | | |
| | r. h. | 0.0 ... 99.9 % | 0.1 % | | 10.0 ... 90.0 % | | $\pm 5\%$ | $\pm 5\%$ | | | | | T/H sensor | |
| EX-TRA ΔU | Z _{L-N} Zoffset | 0 ... 999 mΩ 1.00 ... 9.99 Ω | 1 mΩ 0.01 Ω | $\geq 10 \text{ A AC/DC}$ for $U=120 \text{ V}(-0\%)$ $U=230 \text{ V}(-0\%)$ $U=400 \text{ V}(-0\%)$ $U=690 \text{ V}(-0\%)$ $U=850 \text{ V DC}(-0\%)$ | 50 ... 999 mΩ 1.00 ... 5.00 Ω | $U_N = 120/230 \text{ V}$ 400/690 V AC $U_N = 850 \text{ V DC}$ $f_N = \text{DC}/16.7/50/60/200/400 \text{ Hz}$ | $\pm(10\% \text{ rdg.} + 10 \text{ d})$ $\pm(6\% \text{ rdg.} + 4 \text{ d})$ | $\pm(5\% \text{ rdg.} + 10 \text{ d})$ $\pm(3\% \text{ rdg.} + 3 \text{ d})$ | | | | | | |
| | ΔU ΔU _{offset} | 0.00 ... 9.99% | 0.01% | | Calculated value $\Delta U = (I_N \cdot Z_{LN}) / I_N \cdot 100\%$ | | Calculated value $\Delta U = (I_N \cdot Z_{LN}) / I_N \cdot 100\%$ | Calculated value $\Delta U = (I_N \cdot Z_{LN}) / I_N \cdot 100\%$ | | | | | | |
| | U | 0.0 ... 99.9V 100 ... 999 V | 0.1 V 1 V | | 2.0 ... 99.9V 100 ... 725 V AC 100 ... 850 V DC | | $\pm(2\% \text{ rdg.} + 5 \text{ d})$ $\pm(2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(1\% \text{ rdg.} + 5 \text{ d})$ $\pm(1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |
| | f | DC; 15.0 ... 99.9 Hz 100 ... 999 Hz | 0.1 Hz 1 Hz | | DC; 15.4 ... 99.9 Hz 100 ... 420 Hz | | $\pm(0.2\% \text{ rdg.} + 1 \text{ d})$ | $\pm(0.1\% \text{ rdg.} + 1 \text{ d})$ | | | | | | |

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1



- ¹ With a load of < 50 mΩ:
Auxiliary power: 230 V (-0% +10%), 50 Hz and the included 4 m probe cables. EN 61439-1 specifies a test current of > 10 A AC for protective conductor testing. The limit value is 0.1 Ω.
- ² Only required when testing with direct current
- ³ Depending on max. permissible touch voltage
- ⁴ Measuring range of the signal input at the test instrument, UE:
0 ... 1.0 V_{RMS} (0 ... 1.4 V_{Peak}) AC/DC
- ⁵ Tripping test conducted with:
 - : as specified
 - : 0.7 / 1.4 X I_{ΔN}
 - : 2 X I_{ΔN}
 Max. test current: 2.50 A. All entries are RMS values.
- ⁶ Resistance value RL-PE is a setting value, not a measured value.

Key: d = digits, rdg. = measured value (reading)

The following also applies to the PROFITEST PRIME AC (M506C).

| Function | Measured Quantity | Display range | Resolution | Input Impedance / Test current | Measuring Range | Nominal Values | Measuring Uncertainty | Intrinsic Uncertainty | Connections | | | | | |
|----------|-------------------|----------------------------------|----------------|---|----------------------------------|--------------------|------------------------------------|------------------------------------|-------------|------|-------|-------|-----------------|---|
| | | | | | | | | | 1(L) | 2(N) | 3(PE) | Clamp | Probe HV-P HV-P | |
| HV | U | 10 ... 999V 1.00 ... 2.55 kV | 1 V 10 V | Impedance to earth: ≥ 1 MΩ (typ. ~ 15 MΩ) | 200 ... 999V 1.00 ... 2.55 kV | 1.0/1.5/2.0/2.5 kV | ±(5% rdg.+5 d) ±(5% rdg.+5 d) | ±(2.5% rdg.+5d) ±(2.5% rdg.+5d) | | | | | ● | ● |
| | I | 1.0 ... 99.9 mA 100 ... 200mA | 0.1 mA 1 mA | | 1.0 ... 99.9 mA 100 ... 200mA | | ±(7% rdg.+5 d) ±(7% rdg.+5 d) | ±(5% rdg.+5d) ±(5% rdg.+5d) | | | | | ● | ● |
| | Φ | 0 ... 90° | 1° | | 0 ... 90° | | ±(12% rdg.+10D) ±(10% rdg.+10D) | | | | | | | ● |

Influencing Quantities and Influence Error

| | | | EN61557-4 | EN61557-2 | EN61557-3 | EN61557-6 | EN61557-6 |
|--------------|---|---|---------------------------------------|--|---|--|--------------------------------|
| Abbreviation | Influencing Quantity | U | RLO | RINS | ZLOOP  | RCD If  | RCD I _{ΔN} |
| A | Intrinsic uncertainty | U: ±(1% rdg.+5 d) for 2.0 ... 99.9 V ±(1% rdg.+1 d) for 100 ... 999 V | ±(2% rdg.+2 d) for 0.10 ... 5.99 Ω | ±(3% rdg.+10 d) for 50 k ... 999 kΩ ±(3% rdg.+1 d) for 1.00 MΩ ... 1.20 GΩ | ±(5% rdg.+10 d) for 50 mΩ ... 999 mΩ ±(3% rdg.+3 d) for 1.00 Ω ... 5.00 Ω | ±(3.5% rdg.+2 d) for 3.0 mA ... 2.50 A | ±3 ms for 5.0 ms ... 999 ms |
| E1 | Reference position ±90° | 0% | 0% | 0% | 0% | 0% | 0% |
| E2 | Supply voltage | 0% | 1% | 1% | 1% | 1% | 1% |
| E3 | Temperature: 0 ... +40 °C | 0.5% | 1% | 2.5% | 1% | 2.5% | 5% |
| E4 | Series interference voltage | | | | | | |
| E5 | Probe resistance | | | | | 0% | 0% |
| E6 | Phase angle: 0° ... 18° | | | | 1% | | |
| E7 | Line frequency: 99% ... 101% of nominal frequency | | | | 1% | | |
| E8 | Line voltage: 85% ... 110% of nominal voltage | | | | 1% | | |
| E9 | Mains harmonics | | | | 1% | | |
| E10 | DC component | | | | 1% | | |

 Fields with gray background: not relevant

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Reference Conditions

| | |
|-----------------------------|--|
| Line voltage | 230 V, deviation: $\leq 0.1\%$ |
| Line frequency | 50 Hz, deviation: $\leq 0.1\%$ |
| Measured quantity frequency | 45 ... 65 Hz |
| Waveform | Sine (deviation between effective and rectified value $\leq 0.1\%$) |
| Line impedance angle | $\cos\phi = 1$ |
| Probe resistance | $< 10 \Omega$ |
| Auxiliary power (mains) | 230 V, deviation: $\leq 10\%$ |
| Auxiliary power (battery) | 10.8 V, deviation: $\leq 10\%$ |
| Ambient temperature | +23 °C, deviation: $\leq \pm 2$ K |
| Relative humidity | 40% ... 60% |
| Extraneous field strength | < 0.1 A/m |
| Load resistance | Linear, strictly ohmic |

Ambient Conditions

| | |
|-----------------------------|-----------------------------------|
| Charging temperature range | +10 °C ... + 45 °C |
| Storage temperature range | -20 °C ... + 60 °C |
| Operating temperature range | -5 °C ... + 50 °C |
| Accuracy | 0 °C ... + 40 °C |
| Protective shutdown | > 75 °C |
| Relative humidity | Max. 75%, no condensation allowed |
| Elevation | To 2000 m |

Nominal Ranges of Use

Voltage U_n






120 V (108 ... 132 V)
 230 V (196 ... 253 V)
 400 V (340 ... 440 V)
 690 V (656 ... 725 V)
 850 V DC (765 ... 893 V)

Frequency f_n

16,7 Hz (15.4 ... 18 Hz)
 50 Hz (49.5 ... 50.5 Hz)
 60 Hz (59.4 ... 60.6 Hz)
 200 Hz (190 ... 210 Hz)
 400 Hz (380 ... 420 Hz)

| | |
|-----------------------|--|
| Line voltage waveform | Sinusoidal |
| Temperature range | 0 °C ... + 40 °C |
| Line impedance angle | Corresponds to $\cos\phi = 1 \dots 0.95$ |

Overload Capacity

| Measurement Type | Overload Capacity |
|---|---|
| U, Ures | 1100 V _{RMS} continuous |
| RLO | Electronic protection prevents starting a measurement when interference voltage > 12 V is present. |
| RLOHP | Electronic protection prevents starting a measurement when interference voltage > 12 V is present. Measurement is aborted in case of test current of > 31 A. 10 s on-time, 30 s off-time |
| RINS  | 1200 V DC continuous |
| IdN, IF, IdN+IF, RCM | 440 V continuous |
| ZLOOP  | 725 V AC, 893 V DC (Limits the number of measurements and pause duration. If overload occurs, the measuring function is disabled by means of a thermostatic switch.) |
| ZLOOP , ,  | 440 V (Limits the number of measurements and pause duration. If overload occurs, the measuring function is disabled by means of a thermostatic switch.) |
| IMD | 690 V, I _{LPE} < 25 mA continuous |
| IL  | 15 mA _{RMS} continuous, measurement is stopped in case of interference voltage > 60 V |
|  | 1 V _{RMS} continuous |

Electromagnetic Compatibility

| | |
|------------------|---|
| Product standard | DIN EN 61326-1:2013 DIN EN 61326-2-2: 2013 |
|------------------|---|

| Interference Emission | | Class |
|-----------------------|----------------------------|----------------------|
| EN 55011 | | A |
| Interference Immunity | Test Value * | Evaluation Criterion |
| EN 61000-4-2 | Contact/atmos. – 4 kV/8 kV | B |
| EN 61000-4-3 | 10 V/m | A |
| EN 61000-4-4 | Mains connection – 2 kV | B |
| EN 61000-4-5 | Mains connection – 2 kV | B |
| EN 61000-4-6 | Mains connection – 3 V | A |
| EN 61000-4-8 | 30 A/m | A |
| EN 61000-4-11 | 1;250/300 periods / 100% | C |

* Excerpts from EN 61326-1, table 2

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Power Supply

Mains operation

Auxiliary power (mains) 85 V ... 264 V
16.7 Hz ... 50 Hz ... 400 Hz

Power consumption **PROFITEST PRIME:** < 300 VA
PROFITEST PRIME AC: < 800 VA

Mains disconnection Mains connection terminal with power switch

Battery operation

Battery pack 3 lithium-ion cells (permanently installed),
Type: FEY PA-LN1038.K01.R001
Charging current: 1.9 A
Charging voltage: 12.3 V
Charging time (switch position): 1.5 hrs.
Nominal range of use: 9.7 V ... 10.8 V ... 12.3 V

Number of measurements – For RLO, 0.2 A: approx. 500
– For RINS: approx. 1000

Standby time 32 hours

Scope of Functions Depending on Type of Power Supply

| Auxiliary Power (source) | Scope of Functions | | | | | |
|--|--------------------|-----------------|----------|-------|-------|---------------------|
| | Load | Basic functions | RLO 25 A | HV AC | HV DC | RCD DC ¹ |
| Battery operation | ✗ | ✓ | ✗ | ✗ | ✗ | ✓ ² |
| Mains operation 230/240 V ±10% 50/60 Hz ±1 Hz | ✓ | ✓ | ✓ | ✓ | ✓ | ✓ |
| Mains operation 115 V ±10% 50/60 Hz ±1 Hz | ✓ | ✓ | ✓ | ✗ | ✓ | ✓ |
| Mains operation 85 ... 264 V / 16.7 ... 400 Hz | ✓ | ✓ | ✗ | ✗ | ✓ | ✓ |

✓ Function available

✗ Function not possible or not sensible

¹ Functions for RCD type B, B+ and loop with DC disabling (Loop+DC)

² Measurement of Z_{LOOP} DC+ (DC-H), RCD I_F and RCD I_{ΔN} with DC test current is not advisable unless battery charge level is equal to or higher than 50%

Quick Charging Mode

No measurements can be conducted during the quick charging process. This is assured by the “Charge” position at the rotary switch.

Data Interfaces

Type USB slave for PC connection

Type RS 232 for barcode reader and T/F sensor

Type *Bluetooth*[®] for connection to a PC

Electrical Safety

Protection category I and II per IEC 61010-1/
DIN EN 61010-1/VDE 0411-1

Nominal voltage 230 V

Test voltage 5.4 kV 50 Hz (measurement connections, probe L-N-PE to mains/ PE)

HV AC test voltage Mains / PE / key switch / signal lamp combination externally to high voltage measurement connections: 7.1 kV AC, 50 Hz
Mains to PE: 3.0 kV AC
Mains to external signal lamps: 3.0 kV AC
Impedance to earth: ≥ 1 MΩ (typ. ~ 15 MΩ)

Measuring category Power supply: CAT II, 300 V
Measuring circuit / probes, basic measuring functions: 600 V CAT III / 300 V CAT IV, (without safety caps: 600 V CAT II)
HV measuring circuit: 2500 V, 200 mA,
HV AC potential: 2.5 kV
HV DC potential: 5 kV

Pollution degree 2

Safety shutdown In case of interference voltage and device overheating

Fuses

Mains connection 2 ea. M3.15/250V

Measuring inputs Basic measuring functions:
min. breaking capacity: 30 kA

| F1 | F2 | F3 | F4 |
|--------------|--------------|--------------|--------------|
| 1 kV/20 A | 1 kV/10 A | 1 kV/2 A | 1 kV/440 mA |
| 3-578-319-01 | 3-578-264-01 | 3-578-318-01 | 3-578-317-01 |

PRIME+AC meas. inputs **HV AC test pistols:** 5 kV, 200 mA AC

Mechanical Design

Display Multiple display with dot matrix, b&w, 128 x 128 pixels, illuminated

Protection Device connections: IP 40
Closed case: IP 65
per DIN EN 60529/VDE 0470-1

Excerpt from Table on the Meaning of IP Codes

| IP XY (1 st digit X) | Protection Against Foreign Object Ingress | IP XY (2 nd digit Y) | Protection Against Water Ingress |
|---------------------------------|---|---------------------------------|----------------------------------|
| 4 | ≥ 1.0 mm dianater | 0 | Not protected |

Dimensions 50 x 41 x 21cm (W x D x H)

Weight **PROFITEST PRIME:** 10.15 kg
PROFITEST PRIME AC: 15.10 kg

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Scope of Delivery, Accessories

| Accessories | Article No. | PROFITEST PRIME | PROFITEST PRIME AC |
|--|-------------|-----------------|--------------------|
| | | (M506A) | (M506C) |
| Probe with "active L" 4-wire measuring technology, Start/Stop/Save, 4 m ¹⁾ | Z506T | ○ | ○ |
| Probe with "active L" 4-wire measuring technology, Start/Stop/Save, 12 m ¹⁾ | Z506U | ○ | ○ |
| Probe for L with test probe and 4 m probe cable and alligator clip ¹⁾ | — | ✓ | ✓ |
| Probe for N with test probe and 4 m probe cable and alligator clip ¹⁾ | — | ✓ | ✓ |
| Probe for PE with test probe and 4 m probe cable and alligator clip ¹⁾ | — | ✓ | ✓ |
| USB cable, 1 m, A to B | — | ✓ | ✓ |
| Mains power cable, 1.5 m | — | ✓ | ✓ |
| Accessories pouch, 400 x 350 x 50 | — | ✓ | ✓ |
| Condensed operating instructions | — | ✓ | ✓ |
| Safety data sheet | — | ✓ | ✓ |
| DAkkS calibration certificate | — | ✓ | ✓ |
| Probe for PE with interchangeable test tip and 25 m probe cable | Z506S | ○ | ○ |
| High-voltage pistol for HV-AC | Z506V | ✗ | ○ ²⁾ |
| Cable set with HV measuring probes for DC | Z506W | ✗ | ✗ |
| Signal lamp combination (red/green), SIGNAL PROFITEST PRIME AC | Z506B | ✗ | ○ ²⁾ |
| Cable connected emergency off switch, STOP PROFITEST PRIME AC | Z506D | ✗ | ○ ²⁾ |
| Barrier set for dielectric strength test, CLAIM PROFITEST PRIME AC | Z504G | ✗ | ○ ²⁾ |
| Temperature/moisture sensor | Z506G | ○ | ○ |
| PROFITEST CLIP | Z506H | ○ | ○ |
| Trolley for case system | Z506F | ○ | ○ |
| Guard cable for DC high-voltage | On request | ✗ | ✗ |
| Cable connected barcode scanner | Z502F | ○ | ○ |
| Card with registration key for the software IZYTRONIQ Business Starter | | ✓ | ✓ |

¹⁾ Measuring category with safety cap: 300 V CAT IV, 600 V CAT III, 1 A; Measuring category without safety cap: 600 V CAT II 16 A

²⁾ indispensable accessory for dielectric strength test with PROFITEST PRIME AC

Key

✓ Included

✗ Feature not possible or not sensible

○ Optional accessory (see also order information as of page 14)

General accessories for all 3 device variants



Probe for L, 4 m probe cable (included)

Probe for N, 4 m probe cable (included)

Probe for PE, 4 m probe cable (included)

Each probe is equipped with coded plugs so that it can only be connected to the input for L, N or PE.



PROFITEST PRIME in case (included)



Accessories pouch (included)

Measuring category with safety cap: 300 V CAT IV, 600 V CAT III, 1 A;
Measuring category without safety cap: 600 V CAT II 16 A

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

Accessories

I-SK4/12-PROFITEST-PRIME (Z506T/Z506U) *



Probe with "active L" 4-wire measuring technology with keys for Start-Stop/ $I_{\Delta w}$ /Save-Send, with 4 or 12 m connector cable

SK4-L/N/PE and SK12-L/N/PE (Z506L ... Z506R) *




Probe with 4-wire measuring technology for connection to L, N or PE, SK4 with 4 m and SK12 with 12 m connector cable

SK25-PE (Z506S) *



Probe with 4-wire measuring technology for connection to PE, with 25 m connector cable

* Measuring category with safety cap: 300 V CAT IV, 600 V CAT III, 1 A;
Measuring category without safety cap: 600 V CAT II 16 A

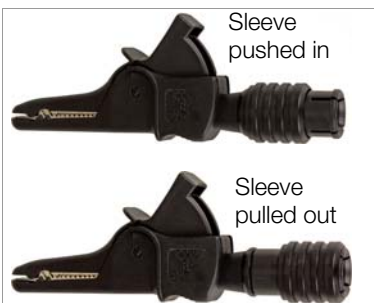

Alligator Clip with Bayonet Lock

Alligator clip with sliding sleeve for reliable securing and locking to the test probe, can be plugged on to series I-SK4/12 and SK4/12/25 test probes (included respectively).



PRIME Cable Lug (Z506X)

Cable lug with sliding sleeve for reliable securing and locking to the test probe, can be plugged on to test probes.



Z506Y

Screw-on replacement test probe (set of 5) for Z506L, M, N, O, P, R, S, T and U probe cables

3-Phase Current Adapter 7-pole




A3-16 Shielded and A3-32 Shielded 3-phase adapters are used for trouble-free connection of test instruments to 7-pole CEE outlets. The two variants differ with regard to plug size, which corresponds respectively to 7-pole CEE outlets with current ratings of 16 and 32 A. Testing the effectiveness of safety measures is conducted via seven 4 mm sockets with touch protection.



PROFITEST CLIP (Z506H)

Clamp meter for leakage or fault current as of 0.1 mA, direct or differential current up to 25 mA

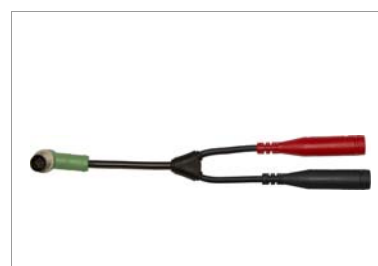

ADAPTER-Z506J-PROFITEST-PRIME (Z506J)

Adapter for connecting current clamp sensors with output via banana plug

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

T/F sensor (Z506G)



Adapter for measuring temperature and humidity with magnetic retainer. Measurement data transmission and **power supply** (5 V DC \pm 10%) via connection to the test instrument's 9-pin RS 232 port.

Characteristic Values

| Measured Quantity | Measuring Range | Inherent Error |
|-------------------|--------------------|---------------------------------------|
| T (Temp) | -10.0 ... +50.0 °C | \pm 2 °C (at 50% relative humidity) |
| r.H. (rHum) | 10.0 ... 90.0% | \pm 5% (at 23 °C) |

| | |
|---------------------------|---|
| EMC interference emission | EN 61326-1:2013, class B |
| EMC interference immunity | EN 61326-1:2013 |
| Ambient conditions | Same as test instrument |
| Protection | IP 20 |
| Dimensions | 70 x 40 x 15 mm (L x W x H) Connector cable length: 4.85 m |
| Weight | 30 g without connector cable 211 g with connector cable |

Accessories for Dielectric Strength Testing with the PROFITEST PRIME AC



SIGNAL PROFITEST PRIME AC (Z506B)

Signal lamp combination for dielectric strength testing per DIN EN 50191/VDE 0104 and DIN EN 61557-14/VDE 0413-14



STOP PROFITEST PRIME AC (Z506D)

Emergency off switch for dielectric strength testing per DIN EN 50191/VDE 0104 and DIN EN 61557-14/VDE 0413-14



PRIME CASE (Z506A)

Case for accessories with internal pocket and mount for trolley (Z506F)

Trolley not included



CLAIM PROFITEST PRIME AC (Z504G)

Barrier set for dielectric strength testing consisting of case with chain, stands and warning signs per DIN EN 50191/VDE 0104 and DIN EN 61557-14/VDE 0413-14



TROLLEY for PRIME hard case system (Z506F)

TROLLEY for PROFITEST PRIME case system

Extended height: 97 cm

Retracted height: 61 cm



HV-P PROFITEST PRIME AC (Z506V)

High-voltage pistol for dielectric strength testing with coded plugs (1 piece per article number)

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

E-Mobility Accessories

PRO-TYP I (Z525B)



Vehicle Simulation (CP)

Vehicle states A through E are selected with a rotary switch.

Cable Simulation (PP)

via permanently wired cable coding

Fault Simulation

Simulation of a short-circuit between CP and PE by means of a rotary switch

Indication of Phase Voltages via LEDs

PRO-TYP II (Z525A)



Vehicle Simulation (CP)

Vehicle states A through E are selected with a rotary switch.

Cable Simulation (PP)

The various codings for charging cables with 13, 20, 32 and 63 A, as well as "no cable connected", can be simulated with the help of a rotary switch.

Fault Simulation

Simulation of a short-circuit between CP and PE by means of a rotary switch

Indication of Phase Voltages via LEDs

Depending on the charging station, either one or three phases can be active.

Testing of electrical charging stations with permanently connected charging cable due to extended CP test pin

Adapter PRO-TYPII-TYPI (Z525C)



Type II Inlet

Type I Inlet

Order Information

| Designation | Type | Article Number |
|---|---------------------------|----------------|
| Basic Devices | | |
| Test instrument per DIN EN 61557/ VDE 0413 for testing the effectiveness of protective measures in electrical installations per DIN IEC 60364/ DIN VDE 0100-600, machines per DIN EN 60204/VDE 0113-1, PV systems per DIN EN 62446/VDE 0126-23 and electric charging stations per VDE 0122-1, voltage measurement: 1000 V AC/DC, Z_{L-PE} 690 V AC/ 800 V DC, R_{LO} 200 mA/25 A, R_{INS} up to 1000 V, testing of RCD types A, AC, F, EV, B, B+, and MI, as well as PRCDs, IMDs, and RCMs, leakage current, touch current, integrated memory, freely programmable test sequences, sensor input, USB, Bluetooth interface | PROFITEST PRIME | M506A |
| Test instrument per DIN EN 61557/ VDE 0413 for testing the effectiveness of protective measures in electrical installations per DIN IEC 60364/ DIN VDE 0100-600, machines per DIN EN 60204/VDE 0113-1, PV systems per DIN EN 62446/VDE 0126-23 and electric charging stations per VDE 0122-1, voltage measurement: 1000 V AC/DC, HV AC (up to 2500 V / 500 VA, adjustable in steps, key switch, connection for signal lamps and emergency off switch), Z_{L-PE} 690 AC/ 800 V DC, R_{LO} 200 mA/25 A, R_{INS} up to 1000 V, testing of RCD types A, AC, F, EV, B, B+, and MI, as well as PRCDs, IMDs, and RCMs, leakage current, touch current, integrated memory, freely programmable test sequences, sensor input, USB, Bluetooth interface (for the testing of dielectric strength the following accessories are required: Z506V, Z506B, Z506D, Z504G) | PROFITEST PRIME AC | M506C |
| Scope of delivery per tester: test instrument in measuring case and accessories pouch with measurement cables, USB cable, mains power cable, condensed operating instructions, complete operating instructions for download from Internet, DAKs calibration certificate | | |
| Accessories for PROFITEST PRIME AC | | |
| Indicator / signal lamp combination with 5 m connector cable for dielectric strength testing with the PROFITEST PRIME AC (M506C) per DIN EN 50191/VDE 0104 and DIN EN 61557-14/ VDE 0413-14 | SIGNAL PROFITEST PRIME AC | Z506B |
| Extension cable 10 m for SIGNAL PROFITEST PRIME AC | E-SK10 SIGNAL | Z516E |
| Emergency off switch with 5 m connector cable for dielectric strength testing with the PROFITEST PRIME AC (M506C) per DIN EN 50191/VDE 0104 and DIN EN 61557-14/ VDE 0413-14 | STOP PROFITEST PRIME AC | Z506D |
| Extension cable 10 m for STOP PROFITEST PRIME AC | E-SK10 STOP | Z516D |
| Barrier set for dielectric strength testing with the PROFITEST PRIME AC (M506C) consisting of case with chain, stands and warning signs per DIN EN 50191/VDE 0104 | CLAIM PROFITEST PRIME AC | Z504G |

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

| Designation | Type | Article Number |
|---|-------------------------------|----------------|
| Key blank for key switch PROFITEST PRIME AC (Note: The key number is on the inside of the case's cover.) | KEY PROFITEST PRIME AC | Z506E |
| 1 High-voltage pistol with integrated test triggering (switch), 4 m connector cable, max. 5 kV AC for PROFITEST PRIME AC (for the testing of dielectric strength 2 pistols are required) | HV-P PROFITEST PRIME AC | Z506V |
| Accessory Test Probes and Sensors | | |
| Intelligent test probe, 4 m, with remote triggering and interchangeable test tip, measuring point illumination and multi-LED as status display for the momentary measurement, as well as storage for PROFITEST PRIME. Measuring category with safety cap attached: 300 V CAT IV, 600 V CAT III, 1 A Measuring category without safety cap attached: 600 V CAT II, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | I-SK4-PROFITEST-PRIME | Z506T |
| Intelligent test probe, 12 m, with remote triggering and interchangeable test tip, measuring point illumination and multi-LED as status display for the momentary measurement, as well as storage for PROFITEST PRIME. Measuring category with safety cap attached: 300 V CAT IV, 600 V CAT III, 1 A Measuring category without safety cap attached: 600 V CAT II, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | I-SK4-PROFITEST-PRIME | Z506U |
| Leakage current clamp meter for PROFITEST PRIME, leakage or fault current as of 0.1 mA, direct or differential current measurement up to 25 mA, 1 kHz filter per VDE 0413-16/DIN EN/IEC 61557-16, ASI plug, LED for monitoring operating state, measuring category CAT III 300 V / CAT II 600 V | PROFITEST CLIP | Z506H |
| Adapter with M12 angle plug and two 4 mm safety sockets for connecting current clamp sensors to PROFITEST PRIME, PRIME DC and PRIME AC test instruments (M506A/B/C). | ADAPTER-Z506J-PROFITEST-PRIME | Z506J |
| T/F sensor with 5 m connector cable for PROFITEST PRIME , measuring ranges: temperature from -10.0 °C to +50.0 °C and humidity from 10.0% to 90.0% | T/F Sensor PROFITEST PRIME | Z506G |
| Accessory Probe Cable, Cable Lug and Replacement Test Tips | | |
| Probe for L with interchangeable test tip and 4 m probe cable for PROFITEST PRIME, 300 V CAT IV, 25 A for short periods, 16 A continuous load (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK4-L * | Z506L |

| Designation | Type | Article Number |
|---|-------------------------------|----------------|
| Probe for N with interchangeable test tip and 4 m probe cable for PROFITEST PRIME, 300 V CAT IV, 25 A for short periods, 16 A continuous load (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK4-N * | Z506N |
| Probe for PE with interchangeable test tip and 4 m probe cable for PROFITEST PRIME, 300 V CAT IV, 25 A for short periods, 16 A continuous load (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK4-PE * | Z506P |
| Probe for L with interchangeable test tip and 12 m probe cable for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK12-L * | Z506O |
| Probe for N with interchangeable test tip and 12 m probe cable for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK12-N * | Z506M |
| Probe for PE with interchangeable test tip and 12 m probe cable for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK12-PE * | Z506R |
| Probe for PE with interchangeable test tip and 25 m probe cable for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK25-PE * | Z506S |
| Probe for PE with interchangeable test tip and 50 m probe cable mounted on cable drum for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK50-PE * | Z516A |
| Probe for PE with interchangeable test tip and 75 m probe cable mounted on cable drum for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK75-PE * | Z516B |
| Probe for PE with interchangeable test tip and 100 m probe cable mounted on cable drum for PROFITEST PRIME, 300 V CAT IV, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time), alligator clip with bayonet lock | SK100-PE * | Z516C |
| The cable lug can be plugged onto test probes in order to contact the measurement cable via the screw at the terminal, 600 V CAT III, 16 A (suitable for 25 A short-circuit operation, 10 s on-time, 30 s off-time) | PRIME cable lug | Z506X |
| 5 replacement test tips for PROFITEST PRIME probe cables (Z506L, M, N, O, P, R, S, T and U probe cables) | PRIME replacement test probes | Z506Y |
| Three-phase adapter shielded, 7-pin for CEE socket outlets 16 A, CAT III 300 V – 10 A | A3-16 Shielded | Z513A |

PROFITEST PRIME, PRIME AC

Testers for IEC 60364-6, EN 50110-1, IEC 60204-1, IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1

| Designation | Type | Article Number |
|---|------------------------------------|----------------|
| Three-phase adapter shielded, 7-pin for CEE socket outlets 32 A, CAT III 300 V – 10 A | A3-32 Shielded | Z513B |
| Set of test probes (red/black) CAT III / 600 V, 1 A, test probe working range: 68 mm – diameter: 2.3 mm | Probe set | Z503F |
| Flat test clip for contacting busbars quickly and safely. Good contact at the front and back of the busbar thanks to time-tested contact blades. Rigid 4 mm socket in the handle, suitable for the insertion of spring-loaded 4 mm plugs with rigid insulating sleeve. 1000 V CAT IV/32 A | PRO-PE Clip | Z503G |
| Telescoping rod for RLO and RINS measurements, CAT III 600 V / CAT IV 300 V, 1 A, retracted: 53.5 cm, extended: 120 cm, 190 g | TELEARM 120 ^{D)} | Z505C |
| Telescoping rod for RLO and RINS measurements, CAT III 600 V / CAT IV 300 V, 1 A, retracted: 73.5 cm, extended: 180 cm, 250 g | TELEARM 180 ^{D)} | Z505D |
| Transport Accessories | | |
| TROLLEY for PROFITEST PRIME case system | TROLLEY for PRIME hard case system | Z506F |
| PRIME case with internal pocket and mount for trolley (Z506F), also for accessories for PROFITEST PRIME and METRISO PRIME 10 test instruments | PRIME CASE | Z506A |

| Designation | Type | Article Number |
|--|----------------------------|----------------|
| Instrument and Accessory Sets | | |
| PROFITEST PRIME (M506A), trolley for case system (Z506F), I-SK4 intelligent probe, 4 m (Z506T) | PRIME starter package | M506D |
| PROFITEST PRIME (M506A), PRIME CASE (Z506A), trolley for PRIME case system (Z506F), I-SK4-PROFITEST-PRIME (Z506T), PROFITEST CLIP (Z506H) | PRIME master package | M506E |
| PROFITEST PRIME AC (M506C), trolley for PRIME case system (Z506F), HV-P PROFITEST PRIME AC (2 ea. Z506V), SIGNAL PROFITEST PRIME AC (Z506B), STOP PROFITEST PRIME AC (Z506D), PRIME CASE (Z506A) | PRIME professional package | M506F |
| HV package: (2 ea. Z506V), SIGNAL PROFITEST PRIME AC (Z506B), STOP PROFITEST PRIME AC (Z506D) | HV package, PRIME AC | Z506Z |
| E-Mobility Accessories | | |
| Single phase test adapter with type 1 plug | PRO-TYP I ^{D)} | Z525B |
| Single and 3-phase test adapter with type 2 plug | PRO-TYP II ^{D)} | Z525A |
| Single and 3-phase test adapter with type 2 plug; Version with swiss type socket | PRO-TYP II-CH | Z525D |
| Test adapter PRO TYP II to TYP I | PRO-TYPII-TYPI | Z525C |
| Report Generating Accessories | | |
| Cable connected barcode scanner | Z502F | Z502F |

* Measuring category with safety cap: 300 V CAT IV, 600 V CAT III, 1 A;

Measuring category without safety cap: 600 V CAT II 16 A

^{D)} Data sheet available

For additional information regarding accessories please refer to:

- *Measuring Instruments and Testers catalog*
- www.gossenmetrawatt.com

PROFITEST PRIME, PRIME AC

**Testers for IEC 60364-6, EN 50110-1, IEC 60204-1,
IEC 61439-1, DIN EN 62446-1 and DIN EN 61851-1**

Edited in Germany • Subject to change without notice • PDF version available on the Internet

 **GOSSEN METRAWATT**

GMC-I Messtechnik GmbH
Südwestpark 15
90449 Nürnberg, Germany

Phone: +49-911-8602-111
Fax: +49 911 8602-777
E-mail info@gossenmetrawatt.com
www.gossenmetrawatt.com