


5 kV & 10 kV Insulation tester lead sets

Application note

Megger provide a range of lead sets and clips of different sizes and electrical characteristics for use with Megger 5 kV and 10 kV insulation resistance testers, enabling the user to choose the most applicable lead set for the work in hand.

The design of the lead sets is intended to facilitate connection to a variety of de-energised systems for the purpose of making insulation resistance measurements. In all cases it is the responsibility of the user to employ safe working practices and verify that the system is safe before connection. Even electrically isolated systems may exhibit significant capacitance which will become highly charged during the application of the insulation test. This charge can be lethal and connections, including the leads and clips, should never be touched during the test. The system must be safely discharged before touching connections.

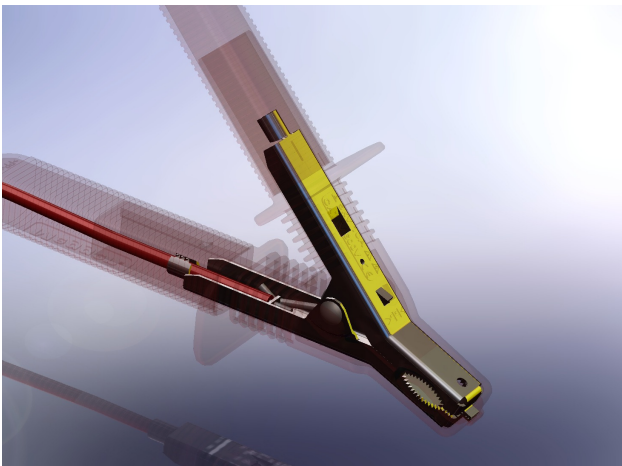

Megger test leads – **NEW** designs using the latest technology

All of the lead sets in this application note are suitable for use with all current Megger 5 kV and 10 kV insulation resistance testers.

Megger test leads designed for the real world – Providing Safety, Reliability and Practicality

At Megger we recognise that test leads are a key component of any precision instrument and that safety, long life, and the ability to provide reliable connections to the wide variety of test pieces found in real applications are of utmost importance.

Careful design ensures repeatable connections, which are practical and safe to use.

Only the best materials and most appropriate materials are used, to provide the essential blend of performance and safety. As an example the careful specification of the cable ensures it remains flexible in all conditions and has extremely good insulation properties which will not effect the measurements made.

Megger uses only the best quality double insulated silicon cable; the inner insulation is specifically manufactured in a different colour to the outer sheath so to instantly highlight any damaged areas; a factor important not just for reliable measurements but safety too.



Using an insulation tester with poor or electrically leaky test leads can provide misleading measurements and may result in perfectly good insulation being diagnosed faulty, wasting both time and money on unnecessary repairs. This is especially so when using long test leads.

NEW Megger MIT 5kV and 10kV HV test leads

The range of HV test leads supplied for use with the MIT and S1 range of 5kV and 10kV insulation testers' were developed from years of experience and practical testing, utilising the latest technology. These leads have been designed to be fully compliant with the latest release of the essential safety standard IEC61010-031 : 2008 which requires a fully insulated clip design essential in reducing arc flash accidents.

IEC 61010-031 :2008

Important safety enhancements

The international standard IEC 61010-031 details the Safety requirements for hand-held probe assemblies for electrical measurement and test. This was amended in 2008 and subsequently the new requirements became law early 2011.

A number of amendments were made to the standard, but the most significant was to add a new section; **Prevention of HAZARD from arc flash and short-circuits.**

Two hazards are considered; firstly the dangers of a probe tip or crocodile clip temporarily bridging two high energy conductors, and secondly the dangers of a contact being broken while current is flowing.

These hazards are particularly applicable to many of the environments in which Megger MIT 5kV and 10kV instruments are used. Should a probe or clip momentarily short out two high energy conductors during connection an extremely high current will flow heating the metal and melting insulation. This itself may cause serious burns to the operator or bystander near the clip or probe. Additionally should the contact be broken while current is flowing arcing may occur leading to an extremely serious situation known as arc-flash.

The standard describes the danger of arcing as follows: ***"The arcing will ionize the air in the vicinity of the arc, permitting continued current flow in the vicinity of the probe tip or crocodile clip. If there is sufficient available energy, then the ionization of the air will continue to spread and the flow of current through the air continues to increase. The result is an arc flash, which is similar to an explosion, and can cause injury or death to an operator or a bystander"***.

IEC 61010-031 :2008 requires probe tips and crocodile clips to be constructed to mitigate the risk of arc flash and short circuits, and this requirement applies to **all** crocodile clips or clamps that are rated to Installation Category III or IV (CATIII or CATIV) . The outer surfaces of crocodile clips must not therefore be conductive and no metal parts should be ACCESSiBLE (as defined by the standard) with the clip closed.

During design phase detailed inspection measurement and test procedures are used to assess electrical creepage and clearance paths and compliance with the standard. Accessibility of conductive metalwork is assessed using an IEC standard test finger – see below. The above processes along with extensive practical testing ensure that Megger test leads maintain class leading levels of safety, performance and practicality for the user.



Megger test clip being tested with a IEC standard test finger for creepage and clearance

The Megger Safety Philosophy

The electrical test environment in which Megger products are used often poses significant hazards and safety risks to users requiring high levels of training and competence. In these environments application of safe working practices is essential to ensure the safety of both operators and others.

At Megger, we take product safety extremely seriously and pride ourselves on our reputation for high quality practical equipment designed to minimise the risk to the user. Whether a complex test instrument or a set of test leads the same rigorous process is employed.

Insulation testing in HV, high energy, environments poses a number of unique hazards against which Megger has implemented innovative solutions to provided added protection.

These hazards and protective features are summarised below and listed in order of importance:-


1. Maintaining practicality with a fully insulated clip

In addition to the overall insulation requirements of a clip Megger considered the challenge of providing this protection without compromising the usability of the design.

An insulated clip is great, but if the added insulation impedes the operation and ability to make reliable connection to the wide variety of bus bars, wires and terminals that are needed the design is useless and the operator may be tempted to remove the additional insulation to make connection.

Megger's unique solution has been achieved by the addition of moving jaw covers that flex back when the clip is applied to a test piece.

A simple but effective design.

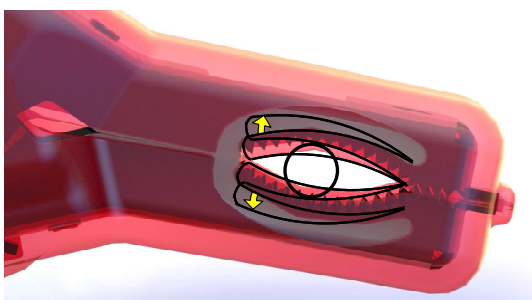


2. Protection from charged capacitance of long cables


Locking HV insulated plugs / Non-removable test clips

All Megger 5kV and 10kV insulation testing test leads are fitted with locking HV plugs at the instrument end. This reduces the likelihood of a plug losing connection or pulling out; a situation which could result in the load inadvertently remaining lethally charged at the end of a test and the instrument to incorrectly report that no voltage was present.

The lock facility is simple to use and prevents "plug end" disconnection and therefore helps ensure the integrity of load discharge after a test

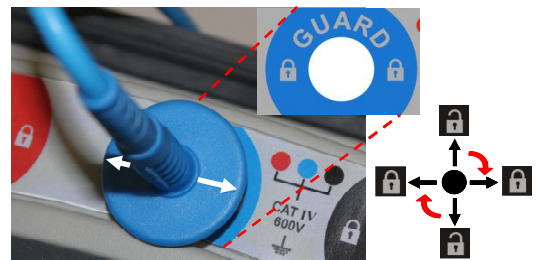

Simply align the arrows on the plug finger guard with the padlock symbols on the instrument to lock, and twist 90° to align with the open padlocks to un-lock. In addition, for the same reason, the test clips are not removable from the test lead.

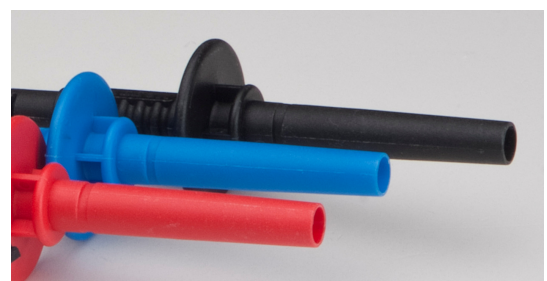

3. Protection from high voltage in CATIV 600V environments

As connection is made to more upstream supply systems, (Overvoltage Category IV relates to incoming supplies of industrial premises), increased protection is required from overvoltages. These are transients that naturally occur on the supply, which are typically caused by switching actions or distant lightning strikes and present the connected equipment, test leads, clips etc with impulses of many thousands of volts. Such equipment must provide protection to the operator during the process of connection. A clip rated for use on a 600V supply in overvoltage category CATIV must be able to withstand such impulses up to 8kV.

Megger Test clips are moulded from a high dielectric strength insulating polymer with carefully defined dimensions to ensure electrical creepage and clearance distances are maintained even under adverse conditions. For instance the unique fins on the front of Meggers large test clips are there not for styling, but to maintain the all important electrical creepage distances necessary for such environments whilst retaining a reasonably small and usable design.

4. Protection from instrument output (5kV or 10kV)

Many people fear the electrical output from their insulation tester which may be 5 or 10kV. However, in reality the current available from the instrument is generally limited to a few milliamperes and in itself presents a relatively low hazard. Whilst highly unpleasant a low current shock from an insulation tester will make you jump but under most conditions is only a serious hazard to those with a heart condition or fitted with a pace maker.

The hazard here is not so much the output of the instrument but more the working environment. If the connected load is capacitive, a long cable perhaps, this can provide very significant energy when charged to high voltage by the instrument, and could prove lethal if touched. Additionally when testing insulation in many HV environments, it is not uncommon to have to climb ladders to reach connections

on equipment such as transformers with associated risks of working at height. In such situations even a small electric shock can cause the user to jump with potentially serious circumstances if this causes a fall. Fully insulated Megger clips help minimise the risk.

Test clip markings explained with respect to protection to instrument output



The square inside a square symbol is the IEC symbol for double insulation. In this example the test clip is therefore rated to 3 kV double insulation. In terms of protecting the user from the low energy output of an insulation tester this provides single insulation protection


to 6 kV, enough to protect the user from the output of an insulation tester set to a test voltage of up to 6 kV

Likewise a test lead marked double insulated with 5kV is suitable to protect the user from a insulation tester set to a 10kV output.



The anatomy of a good quality HV rated CATIV rated test clip

Curved jaws and wire gripping flat jaw tips

Curved jaws to allow reliable connection round test pieces and flat jaw tips to provide excellent connection and gripping of individual wires

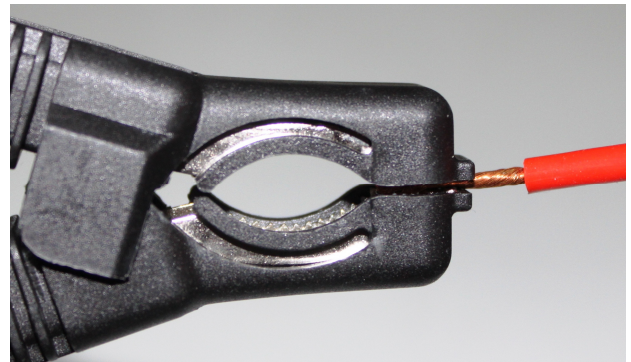

Designed to maintain creepage and clearance

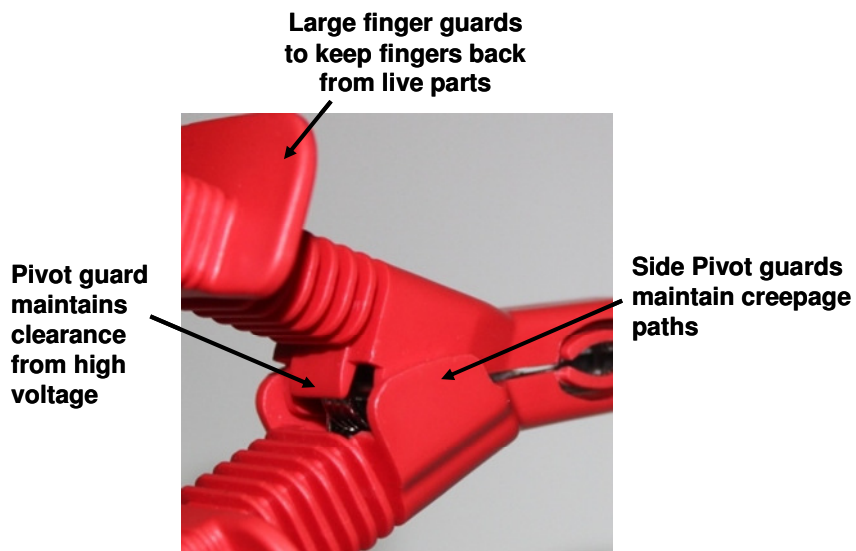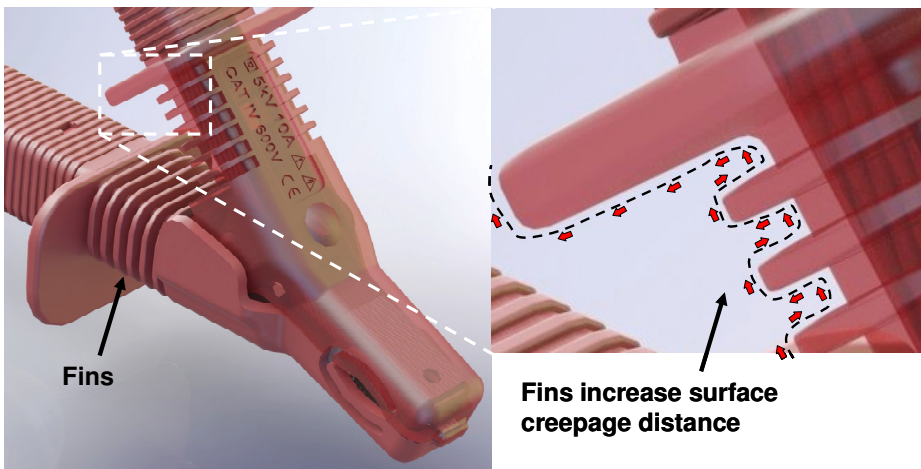

Cable strain relief at both clip and plug designed to withstand 5000 flexes with 10N pull force applied

TEST LEADS AVAILABLE FOR MEGGER 5kV AND 10kV INSULATION TESTERS

MEDIUM TEST CLIP LEAD

Clip details:

Dimensions: 139 (L) X 73 (closed) mm

Lead lengths available: 3 m, 10 m and 15 m

Jaw opening: 34 mm diameter max

Number in set: 3

Double insulation rating: 3 kV d.c.

Basic insulation rating: 6 kV d.c.

Safety specification: IEC61010-31:2008 The clips are therefore touch proof when closed

CAT rating: 600 V a.c. CAT IV

Cable details:

Lead lengths available: 3 m, 10 m and 15 m


Insulation rating: 12 kV d.c. (Marked on cable)

Cable type: Flexible dual insulated silicon (inner insulation layer coloured white to highlight damage)



Part numbers: 3m (10ft)	1002-531
5m (16ft)	1002-641
8m (26ft)	1002-642
10m (33ft)	1002-643
15m (50ft)	1002-644

These test leads may also be supplied in none standard lengths to suit a particular application. Please contact Megger for a quotation. Minimum order quantities may apply.

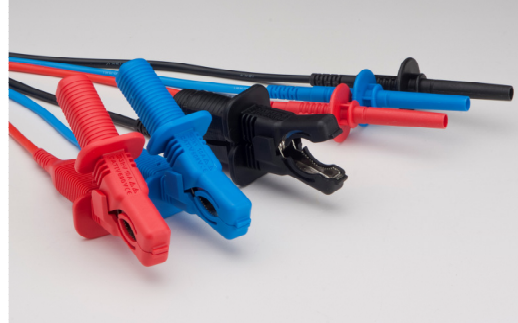

Application notes:

These clips are designed for clamping on larger diameter test pieces but where space is at a premium. The insulation is designed only to protect the user from the output of Megger 5 kV and 10 kV (set below 6 kV) insulation resistance testers.

The clips **cannot** in any circumstance be relied on to protect the user from live systems above 600V a.c. in a CATIV environment, or 1000V a.c. in a CATIII environment.



LARGE TEST CLIP LEAD

Clip details:

Dimensions: 220 (L) X 134 (closed) mm

Jaw opening: 34 mm diameter max

Number in set: 3

Double insulation rating: 5 kV d.c.

Basic insulation rating: 10 kV d.c.

Safety specification: IEC61010-31:2008

The clips are therefore touch proof when closed.

CAT rating: 600 V a.c. CAT IV

Cable details:

Lead lengths available: 3 m, 10 m and 15 m

Insulation rating: 12 kV d.c. (Marked on cable)

Cable type: Flexible dual insulated silicon (inner insulation layer coloured white to highlight damage)

Part numbers:	3m (10ft)	1002-534
	5m (16ft)	1002-645
	8m (26ft)	1002-646
	10m (33ft)	1002-647
	15m (50ft)	1002-648


These test leads may also be supplied in none standard lengths to suit a particular application. Please contact Megger for a quotation. Minimum order quantities may apply.



Application notes:

These clips are designed for clamping on larger diameter test pieces. The insulation is designed only to protect the user from the output of Megger 5 kV and 10 kV insulation resistance testers and systems below 600V to the category rating above.

The clips **cannot** in any circumstance be relied on to protect the user from live systems above 600V a.c. in a CATIV environment, or 1000V a.c. in a CATIII environment.

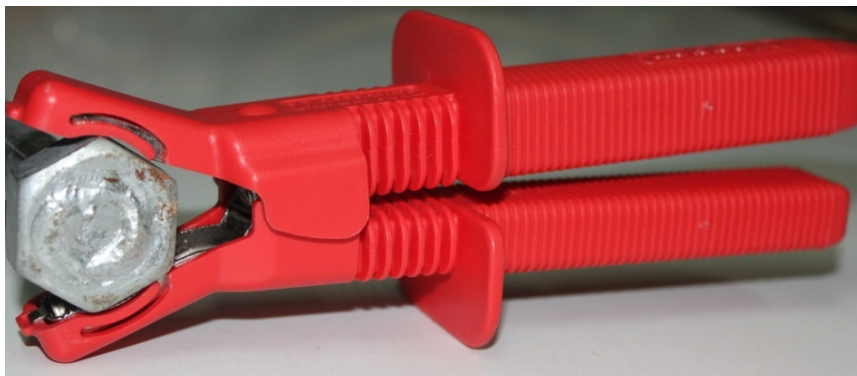

COMPACT TEST CLIP LEAD

Clip details:

Dimensions: 58 (L) X 25 (closed) mm

Lead lengths available: 3 m, 10 m and 15 m

Jaw opening: 18 mm diameter max

Number in set: 3

Double insulation rating: None

Basic insulation rating: None

CAT rating: Not applicable



Cable details:

Lead lengths available: 3 m, 10 m and 15 m

Insulation rating: 12 kV d.c. (Marked on cable)

Cable type: Flexible dual insulated silicon (inner insulation layer coloured white to highlight damage)

Part numbers: 3 m 8101-181

8 m 8101-182

15 m 8101-183



Application notes:

These clips are designed for clamping on test pieces where access is limited. There is no insulation on these clips. Extreme care **must** be taken to avoid electric shock when connecting/disconnecting due to the bare metallic clips.

CONTROL CIRCUIT TEST SET

Clip details:

Dimensions: 58 (L) X 25 (closed) mm

Jaw opening: 20 mm dia max (clip)

Number in set: 2

Double insulation rating: 1 kV d.c.

CAT Rating: 600V a.c. CATIII

Probe details:

Number in set: 2

Double insulation rating: 1 kV d.c.

CAT Rating: 600V a.c. CATIV

Cable details:

Lead length: 3 m

Insulation rating: 1 kV d.c.

Cable type: Flexible double insulated silicon (inner insulation layer coloured white to highlight damage)

Part number: 6220-822

Application notes:

These clips are designed for testing low voltage circuits with test voltages up to 1 kV. The insulation is designed only to protect the user from the output of Megger 5 kV and 10 kV insulation resistance testers set to a maximum output voltage of 1 kV.

Do not use this lead set at voltages above 1 kV.




CLIP SIZE COMPARISON

Large

Medium

Compact

Control circuit

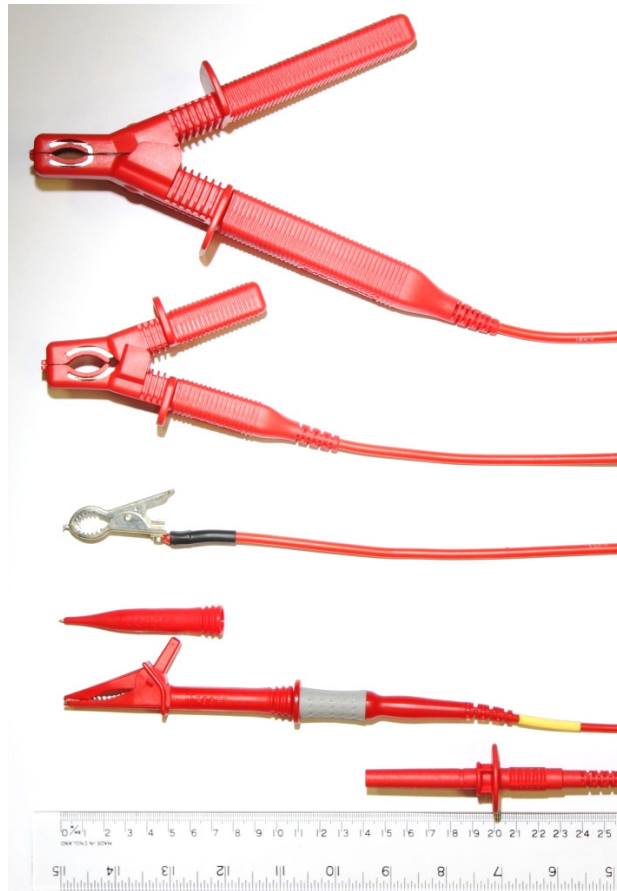


Large

Medium

Compact

Control circuit

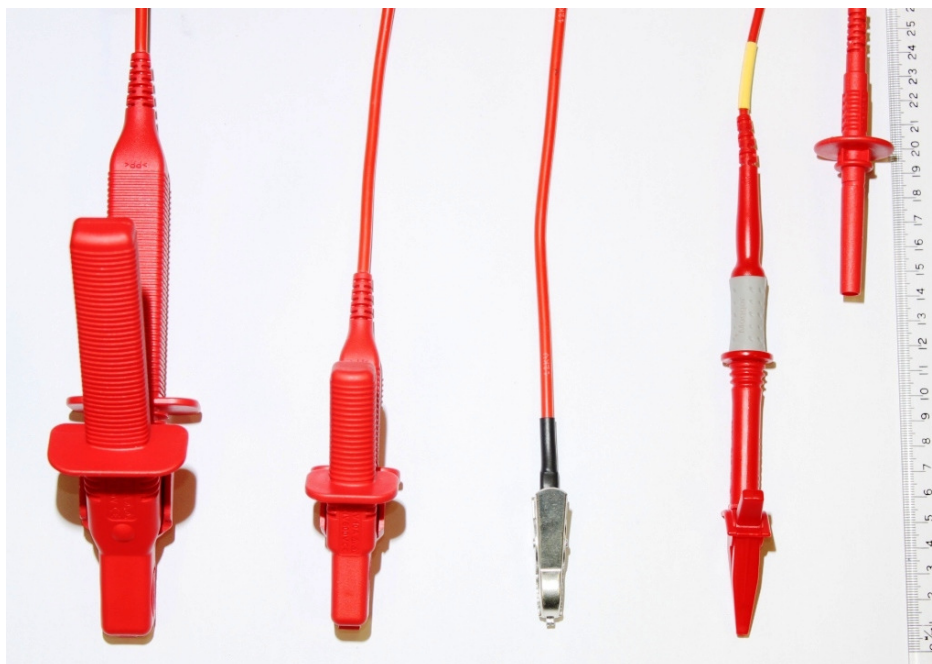

FUSED PROBE AND CLIP TEST LEAD SET (For MIT515, MIT525 and MIT1025)

Clip details:

Dimensions: 90 (L) X 41 (closed) mm

Jaw opening: 20 mm dia max (clip)

Number in set: 2

Double insulation rating: 1 kV d.c.

CAT Rating: 600V a.c. CATIV

Probe details:

Number in set: 2

Double insulation rating: 1 kV d.c.

CAT Rating: 600V a.c. CATIV

Cable details:

Lead length: 1.25 m

Insulation rating: 1 kV d.c.

Cable type: Flexible double insulated silicon (inner insulation layer coloured white to highlight damage)

Fuse rating: FF500mA 50 kA see notes below

Part number: 1002-913

Application notes:

This fused probe and clip leadset is designed for testing low voltage circuits with test voltages up to 1 kV. The leadset is GS38 compliant, fitted with FF500mA 50 kA fuses, which allows voltage measurements to be made in safety when using the user selectable voltage measuring range on the MIT515, MIT525 and MIT1025 instruments.

These clips are designed for testing low voltage circuits with test voltages up to 1 kV. The insulation is designed only to protect the user from the output of Megger 5 kV and 10 kV insulation resistance testers up to a maximum instrument test voltage of 1 kV.

The clips cannot in any circumstance be relied on to protect the user from live systems above 600V a.c. in a CATIV environment, or 1000V a.c. in a CATIII environment.

It is important to check fuse continuity before and after a test



COMPACT TEST CLIP WITH 5kV or 10kV SCREENED CABLE

Clip details

Dimensions: 58 (L) X 25 (closed) mm

Jaw opening: 18 mm diameter max

Number in set: 3

Double insulation rating: None

Basic insulation rating: None

CAT rating: Not applicable

Cable details:

Lead lengths available:

5 kV rated 3 m, 15 m

10 kV rated 3m, 10m, 15m

Insulation rating: 5kv or 10 kV d.c.

Cable type: Flexible screened PVC

Part numbers:

5 kV 3 m 6220-835

5 kV 15 m 6311-080

10 kV 3m 6220-834

10 kV 10m 6220-861


10 kV 15m 6220-833

Application notes:


The test clips are designed for clamping on test pieces where access is limited. There is no insulation on these clips. Extreme care **must** be taken to avoid electric shock when connecting/disconnecting due to the bare metallic clips.

The screened test lead set consists of:

- A black/negative test lead that has been screened. The screen is connected to the guard terminal of the instrument and terminated with a bare clip.
- A red/positive test lead that is not screened. Normal practice means that the positive lead is connected to ground (usually to limit the effects of electro-endosmosis), meaning any induced noise current goes straight to earth and not into the instrument.

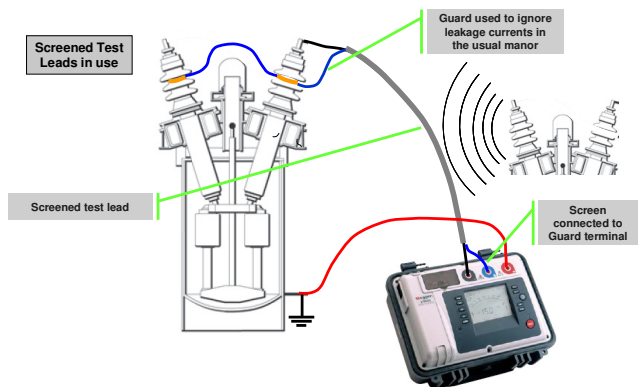



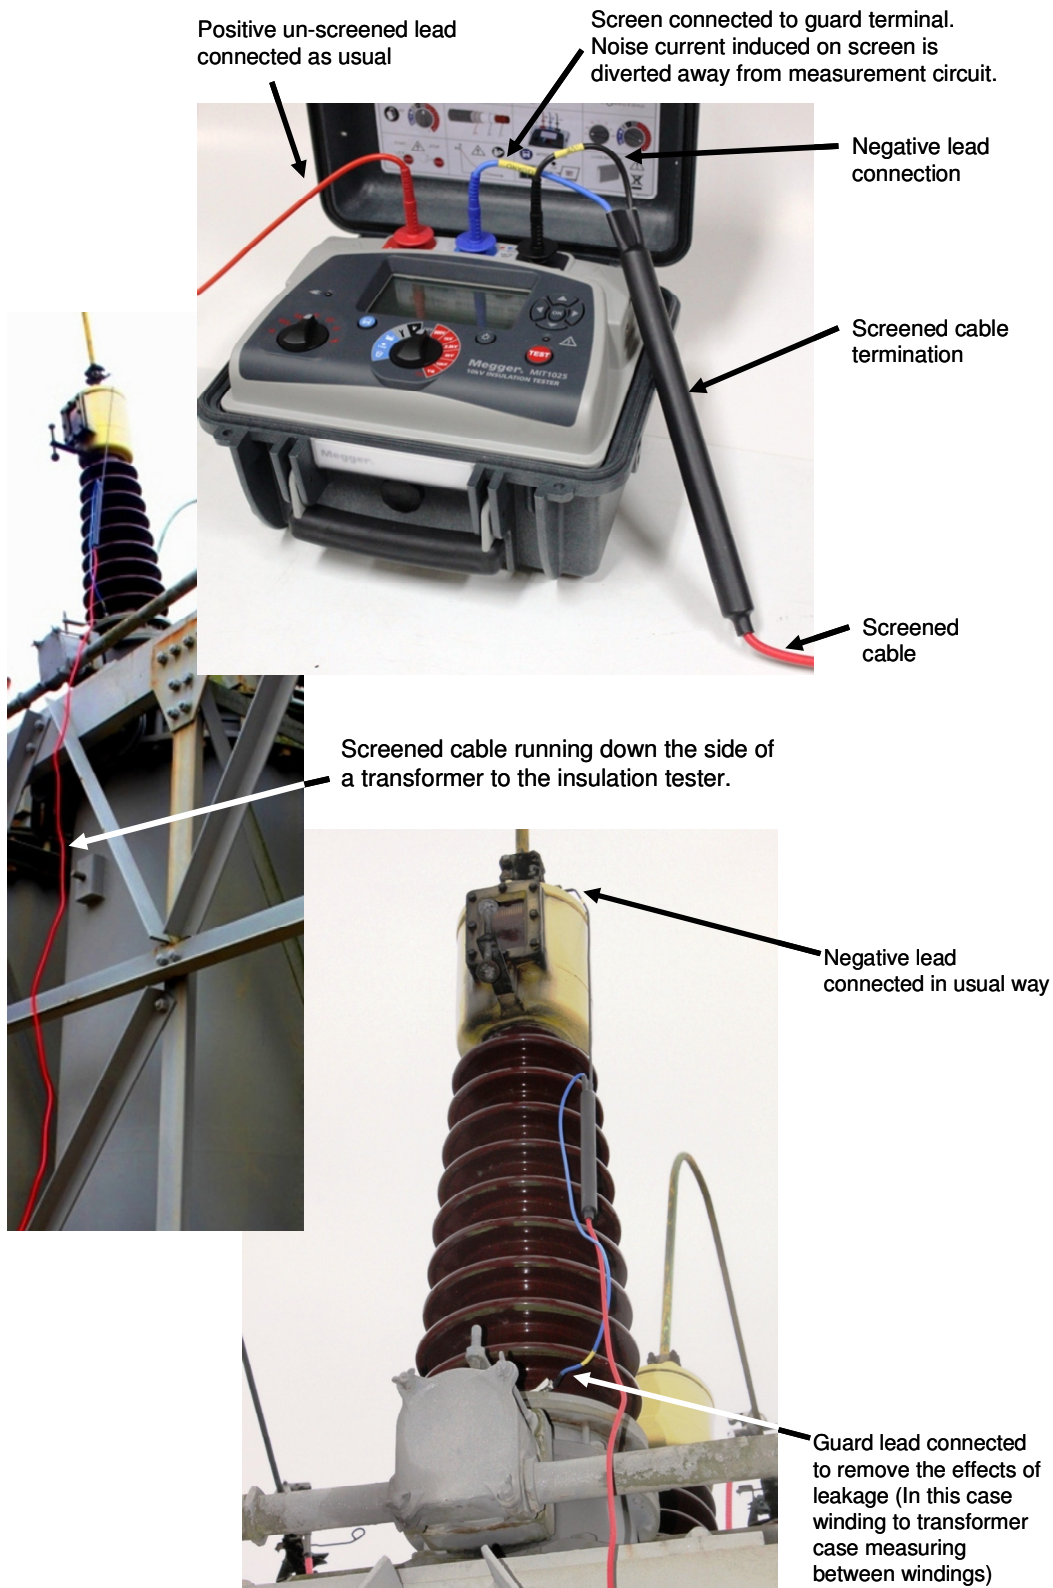

Screened test lead set in use:



Screened test leads are an important accessory for those working in high noise environments, and/or locations where test lead leakage could be a problem.

5kV and 10kV test lead selection chart

Clip type		Leads supplied as standard and optional											
		5 kV Insulation testers					10 kV Insulation testers						
		BM15	MJ15	MIT515	MIT525	S1-552/2	S1-554/2	MIT1025	S1-1052/2	S1-1054/2			
Medium test clip lead * 	Cat. No.	Description	Safety CAT rating	BM15	MJ15	MIT515	MIT525	S1-552/2	S1-554/2	MIT1025	S1-1052/2	S1-1054/2	
	1002-531	3m (10ft), 6 kV MEDIUM insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
	1002-641	5m (16ft), 6 kV MEDIUM insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-642	8m (26ft), 6 kV MEDIUM insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-643	10m (33ft), 6 kV MEDIUM insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-644	15m (50ft), 6 kV MEDIUM insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-534	3m (10ft), 10 kV LARGE insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input checked="" type="checkbox"/>	
	1002-645	5m (16ft), 10 kV LARGE insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-646	8m (26ft), 10 kV LARGE insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-647	10m (33ft), 10 kV LARGE insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	1002-648	15m (50ft), 10 kV LARGE insulated clip, set of 3	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
	Large test clip lead * 	8101-181	3m (10ft), BARE COMPACT clip, set of 3	NONE	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
8101-182		8m (26ft), BARE COMPACT clip, set of 3	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
8101-183		15m (50ft), BARE COMPACT clip, set of 3	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6220-835		3m (10ft), BARE COMPACT clip, 5 kV SCREENED black lead, 3 clips, 2 leads	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6311-080		15m (50ft), BARE COMPACT clip, 5 kV SCREENED black lead, 3 clips, 2 leads	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6220-834		3m (10ft), BARE COMPACT clip, 10 kV SCREENED black lead, 3 clips, 2 leads	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	
6220-861		10m (33ft), BARE COMPACT clip, 10 kV SCREENED black lead, 3 clips, 2 leads	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input checked="" type="checkbox"/>
6220-833		15m (50ft), BARE COMPACT clip, 10 kV SCREENED black lead, 3 clips, 2 leads	NONE	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Control circuit 1 kV 		6220-822	3m (10ft), 1kV insulated probe and clip set for CONTROL CIRCUIT TESTING, set of 2	Clip = CATIII Probe = CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
		1002-913	1.25m (4ft) 1kV insulated FUSED probe and clip set for <1 kV voltage measurements, set of 2.	CATIV 600V	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>	<input type="checkbox"/>
Fused 1 kV 													

* These test leads may also be supplied in non-standard lead lengths to suit a particular application / requirement. Please contact Megger for a quotation, minimum order quantities may apply

= Optional = Supplied as standard

ADDITIONAL SAFETY WARNINGS

Safety Warnings must be observed during use.

- The circuit under test must be switched off, de-energised, isolated and checked to be safe before insulation test connections are made. Make sure the circuit is not reenergised whilst the instrument is connected.
- Circuit connections must not be touched during an insulation test.
- After completing a test, capacitive circuits must be completely discharged before disconnecting the test leads. Capacitive charges can be lethal.
- Tested items should be firmly shorted out with a shorting link, after discharge, until required for use. This is to guard against any stored dielectric absorption charge subsequently being released thereby raising the voltage to potentially dangerous levels.
- Test leads, including crocodile clips, must be in good order, clean, dry and with no broken or cracked insulation.
- The lead set should not be used if any part of it is damaged.
- These accessories are not designed to provide full levels of safety isolation to the operator if touched. The required physical dimensions would render this impractical. Safe working practices must be used.
- All safety warnings in the instruments user guide must be fully read and observed during use.