




Single Zone Heating Performance Curves

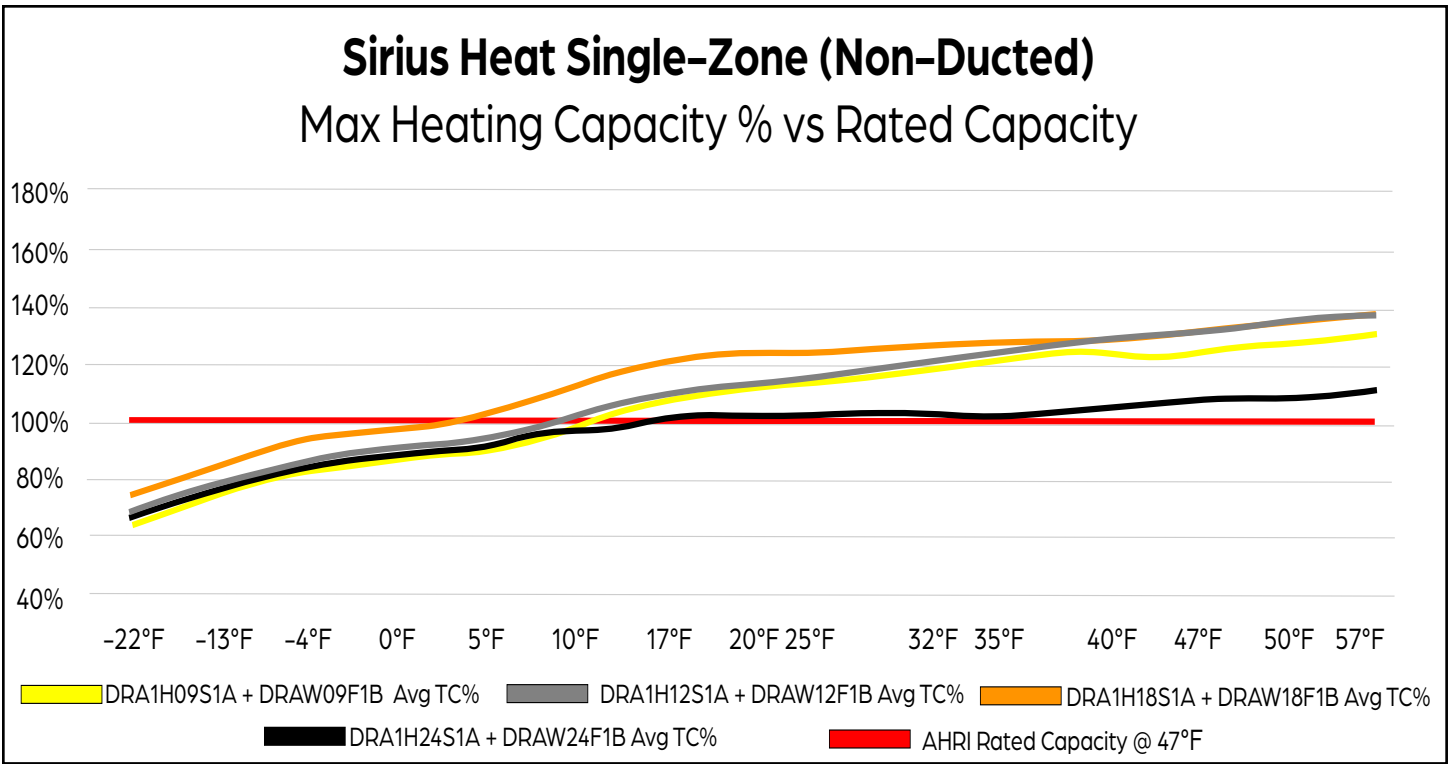

Sirius Heat Non-Ducted Heating Performance Data*

HEATING		OutDoor Temperature															
Unit	Indoor		-22°F	-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-30°C	-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1H09S1A + DRAW09F1B	60°F (15.6°C)	TC	8.27	9.47	10.62	11.03	11.38	12.49	13.64	14.09	14.53	14.94	15.48	15.44	15.57	16.03	16.47
		Input	1.76	1.79	1.70	1.67	1.62	1.69	1.76	1.77	1.74	1.74	1.72	1.49	1.32	1.29	1.24
	65°F (18.3°C)	TC	7.99	9.21	10.27	10.72	11.09	12.15	13.26	13.67	14.16	14.49	14.97	15.05	15.04	15.53	15.92
		Input	1.81	1.84	1.75	1.71	1.67	1.74	1.82	1.81	1.79	1.77	1.76	1.53	1.36	1.32	1.28
	70°F (21.1°C)	TC	7.78	8.94	9.94	10.40	10.80	11.84	12.90	13.30	13.70	14.10	14.52	14.58	14.66	15.02	15.39
		Input	1.85	1.89	1.80	1.75	1.71	1.79	1.87	1.85	1.83	1.81	1.80	1.56	1.38	1.35	1.31
	75°F (23.9°C)	TC	7.45	8.58	9.56	9.96	10.41	11.33	12.41	12.75	13.22	13.60	13.94	14.07	14.00	14.36	14.72
		Input	1.90	1.95	1.86	1.80	1.76	1.84	1.93	1.90	1.88	1.87	1.85	1.60	1.43	1.39	1.35

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.



Sirius Heat Non-Ducted Heating Performance Data* cont.

HEATING			OutDoor Temperature														
Unit	Indoor		-22°F	-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-30°C	-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1H12S1A + DRAW12F1B	60°F (15.6°C)	TC	8.37	9.67	10.76	11.32	11.72	12.64	13.85	14.14	14.61	14.97	15.58	16.12	16.42	16.87	17.29
		Input	1.77	1.80	1.71	1.68	1.62	1.68	1.73	1.72	1.71	1.69	1.68	1.55	1.47	1.44	1.40
	65°F (18.3°C)	TC	8.14	9.41	10.47	10.93	11.39	12.28	13.41	13.68	14.25	14.58	15.09	15.58	15.88	16.37	16.70
		Input	1.82	1.85	1.75	1.72	1.67	1.72	1.77	1.76	1.75	1.74	1.71	1.59	1.51	1.47	1.44
	70°F (21.1°C)	TC	7.92	9.11	10.12	10.60	11.00	11.89	12.96	13.34	13.77	14.17	14.59	15.08	15.49	15.88	16.27
		Input	1.88	1.89	1.80	1.77	1.71	1.77	1.82	1.81	1.79	1.77	1.76	1.64	1.55	1.51	1.47
	75°F (23.9°C)	TC	7.59	8.75	9.68	10.13	10.62	11.45	12.46	12.76	13.15	13.59	14.04	14.49	14.79	15.21	15.53
		Input	1.93	1.94	1.86	1.81	1.77	1.81	1.87	1.86	1.85	1.82	1.80	1.69	1.60	1.56	1.51
DRA1H18S1A + DRAW18F1B	60°F (15.6°C)	TC	13.60	15.60	17.45	18.03	18.80	20.87	22.62	22.78	23.00	23.12	23.41	23.81	24.31	25.36	25.60
		Input	2.91	2.98	2.84	2.77	2.68	2.85	3.02	2.90	2.75	2.65	2.56	2.29	2.07	2.01	1.96
	65°F (18.3°C)	TC	13.22	15.09	16.89	17.52	18.27	20.18	22.03	22.15	22.37	22.49	22.75	23.16	23.69	24.50	24.88
		Input	2.99	3.04	2.91	2.83	2.75	2.93	3.11	2.96	2.83	2.72	2.63	2.34	2.12	2.07	2.01
	70°F (21.1°C)	TC	12.78	14.69	16.32	16.96	17.74	19.69	21.45	21.59	21.74	21.90	22.05	22.53	23.07	23.67	24.22
		Input	3.06	3.12	2.97	2.89	2.83	3.02	3.18	3.04	2.91	2.79	2.69	2.42	2.18	2.13	2.07
	75°F (23.9°C)	TC	12.24	14.06	15.70	16.27	17.09	18.90	20.48	20.64	20.96	21.09	21.06	21.56	22.17	22.70	23.35
		Input	3.17	3.21	3.08	2.97	2.92	3.11	3.26	3.12	3.00	2.88	2.76	2.48	2.25	2.19	2.14
DRA1H24S1A + DRAW24F1B	60°F (15.6°C)	TC	17.97	20.90	23.33	24.22	25.14	26.22	27.21	27.14	27.54	27.68	27.48	28.38	29.22	29.79	30.30
		Input	4.11	4.08	3.88	3.77	3.65	3.79	3.85	3.80	3.74	3.67	3.63	3.29	2.94	2.86	2.79
	65°F (18.3°C)	TC	17.36	20.31	22.54	23.45	24.36	25.43	26.42	26.42	26.61	26.75	26.68	27.58	28.32	28.89	29.50
		Input	4.19	4.16	3.99	3.86	3.76	3.87	3.94	3.89	3.85	3.76	3.71	3.36	3.02	2.94	2.86
	70°F (21.1°C)	TC	16.87	19.62	21.80	22.79	23.70	24.74	25.60	25.70	25.81	25.92	26.03	26.73	27.41	28.13	28.78
		Input	4.29	4.27	4.07	3.96	3.88	3.98	4.05	3.99	3.93	3.87	3.82	3.43	3.10	3.01	2.94
	75°F (23.9°C)	TC	16.25	18.87	21.02	21.78	22.77	23.68	24.50	24.68	24.88	25.01	25.12	25.68	26.18	26.89	27.75
		Input	4.42	4.42	4.20	4.06	4.01	4.10	4.19	4.11	4.03	4.00	3.93	3.53	3.20	3.12	3.02

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.

DB --- Dry Bulb


WB --- Wet Bulb

TC --- Total Net Capacity (1000 Btu/hour)

Input --- Total Power (kW)



Single Zone Heating Performance Curves

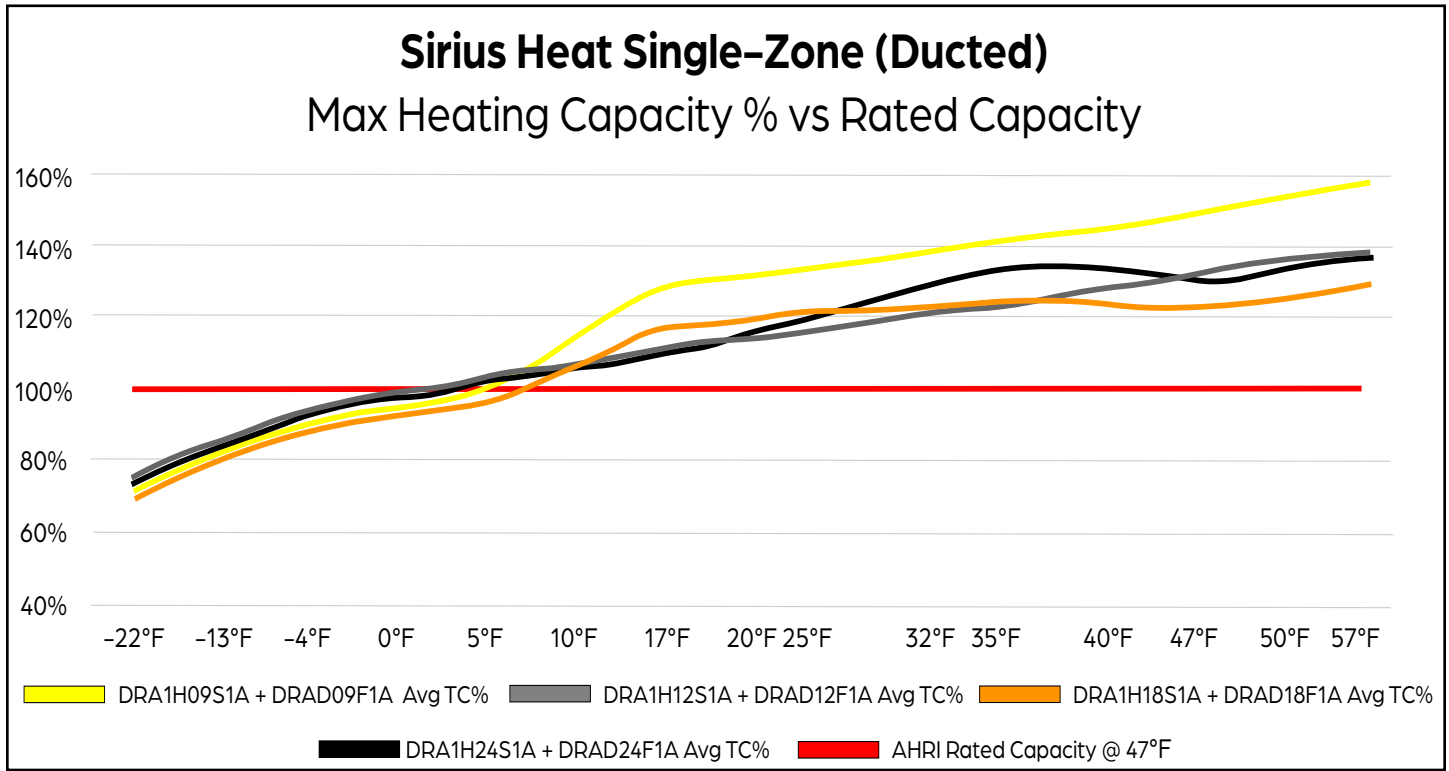

Sirius Heat Ducted Heating Performance Data*

HEATING			OutDoor Temperature														
Unit	Indoor		-22°F	-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-30°C	-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1H09S1A + DRAD09F1A	60°F (15.6°C)	TC	7.56	8.61	9.65	10.07	10.42	12.08	13.45	13.78	14.16	14.63	14.81	15.10	15.55	16.04	16.49
		Input	1.73	1.70	1.63	1.59	1.55	1.72	1.82	1.86	1.89	1.93	2.00	1.64	1.42	1.37	1.36
	65°F (18.3°C)	TC	7.35	8.40	9.41	9.83	10.16	11.75	13.08	13.42	13.72	14.13	14.39	14.73	15.11	15.59	15.96
		Input	1.77	1.75	1.67	1.63	1.60	1.75	1.86	1.90	1.94	1.99	2.05	1.68	1.46	1.41	1.39
	70°F (21.1°C)	TC	7.13	8.20	9.11	9.54	9.90	11.44	12.73	13.04	13.36	13.67	14.02	14.36	14.72	15.10	15.45
		Input	1.81	1.80	1.71	1.67	1.63	1.80	1.90	1.95	2.00	2.05	2.11	1.73	1.50	1.45	1.42
	75°F (23.9°C)	TC	6.81	7.85	8.78	9.16	9.46	10.97	12.19	12.55	12.84	13.19	13.39	13.81	14.05	14.50	14.88
		Input	1.86	1.86	1.76	1.72	1.68	1.85	1.95	2.01	2.07	2.11	2.16	1.77	1.55	1.49	1.46

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.



Sirius Heat Ducted Heating Performance Data* cont.

HEATING			OutDoor Temperature														
Unit	Indoor		-22°F	-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-30°C	-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1H12S1A + DRAD12F1A	60°F (15.6°C)	TC	9.62	10.95	12.11	12.79	13.26	13.88	14.56	15.03	15.48	15.80	16.34	16.85	17.37	17.71	18.18
		Input	2.00	2.03	1.93	1.91	1.87	1.87	1.85	1.83	1.79	1.76	1.73	1.55	1.39	1.36	1.33
	65°F (18.3°C)	TC	9.29	10.63	11.77	12.38	12.88	13.55	14.09	14.53	14.97	15.40	15.94	16.31	16.83	17.23	17.62
		Input	2.06	2.09	1.99	1.96	1.91	1.91	1.91	1.88	1.84	1.80	1.78	1.58	1.42	1.40	1.36
	70°F (21.1°C)	TC	8.99	10.33	11.48	11.98	12.48	13.10	13.75	14.15	14.58	15.00	15.42	15.85	16.34	16.75	17.15
		Input	2.11	2.15	2.05	2.00	1.95	1.96	1.96	1.93	1.89	1.86	1.83	1.63	1.47	1.43	1.39
	75°F (23.9°C)	TC	8.65	9.87	11.02	11.44	12.00	12.54	13.13	13.57	13.92	14.38	14.78	15.15	15.76	16.11	16.48
		Input	2.17	2.21	2.11	2.06	2.01	2.02	2.02	1.99	1.95	1.91	1.88	1.67	1.50	1.46	1.43
DRA1H18S1A + DRAD18F1A	60°F (15.6°C)	TC	13.82	16.06	17.78	18.69	19.32	21.42	23.32	23.96	24.12	24.52	24.74	24.70	24.45	24.98	25.62
		Input	2.94	3.00	2.87	2.75	2.70	2.89	2.99	2.92	2.83	2.73	2.68	2.36	2.07	2.00	1.96
	65°F (18.3°C)	TC	13.44	15.64	17.26	18.08	18.81	20.76	22.73	23.20	23.51	23.78	24.12	24.01	23.83	24.35	24.90
		Input	3.01	3.06	2.92	2.83	2.76	2.95	3.08	3.00	2.89	2.79	2.74	2.43	2.13	2.05	2.01
	70°F (21.1°C)	TC	12.99	15.11	16.79	17.48	18.25	20.15	22.09	22.46	22.80	23.16	23.51	23.33	23.11	23.66	24.27
		Input	3.07	3.14	2.99	2.89	2.84	3.02	3.17	3.06	2.96	2.88	2.80	2.48	2.17	2.10	2.06
	75°F (23.9°C)	TC	12.50	14.43	16.15	16.87	17.43	19.45	21.30	21.45	21.96	22.30	22.52	22.49	22.10	22.76	23.22
		Input	3.17	3.23	3.09	2.98	2.94	3.11	3.28	3.16	3.07	2.95	2.89	2.54	2.24	2.17	2.13
DRA1H24S1A + DRAD24F1A	60°F (15.6°C)	TC	19.05	22.00	24.33	25.50	26.73	27.80	28.57	30.46	32.31	33.65	34.97	34.93	34.28	35.18	35.75
		Input	3.76	3.77	3.55	3.48	3.38	3.25	3.13	3.17	3.19	3.26	3.30	2.80	2.37	2.32	2.27
	65°F (18.3°C)	TC	18.48	21.47	23.74	24.76	26.00	27.01	27.88	29.46	31.31	32.83	34.11	33.75	33.41	33.99	34.84
		Input	3.84	3.85	3.64	3.56	3.48	3.34	3.22	3.25	3.29	3.36	3.37	2.89	2.43	2.37	2.32
	70°F (21.1°C)	TC	17.89	20.80	23.11	24.13	25.12	26.13	27.09	28.72	30.25	31.75	33.28	32.83	32.28	33.10	33.89
		Input	3.94	3.93	3.74	3.67	3.56	3.44	3.29	3.35	3.39	3.43	3.47	2.95	2.51	2.44	2.38
	75°F (23.9°C)	TC	17.08	19.95	22.30	23.28	24.17	25.13	25.95	27.57	29.19	30.61	31.88	31.58	30.89	31.68	32.37
		Input	4.04	4.04	3.86	3.76	3.65	3.53	3.38	3.46	3.48	3.55	3.56	3.04	2.59	2.52	2.46

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.

DB --- Dry Bulb


WB --- Wet Bulb

TC --- Total Net Capacity (1000 Btu/hour)

Input --- Total Power (kW)



Single Zone Heating Performance Curves

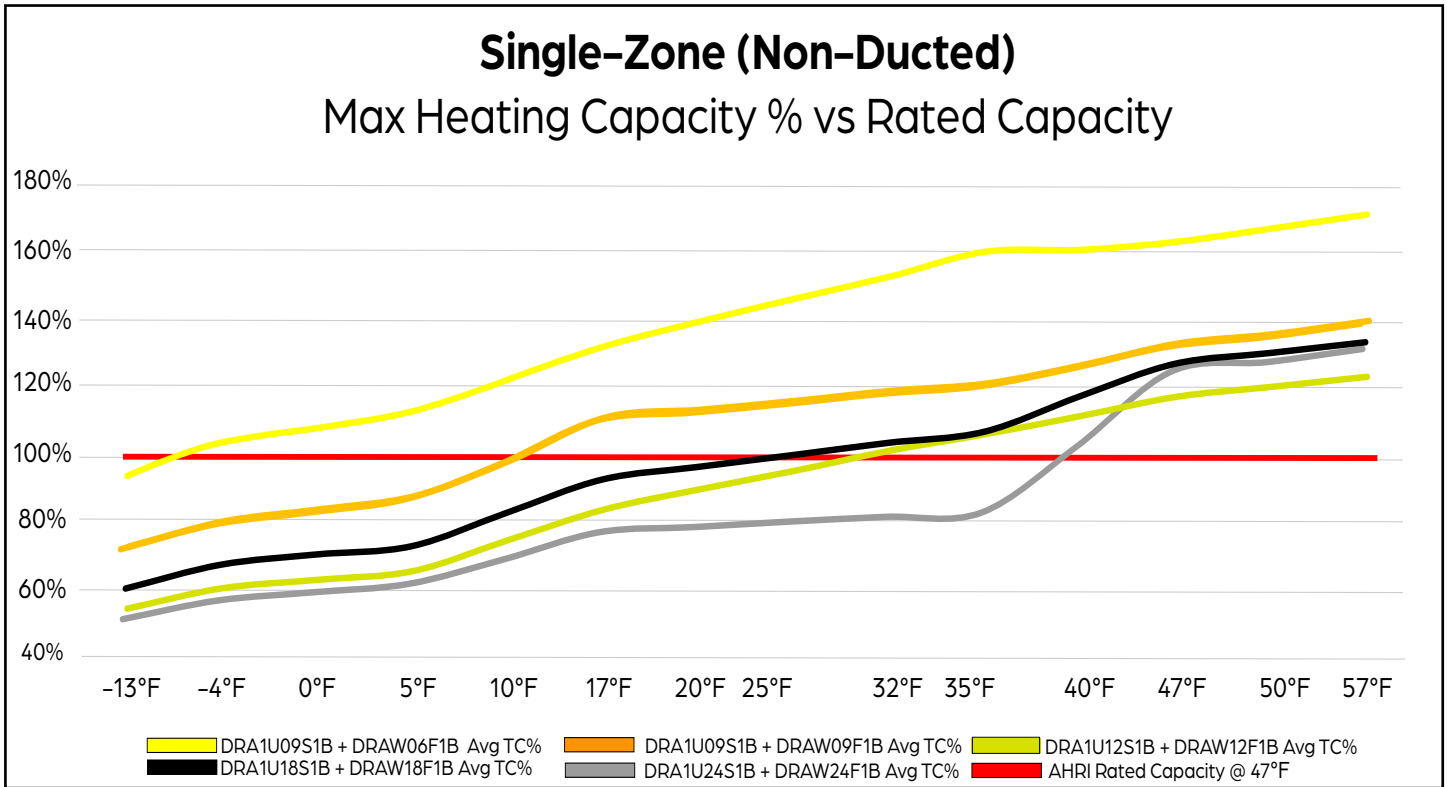

Non-Ducted Heating Performance Data*

HEATING			OutDoor Temperature													
Unit	Indoor Temperature		-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1U09S1B + DRAW06F1B	60°F (15.6°C)	TC	6.90	7.59	7.90	8.25	8.99	9.63	10.21	10.70	11.15	11.72	11.73	11.96	12.20	12.60
		Input	1.21	1.15	1.11	1.09	1.14	1.18	1.19	1.19	1.21	1.19	1.15	1.12	1.10	1.06
	65°F (18.3°C)	TC	6.68	7.35	7.70	8.05	8.72	9.40	9.95	10.43	10.85	11.42	11.44	11.60	11.85	12.22
		Input	1.24	1.18	1.14	1.12	1.17	1.21	1.21	1.22	1.24	1.23	1.19	1.15	1.13	1.10
	70°F (21.1°C)	TC	6.46	7.17	7.47	7.80	8.45	9.17	9.65	10.12	10.57	11.04	11.14	11.24	11.55	11.80
		Input	1.27	1.21	1.17	1.15	1.20	1.24	1.25	1.26	1.26	1.27	1.23	1.18	1.15	1.12
	75°F (23.9°C)	TC	6.18	6.91	7.14	7.52	8.08	8.76	9.22	9.67	10.20	10.64	10.65	10.84	11.15	11.29
		Input	1.31	1.25	1.21	1.19	1.23	1.28	1.29	1.29	1.31	1.30	1.26	1.21	1.18	1.16

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.



Non-Ducted Heating Performance Data* cont.

HEATING			OutDoor Temperature													
Unit	Indoor		-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1U09S1B + DRAW06F1B	60°F (15.6°C)	TC	7.59	8.34	8.68	9.15	10.27	11.57	11.78	12.02	12.38	12.63	13.18	13.84	14.08	14.57
		Input	1.19	1.14	1.11	1.07	1.18	1.31	1.27	1.22	1.18	1.14	1.10	1.08	1.06	1.04
	65°F (18.3°C)	TC	7.34	8.08	8.47	8.85	9.94	11.21	11.44	11.70	12.00	12.27	12.83	13.41	13.74	14.12
		Input	1.22	1.16	1.14	1.10	1.21	1.34	1.29	1.24	1.21	1.17	1.13	1.11	1.08	1.06
	70°FFF (21.1°C)	TC	7.09	7.88	8.21	8.56	9.61	10.90	11.15	11.41	11.66	11.89	12.44	13.07	13.38	13.72
		Input	1.25	1.19	1.16	1.13	1.24	1.37	1.32	1.28	1.24	1.20	1.16	1.15	1.11	1.09
	75°F°F (23.9°C)	TC	6.82	7.53	7.88	8.26	9.21	10.45	10.68	10.98	11.25	11.36	11.90	12.57	12.80	13.15
		Input	1.29	1.22	1.20	1.17	1.27	1.41	1.36	1.31	1.29	1.24	1.20	1.18	1.14	1.12
DRA1U12S1B + DRAW12F1B	60°F (15.6°C)	TC	6.79	7.55	7.87	8.17	9.30	10.44	11.22	11.93	12.67	13.24	13.96	14.61	15.04	15.34
		Input	1.17	1.11	1.09	1.07	1.13	1.17	1.22	1.25	1.28	1.31	1.29	1.25	1.21	1.19
	65°F (18.3°C)	TC	6.58	7.29	7.61	7.97	9.03	10.19	10.84	11.56	12.31	12.90	13.49	14.19	14.54	14.94
		Input	1.20	1.13	1.12	1.09	1.16	1.20	1.26	1.28	1.32	1.35	1.32	1.29	1.25	1.22
	70°FFF (21.1°C)	TC	6.37	7.08	7.39	7.70	8.81	9.84	10.54	11.21	11.90	12.52	13.13	13.80	14.12	14.49
		Input	1.23	1.17	1.14	1.11	1.19	1.24	1.28	1.32	1.36	1.38	1.35	1.33	1.29	1.26
	75°F°F (23.9°C)	TC	6.10	6.82	7.08	7.35	8.44	9.43	10.17	10.71	11.39	11.95	12.61	13.30	13.62	13.97
		Input	1.26	1.20	1.18	1.15	1.22	1.27	1.31	1.37	1.40	1.43	1.39	1.37	1.33	1.30
DRA1U18S1B + DRAW18F1B	60°F (15.6°C)	TC	11.34	12.72	13.32	13.72	15.72	17.48	18.16	18.83	19.60	20.18	22.23	23.96	24.44	25.21
		Input	1.61	1.52	1.49	1.44	1.62	1.81	1.85	1.86	1.90	1.91	1.80	1.74	1.68	1.64
	65°F (18.3°C)	TC	11.06	12.36	12.96	13.39	15.19	16.99	17.72	18.34	18.94	19.59	21.48	23.31	23.84	24.40
		Input	1.65	1.56	1.52	1.48	1.65	1.85	1.89	1.90	1.95	1.96	1.83	1.78	1.72	1.68
	70°FFF (21.1°C)	TC	10.79	11.99	12.55	13.03	14.70	16.51	17.14	17.73	18.38	18.98	20.83	22.54	23.12	23.67
		Input	1.68	1.60	1.56	1.53	1.71	1.90	1.93	1.96	1.99	2.02	1.89	1.82	1.77	1.73
	75°F°F (23.9°C)	TC	10.37	11.57	12.00	12.45	14.11	15.81	16.44	17.10	17.69	18.19	19.92	21.60	22.31	22.72
		Input	1.73	1.65	1.61	1.58	1.76	1.95	1.99	2.02	2.06	2.08	1.94	1.88	1.82	1.79
DRA1U24S1B + DRAW24F1B	60°F (15.6°C)	TC	13.92	15.44	16.12	16.75	18.83	20.96	21.26	21.83	22.23	22.40	27.83	33.76	34.45	35.79
		Input	2.90	2.76	2.68	2.64	2.59	2.59	2.60	2.63	2.62	2.64	2.85	3.00	2.91	2.87
	65°F (18.3°C)	TC	13.54	14.93	15.62	16.25	18.19	20.35	20.72	21.23	21.48	21.83	27.01	32.84	33.58	34.78
		Input	2.97	2.82	2.73	2.69	2.66	2.65	2.66	2.70	2.70	2.72	2.92	3.07	3.00	2.93
	70°FFF (21.1°C)	TC	13.09	14.54	15.11	15.80	17.66	19.71	20.12	20.51	20.89	21.26	26.20	32.00	32.72	33.60
		Input	3.03	2.89	2.82	2.75	2.73	2.72	2.74	2.76	2.78	2.79	2.98	3.16	3.07	3.00
	75°F°F (23.9°C)	TC	12.55	13.96	14.55	15.19	16.88	18.89	19.39	19.61	20.04	20.41	25.23	30.88	31.55	32.16
		Input	3.14	2.98	2.90	2.83	2.81	2.80	2.84	2.84	2.87	2.89	3.05	3.24	3.16	3.10

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.

DB --- Dry Bulb


WB --- Wet Bulb

TC --- Total Net Capacity (1000 Btu/hour)

Input --- Total Power (kW)



Single Zone Heating Performance Curves

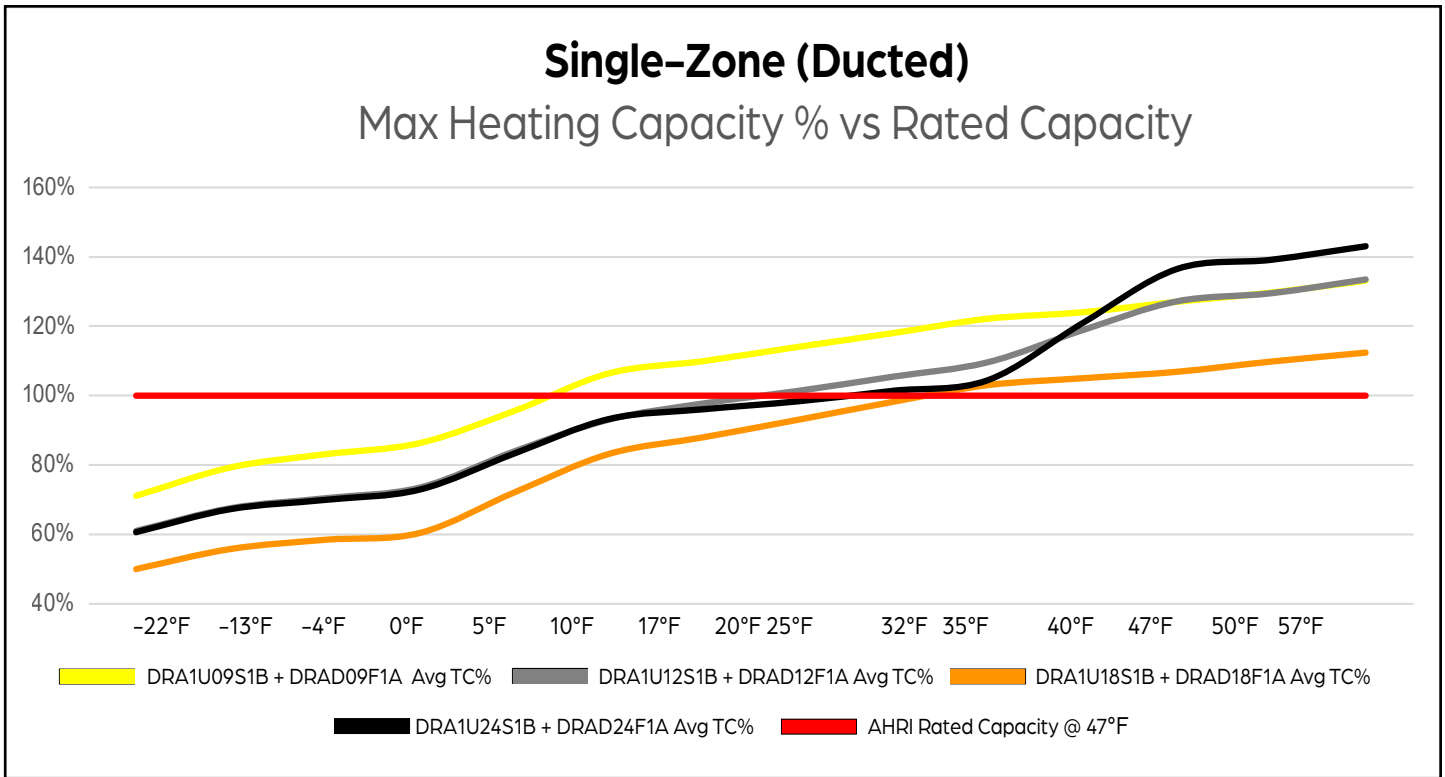

Ducted Heating Performance Data*

Heating			OutDoor Temperature													
Unit	Indoor		-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1U09S1B + DRAD09F1A	60°F (15.6°C)	TC	7.45	8.28	8.72	9.06	10.05	11.18	11.48	11.93	12.35	12.87	12.95	13.27	13.51	13.96
		Input	1.09	1.04	1.02	0.99	1.08	1.19	1.17	1.18	1.17	1.18	1.12	1.09	1.06	1.03
	65°F (18.3°C)	TC	7.22	8.07	8.43	8.78	9.75	10.81	11.20	11.64	12.00	12.43	12.59	12.93	13.18	13.50
		Input	1.12	1.07	1.05	1.02	1.11	1.21	1.21	1.21	1.20	1.21	1.15	1.11	1.09	1.06
	70°F (21.1°C)	TC	7.04	7.82	8.19	8.50	9.43	10.50	10.86	11.26	11.63	12.03	12.28	12.53	12.85	13.16
		Input	1.15	1.10	1.07	1.05	1.14	1.25	1.24	1.24	1.24	1.24	1.18	1.14	1.11	1.08
	75°F (23.9°C)	TC	6.73	7.55	7.90	8.19	9.01	10.08	10.44	10.79	11.22	11.53	11.78	12.08	12.33	12.63
		Input	1.18	1.14	1.10	1.07	1.18	1.28	1.28	1.28	1.28	1.27	1.21	1.17	1.15	1.12

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.



Ducted Heating Performance Data* cont.

HEATING			OutDoor Temperature													
Unit	Indoor		-13°F	-4°F	0°F	5°F	10°F	17°F	20°F	25°F	32°F	35°F	40°F	47°F	50°F	57°F
			-25°C	-20°C	-17.8°C	-15°C	-12.2°C	-8.3°C	-6.7°C	-3.9°C	0°C	1.7°C	40.5°C	8.3°C	10°C	13.9°C
DRA1U12S1B + DRAD12F1A	60°F (15.6°C)	TC	7.67	8.48	8.84	9.26	10.58	11.67	12.29	12.71	13.29	13.80	14.94	16.03	16.26	16.80
		Input	1.20	1.15	1.12	1.09	1.15	1.19	1.18	1.20	1.20	1.20	1.20	1.22	1.23	1.19
	65°F (18.3°C)	TC	7.46	8.24	8.61	8.98	10.24	11.37	11.91	12.37	12.85	13.44	14.52	15.55	15.80	16.30
		Input	1.23	1.18	1.14	1.12	1.18	1.21	1.21	1.23	1.23	1.24	1.26	1.27	1.23	1.20
	70°F (21.1°C)	TC	7.21	8.01	8.36	8.71	9.93	11.08	11.58	12.05	12.50	12.99	14.11	15.07	15.42	15.82
		Input	1.27	1.21	1.18	1.15	1.21	1.24	1.25	1.26	1.26	1.26	1.29	1.30	1.26	1.23
	75°F (23.9°C)	TC	6.94	7.70	8.00	8.34	9.56	10.58	11.16	11.55	12.00	12.40	13.49	14.42	14.72	15.19
		Input	1.31	1.24	1.21	1.19	1.25	1.28	1.29	1.29	1.29	1.30	1.32	1.34	1.31	1.27
DRA1U18S1B + DRAD18F1A	60°F (15.6°C)	TC	10.47	11.75	12.31	12.61	15.14	17.46	18.44	19.38	20.57	21.58	22.02	22.30	22.98	23.60
		Input	1.67	1.58	1.56	1.50	1.67	1.79	1.88	1.96	2.01	2.10	1.84	1.63	1.58	1.56
	65°F (18.3°C)	TC	10.20	11.39	11.89	12.29	14.64	16.90	17.93	18.89	20.03	20.91	21.36	21.76	22.40	22.85
		Input	1.71	1.63	1.60	1.54	1.71	1.85	1.93	2.01	2.07	2.16	1.90	1.67	1.63	1.59
	70°F (21.1°C)	TC	9.91	11.01	11.52	11.97	14.27	16.44	17.40	18.41	19.37	20.38	20.74	21.16	21.73	22.22
		Input	1.75	1.67	1.64	1.59	1.76	1.89	1.97	2.06	2.13	2.21	1.95	1.71	1.66	1.63
	75°F (23.9°C)	TC	9.46	10.52	11.08	11.49	13.66	15.78	16.65	17.77	18.61	19.55	19.89	20.28	20.75	21.25
		Input	1.81	1.72	1.68	1.63	1.82	1.94	2.03	2.13	2.20	2.28	2.00	1.76	1.71	1.67
DRA1U24S1B + DRAD24F1A	60°F (15.6°C)	TC	15.62	17.36	18.08	18.76	21.47	24.07	24.72	25.24	26.27	27.00	31.17	35.21	35.87	36.90
		Input	2.47	2.36	2.29	2.23	2.33	2.38	2.40	2.40	2.40	2.40	2.47	2.55	2.48	2.40
	65°F (18.3°C)	TC	15.17	16.86	17.48	18.20	20.83	23.25	24.02	24.55	25.41	26.14	30.21	34.19	34.75	35.65
		Input	2.53	2.43	2.34	2.30	2.39	2.45	2.46	2.46	2.45	2.46	2.55	2.61	2.53	2.48
	70°F (21.1°C)	TC	14.70	16.33	16.97	17.75	20.28	22.66	23.32	23.95	24.60	25.30	29.36	33.10	33.87	34.75
		Input	2.61	2.49	2.40	2.37	2.45	2.52	2.52	2.51	2.51	2.51	2.63	2.66	2.59	2.53
	75°F (23.9°C)	TC	14.14	15.63	16.28	17.02	19.39	21.78	22.48	23.06	23.49	24.32	28.18	31.84	32.49	33.53
		Input	2.70	2.56	2.48	2.44	2.51	2.59	2.59	2.58	2.60	2.59	2.70	2.75	2.66	2.60

* Estimated performance only. Specific performance may vary based on the installation and ambient environment.

DB --- Dry Bulb

WB --- Wet Bulb

TC --- Total Net Capacity (1000 Btu/hour)

Input --- Total Power (kW)