


	29 V= BUS KNX
$X =$	$x = 2$
	4 x ($\varnothing 0,6 < \text{---} < \varnothing 0,8$) 8 mm
	-5°C → +45°C





PC

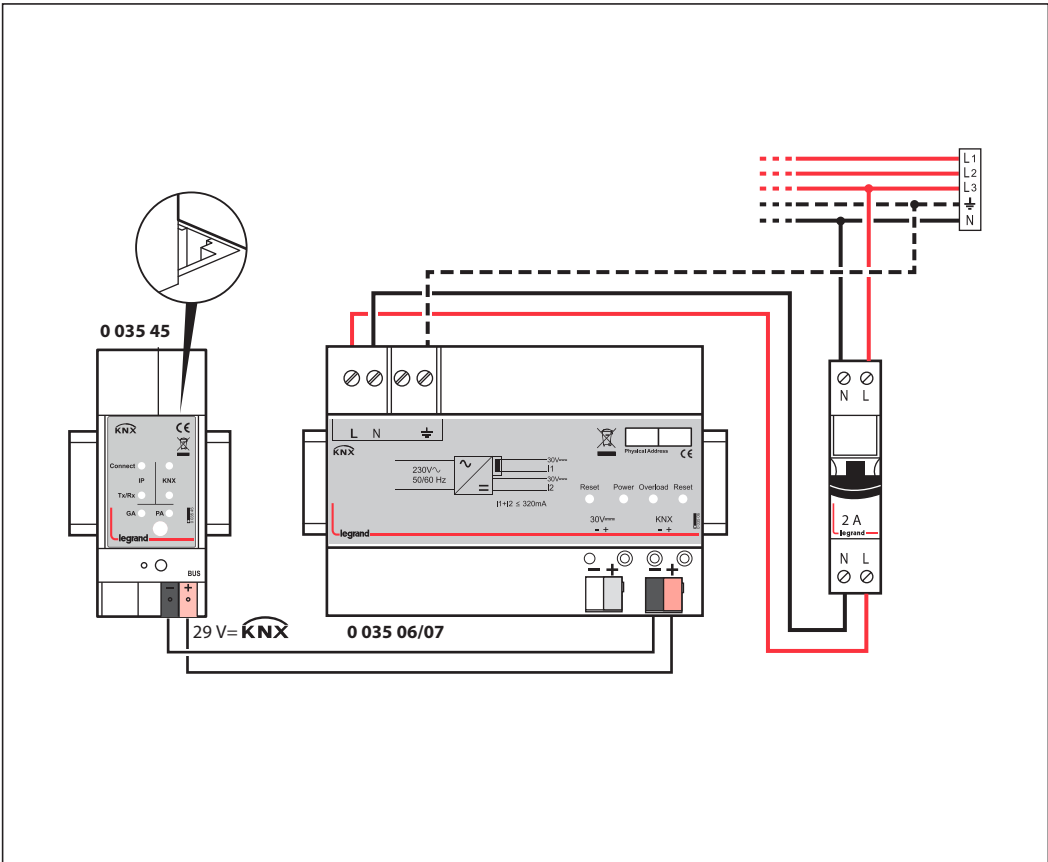

0 779 01


IP

0 035 45

0 035 06/07

0 035 06/07

0 035 45

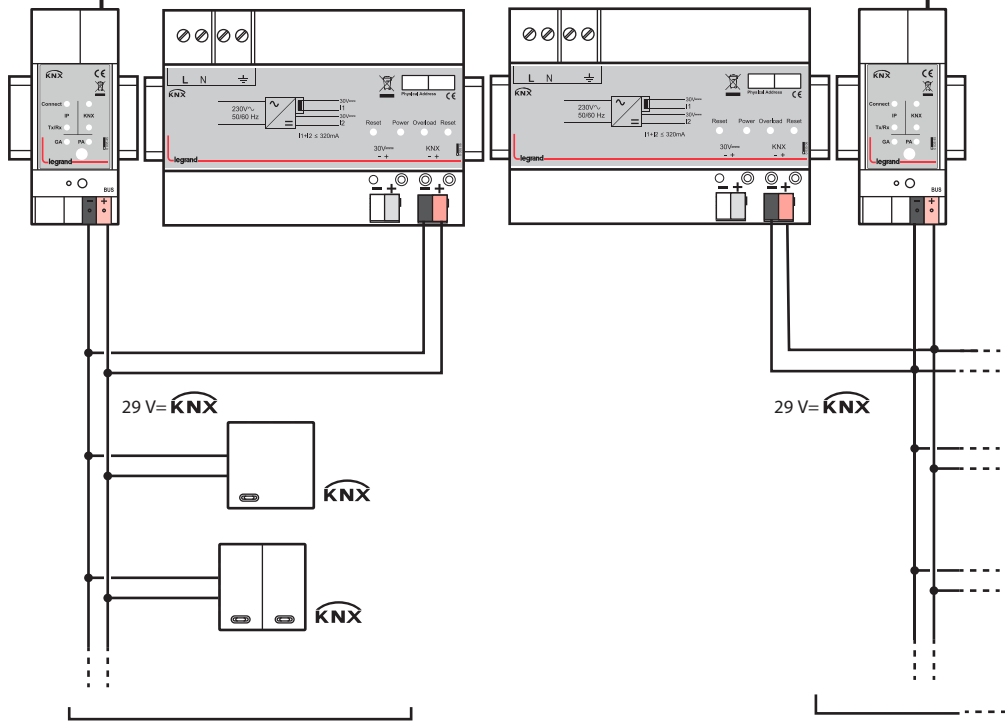

• Ligne 1 • Line 1 • Linea 1

• Ligne 2 • Line 2 • Linea 2