Product Environmental Profile

RM Control Relay








ENVPEP1504008EN_V2 05/2019



Representative product	RM Control Relay - RM22UA33MR				
Description of the product	RM control relay product monitors and detects abnormal operating conditions concerning phase, current, voltage, frequency, speed, or temperature. The relays inform users of abnormal conditio and allow them to initiate the necessary corrective actions before serious and costly breakdowns can occur.				
Description of the range	Depending on the product model, control relay products are categorized into 8 product families of 3-phase control, current control, voltage control, frequency control, speed control, lift temperature control, level control and pump control. Products are with the functions of monitoring, informing, protecting, managing and commissioning.				
	The environmental impacts of this referenced product are representative of the impacts of the other products of the range which are developed with a similar technology.				
Functional unit	To switch ON/OFF electrical contacts when the abnormal operating conditions is detected during 10 years and a 100% use rate.				

Constituent materials

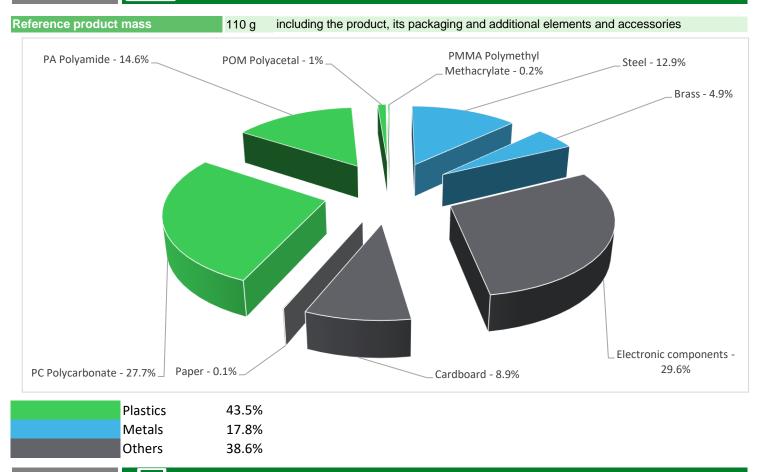

E | Substance assessment

Products of this range are designed in conformity with the requirements of the RoHS directive (European Directive 2011/65/EU of 8 June 2011) and do not contain, or only contain in the authorised proportions, lead, mercury, cadmium, hexavalent chromium or flame retardants (polybrominated biphenyls - PBB, polybrominated diphenyl ethers - PBDE) as mentioned in the Directive

As the products of the range are designed in accordance with the RoHS Directive (European Directive 2002/95/EC of 27 January 2003), they can be incorporated without any restriction in an assembly or an installation subject to this Directive.

Details of ROHS and REACH substances information are available on the Schneider-Electric Green Premium website http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page

ENVPEP1504008EN V2 05/2019

Additional environmental information


The RM Control Relay presents the following relevent environmental aspects							
Manufacturing	Manufactured at a Schneider Electric production site ISO14001 certified						
Distribution	Weight and volume of the packaging optimized, based on the European Union's packaging directive Packaging weight is 10.1 g, consisting of Cardboard (98.4%), Paper(1.6%) Packaging recycled materials is 100% of total packaging mass.						
Installation	RM22UA33MR does not require any installation operations.						
Use	The product does not require special maintenance operations.						
	End of life optimized to decrease the amount of waste and allow recovery of the product components and materials This product contains PCBA assembly(33.4g) that should be separated from the stream of waste so as to optimize end-of-life treatment.						
End of life	The location of these components and other recommendations are given in the End of Life Instruction document which is available on the Schneider-Electric Green Premium website						
	http://www2.schneider-electric.com/sites/corporate/en/products-services/green-premium/green-premium.page						
	Based on "ECO'DEEE recyclability and recoverability calculation method" Recyclability potential: 24% (version V1, 20 Sep. 2008 presented to the French Agency for Environment and Energy Management: ADEME).						

Environmental impacts

Reference life time	10 years					
Product category	Other equipments - Active product					
Installation elements	No special components needed					
Use scenario	The product is in active mode with a power use of 1.5 W for 10 years at a 100% use rate.					
Geographical representativeness	Europe					
Technological representativeness	RM control relay product monitors and detects abnormal operating conditions concerning phase, current, voltage, frequency, speed, or temperature. The relays inform users of abnormal conditions and allow them to initiate the necessary corrective actions before serious and costly breakdowns can occur.					
	Manufacturing	Installation	Use	End of life		
Energy model used	Energy model used: Indonesia	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27	Electricity grid mix; AC; consumption mix, at consumer; < 1kV; EU-27		

RM Control Relay - RM22UA33MR						
Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
kg Sb eq	7.16E-04	7.11E-04	0*	0*	5.59E-06	0*
$kg SO_2 eq$	2.75E-01	6.00E-03	6.48E-05	0*	2.69E-01	4.61E-05
kg PO ₄ 3- eq	1.87E-02	2.42E-03	1.49E-05	0*	1.62E-02	2.12E-05
kg CO ₂ eq	6.67E+01	2.26E+00	1.42E-02	0*	6.44E+01	6.39E-02
kg CFC11 eq	4.44E-06	2.40E-07	0*	0*	4.19E-06	2.21E-09
kg C ₂ H ₄ eq	1.53E-02	5.41E-04	4.62E-06	0*	1.48E-02	3.98E-06
Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
m3	2.33E+02	0*	0*	0*	2.33E+02	0*
MJ	1.32E+03	3.00E+01	2.01E-01	0*	1.29E+03	2.01E-01
	Unit kg Sb eq kg SO $_2$ eq kg PO $_4$ ³⁻ eq kg CO $_2$ eq kg CFC11 eq kg C $_2$ H $_4$ eq Unit m3	Unit Total kg Sb eq 7.16E-04 kg SO $_2$ eq 2.75E-01 kg PO $_4$ eq 1.87E-02 kg CO $_2$ eq 6.67E+01 kg CFC11 4.44E-06 kg C $_2$ H $_4$ eq 1.53E-02 Unit Total m3 2.33E+02	Unit Total Manufacturing kg Sb eq $7.16E-04$ $7.11E-04$ kg SO ₂ eq $2.75E-01$ $6.00E-03$ kg PO ₄ ^{3*} eq $1.87E-02$ $2.42E-03$ kg CO ₂ eq $6.67E+01$ $2.26E+00$ kg CFC11 eq $4.44E-06$ $2.40E-07$ kg C ₂ H ₄ eq $1.53E-02$ $5.41E-04$ Unit Total Manufacturing m3 $2.33E+02$ 0^*	Unit Total Manufacturing Distribution kg Sb eq $7.16E-04$ $7.11E-04$ 0^* kg SO ₂ eq $2.75E-01$ $6.00E-03$ $6.48E-05$ kg PO ₄ ³⁻ eq $1.87E-02$ $2.42E-03$ $1.49E-05$ kg CO ₂ eq $6.67E+01$ $2.26E+00$ $1.42E-02$ kg CFC11 eq $4.44E-06$ $2.40E-07$ 0^* kg C ₂ H ₄ eq $1.53E-02$ $5.41E-04$ $4.62E-06$ Unit Total Manufacturing Distribution m3 $2.33E+02$ 0^* 0^*	Unit Total Manufacturing Distribution Installation kg Sb eq $7.16E-04$ $7.11E-04$ 0^* 0^* kg SO ₂ eq $2.75E-01$ $6.00E-03$ $6.48E-05$ 0^* kg PO ₄ ^{3*} eq $1.87E-02$ $2.42E-03$ $1.49E-05$ 0^* kg CO ₂ eq $6.67E+01$ $2.26E+00$ $1.42E-02$ 0^* kg CFC11 eq $4.44E-06$ $2.40E-07$ 0^* 0^* kg C ₂ H ₄ eq $1.53E-02$ $5.41E-04$ $4.62E-06$ 0^* Unit Total Manufacturing Distribution Installation m3 $2.33E+02$ 0^* 0^* 0^*	Unit Total Manufacturing Distribution Installation Use kg Sb eq 7.16E-04 7.11E-04 0* 0* 5.59E-06 kg SO ₂ eq 2.75E-01 6.00E-03 6.48E-05 0* 2.69E-01 kg PO ₄ ³⁻ eq 1.87E-02 2.42E-03 1.49E-05 0* 1.62E-02 kg CO ₂ eq 6.67E+01 2.26E+00 1.42E-02 0* 6.44E+01 kg CFC11 eq 4.44E-06 2.40E-07 0* 0* 4.19E-06 kg C ₂ H ₄ eq 1.53E-02 5.41E-04 4.62E-06 0* 1.48E-02 Unit Total Manufacturing Distribution Installation Use m3 2.33E+02 0* 0* 0* 2.33E+02

ENVPEP1504008EN_V2 05/2019

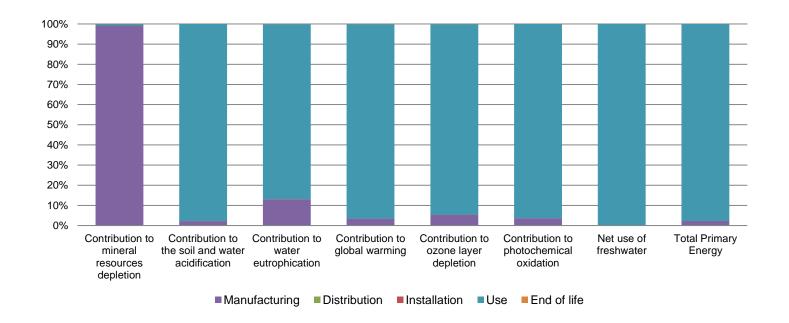

Optional indicators		RM Control	Relay - RM22UA3	3MR			
Impact indicators	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Contribution to fossil resources depletion	MJ	7.54E+02	2.28E+01	1.99E-01	0*	7.31E+02	1.64E-01
Contribution to air pollution	m³	3.04E+03	2.67E+02	6.04E-01	0*	2.77E+03	1.46E+00
Contribution to water pollution	m³	2.90E+03	2.43E+02	2.33E+00	0*	2.66E+03	2.89E+00
Resources use	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Use of secondary material	kg	6.46E-04	6.46E-04	0*	0*	0*	0*
Total use of renewable primary energy resources	MJ	1.64E+02	8.27E-01	0*	0*	1.64E+02	0*
Total use of non-renewable primary energy resources	MJ	1.15E+03	2.92E+01	2.00E-01	0*	1.12E+03	2.00E-01
Use of renewable primary energy excluding renewable primary energy used as raw material	MJ	1.64E+02	6.27E-01	0*	0*	1.64E+02	0*
Use of renewable primary energy resources used as raw material	MJ	2.00E-01	2.00E-01	0*	0*	0*	0*
Use of non renewable primary energy excluding non renewable primary energy used as raw material	MJ	1.15E+03	2.74E+01	2.00E-01	0*	1.12E+03	2.00E-01
Use of non renewable primary energy resources used as raw material	MJ	1.85E+00	1.85E+00	0*	0*	0*	0*
Use of non renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*
Use of renewable secondary fuels	MJ	0.00E+00	0*	0*	0*	0*	0*
Waste categories	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Hazardous waste disposed	kg	3.06E+00	2.81E+00	0*	0*	3.36E-02	2.15E-01
Non hazardous waste disposed	kg	2.41E+02	6.48E-01	0*	0*	2.40E+02	0*
Radioactive waste disposed	kg	1.61E-01	3.97E-04	0*	0*	1.60E-01	0*
Other environmental information	Unit	Total	Manufacturing	Distribution	Installation	Use	End of Life
Materials for recycling	kg	4.24E-02	7.88E-03	0*	1.01E-02	0*	2.45E-02
Components for reuse	kg	0.00E+00	0*	0*	0*	0*	0*
Materials for energy recovery	kg	1.68E-02	0*	0*	0*	0*	1.68E-02
Exported Energy	MJ	3.21E-05	3.01E-06	0*	2.90E-05	0*	0*

^{*} represents less than 0.01% of the total life cycle of the reference flow

Life cycle assessment performed with EIME version EIME v5.8.1, database version 2016-11 in compliance with ISO14044.

The use phase is the life cycle phase which has the greatest impact on the majority of environmental indicators (based on compulsory indicators).

ENVPEP1504008EN_V2 05/2019

According to this environmental analysis, proportionality rules may be used to evaluate the impacts of other products of this range.

Depending on the impact analysis, the mineral resources depletion of other products may be extrapolated by product mass, the water eutrophication of other products may be extrapolated 15% by product mass and 85% by energy consumption values, the rest of the environmental indicators of other products in this family may be proportional extrapolated by energy consumption values.

Please note that the values given above are only valid within the context specified and cannot be used directly to draw up the environmental assessment of an installation.

Registration number	ENVPEP1504008_V2	Drafting rules	PCR-ed3-EN-2015 04 02
Date of issue	05/2019	Supplemented by	PSR-0005-ed2-EN-2016 03 29
Validity period	5 years	Information and reference documents	www.pep-ecopassport.org

Independent verification of the declaration and data

Internal X External

The elements of the present PEP cannot be compared with elements from another program.

Document in compliance with ISO 14021:2016 « Environmental labels and declarations - Self-declared environmental claims (Type II environmental labelling) »

Schneider Electric Industries SAS

Country Customer Care Center http://www.schneider-electric.com/contact

35, rue Joseph Monier CS 30323 F- 92506 Rueil Malmaison Cedex RCS Nanterre 954 503 439 Capital social 896 313 776 €

www.schneider-electric.com

Published by Schneider Electric

ENVPEP1504008EN_V2

© 2019 - Schneider Electric - All rights reserved

05/2019