

Job or Customer :	
Location :	
Engineer :	
<input type="checkbox"/> Complies with Spec <input type="checkbox"/> Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

**Description**

Closed one end and 3/4" PEX insert on the other end. 1/2" branches in single row.

**Listings**

cNSFus-pw-G

**Standards**

ASTM F877  
ASTM F2159  
CSA B137.5  
NSF/ANSI 14  
NSF/ANSI 61  
NSF/ANSI 372

**Technical Data**


Material:..... Modified Polyphenylsulfone

Operating Pressure Rating:..... 180°F @ 100 psi (82.2°C @ 0.69 MPa)

**Codes**

IAPMO UPC

Qty	Stk. #	# of ports	Inlet	Outlet	Dimensions A	Weight
	13202M	2	3/4"	closed	3.502" (89.0 mm)	0.036 lb (0.016 kg)
	13203M	3	3/4"	closed	5.252" (133.4 mm)	0.054 lb (0.024 kg)
	13204M	4	3/4"	closed	7.002" (177.9 mm)	0.072 lb (0.033 kg)

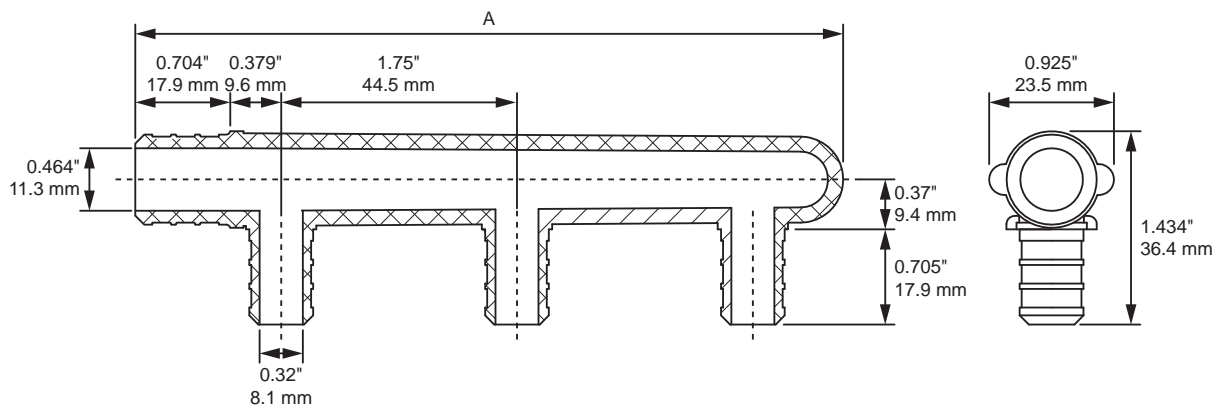

**Installation**

Installation must follow all of HeatLink's instructions and guidelines, found in the Potable Water Systems Installation Guide.

**Related Documents**

- Potable Water Systems Installation Guide (L3235)
- HeatLink Limited Plumbing Warranty

*This page is intentionally blank.*