

Job or Customer :	
Location :	
Engineer :	
☐ Complies with Spec ☐ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description

Closed one end and 3/4" or 1" PEX insert on the other end. 1/2" branches in single row or opposing rows.

Technical Data

Material:..... Modified Polyphenylsulfone
Operating Pressure Rating:..... 180°F @ 100 psi (82.2°C @ 0.69 MPa)

Listings

cNSFus-pw-G

Codes

IAPMO UPC

Standards

ASTM F877
ASTM F2159
CSA B137.5
NSF/ANSI 14
NSF/ANSI 61
NSF/ANSI 372


Qty	Stk. #	# of ports	Inlet	Outlet	Dimensions		Weight
	13203	3	3/4"	closed	5.43"	0.71"	0.117 lb
					(138 mm)	(18 mm)	(0.053 kg)
	13204	4	3/4"	closed	7.20"	0.71"	0.148 lb
					(183 mm)	(18 mm)	(0.067 kg)
	13206	6	3/4"	closed	10.75"	0.71"	0.227 lb
					(273 mm)	(18 mm)	(0.103 kg)
	13208	8	3/4"	closed	14.29"	0.71"	0.295 lb
					(363 mm)	(18 mm)	(0.134 kg)
	13806	6	1"	closed	10.75"	0.86"	0.216 lb
					(273 mm)	(21.8 mm)	(0.098 kg)
	13808	8	1"	closed	14.29"	0.86"	0.284 lb
					(363 mm)	(21.8 mm)	(0.129 kg)
	13833	3+3	1"	closed	5.43"	0.86"	0.132 lb
					(138 mm)	(21.8 mm)	(0.060 kg)
	13844	4+4	1"	closed	7.20"	0.86"	0.165 lb
					(183 mm)	(21.8 mm)	(0.075 kg)

Installation

Installation must follow all of HeatLink's instructions and guidelines.

Related Documents

- Potable Water Systems Installation Guide (L3235)
- HeatLink Limited Plumbing Warranty

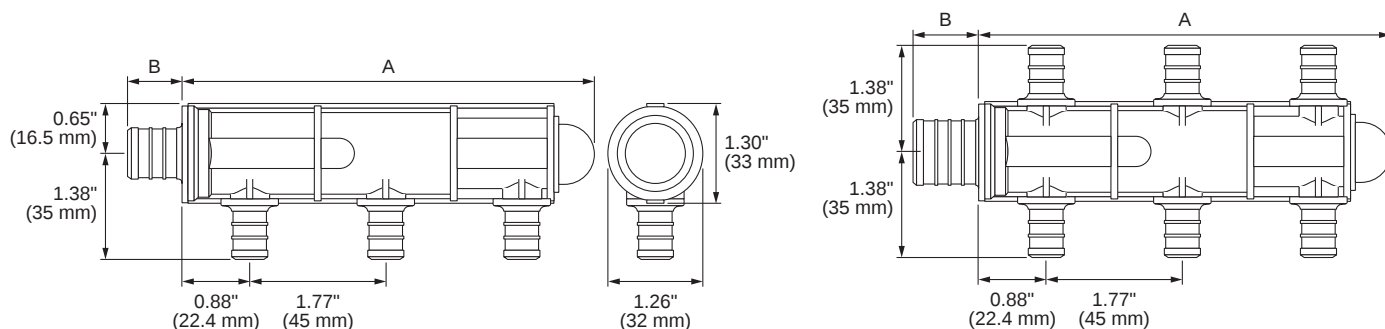

This page is intentionally blank.