

Job or Customer :	
Location :	
Engineer :	
☐ Complies with Spec ☐ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description

Open on both ends with 3/4" PEX insert connections. 1/2" branches in single row.

Listings

cNSFus-pw-G

Standards

ASTM F877
ASTM F2159
CSA B137.5
NSF/ANSI 14
NSF/ANSI 61
NSF/ANSI 372

Technical Data


Material:..... Modified Polyphenylsulfone

Operating Pressure Rating:..... 180°F @ 100 psi (82.2°C @ 0.69 MPa)

Codes

IAPMO UPC

Qty	Stk. #	# of ports	Inlet	Outlet	Dimensions		Weight
					A	B	
	14202M	2	3/4"	3/4"	3.916" (99.5 mm)	2.508" (63.7 mm)	0.039 lb (0.018 kg)
	14203M	3	3/4"	3/4"	5.665" (143.9 mm)	4.257" (108.1 mm)	0.058 lb (0.026 kg)
	14204M	4	3/4"	3/4"	7.415" (188.3 mm)	6.007" (152.6 mm)	0.076 lb (0.035 kg)

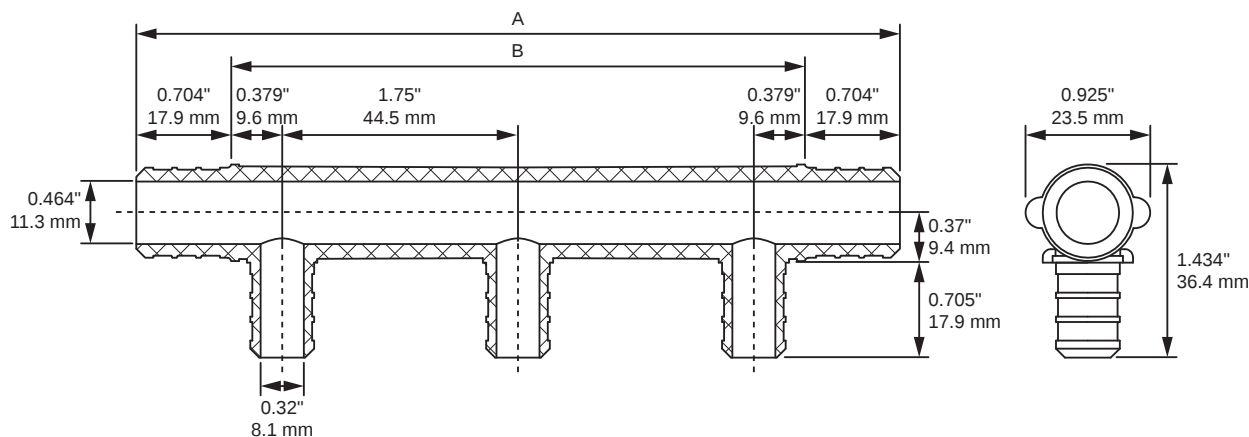

Installation

Installation must follow all of HeatLink's instructions and guidelines, found in the Potable Water Systems Installation Guide.

Related Documents

- Potable Water Systems Installation Guide (L3235)
- HeatLink Limited Plumbing Warranty

This page is intentionally blank.