

Job or Customer :	
Location :	
Engineer :	
☐ Complies with Spec ☐ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description

Open on both ends with ¾" or 1" PEX insert connections. ½" branches in single row or opposing rows.

Technical Data

Material:..... Modified Polyphenylsulfone
Operating Pressure Rating:..... 180°F @ 100 psi (82.2°C @ 0.69 MPa)

Listings

cNSFus-pw-G

Codes

IAPMO UPC

Standards

ASTM F877
ASTM F2159
CSA B137.5
NSF/ANSI 14
NSF/ANSI 61
NSF/ANSI 372


Qty	Stk. #	# of ports	Inlet	Outlet	Dimensions			Weight
					A	B	C	
	14203	3	¾"	¾"	4.92" (125 mm)	0.71" (18 mm)	0.71" (18 mm)	0.119 lb (0.054 kg)
	14204	4	¾"	¾"	6.69" (170 mm)	0.71" (18 mm)	0.71" (18 mm)	0.150 lb (0.068 kg)
	14703	3	1"	¾"	4.92" (125 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.134 lb (0.061 kg)
	14704	4	1"	¾"	6.69" (170 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.165 lb (0.075 kg)
	14706	6	1"	¾"	10.24" (260 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.227 lb (0.103 kg)
	14708	8	1"	¾"	13.78" (350 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.289 lb (0.131 kg)
	14233	3+3	¾"	¾"	4.92" (125 mm)	0.71" (18 mm)	0.71" (18 mm)	0.128 lb (0.058 kg)
	14244	4+4	¾"	¾"	6.69" (170 mm)	0.71" (18 mm)	0.71" (18 mm)	0.165 lb (0.075 kg)
	14733	3+3	1"	¾"	4.92" (125 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.128 lb (0.058 kg)
	14744	4+4	1"	¾"	6.69" (170 mm)	0.86" (21.8 mm)	0.71" (18 mm)	0.165 lb (0.075 kg)

Installation

Installation must follow all of HeatLink's instructions and guidelines.

Related Documents

- Potable Water Systems Installation Guide (L3235)
- HeatLink Limited Plumbing Warranty

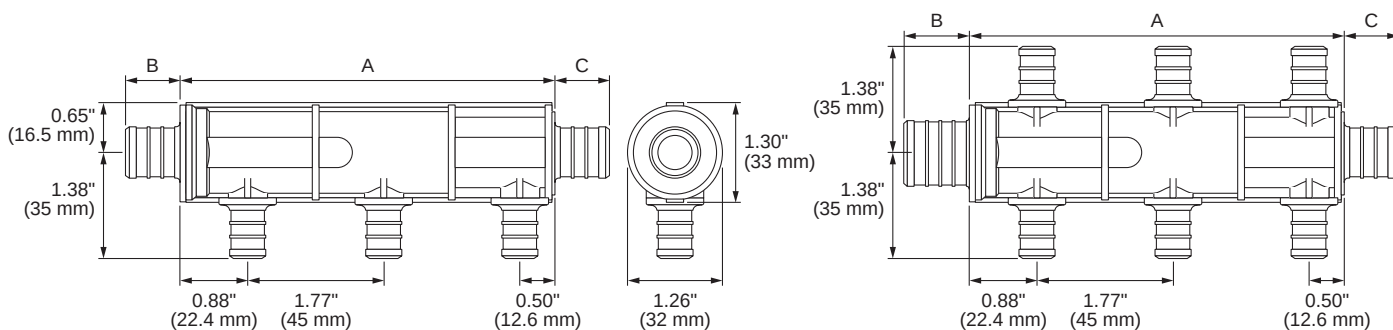

This page is intentionally blank.