



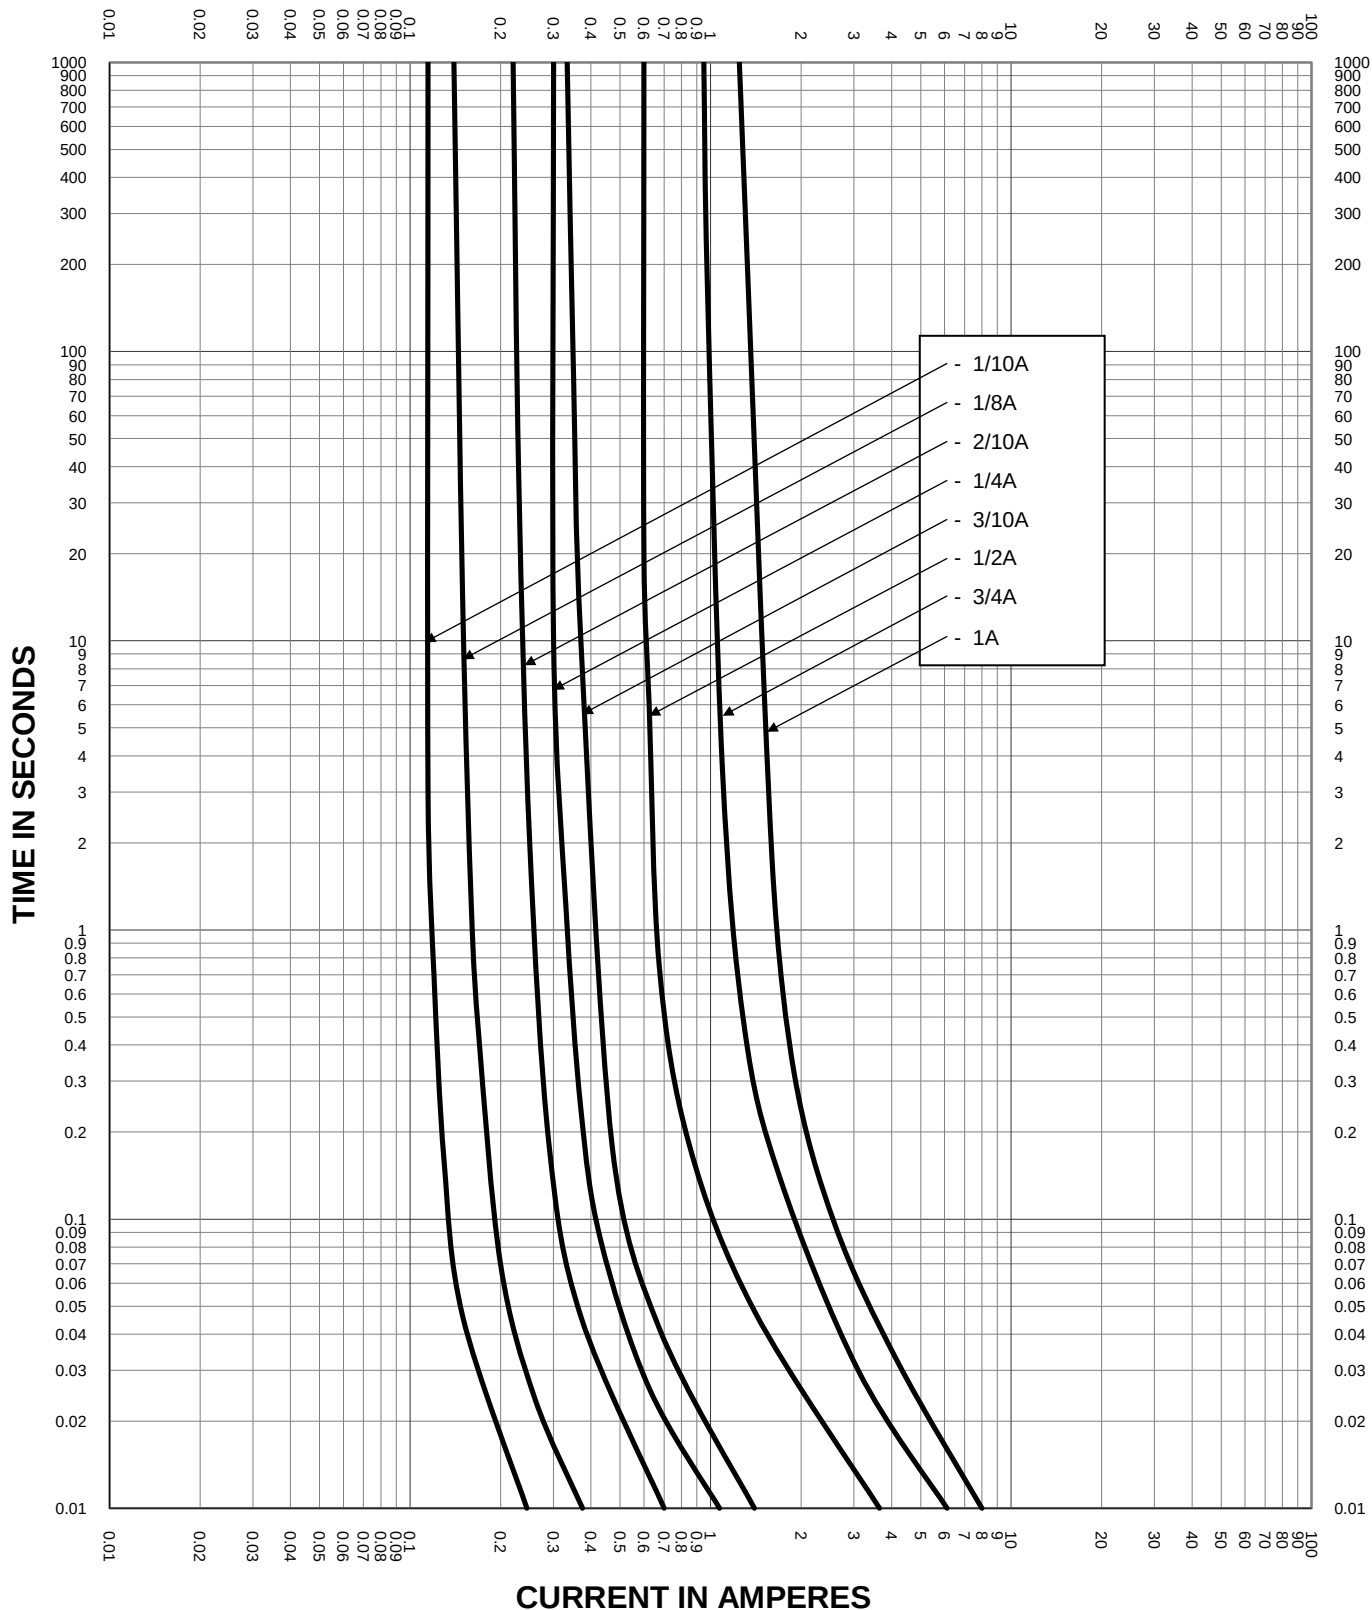


TEST VOLTAGE: 600V TIME CONSTANT/ POWER FACTOR:		FUSE CATALOG NUMBER KLKR 1/10A - 30A
BASIS FOR DATA:		
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 08/21/12 REVISION : A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 2 of 5 FCC01-KLKR

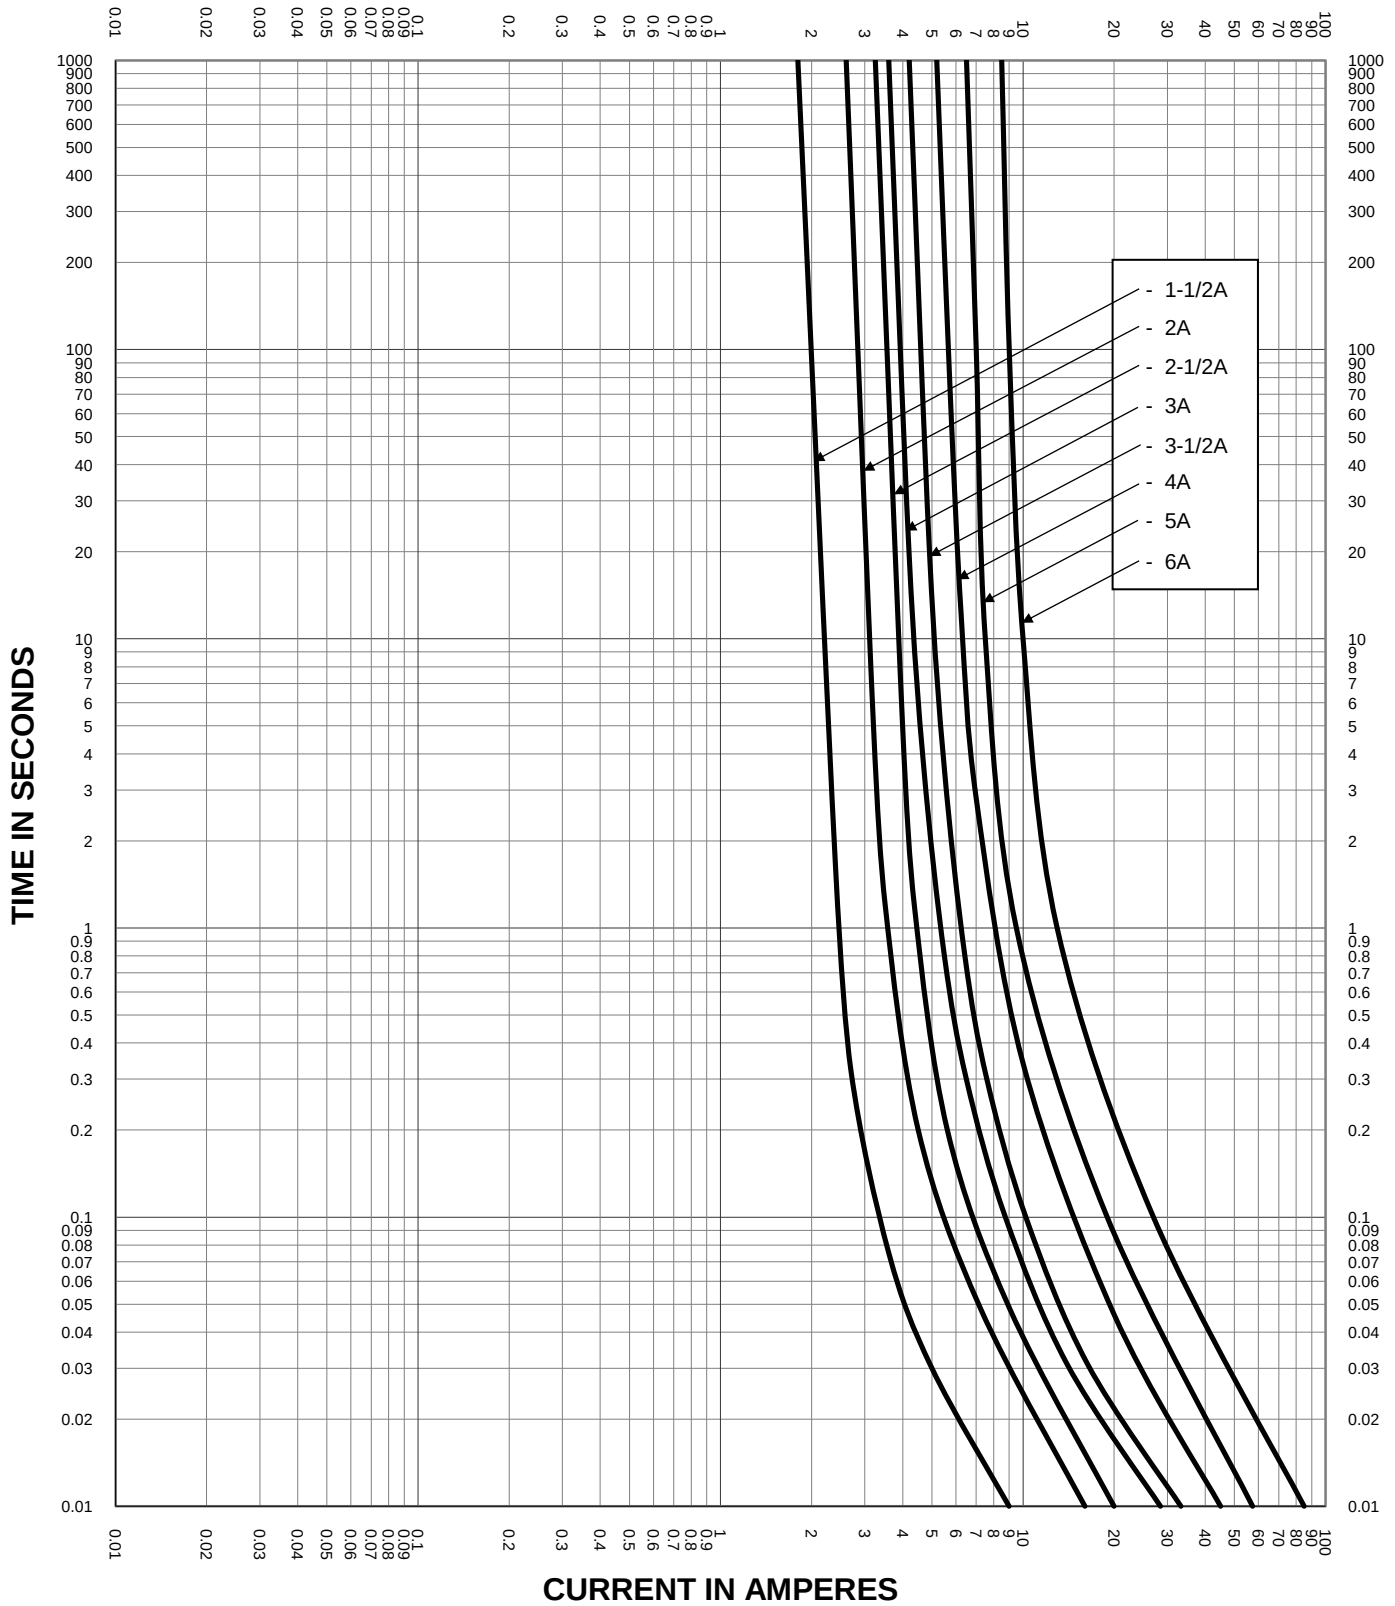


TEST VOLTAGE: 600V		TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER KLKR 1/10A - 30A
BASIS FOR DATA:			
		LITTELFUSE, INC. CHICAGO, IL, USA	DRAWN BY: LLL DATE: 08/21/12 REVISION : A
TIME CURRENT CHARACTERISTIC CURVES			DRAWING NO. Sheet 3 of 5 ECC01-KL KR

TIME IN SECONDS

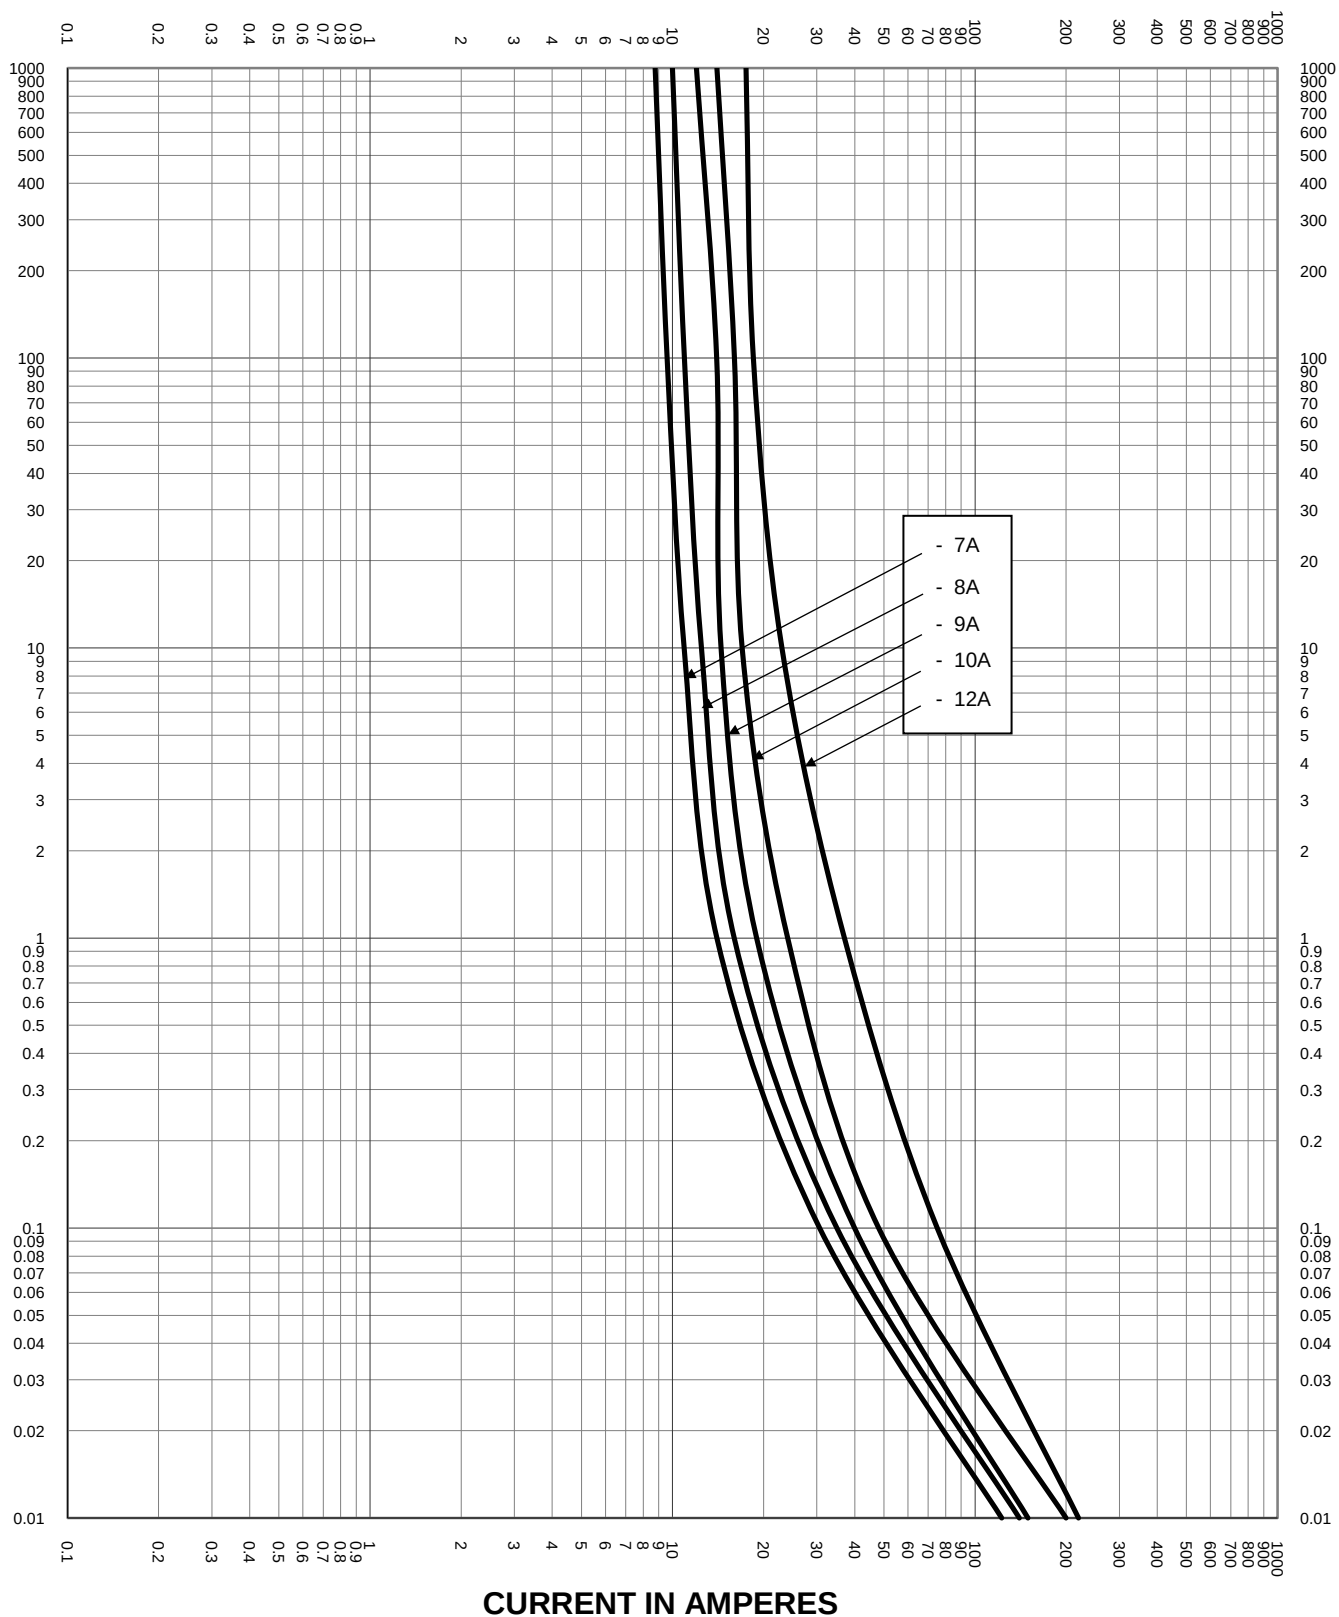

CURRENT IN AMPERES

TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		KLKR 1/10A - 30A
 LITTELFUSE, INC. CHICAGO, IL. USA	DRAWN BY: LLL	
	DATE: 08/21/12	
		REVISION : A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 4 of 5
		FCC01-KLKR

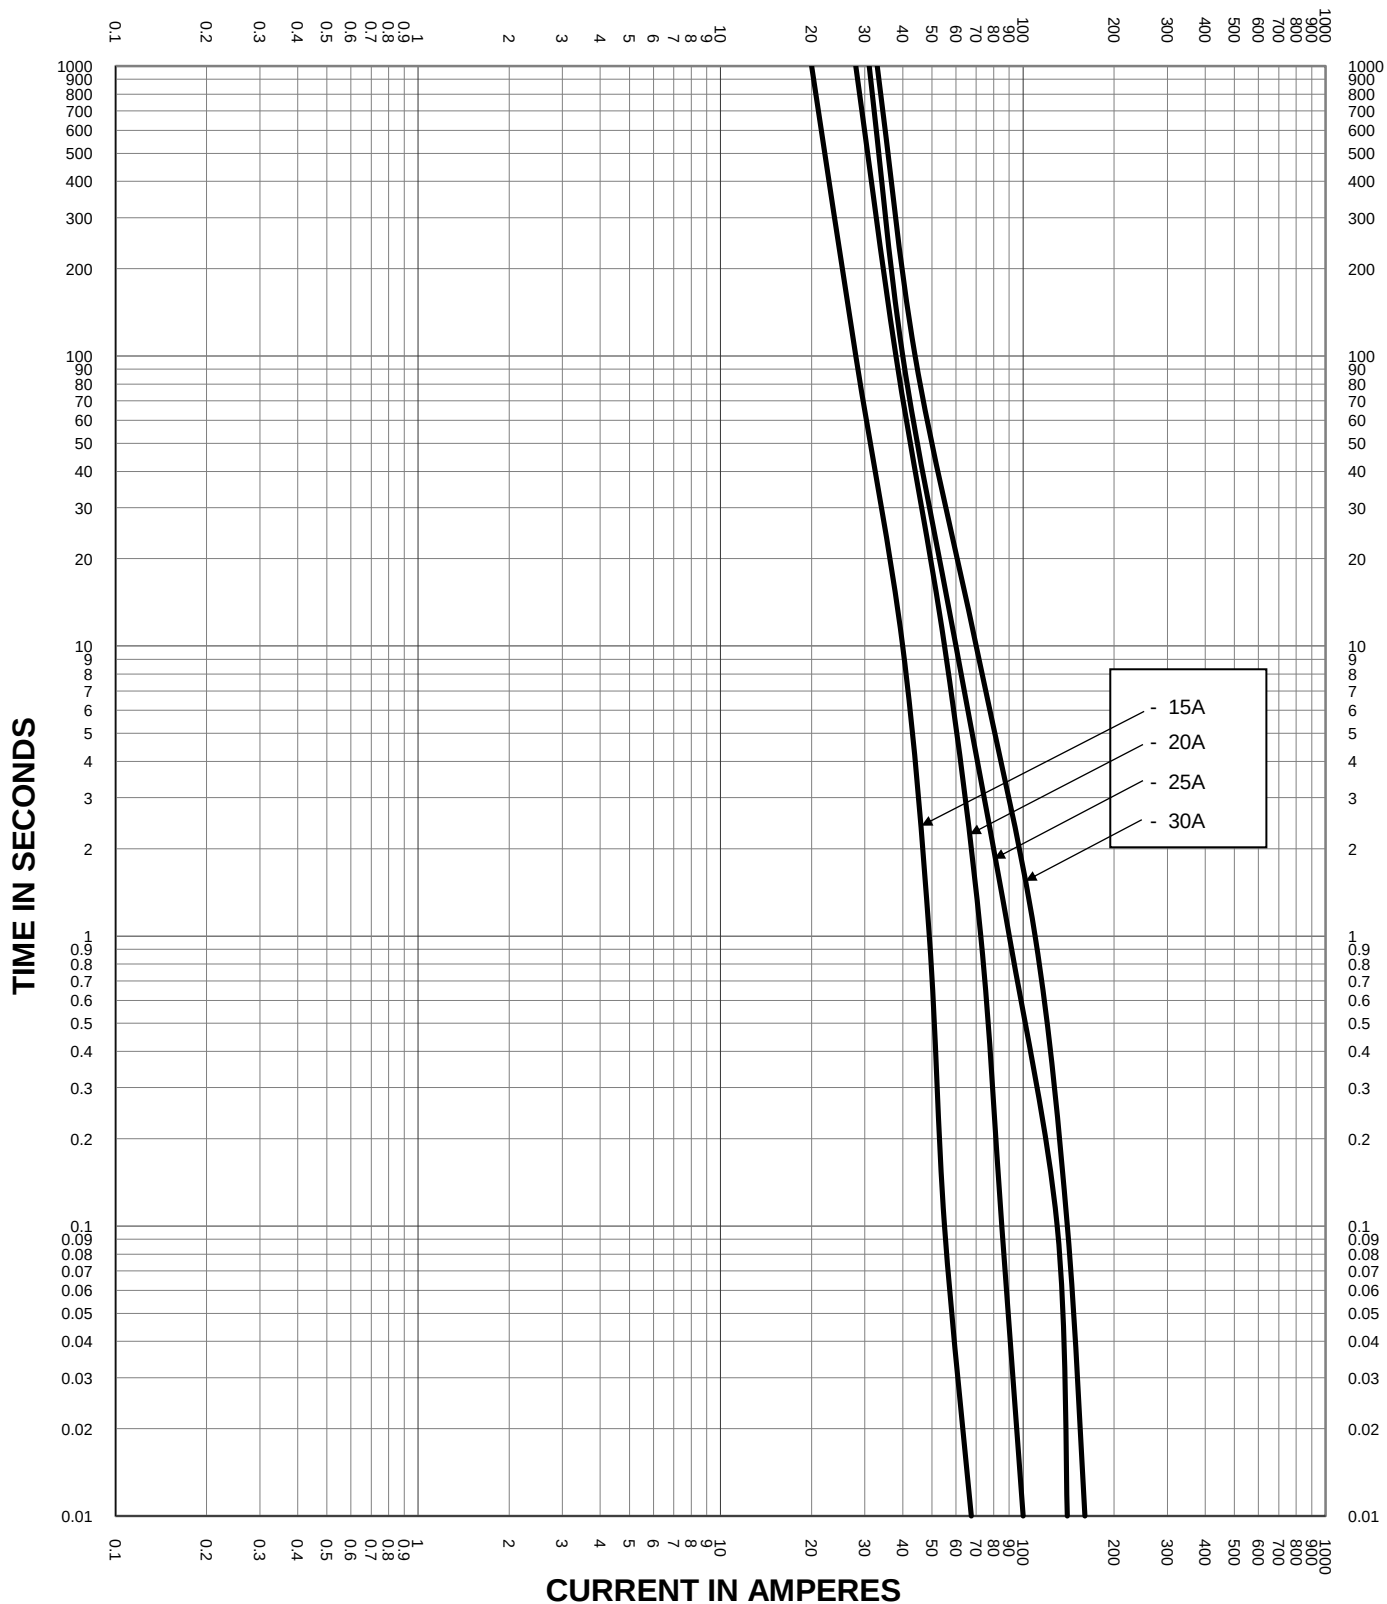

TEST VOLTAGE: 600V	TIME CONSTANT/ POWER FACTOR:	FUSE CATALOG NUMBER
BASIS FOR DATA:		KLKR 1/10A - 30A
 LITTELFUSE, INC. CHICAGO, IL. USA		DRAWN BY: LLL DATE: 08/21/12 REVISION : A
TIME CURRENT CHARACTERISTIC CURVES		DRAWING NO. Sheet 5 of 5 FCC01-KLKR