


USER'S GUIDE

WF/CF SERIES

WALL/CEILING AEROCONVECTOR

REPLACEMENT COMPONENT LIST INCLUDED

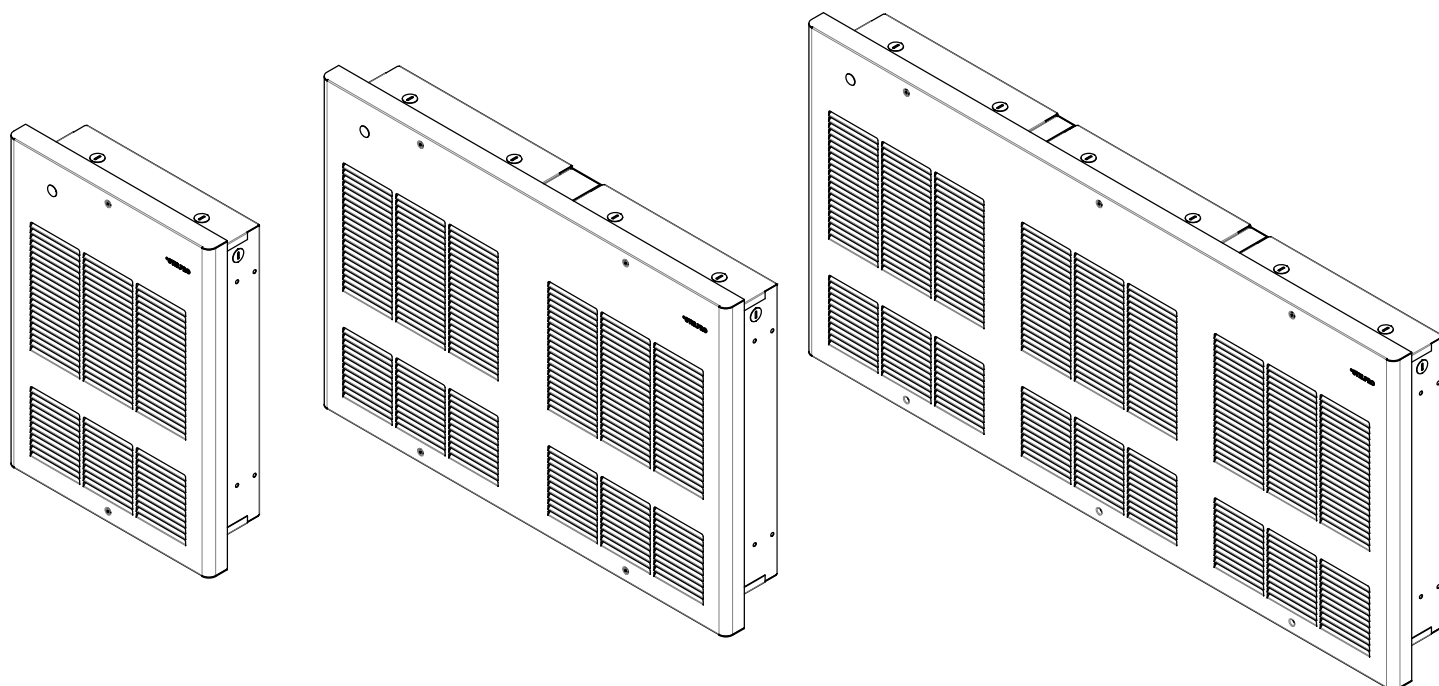

complies
with CSA
standards



WARNING

Before installing and operating this product, the user and/or installer must read, understand and follow these instructions and keep them handy for future reference. If these instructions are not followed, the warranty will be considered null and void and the manufacturer deems no further responsibility for this product.

This product must be installed by a qualified person and connected by a **certified electrician**, according to the **electrical and building codes** effective in your region.

The following instructions must be adhered to in order to avoid personal injuries or property damages, serious injuries and potentially fatal electric shocks.

Protect the heating unit with the appropriate circuit breaker or fuse, in accordance with the nameplate.

Make sure the line voltage (volt) is consistent with that indicated on the unit's nameplate.

This unit must be **grounded**.

Switch off the power at the circuit breaker/fuse before installing, repairing and cleaning the unit.

Make sure the unit is appropriate for the intended use (if needed, refer to the product catalog or a representative).

RECOMMENDED HEATING CAPACITY: 1.25 W/cubic foot (0.03 m³)

It corresponds to **10 W/square foot (0.09 m²)** based on a standard ceiling height of 8 feet (2.44 m). The recommended capacity is usually sufficient for normal heating needs. Please note that the insulation quality of walls and windows are some of the factors that influence heat losses, which modify the required capacity to heat a room. If needed, refer to a specialist (industrial and commercial buildings) who will be able to calculate these heat losses and optimize the required capacity or consult the "Online heating calculation" section of the Stelpro Design Web site (residential buildings). To heat a large room and to increase your comfort, it is recommended to install several units instead of one. For example, 2 X 1000 W rather than 1 X 2000 W.



WARNING

Do not install the unit where objects or pieces of furniture could be heat damaged.

If the unit capacity is insufficient for the size of the room, it will be in operation continuously, and may become defective earlier and turn yellow.

Respect distances and positions indicated in the installation section.

If the installer or the user modifies the unit, he will be held responsible for any damage resulting from this modification, and the CSA certification could be void.

This unit must not come into contact with a water source and must be protected from splashes. Do not use it if any part has been immersed.

When mounting the unit, make sure that the anchorage used can support the total weight of the unit with the mounting brackets.

When cutting or drilling into a wall or a ceiling, do not damage electrical wiring and other hidden utilities.

When starting up the unit for the first time or after a long period, it is normal that it produces some temporary odours and whitish smoke.

Because this unit is hot when in use, it may pose risks even in normal operation. Therefore, be **careful** and **responsible** when using it. To avoid burns, do not let bare skin touch hot surfaces. The unit must cool down for few minutes since it will stay warm for some time after shut-down.

This unit must be installed at least **6 inches (15.2 cm)** from surrounding walls and **6 inches (15.2 cm)** from the floor. The triple unit must be installed at least **12 inches (30.4 cm)** from surrounding walls and **8 inches (20.32 cm)** from the floor. However, make sure objects or pieces of furniture do not come into contact with the unit and keep them at least **24 inches (60 cm)** from the unit since they are more flammable than walls and floors. Failure to comply with this warning could lead to a fire. Some materials are more heat-sensitive than others, so make sure those near the unit can withstand heat.

Do not install on a wall behind a door.

Never block unit air vents. This obstruction could lead to overheating, which could result in a fire.

Do not insert or allow foreign objects to enter any air vent as this may cause electric shocks, fires, or damages to the unit.

This unit has hot and arcing or sparking parts inside. It is not designed to be used or stored in wet areas or areas containing flammable liquids, combustible materials or corrosive, abrasive, chemical, explosive and flammable substances such as, but not limited to, gasoline, paint, chlorine, sawdust and cleaning products.

Some areas are dustier than others. Thus, it is the user's responsibility to evaluate if the unit **must be cleaned** based on the amount of dirt accumulated on and inside air vents. Accumulated dirt can lead to a component malfunction or discoloration (yellow). It may cause a fire hazard if not installed and maintained in accordance with these instructions.

The thermal protection activation indicates that the unit has been subjected to abnormal operating conditions. If the thermal protection remains activated or activates and deactivates repeatedly, it is recommended that a qualified electrician or a certified repair centre examine the unit in order to make sure it is not damaged. (Refer to the limited warranty)

If the unit is damaged or defective, cut off power supply at circuit breaker and call a certified repair centre. (Refer to the limited warranty)

Make sure that all the electrical connections have been secured and made properly. Pull each wire to ensure it is not loose in the connector or the terminal board as this may cause a fire.

If an option must be added, make sure it has been approved by Stelpro. This way, it will ensure that it has been tested in accordance with our safety rules and that an appropriate installation has been planned into the unit.

Note: When a part of the product specification must be changed to improve operability or other functions, priority is given to the product specification itself. In such instances, the instruction manual may not entirely match all the functions of the actual product. Therefore, the actual product and packaging, as well as the name and illustration, may differ from the manual.

SPECIFICATIONS

WF SERIES – WITHOUT CONTROL

UNIT	TYPE	WATTS	VOLTS	KG	LB
SIMPLE	WF1502	1500	240	9	20
SIMPLE	WF2002	2000	240	9	20
SIMPLE	WF3002	3000	240	9	20
SIMPLE	WF4002	4000	240	9	20
SIMPLE	WF4802	4800	240	9	20
SIMPLE	WF1508	1500	208	9	20
SIMPLE	WF2008	2000	208	9	20
SIMPLE	WF3008	3000	208	9	20
SIMPLE	WF4008	4000	208	9	20
SIMPLE	WF4808	4800	208	9	20
SIMPLE	WF1507	1500	277	9	20
SIMPLE	WF2007	2000	277	9	20
SIMPLE	WF3007	3000	277	9	20
SIMPLE	WF4007	4000	277	9	20
SIMPLE	WF4807	4800	277	9	20

Add **W** for white, **SW** for silica white, **S** for silver or **SS** for stainless steel


CF SERIES – WITHOUT CONTROL

UNIT	TYPE	WATTS	VOLTS	KG	LB
SIMPLE	CF1502	1500	240	9	20
SIMPLE	CF2002	2000	240	9	20
SIMPLE	CF3002	3000	240	9	20
SIMPLE	CF4002	4000	240	9	20
SIMPLE	CF1508	1500	208	9	20
SIMPLE	CF2008	2000	208	9	20
SIMPLE	CF3008	3000	208	9	20
SIMPLE	CF4008	4000	208	9	20
SIMPLE	CF1507	1500	277	9	20
SIMPLE	CF2007	2000	277	9	20
SIMPLE	CF3007	3000	277	9	20
SIMPLE	CF4007	4000	277	9	20


Add **W** for white, **SW** for silica white, **S** for silver or **SS** for stainless steel

Several other models with control are available in higher voltages and wattages. For a complete model list, consult our online catalog at www.stelpro.com


SIMPLE UNIT

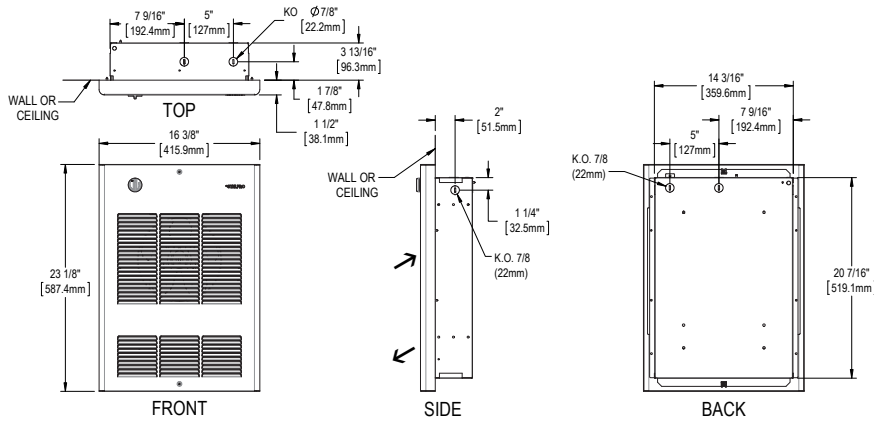

DOUBLE UNIT

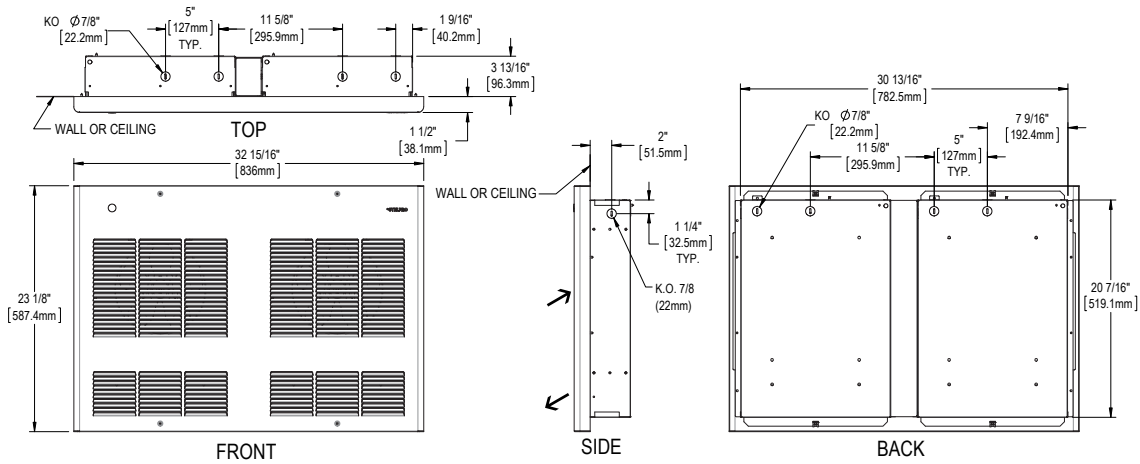

TRIPLE UNIT

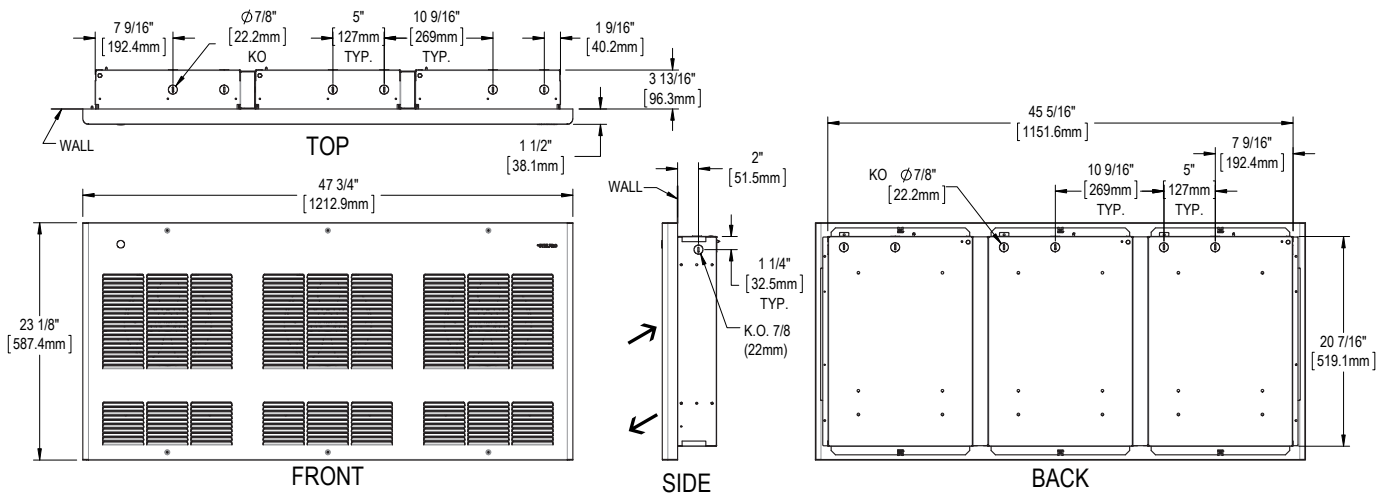



N.B. Cut off power supply at circuit breaker/fuse before proceeding to the installation and wiring connections. This product must be connected by a certified electrician, according to the electrical and building codes effective in your region.

When the unit is recessed, the flanged shoulders must rest on the finished surface of the wall or ceiling.

WARNINGS

1. Recessed and surface installation of WF units (wall mounting) must meet the minimum distances for single and double units (see figures 1 and 2). For CF units (ceiling mounting), the minimum distance from the wall is 12 inches (305 mm) (see figure 4).
2. Triple units must meet a minimum distance of **12 inches (305 mm)** from surrounding walls and **8 inches (203 mm)** from the floor. For recessed installation opening for triple units, see figure 3.
3. Recessed structure requirement on outside walls for WF (wall mounting) and CF (ceiling mounting) units is the same as for a window structure (refer to the applicable building codes effective in your area).
4. For surface installation, put a wooden plate at the back of the gypsum in order to fix the unit to the wall securely. For the wooden plate dimensions, refer to the opening for the recessed application (see figures 2 and 3). Use the same dimensions for ceiling application (CF).

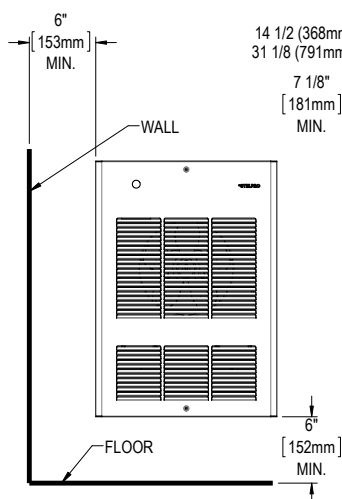


FIG. 1

FRONT
SURFACE INSTALLATION
SINGLE AND DOUBLE UNIT
SURFACE ADAPTOR REQUIRED

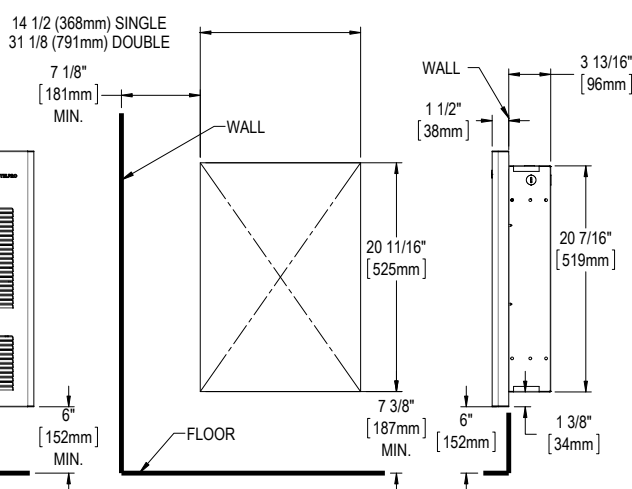


FIG. 2

OPENING
RECESSED INSTALLATION
SINGLE AND DOUBLE UNIT

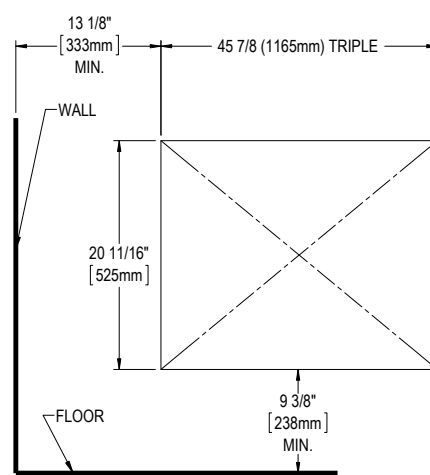


FIG. 3

OPENING
RECESSED INSTALLATION
TRIPLE UNIT

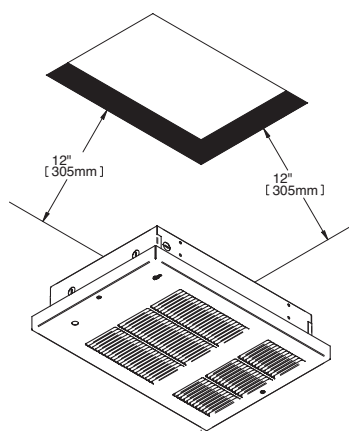


FIG. 4

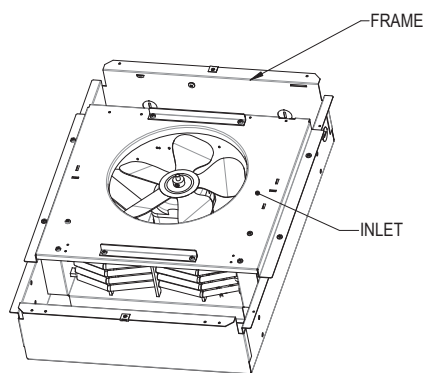


FIG. 5

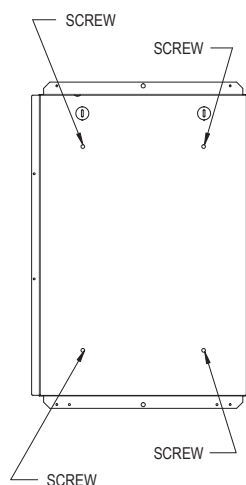


FIG. 6

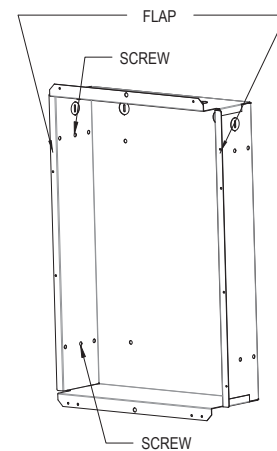


FIG. 7

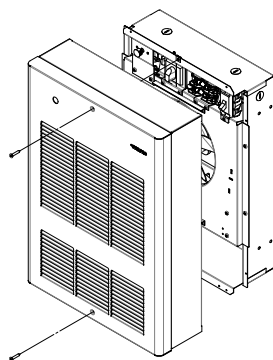


FIG. 8

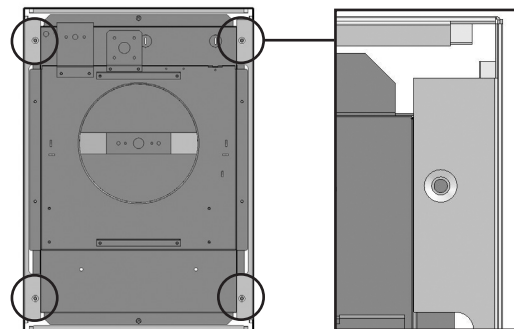
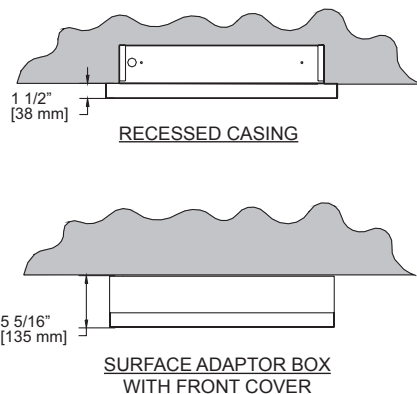


FIG. 9

SEE PREVIOUS PAGE FOR WARNINGS

SURFACE INSTALLATION

1. Make sure you use the proper sleeve surface depending on the device you are installing: WFSA1 (single units), WFSA2 (double units), WFSA3 (triple units).
2. Unscrewed the two (2) screws holding the grille (see figure 8) and remove.
3. Remove the inlet of the frame (see figure 5) by unscrewing the four (4) screws.
4. Open the KO to be used and insert the wire with connector.
5. Place the frame against the wall, level and tighten with four (4) wood screws (not included) into the holes provided for this purpose (see figure 6).
6. Replace the inlet, make the required electrical connections. Insert the sleeve surface into the grille and replace the four (4) screws removed previously (see figure 5).
7. Position the sleeve around the frame and secure it with four (4) screws (not provided) as shown in figure 9.

8. Put back the grille and tighten with two (2) screws removed previously (see figure 8).

RECESSED INSTALLATION

1. The opening in the wall must be made in accordance with acceptable standards (see figures 2 and 3, and Warning).
2. Unscrew the two (2) screws holding the grille (see figure 8).
3. Remove the inlet of the frame (see figure 5) by unscrewing the four (4) screws.
4. Open the KO to be used and insert the wire with connector.
5. Insert the frame into the opening, press the flap against the wall. Screw in wood screws (not included) in the left and the right studs, through holes provided for this purpose (see figure 7).
6. Replace the inlet, make the required electrical connections and replace the grille.

MAINTENANCE



N.B. In order for the warranty to be valid, the unit must be cleaned regularly.

Switch off the main breaker in the electrical panel before cleaning the unit. Use a soft rag for dusting. When cleaning, use only a damp rag and non-abrasive dish soap. If you use a cleaning product, always wipe the product off properly to avoid the discoloration of the unit. Do not use abrasive or chemical cleaners because they may damage the finishing. If the unit is used in a very dusty location, use a vacuum brush to remove dust and

other foreign objects from the grilles. If needed, vacuum out the dust inside the unit. Note that cigarette smoke could yellow the discharge grille and that the best way to prevent it is to clean the unit on a regular basis.

Do not use cleaning products identified with these symbols:



TROUBLESHOOTING

PROBLEM	DEFECTIVE PART OR PART TO CHECK
The unit does not work	<ul style="list-style-type: none"> • The circuit breaker is in the OFF position or removed fuse • Defective thermostat or wrong thermostat setting • Activated thermal protection • Faulty connections
The unit runs continuously	<ul style="list-style-type: none"> • Defective thermostat or wrong thermostat setting • Heat losses higher than the unit capacity
The enclosure is extremely hot	<ul style="list-style-type: none"> • Defective thermal protection • Blocked air vents
The desired ambient temperature can never be reached	<ul style="list-style-type: none"> • One or more elements are defective • Defective thermostat or wrong thermostat setting • Voltage lower than that written on the nameplate • Heat losses higher than the unit capacity
Overheating	<ul style="list-style-type: none"> • Defective thermostat or wrong thermostat setting
The unit cycles under control of the thermal protection (overheat indicator)	<ul style="list-style-type: none"> • Blocked air vents • Defective motor
The breaker trips when the heater is turned on	<ul style="list-style-type: none"> • Faulty connections • Voltage higher than that written on the nameplate

N.B. If you do not solve the problem after checking these points, cut off the power supply at the main electrical panel and contact our customer service (see the "Limited warranty" section to obtain the phone numbers).

REPLACEMENT COMPONENT LIST

REF #		PART #	DESCRIPTION
1	WF/CF	BLA-003	FAN BLADE 8"
2	WF/CF	BOUT-009	THERMOSTAT BUTTON, WHITE
2	WF/CF	BOUT-010	THERMOSTAT BUTTON, BLACK
2	WF/CF	BOUT-011	THERMOSTAT BUTTON, WHITE
3	WF/CF	CONT-3002	CONTACTOR 2P/24V/30A RESISTIVE
3	WF/CF	CONT-3503	CONTACTOR 3P/24V/35A RESISTIVE
3	WF/CF	CONT-5002	CONTACTOR 2P/24V/50A RESISTIVE
3	WF/CF	CONT-3022	CONTACTOR 2P/240-208V/30A RESISTIVE
3	WF/CF	CONT-4023	CONTACTOR 3P/240-208V/40A RESISTIVE
3	WF/CF	CONT-5023	CONTACTOR 3P/240-208V/50A RESISTIVE
4	WF/CF	ELF-WF1502	ELEMENT ASSEMBLY WF1502
4	WF/CF	ELF-WF1503	ELEMENT ASSEMBLY WF1503
4	WF/CF	ELF-WF1506	ELEMENT ASSEMBLY WF1506
4	WF/CF	ELF-WF1507	ELEMENT ASSEMBLY WF1507
4	WF/CF	ELF-WF2002	ELEMENT ASSEMBLY WF2002
4	WF/CF	ELF-WF2003	ELEMENT ASSEMBLY WF2003
4	WF/CF	ELF-WF2006	ELEMENT ASSEMBLY WF2006
4	WF/CF	ELF-WF2007	ELEMENT ASSEMBLY WF2007
4	WF/CF	ELF-WF2008	ELEMENT ASSEMBLY WF2008
4	WF/CF	ELF-WF3002	ELEMENT ASSEMBLY WF3002
4	WF/CF	ELF-WF3003	ELEMENT ASSEMBLY WF3003
4	WF/CF	ELF-WF3006	ELEMENT ASSEMBLY WF3006
4	WF/CF	ELF-WF3007	ELEMENT ASSEMBLY WF3007
4	WF/CF	ELF-WF4002	ELEMENT ASSEMBLY WF4002
4	WF/CF	ELF-WF4003	ELEMENT ASSEMBLY WF4003
4	WF/CF	ELF-WF4006	ELEMENT ASSEMBLY WF4006
4	WF/CF	ELF-WF4007	ELEMENT ASSEMBLY WF4007
4	WF/CF	ELF-WF4008	ELEMENT ASSEMBLY WF4008
4	WF/CF	ELF-WF4802	ELEMENT ASSEMBLY WF4802
4	WF/CF	ELF-WF4803	ELEMENT ASSEMBLY WF4803
4	WF/CF	ELF-WF4805	ELEMENT ASSEMBLY WF4805
4	WF/CF	ELF-WF4806	ELEMENT ASSEMBLY WF4806
4	WF/CF	ELF-WF4807	ELEMENT ASSEMBLY WF4807
4	WF/CF	ELF-WF4808	ELEMENT ASSEMBLY WF4808

REF #		PART #	DESCRIPTION
5	WF/CF	MO-016	MOTOR 208/240V 50/60HZ 0.4A
6	WF/CF	PROT-006	THERMAL PROTECTION 1500-2000W
6	WF/CF	PROT-007	THERMAL PROTECTION 3000-12000W
7	WF/CF	ST-017	THERMOSTAT SP 120 TO 277V-22A, 600V-10A
7	WF/CF	ST-007	THERMOSTAT SP 120 TO 277V-25A, 600V-10A
7	WF/CF	ST-013	THERMOSTAT DP 120 TO 277V-25A, 600V-10A
8	WF/CF	TRF200040D	TRANSFORMER 208-240/24/40VA CL.2
8	WF/CF	TRF700025	TRANSFORMER 277/24/25VA
8	WF/CF	TRF720025	TRANSFORMER 277/240/25VA
8	WF/CF	TRF300040	TRANSFORMER 347/24/40VA CLS 2
8	WF/CF	TRF320025	TRANSFORMER 347/240/25VA
8	WF/CF	TRF500025D	TRANSFORMER 240-480/12-24/25VA
8	WF/CF	TRF520025	TRANSFORMER 480/240/25VA
8	WF/CF	TRF600040	TRANSFORMER 600/24/40VA CLS 2
8	WF/CF	TRF620025	TRANSFORMER 600/240/25VA
8	WF/CF	TRF720100	TRANSFORMER 277/240/100VA
8	WF/CF	TRF520100	TRANSFORMER 480/240/100VA
8	WF/CF	TRF620100	TRANSFORMER 600/240/100VA
9	WF	M-WF112Z*	GRILLE WF-1
9	WF	M-WF212Z*	GRILLE WF-2
9	WF	M-WF312Z*	GRILLE WF-3
9	CF	M-CF112Z*	GRILLE CF-1
9	CF	M-CF212Z*	GRILLE CF-2
9	CF	M-CF312Z*	GRILLE CF-3
13	WF/CF	SWI-027	MOTOR SWITCH 600V/30A, 2 POLES
13	WF/CF	SWI-028	DISCON. SWITCH 600V/40A 2 POLES/3 POLES
13	WF/CF	SWI-029	DISCON. SWITCH 600V/60A 2 POLES/3 POLES

*Add **W** for white, **SW** for silica white, **S** for silver or **SS** for stainless steel

