

### Application

Designed for installation on water lines to protect against both backsiphonage and backpressure of polluted water into the potable water supply. Assembly shall provide protection where a potential health hazard does not exist.

### Standards Compliance

(All sizes approved horizontal. Vertical approvals as listed below.)

- ASSE® Listed 1015 ( vertical 3/4", 1 1/2" & 2")
- IAPMO® Listed (vertical 1 1/2", 2")
- CSA® Listed ( vertical 3/4", 1 1/2" & 2")
- AWWA Compliant C510 (vertical 3/4")
- UL® Classified (less shut-off valves only)
- C-UL® Classified (less shut-off valves only)
- Approved by the Foundation for Cross Connection Control and Hydraulic Research at the University of Southern California (vertical 3/4")
- City of Los Angeles Approved (vertical 1 1/2", 2")
- NYC MEA 426-89-M VOL 3


### Materials

|                 |                             |
|-----------------|-----------------------------|
| Main valve body | Cast Bronze ASTM B 584      |
| Access covers   | Cast Bronze ASTM B 584      |
| Internals       | Stainless Steel, 300 Series |
| Elastomers      | Silicone (FDA approved)     |
|                 | Buna Nitrile (FDA approved) |
| Polymers        | Noryl™, NSF Listed          |
| Springs         | Stainless steel, 300 series |

### Features

Sizes: 3/4", 1", 1 1/2", 2"

|                                   |              |
|-----------------------------------|--------------|
| Maximum working water pressure    | 175 PSI      |
| Maximum working water temperature | 180°F        |
| Hydrostatic test pressure         | 350 PSI      |
| End connections Threaded          | ANSI B1.20.1 |

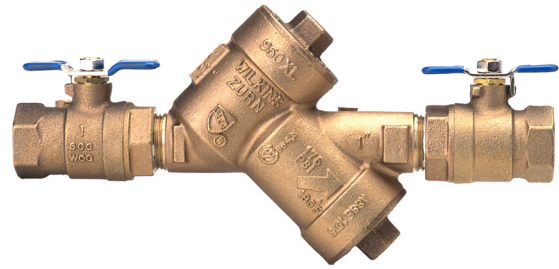

### Options


(Suffixes can be combined)

- ☐ - with full port QT ball valves (standard)
- ☐ L - less ball valves
- ☐ U - with union ball valves
- ☐ S - with bronze "Y" type strainer
- ☐ TCU - with test cocks "vertical" up
- ☐ V - with union swivel elbows (3/4" & 1")
- ☐ OSY - with OS & Y gate valves
- ☐ FDC - with fire hydrant connection (2" only)
- ☐ FT - with integral male 45° flare SAE test fitting
- ☐ PF - with Z-Bite™ push fit connections\* (1/2"-1" only)
- ☐ PR - with Z-Press™ press fit connections\*

\*Fittings ship in box with valve and must be threaded into valve by hand on site.

### Accessories

- ☐ Repair kit (rubber only)
- ☐ Thermal expansion tank (Model XT)
- ☐ QT-SET Quick Test Fitting Set

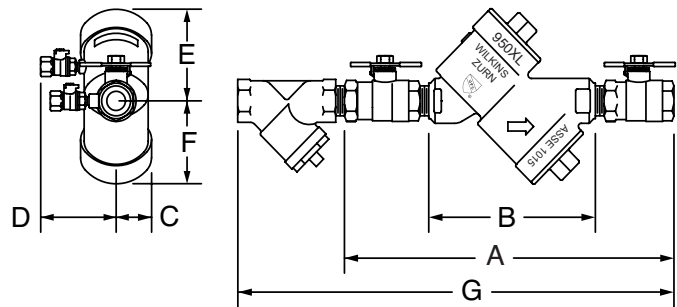


### Dimensions & Weights (do not include pkg.)

| MODEL<br>SIZE |    | DIMENSIONS (approximate) |     |                           |     |                       |     |       |    |       |    |       |     |       |     |        |     | WEIGHT                 |     |                        |      |
|---------------|----|--------------------------|-----|---------------------------|-----|-----------------------|-----|-------|----|-------|----|-------|-----|-------|-----|--------|-----|------------------------|-----|------------------------|------|
|               |    | A                        |     | A UNION<br>BALL<br>VALVES |     | B LESS BALL<br>VALVES |     | C     |    | D     |    | E     |     | F     |     | G      |     | LESS<br>BALL<br>VALVES |     | WITH<br>BALL<br>VALVES |      |
|               |    |                          |     |                           |     |                       |     |       |    |       |    |       |     |       |     |        |     |                        |     |                        |      |
| in.           | mm | in.                      | mm  | in.                       | mm  | in.                   | mm  | in.   | mm | in.   | mm | in.   | mm  | in.   | mm  | in.    | mm  | lbs                    | kg  | lbs.                   | kg   |
| 3/4           | 20 | 11 1/4                   | 286 | 12 1/2                    | 318 | 7                     | 178 | 1 1/2 | 38 | 3     | 76 | 3 1/2 | 89  | 3     | 76  | 15     | 381 | 5                      | 2.3 | 7                      | 3.2  |
| 1             | 25 | 12 1/4                   | 311 | 13 7/8                    | 353 | 7                     | 178 | 1 1/2 | 38 | 3     | 76 | 3 1/2 | 89  | 3     | 76  | 17 3/4 | 451 | 8                      | 3.6 | 12                     | 5.4  |
| 1 1/2         | 40 | 17 1/8                   | 435 | 19 1/8                    | 486 | 10 9/16               | 268 | 2     | 51 | 3 1/2 | 89 | 4 1/2 | 114 | 4 1/2 | 114 | 22 3/4 | 578 | 16                     | 7.3 | 22                     | 10   |
| 2             | 50 | 18 1/4                   | 460 | 20                        | 508 | 10 9/16               | 268 | 2     | 51 | 3 1/2 | 89 | 4 1/2 | 114 | 4 1/2 | 114 | 25 1/8 | 638 | 16                     | 7.3 | 28                     | 12.7 |

\*Size 1-1/4" Discontinued


MODEL 950XL 3/4", 1", 1 1/2" & 2" (STANDARD & METRIC)

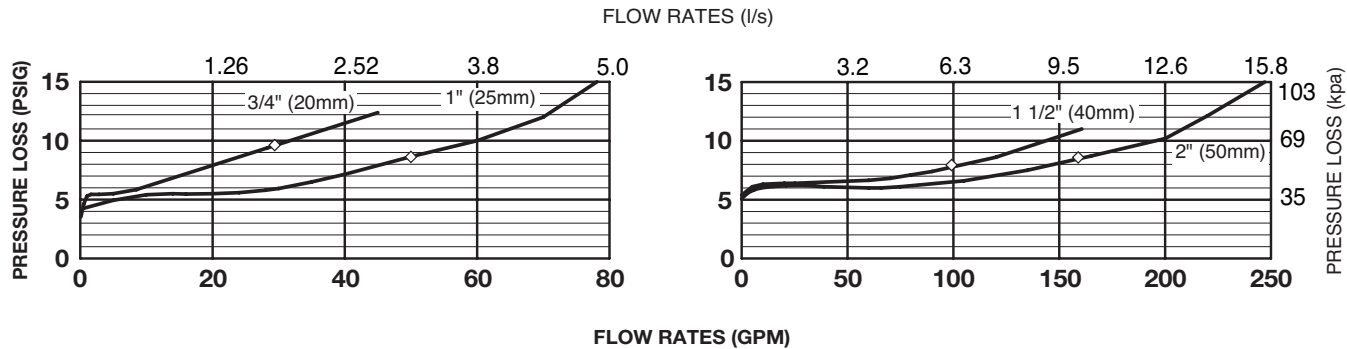


Typical Installation

Local codes shall govern installation requirements. To be installed in accordance with the manufacturer's instructions and the latest edition of the Uniform Plumbing Code. Unless otherwise specified, the assembly shall be mounted at a minimum of 12" (305mm) and a maximum of 30" (762mm) above adequate drains with sufficient side clearance for testing and maintenance. The installation shall be made so that no part of the unit can be submerged.

| Capacity thru Schedule 40 Pipe |          |            |           |           |
|--------------------------------|----------|------------|-----------|-----------|
| Pipe size                      | 5 ft/sec | 7.5 ft/sec | 10 ft/sec | 15 ft/sec |
| 1/8"                           | 1        | 1          | 2         | 3         |
| 1/4"                           | 2        | 2          | 3         | 5         |
| 3/8"                           | 3        | 4          | 6         | 9         |
| 1/2"                           | 5        | 7          | 9         | 14        |
| 3/4"                           | 8        | 12         | 17        | 25        |
| 1"                             | 13       | 20         | 27        | 40        |
| 1 1/4"                         | 23       | 35         | 47        | 70        |
| 1 1/2"                         | 32       | 48         | 63        | 95        |
| 2"                             | 52       | 78         | 105       | 167       |

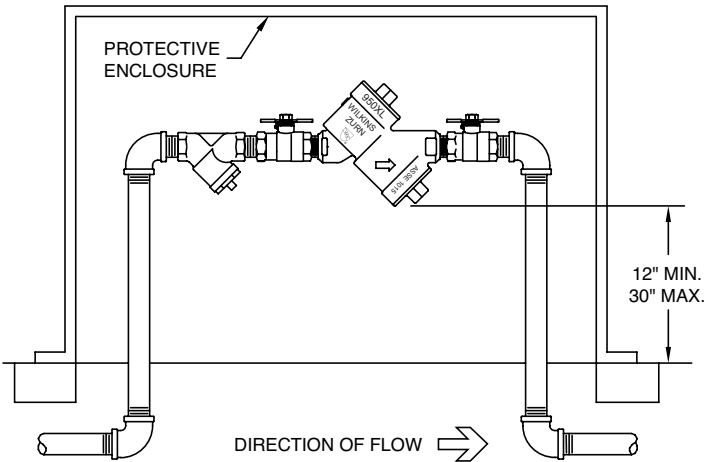

OUTDOOR INSTALLATION

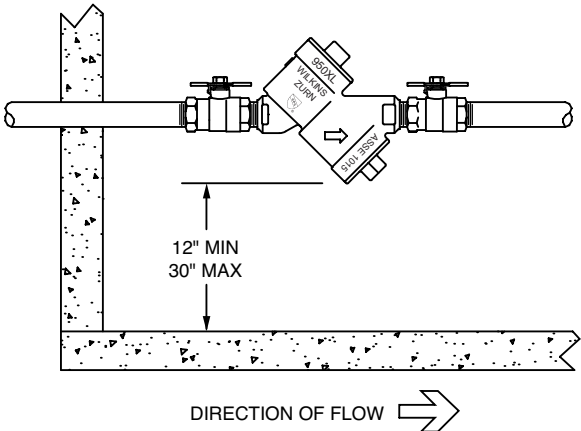

INDOOR INSTALLATION

Specifications

The Double Check Valve Backflow Preventer shall be ASSE® Listed 1015 approved, and supplied with full port ball valves. The main body and access covers shall be bronze (ASTM B 584), the seat rings and all internal polymers shall be NSF® Listed Noryl™ and the seat disc elastomers shall be silicone. The first and second checks shall be accessible for maintenance without removing the device from the line. The Double Check Valve Backflow Preventer shall be a ZURN WILKINS Model 950XL.