

INSTALLATION, OPERATING, AND SERVICE INSTRUCTIONS

HEAT-FLO INDIRECT-FIRED WATER HEATERS

MODELS 30, 40, 40L, 50, 60, 60L, 80, 115
AND 60-HO, 80-HO, 80-HO-C, 115-HO, 115-HO-C
85-XHO, 115-XHO HIGH OUTPUT UNITS

FOR SINGLE WATER HEATER INSTALLATIONS



Intertek

*Conforms to UL STD 174 and NSF/ANSI 372
Certified to CAN/CSA STD C22.2 No. 110-94*

For service or repairs to the water heater, call your heating contractor. Your water heater has been manufactured to provide years of service. In order to insure proper service, the following information is provided to assist in enabling the installation, operation, and maintenance of this water heater. For your comfort, safety, and convenience, we recommend that this water heater be installed and serviced by a plumbing professional. When the installation is completed, keep this manual with the water heater. Information and specifications outlined in this manual in effect at the time of printing of this manual. Heat-Flo reserves the right to discontinue, change specifications, or change system design at any time without notice.

Heat-Flo, Inc.
15 Megan Ct., P.O. Box 612 Uxbridge, MA 01569 USA

Bulletin I0-010115

Safety Information

The following terms and symbols are used to bring attention to the presence of various risk levels, or to important information concerning product life.

DANGER

Indicates presence of a hazard, which will cause severe personal injury, death, or substantial property damage if ignored.

WARNING

Indicates the presence of a hazard, which can cause severe personal injury, death, or substantial property damage if ignored.

CAUTION

Indicates the presence of a hazard, which can cause minor personal injury or damage if ignored.

NOTICE

Indicates special instructions on installation, operation, or maintenance, which are important but not related to personal injury hazards.



Table of Contents

General Information	1, 2
Pre-Installation Considerations	3-10
Dimensions and Capacities	4, 5
Piping	8-12
Electrical	13-15
Operation	13
Important Scalding Information	13, 16
Maintenance	17, 19
Troubleshooting	20
Boiler Supply Ratings	21
Replacement Parts	22
Limited Warranty	23, 24

IMPORTANT INFORMATION – READ CAREFULLY

NOTE: The equipment shall be installed in accordance with those installation regulations required in the area where the installation is to be made. These regulations shall be carefully followed in all cases. Authorities having jurisdiction shall be consulted before the installations are made.

All wiring on water heaters must be in accordance with the National Electrical Code (latest edition) and/or local regulations in the US, and in accordance with the Canadian Electrical Code (latest edition) and/or local regulations in Canada.

WARNING

Improper installation, adjustment, alteration, service or maintenance can cause property damage, personal injury, or loss of life. Read and understand the entire manual before attempting installation, start-up, operation, or service. Installation and service must be performed only by an experienced, skilled installer or service agency.

This water heater contains very hot water under high pressure. Do not unscrew any pipe fittings or attempt to disconnect any components of this water heater without positively assuring that the water is cool and has no pressure. Always wear protective clothing and equipment when installing, starting up or servicing this water heater to prevent scalding injuries. Do not rely on the pressure and temperature gauges to determine the temperature and pressure of the water heater. This water heater contains components that become very hot when the boiler is operating. Do not touch any components unless they are cool.

Failure to follow all instructions in the proper order can cause personal injury or death. Read all instructions, including all those contained in component manufacturers' manuals before installing, starting up, operating, maintaining, or servicing the water heater.

CAUTION

To reduce the risk of excessive pressures and temperatures in this water heater, install temperature and pressure protective equipment required by local codes but no less than a combination temperature relief valve certified by a nationally recognized testing laboratory that maintains periodic inspection of production of listed equipment or materials, as meeting the requirements for Relief Valves and Automatic Shutoff Devices for Hot Water Supply Systems, ANSI Z21.22-latest edition. This valve must be marked with a maximum set pressure not to exceed the marked working pressure of the water heater. Install the valve into an opening provide and marked for this purpose in the water heater, and orient it or provide tubing so that any discharge from the valve will exit only within 6 inches above, or at any distance below, the structural floor, and cannot contact any live electrical part. The discharge opening must not be blocked or reduced in size under any circumstances.

These water heaters with single-wall stainless steel heat exchangers meet the Uniform Plumbing Code for installation in potable water systems provided that:

- The boiler water, including additives, is practically non-toxic, having a toxicity rating of class 1 as listed in Clinical Toxicology of Commercial Products, latest edition.
- The boiler water pressure is limited to maximum 30 psig by an approved safety or relief valve.
- The heat transfer medium is potable water or contains only substances that are recognized as safe by the U.S. Food and Drug Administration. (FDA)
- The pressure of the heat transfer medium is maintained less than the normal minimum operating pressure of the potable water system.

The maximum boiler water supply temperature to the indirect heat exchanger must not exceed 240 deg. F (115 deg. C).

Improper water quality will reduce the life of the water heater. Hard water, sediment, high or low PH and high levels of chlorides in the domestic water should be avoided. Be sure that PH levels fall between 6 and 8 and dissolved chlorides are less than 100 ppm. A filter must be used where sediment is greater than 5 microns in size in the water supplied to the unit. A water softening system is recommended for areas with hard water. In cases where water quality is unknown, a qualified water treatment expert should be consulted.

NOTICE: Damage to tanks caused by improper water quality is not covered under the warranty.

DANGER

DO NOT store or use gasoline or other flammable vapors or liquids in the vicinity of this or any other appliance. If you smell gas vapors, DO NOT try to operate any appliance - DO NOT touch any electrical switch or use any phone in the building. Immediately, call the gas supplier from a remotely located phone. Follow the gas supplier's instructions or if the supplier is unavailable, contact the fire department. Do not operate any appliance until the leakage is corrected.

DANGER

This water heater is supplied with an adjustable thermostat to control the water temperature. Hot water temperatures required for automatic dishwashers and laundry use can cause scald burns resulting in serious personal injury and/or death. The temperature at which injury occurs varies with the person's age and the time of exposure. The slower response time of disabled persons increases the hazard to them. **NEVER** allow small children to use a hot water tap or to draw their own bath water. **NEVER** leave a child or disabled person unattended in a bathtub or a shower.

IMPORTANT SAFETY INSTRUCTIONS

READ ALL INSTRUCTIONS BEFORE USING THIS WATER HEATER.

WARNING – When using electrical appliances, safety precautions should be taken to reduce the risks of fire, electric shock, and injury. These precautions include the following:

- This water heater must be grounded. Connect only to a properly grounded outlet. See "GROUNDING INSTRUCTIONS" found in Section IV.
- Install or locate this water heater only in accordance with the provided installation instructions.
- Use this water heater only for its intended use as described in this manual.
- Do not use an extension cord set with this water heater. If no outlet is available adjacent to the water heater, contact a qualified electrician to have one properly installed.
- As with any appliance, close supervision is necessary when used by children.
- Do not operate this water heater if it has a damaged cord or plug, if it is not working properly, or if it has been damaged or dropped.
- Your water heater should be installed and serviced only by qualified personnel. Contact nearest authorized service facility for examination, repair, or adjustment.

SAVE THESE INSTRUCTIONS

Pre-installation Considerations

Inspect shipment carefully for signs of damage. All equipment is carefully inspected and packed. Heat-Flo's responsibility ceases upon delivery of the water heater to the carrier in good condition. Any claims for damage or shortage must be filed immediately against the carrier by the consignee. No claims for variances or shortages will be allowed by the Manufacturer, unless they are presented within sixty days after receipt of the equipment.

Installation must conform to the requirements of the authority having jurisdiction. In the absence of such requirements, installation must conform to the National Plumbing Code and the National Electrical Code ANSI/NFPA No. 70 (current edition).

IMPORTANT CONSIDERATIONS BEFORE INSTALLATION

1. Water heater sizing:

Choose the water heater model based on the expected water usage for the given site. The average residence with one shower or more will require a Model 40 or larger. The Model 30 should only be considered for residences with minimal water demand, or for commercial applications without showers.

Factors that increase water demand dramatically include high flow shower heads, hot tubs, and the use of more than one shower at a time. Increase the tank size if these factors are present. Consult ASHRAE sizing guides and other references.

Dimensions, weights, ratings, and capacities are outlined in Tables 1, and 2 (Pg. 2).

2. Boiler sizing:

The water heater will provide the rated performance only if it is used with a boiler with a heating capacity of at least as much as the capacity ratings in Table 2. If the boiler has less capacity, the water heating output will be reduced. To determine performance with other boiler outputs, refer to the expanded capacity tables at www.heat-flo.com.

NOTICE

The maximum heat transfers through the coil (heat input) of the water heaters at 240 deg. F boiler supply temperature and 210 deg. F potable water temperature are as follows:

- Models 30 – 115 single coil units and models 60-D, 80-D, and 115-D dual coil units are less than 96,000 BTU/HR.
- Models 80-HO, 115-HO, 80-HO-C, and 115-HO-C high output units are less than 84,000 BTU/HR.
- Models 85-XHO and 115-XHO, the extra high output series, are less than 175,000 BTU/HR.

Potable water temperature is limited to below 210 deg. F and nominal water containing capacity is below 120 gallons for all indirect models.

Accordingly, per Part HLW-101.2, Section IV of the ASME Boiler and Pressure Vessel Code, all Heat-Flo indirect water heater products are exempt from compliance with the code.

Check with local codes for applicability.

Table 1: Dimensions and Capacities

Model	Storage Volume	Coil Heating Surface	Dimensions (Inches)		Piping Connections (NPT)		Max. Tank Working Pressure	Max. Coil Working Pressure	Approx. Shipping Wt.
	(Gals.)	Sq. Ft.	Ht.	Dia.	In/ Out	In/ Out	(psi)	(psi)	(Lbs.)
HF-30	30	7.3	34.0	23.5	3/4	1	150	90	85
HF-40	40	7.7	44.0	23.5	3/4	1	150	90	100
HF-40L	42	7.4	36.0	28.0	3/4	1	150	90	100
HF-50	50	8.2	54.0	23.5	3/4	1	150	90	110
HF-60	60	8.6	62.0	23.5	3/4	1	150	90	125
HF-60L	60	7.7	46.0	28.0	3/4	1	150	90	120
HF-80	80	8.2	56.0	28.0	1	1	150	90	140
HF-115	115	9.1	74.0	28.0	1	1	150	90	175

High Output Units: 60-HO, 80-HO, 115-HO

60-HO	60	15.1	62.0	23.5	1	1	150	90	140
80-HO	80	14.8	56.0	28.0	1	1	150	90	155
80-HO-C	80	14.8	56.0	28.0	1 1/2	1 1/4	150	90	155
115-HO	115	15.6	74.0	28.0	1	1	150	90	190
115-HO-C	115	15.6	74.0	28.0	1 1/2	1 1/4	150	90	190

Extra High Output Units: 85-XHO, 115XHO

85-XHO	87	28.7	64.0	28.0	1 1/2	1 1/2	150	90	215
115-XHO	115	28.7	74.0	28.0	1 1/2	1 1/2	150	90	240

STANDARD AND HO UNITS

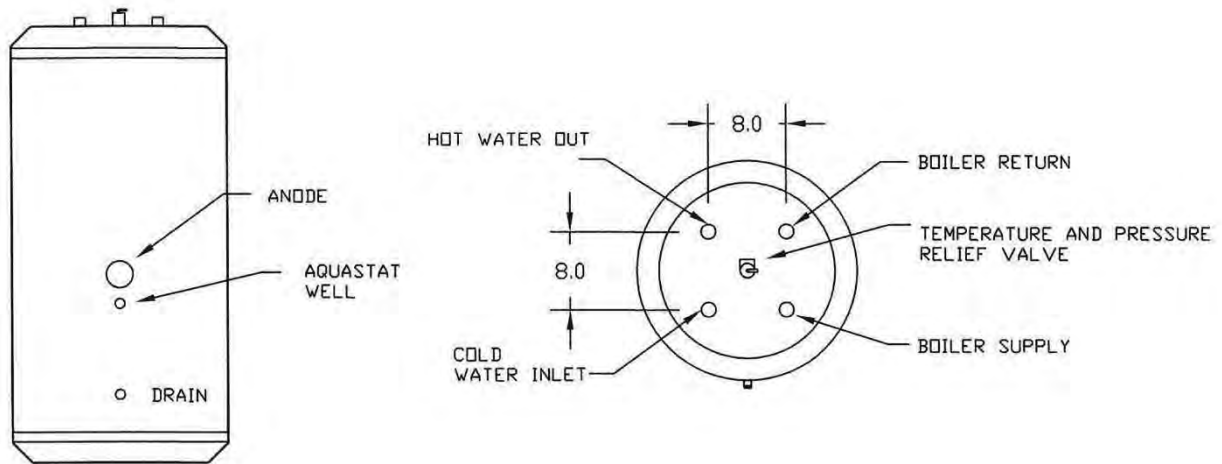


Table 2: 200° F Boiler Supply Ratings

Model	Max. First Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)		Boiler Output Needed (BTU/Hr.)	Boiler Water Flow Through Coil (Gal./ Min)	Pressure Drop Through Coil (Ft. Water)
	140° F	115° F	140° F	115° F	(BTU/Hr.)	Gal./ Min	(Ft. Water)
HF-30	202	269	175	242	131,250	14.0	5.3
HF-40	221	292	185	256	138,670	14.0	5.7
HF-40L	212	251	176	215	132,000	14.0	5.3
HF-50	223	291	178	246	133,280	14.0	6.0
HF-60	262	342	208	288	155,700	14.0	6.2
HF-60L	239	310	185	256	138,570	14.0	5.7
HF-80	271	348	199	276	149,390	14.0	6.0
HF-115	324	409	221	306	165,750	14.0	6.6

High Output Units: 60-HO, 80-HO, 115-HO

60-HO	406	541	352	487	263,900	14.0	10.1
80-HO	418	551	346	479	259,340	14.0	9.9
80-HO-C	442	584	370	512	277,070	21.0	10.5
115-HO	467	607	364	504	273,100	14.0	15.8
115-HO-C	479	623	376	520	281,800	21.0	16.7

Extra High Output Units: 85-XHO, 115XHO

85-XHO	738	992	660	914	495,000	28.0	13.0
115-XHO	763	1017	660	914	495,000	28.0	13.0

Table 3: 180° F Boiler Supply Ratings

Model	Max. First Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)		Boiler Output Needed (BTU/Hr.)
	140° F	115° F	140° F	115° F	(BTU/Hr.)
HF-30	176	233	149	206	111,560
HF-40	193	254	157	218	117,870
HF-40L	186	251	150	215	112,200
HF-50	196	254	151	209	113,290
HF-60	231	298	177	244	132,340
HF-60L	211	272	157	218	117,785
HF-80	241	306	169	234	126,980
HF-115	291	363	188	260	140,890

High Output Units: 60-HO, 80-HO, 115-HO


60-HO	353	468	299	414	220,880
80-HO	366	479	294	407	220,440
80-HO-C	386	507	314	435	235,510
115-HO	413	532	310	429	232,135
115-HO-C	423	545	320	442	239,530

Extra High Output Units: 85-XHO, 115XHO


85-XHO	649	868	571	790	428,000
115-XHO	674	893	571	790	428,000

NOTE: All ratings are based on a 50° F. cold water inlet. For other boiler supply temperatures, see additional tables on the website (www.heat-flo.com).

HO-C UNITS

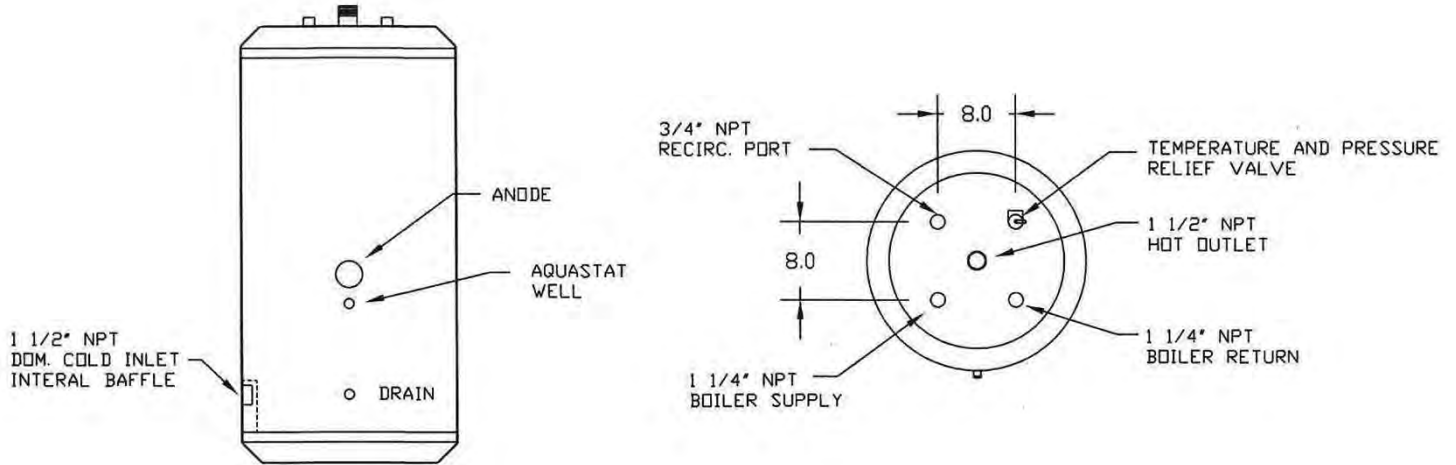

XHO EXTRA HIGH OUTPUT UNITS

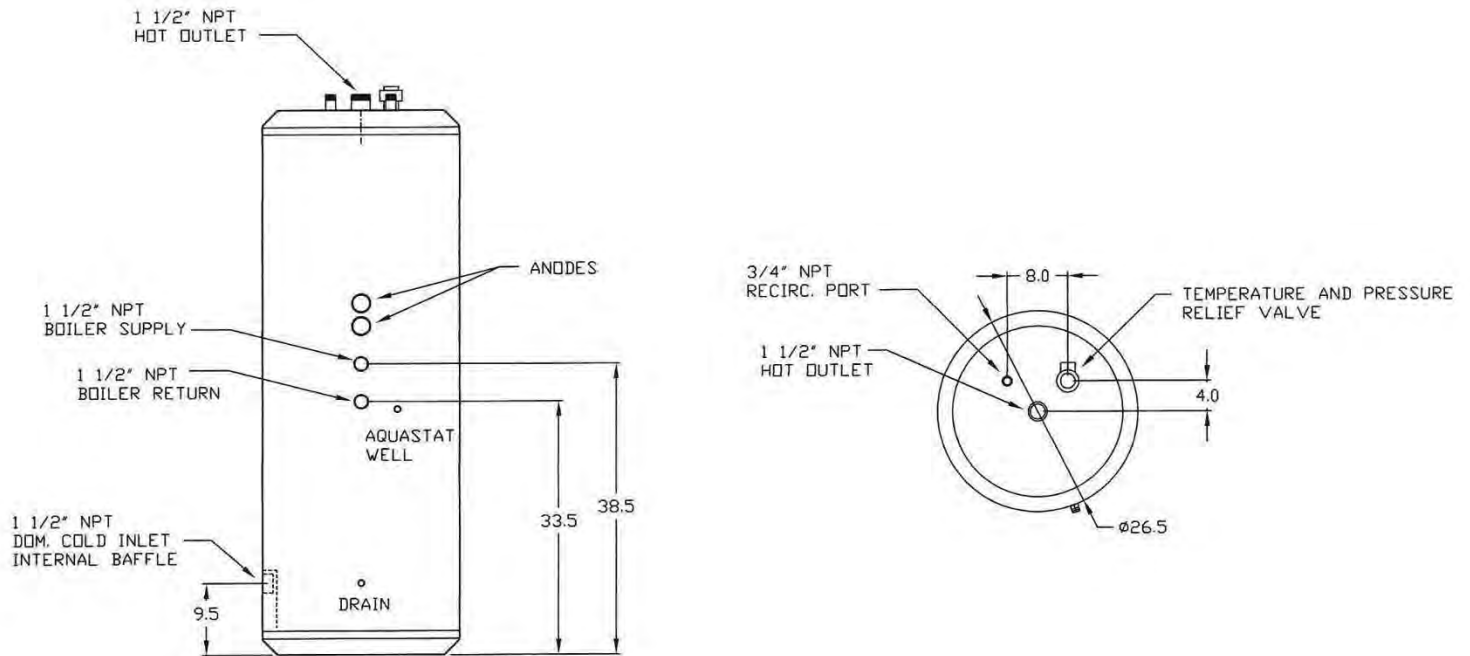

XHO HIGH OUTPUT INDIRECTS
 MODEL 115-XHO - HEIGHT = 74" - 115 GAL.
 MODEL 85-XHO - HEIGHT = 64" - 86 GAL.

COLD AND HOT DOMESTIC - 1 1/2" NPT CONNECTIONS
 COIL SUPPLY AND RETURN - 1 1/2" NPT CONNECTIONS

3. Circulator sizing:

Refer to Table 2 (Pg. 2) for the flow through the water heater coil and the pressure drop. Calculate the pressure drop across all piping and fittings connected to the water heater zone. Be sure to include all zone valves, check valves, and shut-off valves. It is recommended that the water heater zone be piped with 1" pipe around the entire loop on typical residential sites and with 1-1/4" and 1-1/2" pipes on high output units used on commercial sites.

SYSTEM ZONE CONTROL

The water heater must be installed as a separate zone from the space heating system. The water heating zone's piping and circulator must be sized for the minimum flow rate with all the zones in use and a maximum flow with only the water heater in use. The best method is to use a separate circulator for the water heater.

The three most common systems are:

1. Zone Circulators- The space heating zones use a circulator for each zone, and the water heater is controlled with an additional circulator.
2. Hybrid System- The space heating zones use zone valves for each zone, and the water heater is controlled with an additional circulator.
3. Zone Valves – The space heating zones use zone valves for each zone, and the water heater is controlled with an additional zone valve. Select a valve with a low pressure drop, and assure minimum flow with adequate pipe sizing.

PRIORITY OR NON-PRIORITY FOR HOT WATER

Option 1: Priority

The demand for space heating is interrupted until the hot water demand is satisfied. This option provides the maximum delivery of hot water.

Priority is recommended when:

- a. The boiler output is less than 100,000 Btu per hour. Or,
- b. The boiler output required to satisfy the hot water demand is more than 50% of the boiler output needed to satisfy the space heating demand. Or,
- c. When an interruption in space heating can be tolerated during long domestic hot water draws.

In most cases the delay in space heating will not be noticed because of the rapid recovery of the water heater. It must be recognized however that certain water heater malfunctions, such as a failed thermostat or circulator, could delay space heating indefinitely.

Option 2: Non-Priority:

The boiler output is divided between space heating and water heating. Heating of domestic hot water can be reduced during simultaneous space and water heating demands. The amount of reduction depends on the boiler output, the number of space heating zones calling, and the amount of boiler water flow split between the space heating and zones and the water heater zone.

LOCATING THE WATER HEATER

The water heater should be located in an area where water leakage from the tank or connections will not result in damage to areas adjacent to the water heater or to lower floors of the structure. When such a location cannot be avoided, a suitable drain pan must be installed under the water heater, and the drain pan must be connected to a drain. The drain pan depth must be suitable for draining and collecting water. The piping to drain must be at least 3/4" diameter and be pitched for proper drainage.

The water heater should be installed as close to the boiler as is practical for easy access for service. The unit is designed for installation on combustible flooring and in alcoves, closets, etc.

The minimum clearances from combustible surfaces are:

Bottom	0"
Left, Right, and Rear Sides	1"
Front	1"
Top	6"

The minimum clearances for service are:

Bottom	0"
Left, Right, and Rear Sides	3"
Front	30"
Top	6"

ADDITIONAL RECOMMENDED COMPONENTS

1. **Shut-Off Valves:** Allows the isolation of the water heater from the boiler system during service.
2. **Unions:** Allows for easy locating or removal.
3. **Vacuum Breaker:** Protects the water heater from collapse if a hot tank is valved off to service other components in the system.
4. **Thermal expansion tank.** If the water heater is installed in a closed water supply system, such as a system having a back flow preventer, a check valve, or a pressure reducing valve in the cold water supply line, the installation of a thermal expansion tank is required.

REMOVING THE EXISTING DOMESTIC WATER HEATING SYSTEM

External Tankless Heater

Disconnect all lines to the boiler and plug the boiler fittings. Disconnect the external heater from the boiler piping, and the domestic piping systems.

Internal Tankless Heaters

Disconnect the domestic piping. Do not plug the cold water or the hot water fittings in the internal tankless coil. Leave the coil in the boiler with the cold and hot water fittings open to prevent pressure build-up in the coil.

NOTICE

For California installation this water heater must be braced, anchored, or strapped to avoid falling or moving during an earthquake. See instructions for correct installation procedures. Instructions may be obtained from California Office of the State Architect.

Water Quality

Improper water quality will reduce the expected life of the water heater. Hard water, sediment, high or low Ph, and high levels of chlorides in the domestic water should be avoided. Sediment and hard water will eventually coat the heating coil inside the water heater and reduce the rate of hot water production and may eventually cause a failure. High or low Ph and/or high chloride concentrations will cause corrosion and eventually failure. A filter is strongly recommended where sediment is present in the water. A water softening system is recommended for areas with hard water. In an area where the water quality is not known, a water quality test should be performed.

WARNING:

Do not operate the Heat-Flo water heaters in areas where the Ph is above 8.0 or below 6.0, and/or with chloride concentrations greater than 100 parts per million (ppm). Heat-Flo's standard warranty does not cover problems caused by improper water Ph or excessive levels of chlorides.

NOTICE

Damage to tanks caused by improper water quality is not covered under the warranty.

PIPING

DOMESTIC WATER PIPING (See Figure 1, Pg. 9)

1. Drain the domestic water system.
 - Shut off the cold water supply at the main shutoff valve.
 - Open one or more faucets to relieve the pressure.
 - Open the system drain, leaving the faucets open.

2. Position the water heater in its final location
3. Connect the cold water supply piping.
 - Install piping onto cold inlet connection.
 - Connect to cold water supply connection using a union, a heat trap, a shut-off valve, a vacuum breaker, an expansion tank (where required), and a filter (recommended to prevent sediment buildup).

NOTICE

If installing on a city supply, a properly sized thermal expansion tank is required and should be installed in accordance with the product installation manual.

If a water heater is installed in a closed water supply system, such as one having a backflow preventer in the cold water supply, a check valve in the cold water supply, or a pressure reducing valve in the cold water supply means shall be provided to control thermal expansion.

The appliance, when installed, must be grounded in accordance with the local codes, or in the absence of local codes, with the National Electrical Code, ANSI/NFPA 70.

⚠ WARNING

If this product is connected to a cold water supply line that has a check valve, a backflow preventer, a pressure reducing valve, or a check valve in the water meter, it is a requirement that a properly sized thermal expansion tank be installed in the cold water inlet line. *There will be no warranty on applications where there is no pressure control.*

4. Connect the domestic hot water piping.
 - Install piping onto hot water supply connection using a union, a heat trap, and a shut off valve.
 - Pipe the relief valve discharge so that the discharge from the valve will exit only within 6 inches above, or at any distance below, the structural floor and so that it cannot contact any live electrical part. The discharge opening must not be blocked or reduced in size under any circumstances.

⚠ WARNING

Install a discharge line so that water discharged from the temperature and pressure relief valve will exit within six (6) inches above, or any distance below, the structural floor and cannot contact any live electrical part. The discharge line is to be installed to allow for complete drainage of both the temperature and pressure relief valve and the discharge line. The discharge opening must not be subjected to blockage or freezing.

DO NOT thread, plug, or cap the discharge line. It is recommended that a minimum clearance of four (4) inches be provided on the side of the water heater for servicing and maintenance of the combination temperature and pressure relief valve.

Do not place a valve between the combination temperature and pressure relief valve and the tank!

5. Fill the water heater.
 - Open all faucets to allow air to purge from the tank and piping. Remove screens on faucets.
 - Open domestic hot water shut-off valve.
 - Open cold water inlet shut-off valve.
 - Purge all of the air from the domestic water system. Allow water to run so the tank is completely purged of any debris. Run the water long enough to change at least five tank volume changes.
 - Close all faucets. Reinstall all of the screens in the faucets.
 - Check the system for leaks. Repair as required.

WATER BOILER PIPING (Refer to Figures 2, 3 on Pg. 10)

1. Determine where the boiler, the space heating, and the water heater connections should be made based on the type of piping system that is either in place, or is to be installed for a new hydronic system installation. See Figure 2 (Boiler Water Piping with Zone Circulators) and Figure 3 (Boiler Water Piping with Zone Valves).
2. It is recommended that 1" pipe and 1" zone valves be used on the water heater zone on residential sites, and 1-1/4" and 1-1/2" pipe be used on high output units on commercial sites.

ZONE CIRCULATOR SYSTEM

For space heating systems that use Zone Circulators, refer to Figure 2. The water heater connection labeled "BOILER SUPPLY" should be piped to the boiler supply piping after the air purger and before the space heating takeoffs. Mount the water heater circulator as close to the water heater as possible, and make sure the flow arrow points toward the water heater. The use of shut-off valves is recommended for future service convenience.

The water heater connection labeled "BOILER RETURN" should be piped to the boiler return piping as close to the boiler as possible and after any flow control or check valves in the space heating return piping. The use of a union and a shut-off valve is recommended. The use of a check valve is required to prevent back flow through the water heater during operation of the space heating system.

ZONE VALVE SYSTEM

For a space heating system that uses Zone Valves, refer to Figure 3. The water heater connection labeled "BOILER SUPPLY" should be piped to the boiler supply piping after the air purger and before the space heating circulator. Mount the water heater circulator as close to the water heater as possible, and make sure the flow arrow points toward the water heater. The use of a shut-off valve is recommended for future service convenience.

The water heater connection labeled "BOILER RETURN" should be piped to the boiler return piping as close to the boiler as possible and after any flow control or check valves in the space heating return piping. The use of a union and a shut-off valve is recommended. The use of a check valve is required to prevent back flow through the water heater during operation of the space heating system.

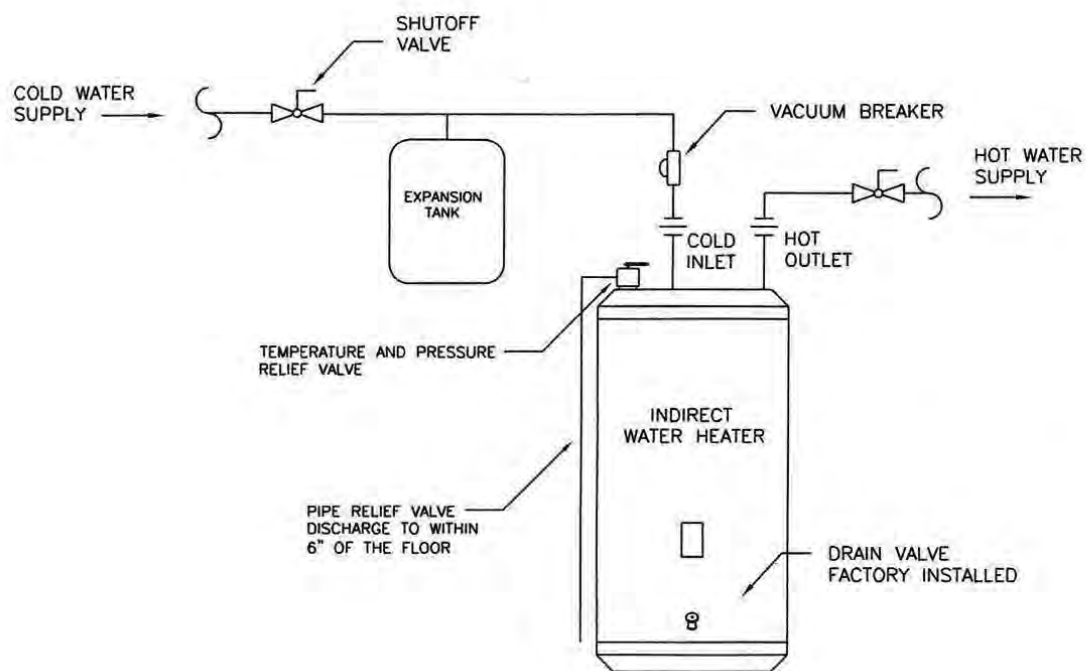


FIGURE 1
DOMESTIC WATER PIPING

NOTE: FIGURES 1, 2, AND 3 ARE MEANT TO ILLUSTRATE SYSTEM PIPING ONLY. THE INSTALLER IS RESPONSIBLE FOR CONFORMING TO THE LOCAL CODES. IN MASSACHUSETTS, YOU MUST INSTALL A VACUUM RELIEF VALVE PER 248 CMR. SEE LOCAL CODE REQUIREMENTS.

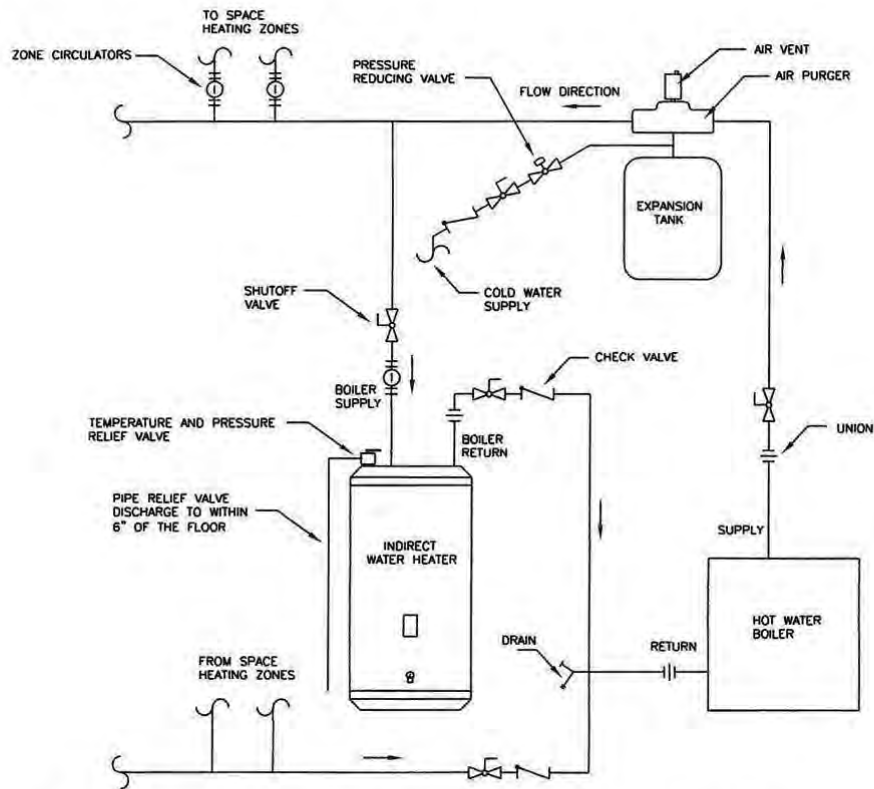


FIGURE 2 – BOILER WATER PIPING WITH ZONE CIRCULATORS

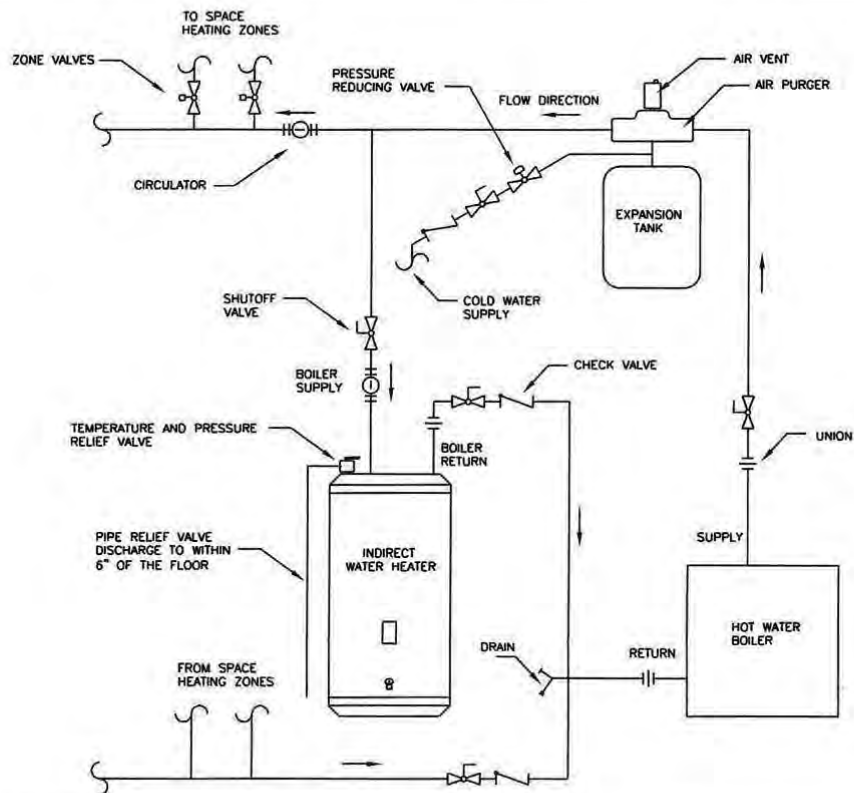


FIGURE 3 – BOILER WATER PIPING WITH ZONE VALVES

ELECTRICAL

1. Install electric wiring and grounding in accordance with the National Electrical code (latest edition) and/or local regulations in the US, and in accordance with the Canadian Electrical Code (latest edition), and/or local regulations in Canada.
2. All water heaters are supplied with a thermostat.
 - Refer to schematics 1, 2 and 3 for separate circulator wiring.
 - Refer to schematics 4, 5 and 6 for zone valve wiring.
 - Other options include using one of the many good zone controls that are on the market.

---Reference should be made to the Installation Manual for the boiler as well.---

OPERATION

STARTUP

After the water heater has been plumbed and wired and the boiler water piping is purged of air, the water heater is ready to be started.

1. Follow the boiler installation instructions to place the boiler in operation.
2. The tank thermostat is factory pre-set to 125 degrees F and will call for heat if the water in the tank is lower than that (125 deg. F).
3. On a call for heat, the tank thermostat contacts close to start the water heater zone circulator and the boiler.
4. After the tank has reached the temperature setting, the tank thermostat opens and de-energizes the circulator and the boiler. If there is a call for space heating, the boiler will continue to run until the room thermostats are satisfied.

▲ WARNING - SCALDING!


This water heater can deliver scalding temperature water at any faucet in the system. Be careful when using hot water to avoid scalding injury. By setting the thermostat on this water heater to obtain an increased water temperature, you create the potential for scald injury. To protect against injury, you should install an ASSE approved mixing valve (a device to limit the temperature of water to protect against scald injury via mixing hot and cold water supply) in the water system. This valve will reduce point of discharge temperature in branch supply lines. Such valves are available from a local plumbing supplier. Please consult with a plumbing professional.

SCALD RELATIONSHIPS


The tank thermostat controls the maximum water temperature in the water heater. If it is set too high, the resulting hot water can cause painful scalding with possible serious and permanent injury. The temperature at which this occurs varies with a person's age, and the length of time in contact with the hot water. The slower response time of infants, older, or handicapped people increases the hazard for them.

SEPARATE CIRCULATOR WIRING

Honeywell Relay R4222D1013 with Q633A receptacle

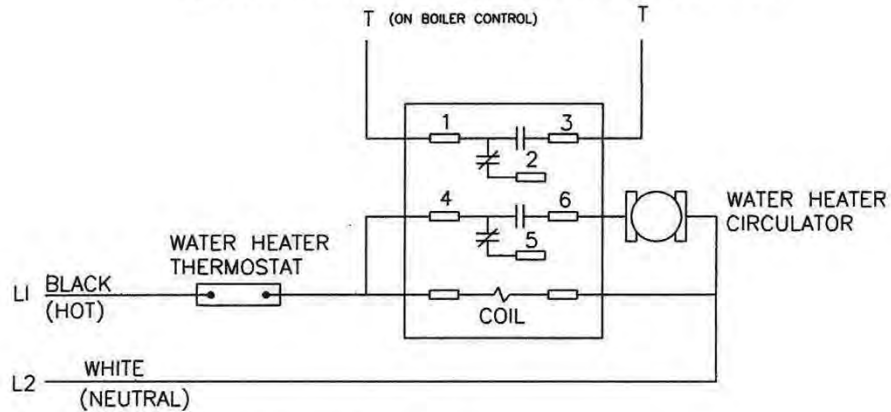


SCHEMATIC 1
24 VOLT "T-T" WIRING

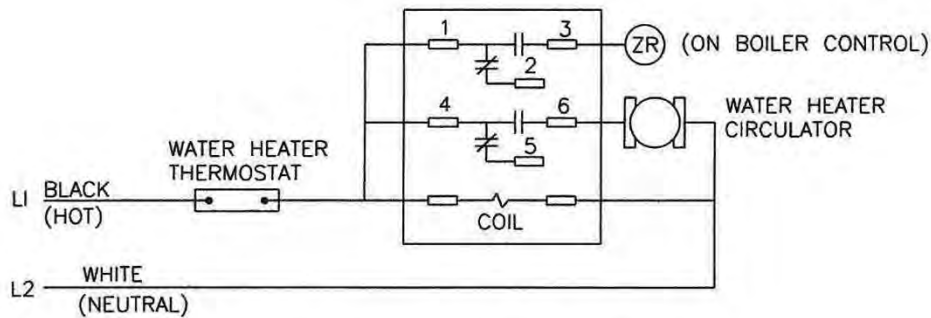


WHEN NO "ZR" TERMINAL IS AVAILABLE
WIRE TO THE SUPPLY SIDE OF THE HI LIMIT

SCHEMATIC 2
120 VOLT - ZR TERMINAL

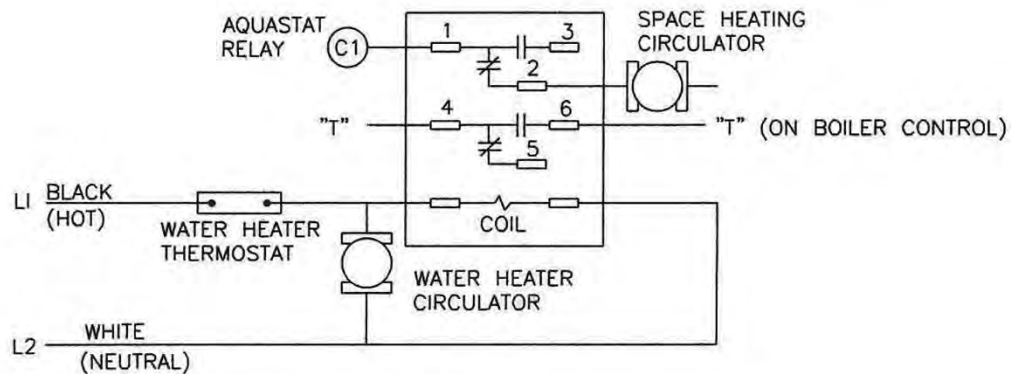


SCHEMATIC 3
PRIORITY WITH CIRCULATORS


ZONE VALVE WIRING

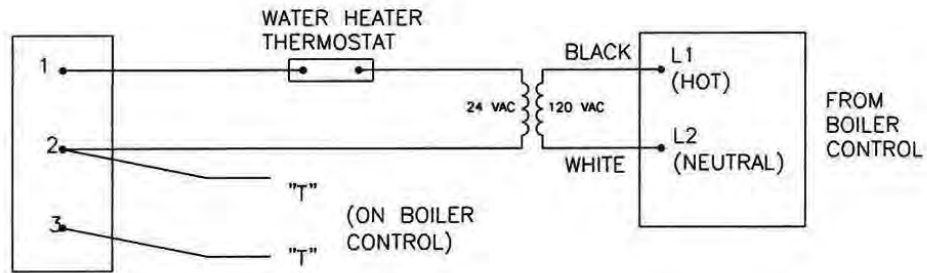

SCHEMATIC 4
3-WIRE ZONE VALVE

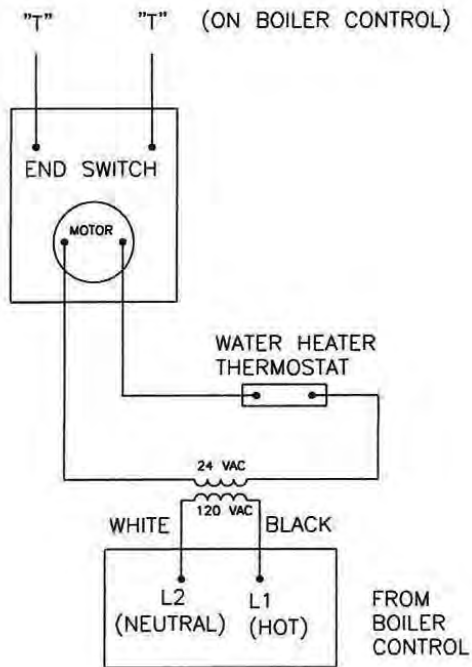

SCHEMATIC 5
4-WIRE ZONE VALVE WITH 24 VOLT MOTOR

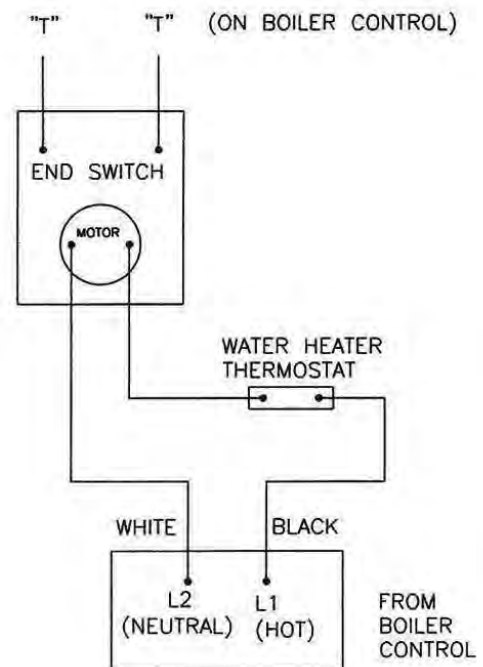

SCHEMATIC 6
4-WIRE ZONE VALVE WITH 120 VOLT MOTOR

WATER TEMPERATURE ADJUSTMENT

It is recommended that the thermostat be set for the lowest possible temperature that satisfies your needs. This will also provide you with the lowest energy consumption and cost.

Check the water temperature at a hot water faucet soon after the tank thermostat has satisfied, and the circulator and the boiler have turned off. Adjust as needed.


Lowering the thermostat setting will not have an immediate effect on the water temperature because the stored water will have to be used and the thermostat must go through the cycle of heating cold water and satisfying at the new, lower temperature. Additional temperature checks should follow the completion of a heating cycle. Further adjustments may be required after you have used the water heater.

The table below details the approximate relationship of water temperature and time with regard to scald injury and may be used as a guide in determining the safest water temperature for your applications.

APPROXIMATE TIME/ TEMPERATURE RELATIONSHIPS IN SCALDS	
120°F (52°C)	More than 5 Minutes
125°F (52°C)	1-1/2 to 2 Minutes
130°F (54°C)	About 30 Seconds
135°F (57°C)	About 10 Seconds
140°F (60°C)	Less than 5 Seconds
145°F (63°C)	Less than 3 Seconds
150°F (66°C)	About 1-1/2 Seconds
155°F (68°C)	About 1 Seconds

The scald label shown to the right can be found on all Heat-Flo Indirect Water Heaters and Storage tanks. Take note and use caution when adjusting the temperature settings with your water system. Be sure to always feel the water before bathing or showering, especially when drawing a bath for an infant or elder.

⚠ DANGER

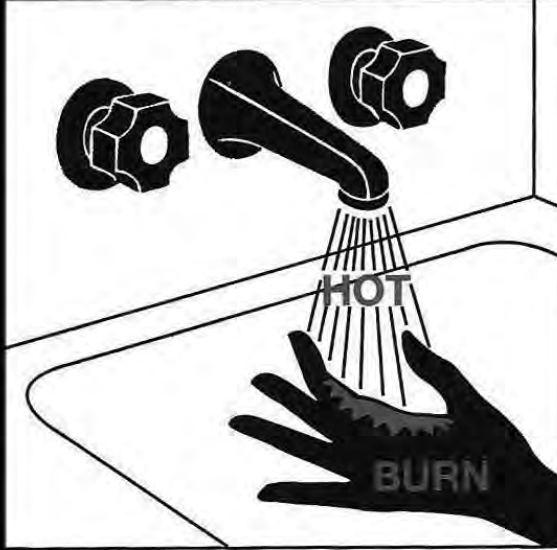

Water temperature over 125°F can cause severe burns instantly or death from scalds.

Children, disabled and elderly are at highest risk of being scalded.

See instruction manual before setting temperature at water heater.

Feel water before bathing or showering.

Temperature limiting valves are available, see manual.

– Important **WARNING** information on the following page. –

▲ WARNING

It is the responsibility of the installing contractor to see that all controls are correctly installed and are operating properly when the installation is complete.

DO NOT operate the water heater with jumpered or absent controls or safety devices.

DO NOT tamper with or alter the water heater and/ or controls.

DO NOT operate the water heater if any external part has been under water. Immediately call a qualified service technician to inspect the appliance and to replace any part of the control system that is or had been under water.

DO NOT install this water heater on carpeting. This water heater is suitable for installation on combustible flooring.

DO NOT operate this water heater without first being certain it is filled with water.

MAINTENANCE

The water heater is intended to provide many years of reliable service. Components, such as thermostats and relief valves, may be subject to failures that require service. Depending on the quality of the water supply, sediment and/or scale may coat the heating coil in the tank and reduce hot water recovery rate. Failure to use the correct procedures or parts can result in unsafe operation.

The owner should arrange to have the following inspections and simple maintenance procedures done at the suggested frequencies.

1. Boiler and Domestic Water Piping (Annual)

- Check all piping for signs of leakage at the joints, unions and shut-off valves. Repair as required.

2. Temperature and Pressure Relief Valve (Annual)

- The temperature and pressure relief valve should be checked to ensure that it is in operating condition. To check the relief valve, lift the lever at the end of the valve several times. The valve should seat properly and operate freely. If water does not flow, remove and inspect for obstructions or corrosion. Replace with a new valve of the recommended capacity as necessary. Do not attempt to repair the valve, as this could result in improper operation and a tank explosion. In areas with poor water conditions, it may be necessary to inspect the temperature and pressure relief valve more often than once a year.

▲ CAUTION

Before manually operating the valve, make sure that a drain line has been attached to the valve to direct the discharge to an open drain. Failure to take this precaution could mean contact with extremely hot water discharging from the valve during this checking operation.

If the temperature and pressure relief valve on the heater discharges periodically or continuously, it may be due to thermal expansion of water in a closed water supply system, or it may be due to a faulty relief valve. Thermal expansion is the normal response of water when it is heated. In a closed system, thermal expansion will cause the system pressure to build until the relief valve actuation pressure is equaled. Then the relief valve will open, allowing some water to escape, slightly lowering the pressure. Contact your water supplier or local plumbing inspector on how to control this situation.

ABOVE ALL, DO NOT PLUG THE TEMPERATURE AND PRESSURE RELIEF VALVE. THIS IS NOT A SOLUTION AND CAN CREATE A HAZARDOUS SITUATION.

3. Sediment (Annual except where harsh water quality may require more frequent service)
 - Depending on water conditions, a varying amount of sediment may collect in the tank. Levels requiring service are indicated by a small temperature difference between the boiler supply and return lines, and a reduced recovery rate. Repeated flushing usually clears such material. As a preventive measure, water should be drawn from the drain valve until it runs clear and the installation of a water filter should be considered.
4. Scale (Annual)
 - Hard water may cause scale buildup on the outside of the heating coil inside the tank. A water softener will prevent this problem. Symptoms are identical to sediment buildup. If repeated flushing does not resolve the problem, chemical cleaning may be required. Proceed as follows:

CHEMICAL CLEANING OF THE HEATING COIL

1. To avoid water damage, shut off the cold water supply to the water heater.
 2. Make a note of the temperature control setting on the water heater, and turn off the power to the water heater.
 3. Relieve the water pressure in the tank by opening a hot water faucet. This will reduce the risk of scalding.
 4. Remove the relief valve from the water heater.
 5. Drain the water heater until the water is at a level equal to 3" above the thermostat well. This level will cover the coil and the thermostat.
 6. Using a funnel, pour one gallon of commercial ice maker cleaning solution into the tank through the relief valve opening. Follow the instructions, cautions, and warnings supplied with the cleaning solution.
 7. Turn on the power to the water heater, and allow the boiler to heat the water until the tank thermostat is satisfied. The boiler may cycle on its high limit several times during this period. If the tank thermostat is not satisfied after 45 minutes of boiler operation, turn the thermostat to its lowest setting.
 8. Allow the heated solution to set in the tank 30 minutes.
 9. Drain the tank completely using fittings and hoses, as required, to reach a drain.
 10. Fill the water heater tank with fresh, cold, water and drain it completely. Repeat filling and draining at least three (3) times to flush all of the cleaning solution from the tank.
 11. Reinstall the relief valve and the drain piping.
 12. Open the cold water supply and fill the tank with water. Purge the air from the tank and the piping by opening the cold and hot water faucets in the house.
5. Inspect Anode (annual)
 - The purpose of the magnesium anode is to reduce the damaging effects of aggressive water on the water heater. Aggressive water will cause the anode(s) to erode. The anode(s) must be inspected at least annually to determine whether a new anode should be installed. Use anode replacement parts supplied by Heat-Flo only. Heat-Flo anodes are 1-1/4 NPT and are made with magnesium, brass, and stainless steel. There is no steel in a Heat-Flo anode. Severe or rapid deterioration of the anode indicates very aggressive water. If this occurs, have the water tested to verify whether it is within the limits

outlined on page 6. Failure to inspect the anode regularly and replace if necessary could result in damage to the water heater. If this unit is installed and maintained according to the instructions and conditions in this manual, this product will last for a long time.

1. Close domestic water isolation valves.
2. Drain the water heater completely and allow it to cool off.
3. Remove the anode cover on the front of the unit. See figures on pages 2 and 3. The temperature control can be turned to the side to allow easier access.
4. After the water heater has drained and cooled, remove the anode using a 1 ¾" 6-point socket and a breaker bar.
5. Inspect the anode and replace if needed. The anode should be replaced when more than 6" of core wire is exposed. The anode should be replaced with a Heat-Flo supplied anode only. See above. The brass hex on the anode is 1 ¼ NPT and installs into a 1 ¼ stainless half coupling on the shell of the tank. This part will need to be properly Teflon taped and coated with a quality Teflon based pipe sealant.
6. Replace the inspection cover.
7. Refill the water heater, and restore to operation.
8. Verify operation of boiler and water heater.

TROUBLESHOOTING

PROBLEM	CAUSE	SOLUTION
No hot water at faucets.	- Boiler does not operate - Circulator does not operate - Improper thermostat setting - Zone valve does not open - Electrical problem - Sediment and/or scale buildup - Clogged filter	Press reset button. Check main cut-off switch. Check fuses or breakers. Check power supply. Check shaft coupling. Turn thermostat to a higher setting. Check power supply and valve. Check fuses and replace. Check circuit breaker and reset. Check power supply. If boiler, circulator, and thermostat are operating properly, and the boiler is cycling on the high limit several times before the tank thermostat is satisfied, the coil may have a coating of sediment and/or scale. See chemical cleaning instructions (Pg. 16). Clean or replace filter.
Insufficient/ runs out of hot water at the faucet.	- Thermostat setting too low. - Undersized boiler with no priority to domestic water heating. - Peak draw of hot water is greater than the tank storage. - Sediment and/or scale buildup - Faulty water heater thermostat	Turn the thermostat to a higher setting. Rewire for priority. Determine peak usage and compare to tank volume. Clean coil. Replace thermostat.
Water at faucet too hot.	- Thermostat set to high - Improper system plumbing - Improper wiring	Lower thermostat setting. Compare plumbing to installation guide. Inspect check valves. Compare wiring to installation guide.
Boiler cycles more than 5 times per day in summer.	- Excessive demand - Faulty thermostat - Boiler high limit set to low - Sediment and or scale buildup	Reduce demand or consider larger boiler and/or water heater. Replace thermostat. Increase boiler hi-limit setting. Clean coil.

**180°F Boiler Supply
IBR Rating Condition**

MODEL	30 And 40-L				40				60			
	Boiler Flow = 14 gpm				Boiler Flow = 14 gpm				Boiler Flow = 14 gpm			
Boiler Output (BTU/HR)	1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)		1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)		1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)	
	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F
50,000	94	119	67	92	103	128	67	92	121	146	67	92
60,000	107	138	80	111	116	147	80	111	134	165	80	111
80,000	134	174	107	147	143	183	107	147	161	201	107	147
100,000	160	211	133	184	169	220	133	184	187	238	133	184
120,000	175	233	148	206	193	253	157	217	214	275	160	221
140,000	175	233	148	206	193	253	157	217	230	298	176	244

MODEL	60-L				80				115			
	Boiler Flow = 14 gpm				Boiler Flow = 14 gpm				Boiler Flow = 14 gpm			
Boiler Output (BTU/HR)	1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)		1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)		1st Hour Rating (GAL/HR)		Continuous Rating (GAL/HR)	
	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F
50,000	121	146	67	92	139	164	67	92	170	195	67	92
60,000	134	165	80	111	152	183	80	111	183	214	80	111
80,000	161	201	107	147	179	219	107	147	210	250	107	147
100,000	187	238	133	184	205	256	133	184	236	287	133	184
120,000	211	271	157	217	232	293	160	221	263	324	160	221
140,000	211	271	157	217	241	306	169	234	289	361	186	258
160,000	211	271	157	217	241	306	169	234	290	363	187	260

HIGH OUTPUT UNITS: 60-HO, 80-HO, 115-HO


MODEL	60-HO High Output				80-HO High Output				115-HO High Output			
	Boiler Flow = 14 gpm				Boiler Flow = 14 gpm				Boiler Flow = 14 gpm			
Boiler Output (BTU/HR.)	1st Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)		1st Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)		1st Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)	
	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F
100,000	187	238	133	184	205	256	133	184	236	287	133	184
120,000	214	275	160	221	232	293	160	221	263	324	160	221
140,000	240	312	186	258	258	330	186	258	289	361	186	258
160,000	267	350	213	296	285	368	213	296	316	398	213	296
180,000	294	387	240	333	312	405	240	333	343	435	240	333
200,000	321	424	267	370	339	442	267	370	370	473	267	370
220,000	347	460	293	406	365	478	293	406	396	509	293	406
240,000	353	468	299	414	381	501	309	429	412	532	309	429
250,000	353	468	299	414	381	501	309	429	412	532	309	429

EXTRA HIGH OUTPUT UNITS: 85-XHO, 115-XHO


MODEL	85-XHO High Output				115-XHO High Output			
	Boiler Flow = 14 gpm				Boiler Flow = 14 gpm			
Boiler Output (BTU/HR.)	1st Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)		1st Hour Rating (Gal./Hr.)		Continuous Rating (Gal./Hr.)	
	140°F	115°F	140°F	115°F	140°F	115°F	140°F	115°F
200,000	339	442	267	370	370	473	267	370
220,000	365	478	293	406	396	509	293	406
240,000	392	515	320	443	423	546	320	443
250,000	411	540	333	462	436	565	333	462
275,000	445	586	367	508	470	611	367	508
325,000	511	679	433	601	536	704	433	601
350,000	545	725	467	647	570	750	467	647
375,000	578	771	500	693	603	796	500	693
400,000	611	817	533	739	636	842	533	739
425,000	639	856	561	778	664	881	561	778

Replacement Parts List


	Description	Heat-Flo Part Number
1	Temperature and Pressure Relief Valve Watts 3/4" 100XL-8	Valve 75 - WATTS-STAN100
2	Temperature and Pressure Relief Valve Watts 3/4" 40XL-8	Valve 75 - WATTS40XL8
3	Aquastat Well, 1/2"	Aquastat-Well
4	Honeywell 4080B Aquastat	Aquastat-L4080B
5	1/2" X 3-1/2" Nipple	Nipple-5035-316
6	1/2" Drain Valve	Valve-50-LGND-107554
7	Anode (See pgs 16, 17)	ANODE-ROD-ASSY-1.315-17WCAP

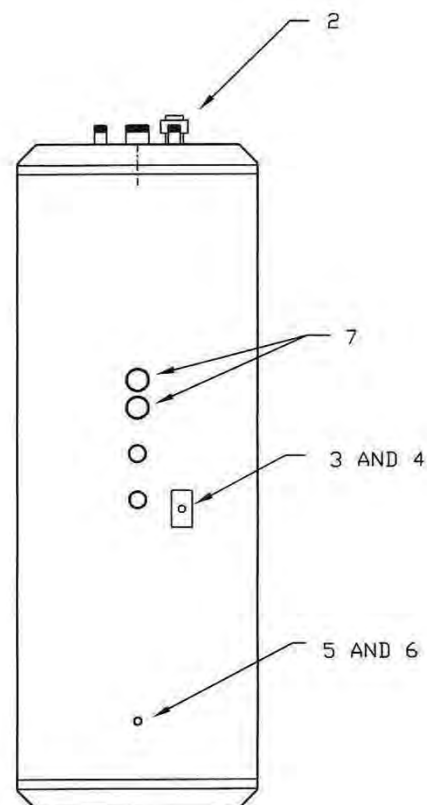

-XHD HIGH OUTPUT INDIRECTS

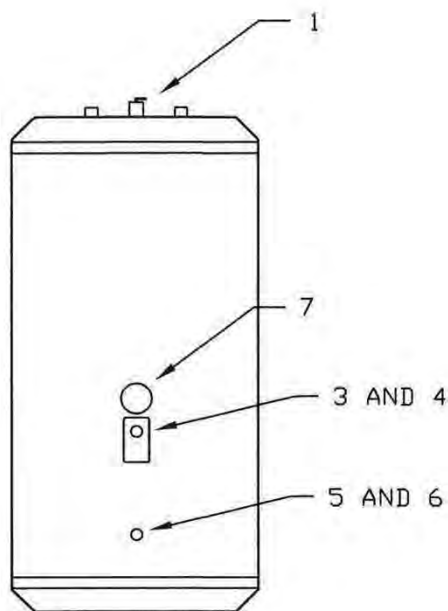

STANDARD AND HD UNITS

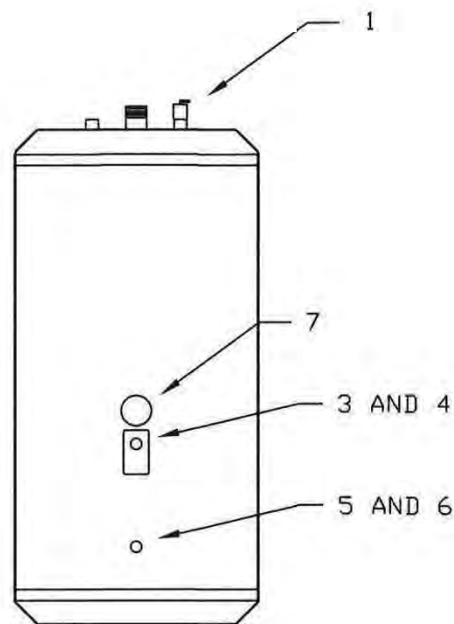

HD-C UNITS

Heat-Flo, Inc.

LIMITED WARRANTY

FOR INDIRECT WATER HEATER

These Heat-Flo, Inc. warranties protect your indirect-fired water heater. These warranties are applicable to the original purchasers only.

WARRANTY COVERAGE FOR RESIDENTIAL USAGE

The warranties listed in this section shall apply to Heat-Flo, Inc., indirect-fired water heaters used in a residential setting by the original consumer purchases only. A “residential setting” as used herein shall mean usage in a single-family dwelling in which the original consumer purchaser of the indirect-fired water heater resides on a permanent basis. “Residential setting” shall also mean usage in a multiple family dwelling provided that a Heat-Flo, Inc. indirect-fired water heater services only one (1) dwelling in a multiple family dwelling. The term “residential setting” shall not include any usage of the indirect-fired water heater above 150 degrees Fahrenheit.

Heat-Flo, Inc. warrants that it will repair or replace, at its option, without charge, any defective or malfunctioning component of the water heater during the first year after the original date of installation in the dwelling. It is expressly agreed between Heat-Flo, Inc. and the original consumer purchaser that repair or replacements are the exclusive and sole remedy of the original consumer purchaser.

After one year, Heat-Flo, Inc. will repair or replace, at its option, without charge, any water heater having a defect or malfunction that results in a water leak from outer the jacket, inner tank, or heat exchanger as a result of normal use and service. It is expressly agreed between Heat-Flo, Inc. and the original consumer purchaser that the repair or replacement is the exclusive and sole remedy of the original consumer purchaser.

Should a defect or malfunction result in a leakage of water within the above-stated warranty periods due to defective material or workmanship, malfunction, or failure to comply with the above warranty, such defect or malfunction having been verified by an authorized Heat-Flo, Inc. representative, then Heat-Flo, Inc. will replace the defective or malfunctioning water heater with a replacement water heater of the nearest compatible model available at the time of replacement.

If Heat-Flo, Inc. is unable to repair or replace a water heater so as to conform to this warranty, after a reasonable number of attempts, then Heat-Flo, Inc. will provide at its option, either a replacement product, or a full refund of the purchase price. These remedies are the consumer purchaser’s exclusive remedies for breach of the warranty.

WARRANTY COVERAGE FOR COMMERCIAL USAGE

The warranties listed in this section shall apply to Heat-Flo, Inc. water heaters used in a commercial setting by the original consumer purchasers only. A “commercial setting” as used herein shall mean any usage not falling within the above definition of a “residential setting”. A Heat-Flo, Inc. water heater shall be deemed used in a “commercial setting” if at any time it is operated at a temperature above 150 degrees Fahrenheit.

Heat-Flo, Inc. warrants that it will repair or replace, at its option, without charge, any defect or malfunctioning of the water heater during the first year after the original date of delivery to the original consumer purchaser. It is expressly agreed between Heat-Flo, Inc. and the original consumer purchaser that the repair or replacement is the exclusive and sole remedy of the original consumer purchaser.

During the second through fifth years after the original date of delivery to the original consumer purchaser, Heat-Flo, Inc. will repair or replace, at its option, without charge, any water-heater having a defect or malfunction that results in a water leak from the outer jacket, inner tank, and heat exchanger as a result of normal use and service. It is expressly agreed between Heat-Flo, Inc. and the original consumer purchaser that the repair or replacement is the exclusive and sole remedy of the original consumer purchaser.

Should a defect or malfunction result in a leakage of water within the above-stated warranty periods due to defective material or workmanship, malfunction, or failure to comply with the above warranty, such defect or malfunction having been verified by an authorized Heat-Flo, Inc. representative, then Heat-Flo, Inc. will replace the defective or malfunction water heater with a replacement indirect water heater of the nearest comparable model available at the time of replacement.

If Heat-Flo, Inc. is unable to repair or replace the water heater so as to conform with this warranty after a reasonable number of attempts, then Heat-Flo, Inc. will provide, at its option, either a replacement product, or a full refund of the purchase price. These remedies are the exclusive remedies of the original consumer purchaser See reverse side for exclusions, limitations, remedies and service request information.

WHAT IS NOT COVERED BY EITHER OF THESE WARRANTIES

Heat-Flo, Inc. does not warrant:

1. Defects or malfunctions resulting from improper installation or failure to maintain and operate an indirect-fired water heater in accordance with the printed instructions which accompany the water heater.
2. Defects or malfunctions resulting from consumer damage, such as: (A) improper maintenance or (B) misuse, abuse, accident, or alteration.
3. Defects or malfunctions on indirect-fired water heaters where the original serial number cannot be readily determined.
4. Service calls not involving malfunction or defects in materials or workmanship, and the original consumer purchaser shall pay for such calls.
5. Water heaters installed outside of the United States and Canada.
6. Water heaters repaired or altered without prior written approval of Heat-Flo, Inc. so as to affect adversely their reliability.
7. Components of an indirect-fired water heater which are not defective, but must be replaced during the warranty period as a result of reasonable wear and tear.
8. Components of an indirect-fired water heater which are subject to warranties, if any, given by their manufacturers. Heat-Flo, Inc. does not adopt these warranties.
9. Malfunctions resulting from, or repairs necessitated by, a failure to maintain an indirect-fired water heater free of water sediments or scale deposits.
10. This warranty does not extend to labor costs, shipping charges, delivery expenses, or administrative fees incurred by the original household consumer purchaser in repairing or replacing an indirect-fired water heater.
Heat-Flo, Inc. will not accept claims for labor costs incurred by the original consumer purchaser in removing or reinstalling an indirect-fired water heater.
11. Malfunctions resulting from, or repairs necessitated by, uses of the indirect-fired water heater for purposes other than that for which it was designed, or resulting from flood, fire, wind, or lightning.

OWNER'S RESPONSIBILITIES

The owner or installer must:

1. Have the storage tank installed with a vacuum relief valve and a temperature and pressure relief valve in accordance with local, state, and federal codes and ordinances bearing the listing marks of the American Society of Mechanical Engineers (A.S.M.E).
2. Operate the storage assembly at a pressure below that shown on the rating plate on the pressure relief valve.
3. Keep the tank free of scale deposits.
4. **Make provisions so if the tank or any component part or connection should leak, the resulting flow of water will not cause damage to the area in which it is installed.**
The warranty hereunder does not apply to defects resulting from:
 1. Freezing, excessive pressure, or leaks at water connections.
 2. Failure of a component, control or component part other than a component part manufactured solely by HFI.
 3. Any cause similar to the above, not resulting solely due to defective material and/or workmanship.
 4. Water Quality: The warranties extended by HFI are conditioned upon potable water with a Ph not to exceed 8.0 and not below 6.0, and/ or chloride concentrations not to exceed 100 parts per million (ppm). HFI specifically disclaims liability of any kind resulting from or relating to potable water that does not match these characteristics.

LIMITATION OF WARRANTIES AND REMEDIES

THE FOREGOING WARRANTIES ARE EXCLUSIVE AND ARE GIVEN AND ACCEPTED IN LIEU OF ANY AND ALL OTHER WARRANTIES, EXPRESS OR IMPLIED, INCLUDING WITHOUT LIMITATION THE IMPLIED WARRANTIES OF MERCHANTABILITY AND FITNESS FOR PARTICULAR PURPOSE, AND ANY OBLIGATION, LIABILITY, RIGHT, CLAIM, OR REMEDY IN CONTRACT OR TORT, WHETHER OR NOT ARISING FROM HEAT-FLO, INC.'S NEGLIGENCE, ACTUAL OR IMPUTED.

THE REMEDIES OF THE ORIGINAL CONSUMER PURCHASES SHALL BE LIMITED TO THOSE PROVIDED HEREIN TO THE EXCLUSION OF ANY OTHER REMEDIES INCLUDING WITHOUT LIMITATION, INCIDENTAL OR CONSEQUENTIAL DAMAGES INCLUDING, BUT NOT LIMITED TO, PROPERTY DAMAGE, LOST PROFIT, OR DAMAGES ALLEGED TO HAVE BEEN CAUSED BY ANY FAILURE OF HEAT-FLO, INC. TO MEET ANY OBLIGATION UNDER THIS AGREEMENT INCLUDING THE OBLIGATION TO REPAIR AND REPLACE SET FORTH ABOVE.

NO AGREEMENT VARYING OR EXTENDING THE FOREGOING WARRANTIES, REMEDIES, OR THIS LIMITATION WILL BE BINDING UPON HEAT-FLO, INC. UNLESS IN WRITING AND SIGNED BY A DULY AUTHORIZED OFFICER OF HEAT-FLO, INC.

THE WARRANTY STATED HEREIN IS NOT TRANSFERABLE AND SHALL BE FOR THE BENEFIT OF THE ORIGINAL CONSUMER PURCHASER OF A WATER HEATER ONLY.

These warranties give you specific legal rights, and you may also have other rights which vary from state to state. Some states do not allow the exclusion or limitation of incidental or consequential damages so this limitation or exclusion may not apply to you.

These are the only written warranties applicable to water heaters manufactured and sold by Heat-Flo, Inc. Heat-Flo, Inc. neither assumes nor authorizes anyone to assume for it any other obligation or liability in connection with said water heaters.

SERVICE REQUESTS

FOR SERVICE UNDER THESE WARRANTIES CONTACT HEAT-FLO, INC., AT THIS ADDRESS:

Heat-Flo, Inc., P.O. Box 612, Uxbridge, MA 01569

At the time a claim is filed the original consumer purchaser must present a copy of the original sales receipt, and a deed, utility bill, or equivalent document evidencing both ownership of the water heater and installation in the dwelling or commercial property owned by the original consumer purchaser. With regard to claims made by original consumer purchasers of water heaters used in commercial settings as that term is defined herein, in no event shall notification of a service request be received later than five years from the date of purchase.

The obligations under this warranty apply only to domestic hot water tank installations where the warranty registration card has been completed by the owner of the site of the original installation and received by Heat-Flo in accordance with the terms and conditions herein set out and Heat-Flo has been notified of the alleged defect or deficiency within forty eight (48) hours from the occurrence or discovery of the alleged defect or deficiency. Heat-Flo, Inc. reserves the right to change specifications or discontinue models without notice.

Bulletin WAR-071514 Page 2 of 2



Providing Solutions through Superior Design.

Heat-Flo, Inc.

15 Megan Ct., P.O. Box 612, Uxbridge MA, 01569, USA

Phone: (508) 278-2400 | Fax: (508) 278-2466 | e-mail: sales@heat-flo.com

www.heat-flo.com