

Job or Customer :	
Location :	
Engineer :	
<input type="checkbox"/> Complies with Spec	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :


### Description

Closed one end and  $\frac{3}{4}$ " or 1" PEX F1960 on the other end.  $\frac{1}{2}$ " PEX F1960 branches in a single row. Used with PEX-a potable water expansion systems.

***The use of PEX tubing in a potable hot-water plumbing system with an operating temperature above 140°F (60°C) or system pressure above 80 psig (550 kPaG) or highly aggressive water quality or any combination thereof can significantly reduce the service life of the tubing.***

***HeatLink requires following the guidelines described in Plastics Pipe Institute TN-53, Guide to Chlorine Resistance Ratings of PEX Pipes and Tubing for Potable Water Applications and HeatLink INFO 37, Domestic Hot Water Recirculation Systems.***

Qty	Stk. #	# of Ports	Inlet	Outlet	Dimension, in/(mm)						Weight, lb/(kg)	
					A	B	C	D	E	ID1	ID2	
	EX13203	3	$\frac{3}{4}$	Closed	5.37 (136.3)	0.94 (24.0)	0.86 (21.9)	1.25 (31.8)	0.56 (14.2)	0.60 (15.2)	0.41 (10.3)	0.080 (0.036)
	EX13204	4	$\frac{3}{4}$	Closed	6.62 (168.1)	0.94 (24.0)	0.86 (21.9)	1.25 (31.8)	0.56 (14.2)	0.60 (15.2)	0.41 (10.3)	0.102 (0.046)
	EX13206	6	$\frac{3}{4}$	Closed	9.11 (231.5)	0.94 (24.0)	0.86 (21.9)	1.25 (31.8)	0.56 (14.2)	0.60 (15.2)	0.41 (10.3)	0.146 (0.066)
	EX13804	4	1	Closed	6.92 (175.8)	1.18 (30.0)	0.58 (14.8)	1.84 (46.8)	1.50 (38.0)	0.79 (20.0)	0.39 (10mm)	0.146 (0.066)
	EX13806	6	1	Closed	9.41 (239.3)	1.18 (30.0)	0.58 (14.8)	1.84 (46.8)	1.50 (38.0)	0.79 (20.0)	0.39 (10mm)	0.208 (0.094)

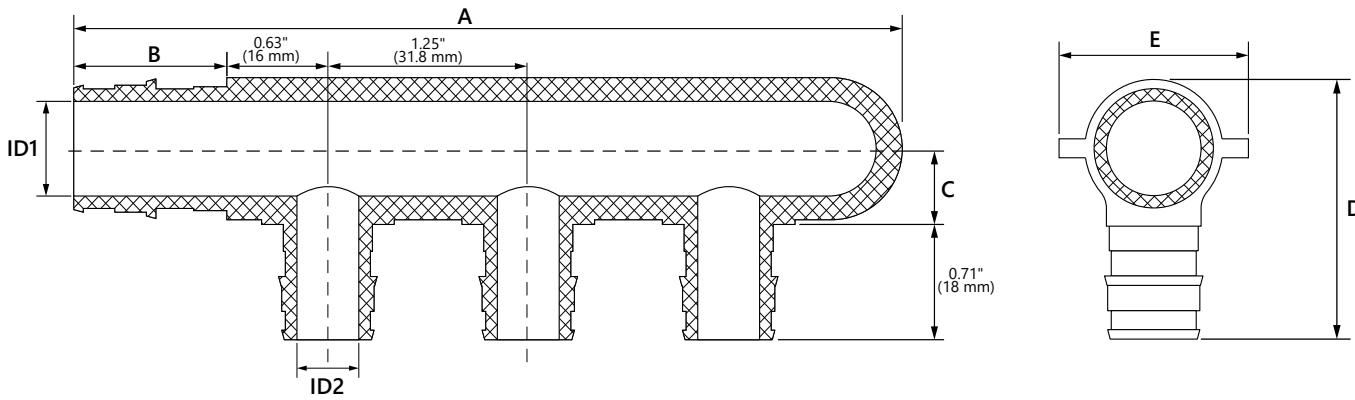

**Technical Data**

	Specifications
Material	PPSU
Operating Pressure rating	180°F @ 100psi (82.2°C @ 0.69MPa)

Listings	Codes	Standards
ICC-ES PMG 1087	IMC	ASTM E84
cNSFus-pw	IPC	ASTM F877
cQAlus P371	IRC	ASTM F1960
U.P. Code	NPC of Canada	CSA B137.5
	NSPC	NSF/ANSI 14
	UMC	NSF/ANSI 61
	UPC	NSF/ANSI 372
		ULC S102.2

**Installation**

Installation must follow all of HeatLink's instructions and guidelines.

**Related Documents**

- PEX-a F1960 Potable Water Expansion System Installation Guide (I3240)
- HeatLink Limited Plumbing Warranty