Job or Customer :	
Location :	
Engineer :	
☐ Complies with Spec ☐ Alternate	Notes :
Contractor :	
HeatLink Rep :	
Submitted By :	Date :
Approved By :	Date :
P.O. Number :	Date :

Description

SST series panels are distribution panels with their own pump and mixing valve to supply radiant areas that each need a different supply water temperature. Typical applications include radiant heating and snow melting.

Base components:

- Recessed or surface mounted housing with one key lock and coin lock(s)
- Pre-wired UPS 15-58 or UPS 26-99 pump
- Mixing valve
- Top or bottom mains feed available
- Isolation valves
- Thermometer
- Manifold comes with 1 loop closed and plugged with manifold caps (#77100) unless all loops in use

For one and two loop applications, a 4-loop manifold is used with the unrequired loops valves closed and capped (#77100).

Additional #77100 caps, and #77100 and #EX77300 series tubing to manifold connectors *sold separately*.

Technical Data

	Specifications
Min operating temperature	36ºF (2ºC)
Max operating temperature	212ºF (100ºC)
Max operating pressure	87 psi (600 kPa)
Power supply	120/24 V(ac)
Piping	¾" 304SS Tubing
Piping connections	1" FNPT
Material - manifold	Stainless steel
Material - backplate	16 Gauge galvanized steel
Material - enclosure	16 Gauge satin coated steel

Standards / Listings
CAN/CSA-C22 No.14, UL508 cETLus

Note: When ordering, please include a copy of the completed submittal.

©2025 HeatLink Group Inc.

Panel Selection

Use the tables below to select the required SST configuration and generate SKU for ordering. Multiple configurations require additional submittals. See pages 3-6 for component details.

Note: *Availability of component options is context-based. See footnotes for compatibility limitations.*

1. PANEL SERIES			
CODE	**DESCRIPTION**		**SELECT**
SSTV	UPS 15-58	TMV Cv=3.7	○
SSTS	UPS 15-58	3-way Cv=3.25	○
SSTM	UPS 15-58	3-way Cv=7.3	○
SSTL	UPS 26-99		○
2. HOUSING			
R	Recessed - Satin/Galvanized		○
A	Recessed - Satin/Galvanized, extended[1]		○
B	Recessed - Stainless Steel		○
C	Recessed - Stainless Steel, extended[1]		○
S	Surface - Satin/Galvanized		○
D	Surface - Satin/Galvanized, extended[1]		○
E	Surface - Stainless Steel		○
F	Surface - Stainless Steel, extended[1]		○
3. MANIFOLD			
1	75100 w/flow meters		○
2	75200 high flow		○
4. MAINS FEED			
T	Top Feed		○
B	Bottom Feed		○
6. MANIFOLD ADD-ONS			
N	None (Default)		◉
A	Pressure Bypass (76945)		○
B	Side Mount Auto Air Vent (76944)		○
C	Bypass (76945) + Auto Air Vent (76944)		○

5. CONTROLS		
CODE	**DESCRIPTION**	**SELECT**
A	Pump Contacts	
B	StatLink (#40414) w/Pump Relay (optional Actuators #56201)[3]	
C	Pump contacts w/Thermostatic Head (#57094)	
D	StatLink (#40414) w/Pump Relay, Thermostatic Head (#57094) (optional Actuators #56201) [3]	
E	BMS Wiring w/DDC Actuator (#56121)	
M	BMS Pump Relay w/DDC actuator (#56121)	
N	BMS wiring w/DDC Actuator (#56121), StatLink (optional actuators #56201) [3]	
H	Snow Melt Control (#30654) w/DDC Actuator (#56121) [4,5]	
K	Snow Melt Control w/ BACnet (#31680) w/DDC Actuator (#56121) [4,5]	
F	BMS Wiring w/DDC Mixing Valve Motor (#58132)	
P	BMS Pump Relay w/DDC Mixing Valve Motor (#58132)	
Q	BMS Wiring w/DDC Mixing Valve Motor (#58132) and StatLink (optional Actuators #56201) [3]	
G	Indoor/Outdoor Reset (#30360) w/Floating Action Mixing Valve Motor (#58131), StatLink (#40414) (optional Actuators #56201) [3]	
J	Snow Melt Control (#30654) w/DDC Mixing Valve Motor (#58132) [5]	
L	Snow Melt w/BACnet (#31680), Floating Action Mixing Valve Motor (#58131) [5]	

1. *Extended height housings available by special order. Please allow additional time for delivery.*
2. *SSTS and SSTV panel series with 75200 series manifolds are limited to 6 loops.*
3. *Thermostats sold separately. Please include a copy of the "Heating System Summary Report" from LoopCAD or equivalent table showing the # of zones and # of actuators per zone.*
4. *75200 series manifold only up to 6 loops.*
5. *Snow melt controls only available with 75200 series manifolds. Snow/Ice Detector 30090/30091 sold separately.*

Panel SKU - use this for ordering

Panel SKU generates here as options are selected.
Subject to review by HeatLink staff before order is finalized.

Note: *Zoning only applicable for StatLink controls. Input # of Zones then QTY-Actuators to auto generate QTY-StatLink Modules.*

1. PANEL SERIES	2. HOUSING	3. MANIFOLD	LOOPS (MAX ZONES)	4. MAINS FEED	5. CONTROL		6. MANIFOLD ADD-ONS	PIPING ADD-ONS (n/a)	QTY-STATLINK MODULES[3]	QTY-ACTUATORS[3]	# of ZONES	PANEL QTY	NOMINAL OUTPUT	NOMINAL FLOW
			04		-		N	N	0	00			Btu/hr	USgpm @ 20°F ΔT
			06		-		N	N	0	00			Btu/hr	USgpm @ 20°F ΔT
			08		-		N	N	0	00			Btu/hr	USgpm @ 20°F ΔT
			10		-		N	N	0	00			Btu/hr	USgpm @ 20°F ΔT
			12		-		N	N	0	00			Btu/hr	USgpm @ 20°F ΔT

Additional Notes:

CLEAR FORM

GENERATE SUMMARY PAGE


All information is subject to change without notice.
Please check our website to ensure you have the latest version of this document.

©2025 HeatLink Group Inc.


Controls

All controls include an electrical junction box for 120V wiring, and relay(s) (if applicable).
Control options (excluding (B), (D), (G)) include a terminal strip for applicable external control connections. *Illustrations are representative and may differ slightly from actual control.*
See control manuals for wiring and connection details.


A




B

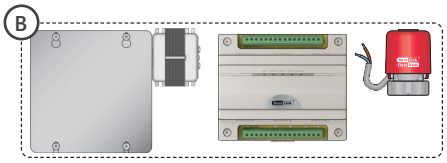


C




D

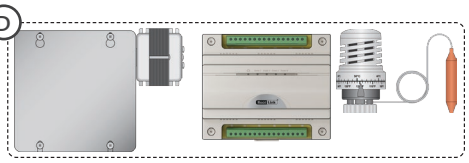


E




M




N

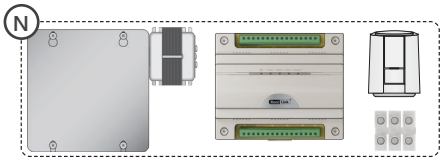

H

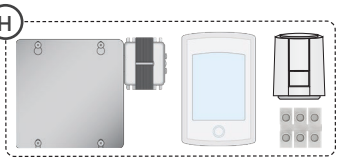


K

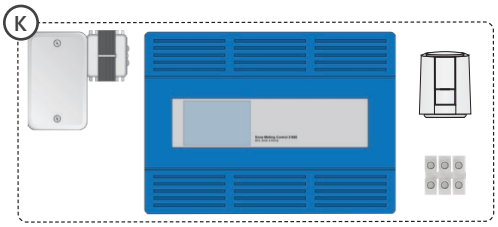


F




P

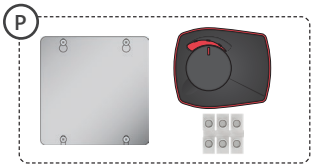


Q

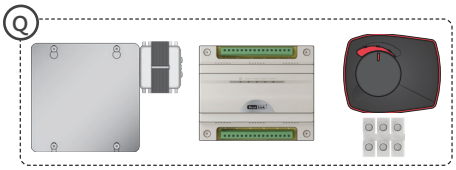


G

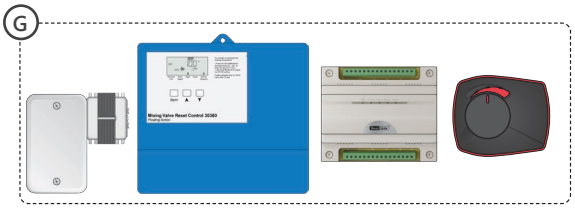

J

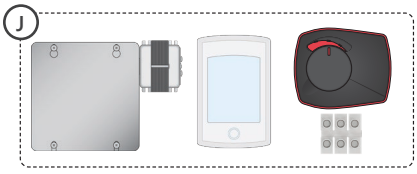


L

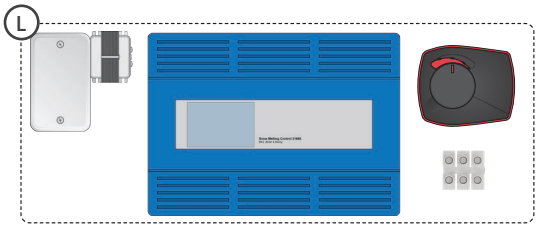


Manifold Add-Ons

A

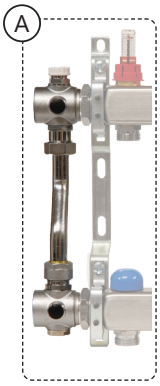


B

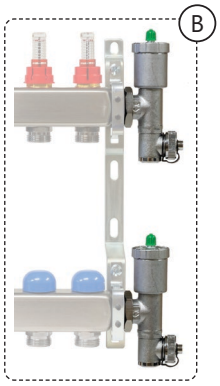


©2025 HeatLink Group Inc.


Panel Components

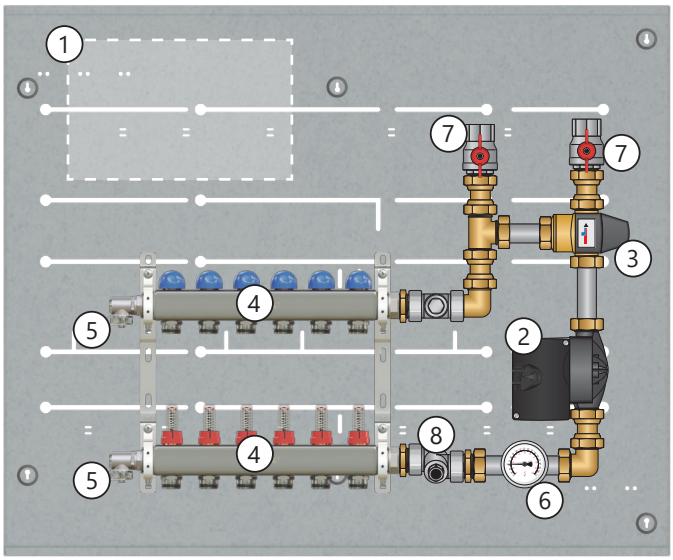


SSTV with UPS15-58, 75106 manifold, top feed mains

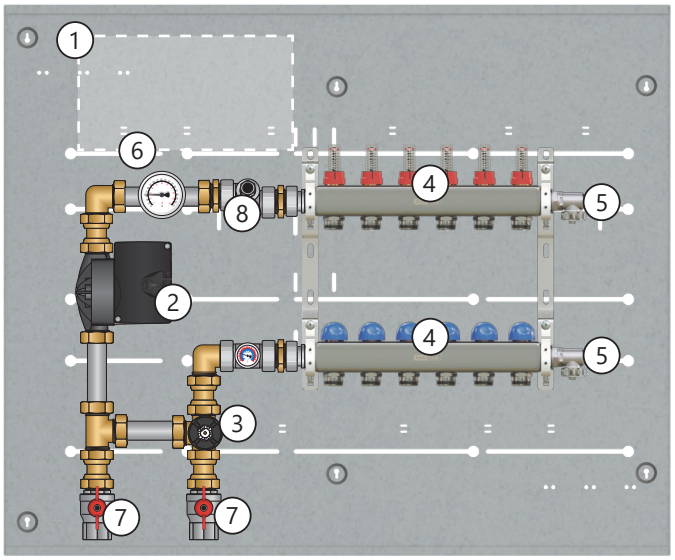

SSTM with UPS15-58, 75106 manifold, bottom feed mains

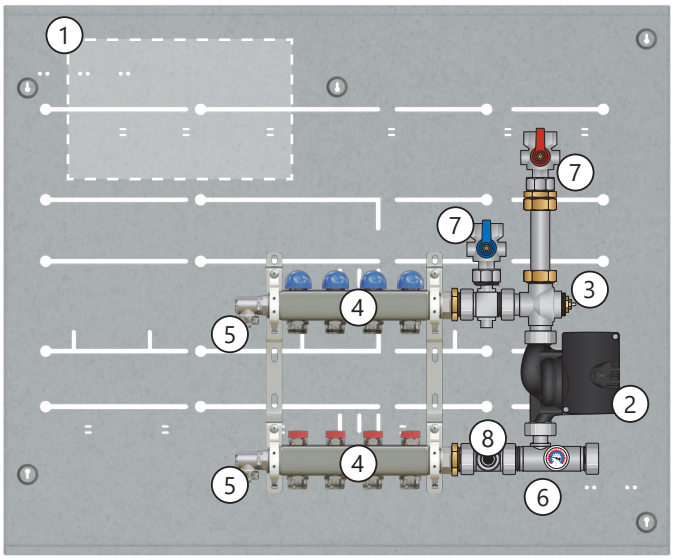


SSTS with UPS15-58, 75204 manifold, top feed mains

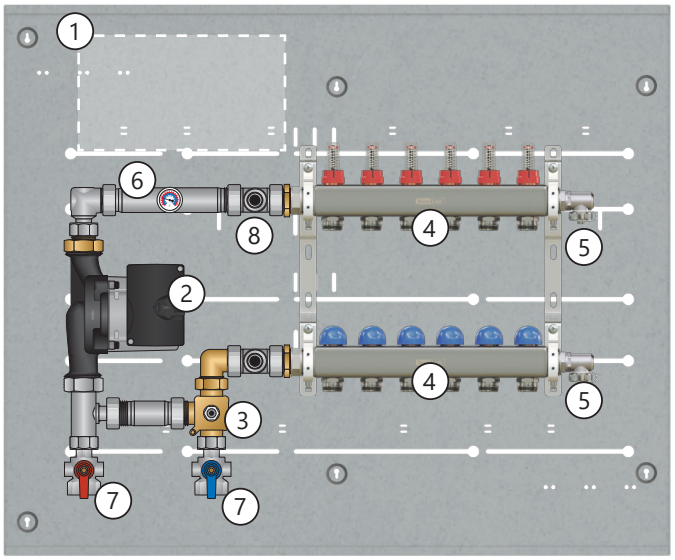

SSTL with UPS26-99, 75106 manifold, bottom feed mains


#	Components	Component Description			
		SSTV	SSTM	SSTS	SSTL
1	Controls location	Mounting location for selected controls			
2	Pump	UPS15-58			UPS26-99
3	Mixing Valve	TMV	3-way		
4	Manifold	Supply and return manifold with flow meters; one loop closed and plugged			
5	Hosebib	Allows for system fill and purge			
6	Thermometer	Displays supply water temperature			
7	1" FNPT ball valves	Isolates panel for servicing			
8	Sensor Well	Sensor well for supply sensor, when applicable controls selected.			
9	Accessory pack				
i	Mounting screws	For panel mounting			
ii	1" nitrile washers	Spare nitrile washers			

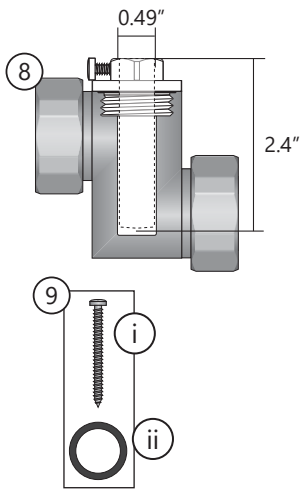


©2025 HeatLink Group Inc.

Panel Dimensions

# of Loops	Enclosure			Surface Cover Dimensions		Recessed Cover Dimensions		Surface Ext. Cover	Recessed Ext. Cover	Extended Height	# of Locks	Addl. Locks - ext. cabinet
	A	B	C	D	E	D	E	F	F	G		
4-6 Loop	34 ½" (876 mm)	28 ½" (724 mm)	5 ⅞" (149 mm)	32 ⅞" (835mm)	26.9" (683mm)	36" (915mm)	30" (762mm)	16.4" (417mm)	16 ¾" (425 mm)	45" (1143 mm)	2	2
8-10 Loop	42 ½" (1080 mm)	28 ½" (724 mm)	5 ⅞" (149 mm)	40 ⅞" (1038mm)	26.9" (683mm)	44" (1118mm)	30" (762mm)	16.4" (417mm)	16 ¾" (425 mm)	45" (1143 mm)	2	2
12 Loop	46 ½" (1180 mm)	28 ½" (724 mm)	5 ⅞" (149 mm)	44 ⅞" (1140mm)	26.9" (683mm)	48" (1219mm)	30" (762mm)	n/a	n/a	n/a	3	n/a

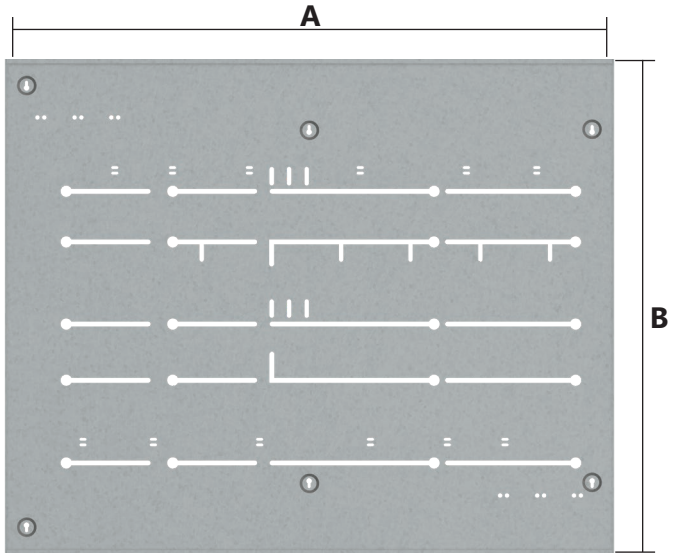





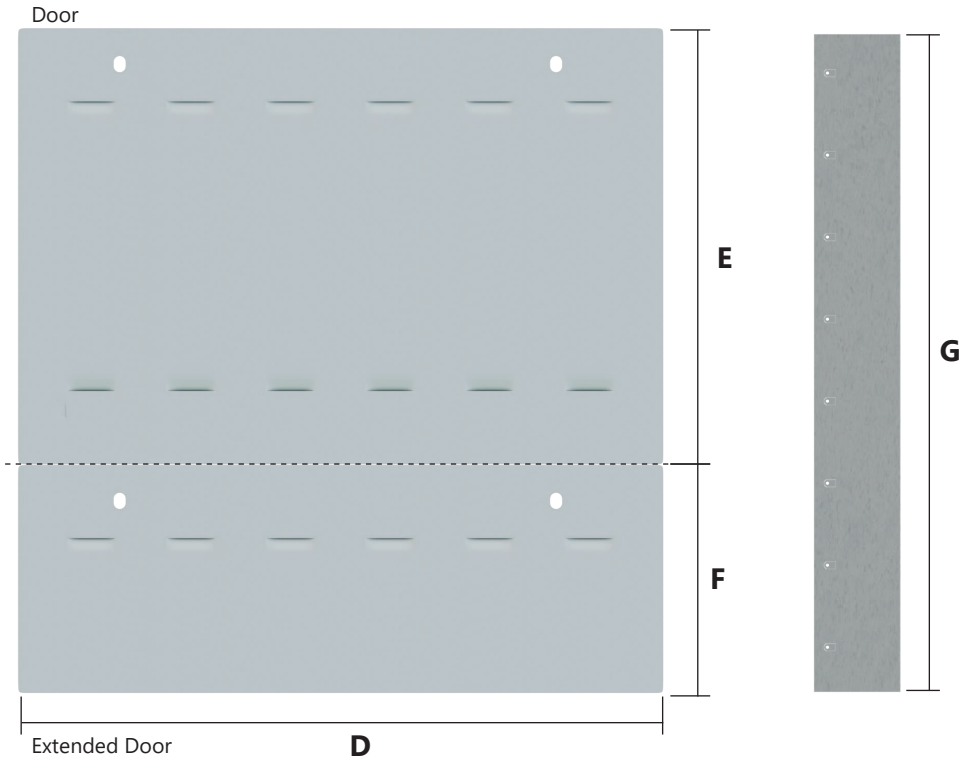

©2025 HeatLink Group Inc.

Pump Curves

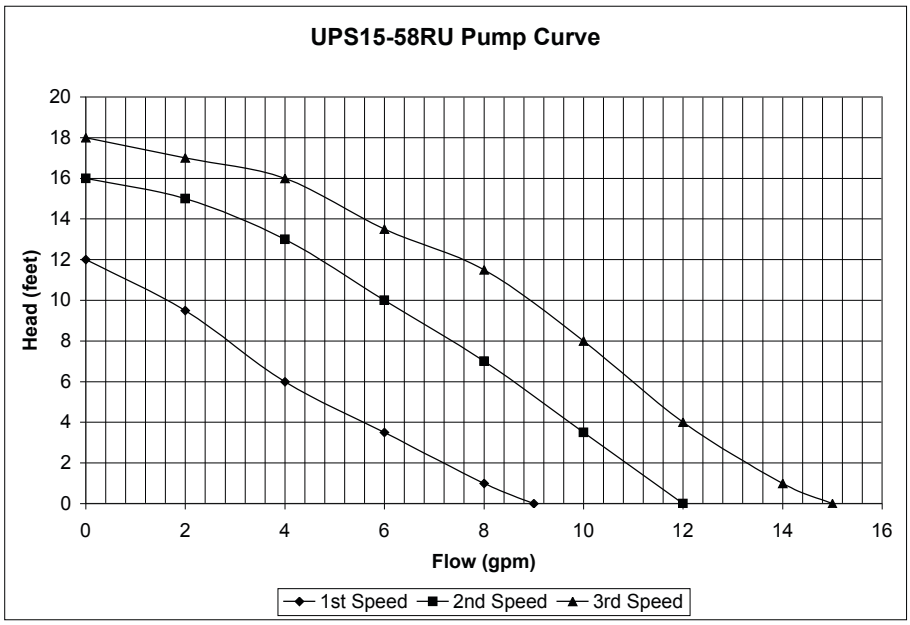

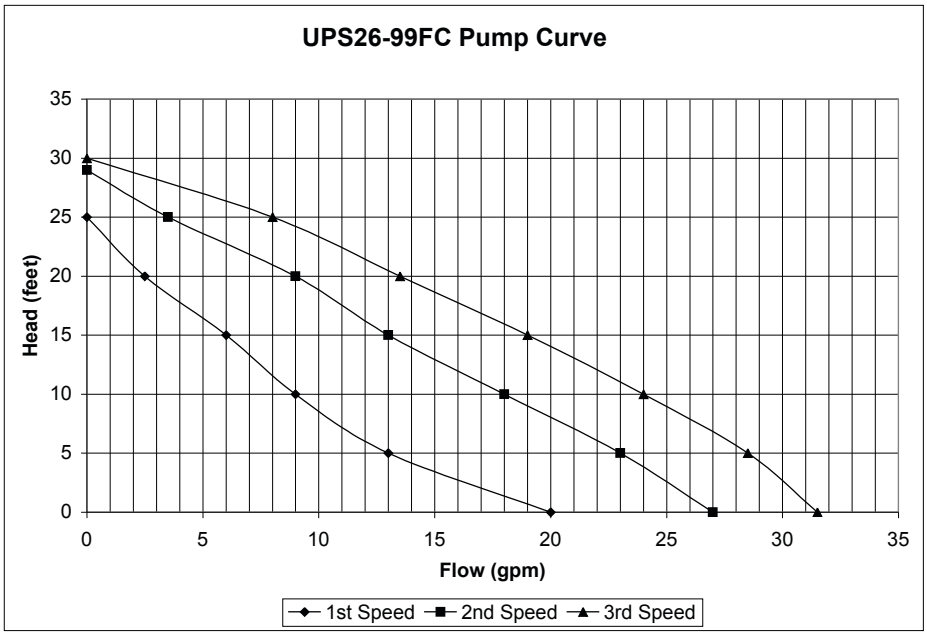

Installation

Installation must follow all of HeatLink's instructions and guidelines.

Maintenance

Maintenance must follow all of HeatLink's instructions and guidelines.

Related Documents

- SUB40414 StatLink Submittal
- SUB56200 Actuator Submittal
- SUB76944 Pressure Bypass Submittal
- SUB76945 Side Mount Auto Air Vent Kit Submittal
- Mechanical Installation, Operation, and Maintenance Manual (L6SST Series Mechanical Manual)
- HeatLink Limited Heating Warranty

©2025 HeatLink Group Inc.

Summary Sheet

Item description and summary with itemized part numbers

Qty	Panel Description(s)

All information is subject to change without notice.
Please check our website to ensure you have the latest version of this document.

©2025 HeatLink Group Inc.