

AC OVERCURRENT & UNDERCURRENT

CAH, COH & CUH SERIES



- ◆ Monitors AC current
- ◆ Can be used as either an over-current or undercurrent relay
- ◆ Three separate adjustable Fault Trip Current ranges covering 0.5 – 50 amperes
- ◆ Built-in current transformer allows easy access & multiple loops for increased sensitivity
- ◆ Adjustable time delay on fault trip
- ◆ LED indicates fault condition
- ◆ 10A SPDT output contacts
- ◆ Encapsulated for protection in harsh environments
- ◆ Pilot Duty Rating



Better. By Design.

800.238.7474


WWW.MACROMATIC.COM

SALES@MACROMATIC.COM

The CxH Series is an AC current sensing relay that is available in three versions: **CAH Series**--can detect either an overcurrent or undercurrent fault (selectable); **COH Series**--overcurrent only; and **CUH Series**--undercurrent only. The current-carrying wire is run through the built-in current transformer and can be looped multiple times for greater sensitivity. These relays include user-adjustable settings for Fault Trip Current & Time Delay on Fault Trip as well as an LED to indicate fault condition. The encapsulated construction offers protection in harsh environments. Applications such as monitoring for locked rotor or load loss condition, open heater or lamp, and process control are perfect for these products.


Overcurrent Sensing

After input voltage is applied & the sensing delay on power-up (t_s) is completed, the unit will begin sensing for a fault condition. A fault will occur when the monitored AC current (I) goes above the Fault Trip Current setting & remains above the Reset level for a period longer than the adjustable time delay period (t). The LED will turn ON immediately and the relay will energize after the time delay on pick-up (t) is completed. The relay will de-energize & the LED will turn OFF when the monitored AC current goes below the Reset level.

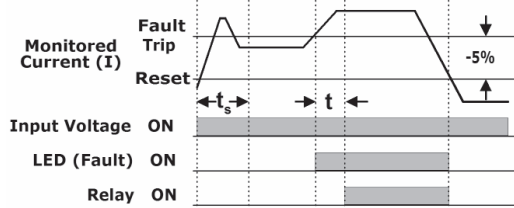

Undercurrent Sensing

After input voltage is applied & the sensing delay on power-up (t_s) is completed, the unit will begin sensing for a fault condition. A fault will occur when the monitored AC current (I) goes below the Fault Trip Current setting & remains below the Reset level for a period longer than the adjustable time delay period (t). The LED will turn ON immediately and the relay will energize after the time delay on pick-up (t) is completed. The relay will de-energize & the LED will turn OFF when the monitored AC current goes above the Reset level.

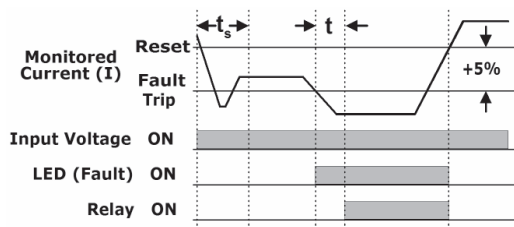

CATALOG NUMBER

Complete by selecting proper code for each option below:

XXX XXX X X X

FUNCTION	FAULT TRIP CURRENT (I)	INPUT VOLTAGE	TRIP DELAY (t)	SENSING DELAY ON POWER-UP (t_s)
CAH Over & Under Current	05A 0.5 - 5A	2 120VAC	A 0.150 - 7 Sec.	C No Delay
COH Overcurrent Only	20A 2 - 20A	6 12VDC	B 0.5 - 50 Sec.	D 1 Second
CUH Undercurrent Only	50A 5 - 50A	8 24VAC/DC	Fixed Times	E 2 Seconds
		1 240VAC	F followed by time delay in seconds, i.e., F0.5, F3, etc.	F 3 Seconds
				G 4 Seconds
				H 5 Seconds
				J 6 Seconds

Example: CAH20A2BD, COH05A8AC, CAH20A2F1E