

FACTORY JACKETED AND INSULATED STORAGE TANKS

Large volume tanks are designed for storing potable water.

FEATURES

STANDARD SIZES - From 140 to 2,500 gallons - A. O. Smith stocks vertical factory jacketed and insulated tanks from 140 gallons up to 2,500 gallons for fast delivery and retrofit applications. All stock tanks are glasslined with standard tank openings as shown on following pages. For custom or larger capacities, see our custom line tanks or consult your factory representatives.

ASME CODE CONSTRUCTION - All tanks are constructed to the requirements of the ASME. ASME code tanks are generally available in 125 or 150 PSI working pressures (125 psi working pressure - standard). Consult factory for tanks with greater or lesser working pressures, with special configurations. Please check the tables below for specific working pressures - standard and optional.

INSULATION - Entire tank is insulated to meet ASHRAE 90.1 (current edition) depth of insulation cavity requires use of remote bulb-type tank temperature control and thermometer. Storage tanks meet R12.5 minimum thermal insulation requirements of the U.S. Department of Energy and current edition of ASHRAE/IESNA 90.1

CABINET - Heavy gauge steel with high quality paint.

LINING - Thorough investigation on the service life of steel tanks with protective coatings or linings has led to the recommendations of the following lining:

- Glasslined - These are normally stocked tanks for water storage up to 180°F, with glass lining to prevent corrosion and addition of rust to water. The glass lining was developed over many years of ceramic research for a wide variety of conditions.

CATHODIC PROTECTION - Tanks are furnished with anodes designed for maximum protection.

ACCESSORIES - Tanks will be supplied with the fittings located as indicated on the drawings unless specified otherwise. A 12" X 16" manhole or 4" x 6" handhole is optional on tanks 36" diameter or less.

Attention: Significant changes have been made to models now manufactured in Lebanon, Tn. Please note that this Spec Sheet refers to models manufactured in MeBee, SC and Lebanon, Tn.


MODELS TJV AND TJH



Low Lead Content




HLW



U
OPTIONAL

CRN

STORAGE TANK SELECTION TJV-140 THRU TJV-400 FIGURE 1.

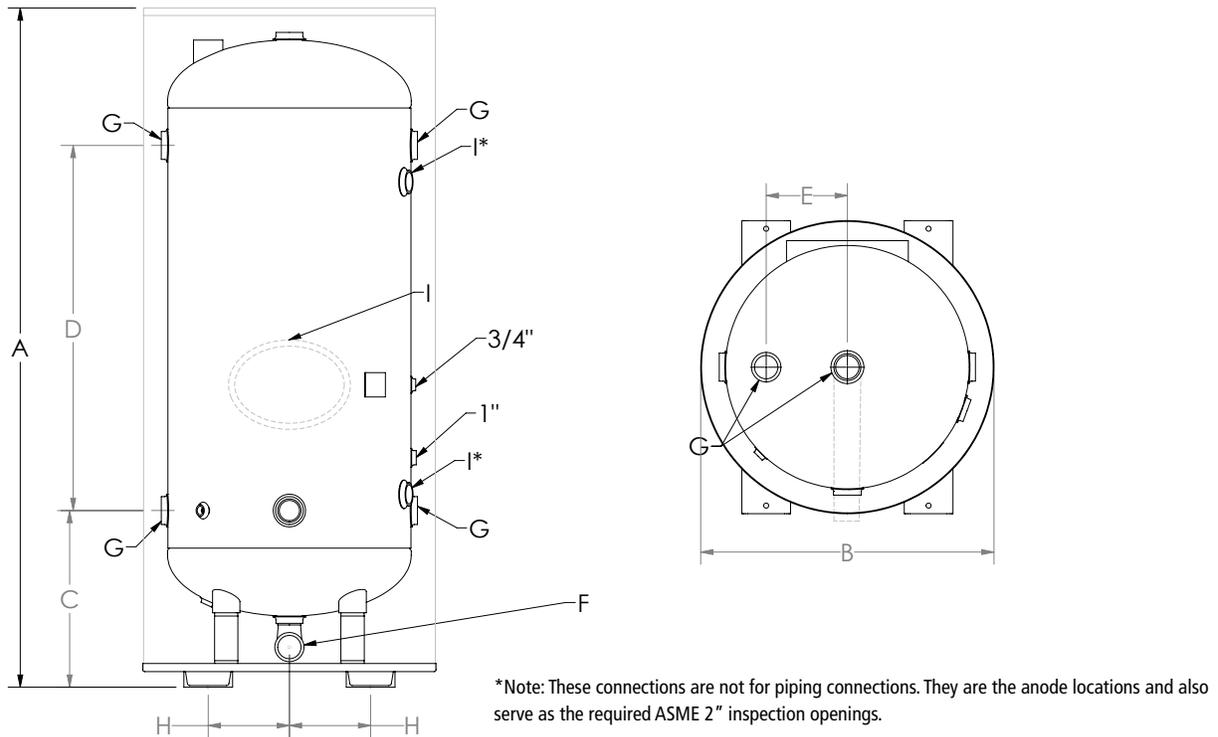

NOTE: Inspection openings i.e., 4" x 6" handholes and 12" X 16" manholes, are optional on diameters 36" and below and are to be included with tanks only when specified.

- Other tanks to 72" diameter and 3500 gallon are available on special order.
- All openings Female Pipe Thread except as noted.
- "F" opening Male Pipe Thread.

| Model Number | A | B | C | D | E | F | G | H | "I" ASME Inspection Openings |
|--------------|-----|----|--------|----|----|-------|-------|-------|------------------------------|
| TJV-140A | 87 | 30 | 21 1/2 | 51 | 8 | 1-1/2 | 2-1/2 | 6-3/8 | 2" |
| TJV-200A | 83 | 36 | 22 | 45 | 10 | 1-1/2 | 2-1/2 | 7-3/4 | 2" |
| TJV-250A | 96 | 36 | 22 | 58 | 10 | 1-1/2 | 2-1/2 | 7-3/4 | 2" |
| TJV-350A | 97 | 42 | 24 1/2 | 54 | 14 | 1-1/2 | 2-1/2 | 9-1/2 | 2" |
| TJV-400A | 105 | 42 | 24 1/2 | 61 | 14 | 1-1/2 | 2-1/2 | 9-1/2 | 2" |

DIMENSIONS AND SPECIFICATIONS FOR VERTICAL TANKS

VERTICAL ROUND JACKETED ASME

| Model Number | A | B | C | D | Gallons |
|--------------|-----|----|--------|----|---------|
| TJVT-500A | 91 | 46 | 20.875 | 2" | 500 |
| TJV-500A | 77 | 52 | 22.875 | 2" | 500 |
| TJV-600A | 88 | 52 | 22.875 | 2" | 600 |
| TJV-700A | 97 | 52 | 22.875 | 2" | 700 |
| TJV-750A | 100 | 52 | 22.875 | 2" | 750 |
| TJV-1000A | 124 | 52 | 22.875 | 2" | 1000 |

Working PSI of 125 is standard on all models 500 gallon and above. 150 PSI is an available option.

VERTICAL SQUARE JACKETED ASME



| Model Number | A | B | C | D | Gallons |
|--------------|-------|----|--------|----|---------|
| TJV-1250A | 133 | 60 | 24.375 | 3" | 1,250 |
| TJV-1500A | 129 | 66 | 25.875 | 3" | 1,500 |
| TJV-1750A | 153 | 66 | 25.875 | 3" | 1,750 |
| TJV-2000A | 126 | 78 | 28.375 | 3" | 2,000 |
| TJV-2500A | 146.5 | 78 | 28.375 | 3" | 2,500 |

NOTE: Inspection openings, i.e., handholes and manholes, are optional and are to be included with tanks only when specified.

- All openings Female Pipe Thread except as noted.

OPTIONAL

- 4"x6" handhole or 12" X 16" manhole on vessels 36" in diameter or less.
- Additional openings

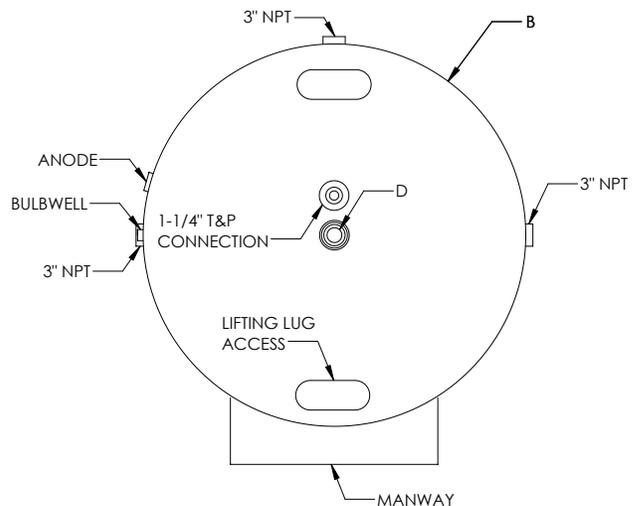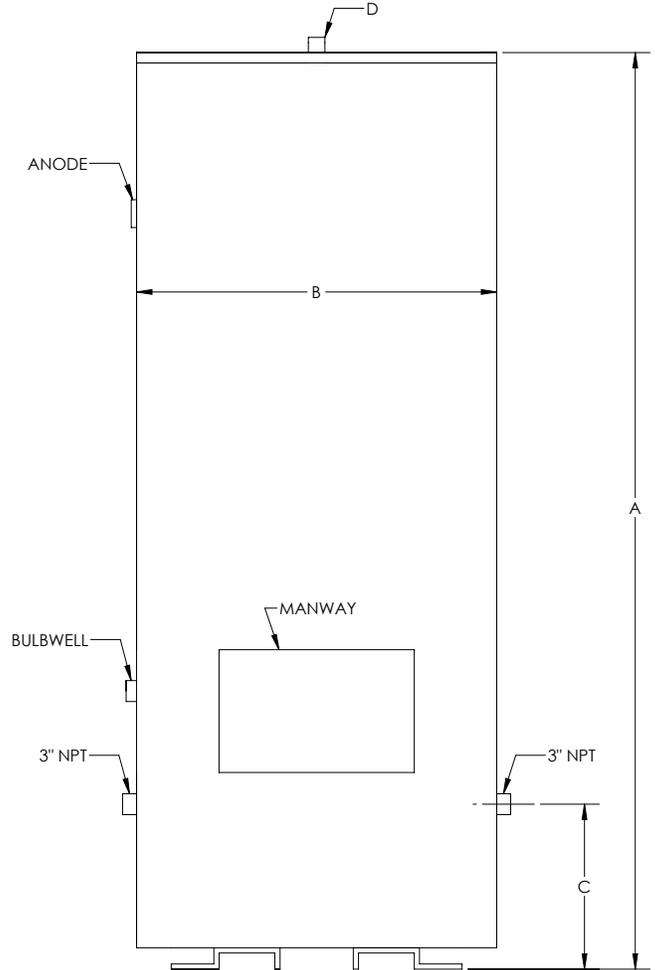


CAUTION

All openings are shipped open and unused. Openings must be plugged or capped at time of installation except as noted.

DIMENSIONS AND SPECIFICATIONS FOR HORIZONTAL TANKS


HORIZONTAL ROUND JACKETED ASME TANKS

| Model Number | A | B | Diameter | Gallons |
|--------------|----|-----|----------|---------|
| TJH-250A | 41 | 87 | 34 | 250 |
| TJH-300A | 47 | 76 | 40 | 300 |
| TJH-400A | 53 | 76 | 46 | 400 |
| TJHT-500A | 53 | 87 | 46 | 500 |
| TJH-500A | 59 | 77 | 52 | 500 |
| TJH-600A | 59 | 88 | 52 | 600 |
| TJH-700A | 59 | 97 | 52 | 700 |
| TJH-750A | 59 | 100 | 52 | 750 |
| TJH-1000A | 59 | 124 | 52 | 1000 |

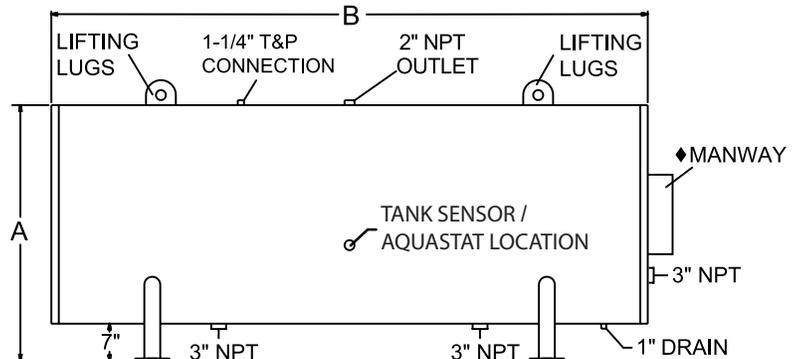

HORIZONTAL SQUARE JACKETED ASME TANKS

| Model Number | A | B | Depth | Gallons |
|--------------|------|-----|-------|---------|
| TJH-1250A | 68.5 | 134 | 60.25 | 1,250 |
| TJH-1500A | 74.5 | 127 | 66.25 | 1,500 |
| TJH-2000A | 86.5 | 127 | 78.25 | 2,000 |
| TJH-2500A | 86.5 | 144 | 78.25 | 2,500 |

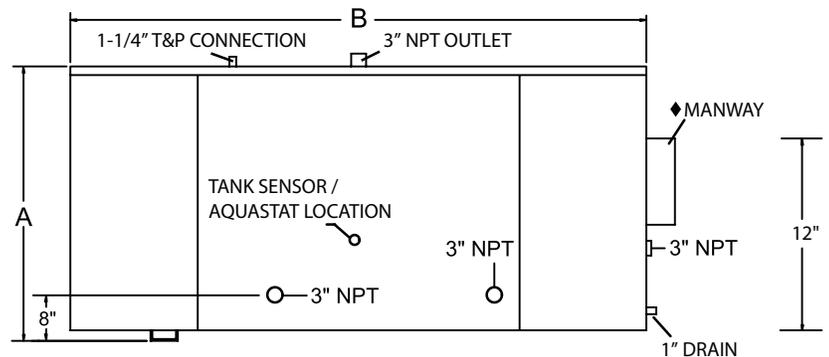

LIMITED WARRANTY OUTLINES

GLASSLINED: If the tank should leak anytime during the first five years, under the terms of the warranty, A. O. Smith will repair or replace the tank; installation, labor and handling extra.

NOTE: THIS OUTLINE IS NOT A WARRANTY. For complete information, consult the written warranty or A. O. Smith. Warranty does not apply to product installed outside of the United States of America or its territorial possessions and Canada.

SAMPLE SPECIFICATION FOR CUSTOM-LINE STORAGE TANKS

When jacketed or insulated these models meet R12.5 minimum thermal insulation requirements of the U.S. Department of Energy and current edition of ASHRAE/IESNA 90.1. ASME storage tank to be A. O. Smith Custom-Line model _____. Capacity to be _____ gallons with a diameter of _____ inches. Tank(s) shall be constructed and stamped according to ASME specification for _____ psi working pressure. Manhole (12 X 16), handhole (4x6) or inspection openings (2-2") shall be installed in accordance with ASME code requirements and manufacturer(s) standard practice. Tank to be constructed of (carbon steel) _____. Lining shall be (glass) _____. Tank(s) lined with (glass) _____ lining shall be equipped with the number and size of magnesium anode rod(s) sufficient to provide adequate protection for the tank lining. Tank shall be (vertical, horizontal) _____ design and provided with _____ ring base, (or _____ Saddles.)

For Technical Information call 800-527-1953. A. O. Smith Corporation reserves the right to make product changes or improvements without prior notice.